

Methods of Application

Trowel

Application of the coating is done using the handheld trowel, by simply applying and spreading the coating using the trowel.

Spray

This method uses spraying equipment like the ones used in painting vehicles. It is preferred due to its precise finish and efficiency. It is also faster to use the spray than the trowel method.

Brush

Use a typical brush similar to roll brushes that are used in painting houses. It also has a uniform finish and is faster to use compared to the trowel.

It is good to note that different surfaces will dictate the method of application.

ITEM 14E : SIGNAGES**SCOPE OF WORK**

Furnish materials and perform labor to include miscellaneous works required for the installation of room identification for the toilets and port office.

SAMPLE AND SHOP DRAWINGS

The Contractor shall submit samples for approval by the Architect. Notify the Architect for any changes, clarifications and discrepancies.

For the room I.D. full size lettering layout and installation method shall be submitted to the Architect for approval before start of work.

MATERIAL REQUIREMENTS**1. PPA LOGO**

- Hot dipped cut out 4.5 mm thick Metal sheet screwed with Backlit
- 12.5mm thk. Colored Acrylic Plastic Sheet Screwed with backlit for PPA Logo

EXECUTION**WORKMANSHIP**

Workmanship shall be executed in high quality comparable with artworks.

MOUNTING

For all mounted assemblies, appropriate mounting hardware and connectors which are concealed shall be sufficiently used.

Assemblies shall be mounted plumb, straight, level, and at prescribed heights.

INSTALLATION

Installation shall be done in a secure and permanent manner at prescribed heights and/or layout. The backwall shall not be mutilated. After the dowels are positioned, fill with expanding grout, or other approved fillers, and retouch, flashed to the backwall surface.

ITEM 15 : MASONRY WORKS

GENERAL

General Requirements contain provisions and requirements essential to these Specifications and apply to this Section, whether or not referred to herein.

SCOPE OF WORK

This Section includes the furnishing of all labor and materials to complete the work as shown on the drawings and specified herein. The works shall include but not necessarily be limited to the following:

1. Supply and installation of concrete hollow block (CHB) walls with reinforcement
2. Plastering
3. Installing temporary works like scaffolding, platforms, steps, etc.

GENERAL PROVISIONS

The following publications of the issues below but referred to thereafter by basic designation only form a part of these specifications to the extent indicated by the reference thereto:

American Society for Testing and Materials (ASTM) Publications:

A 615 Deformed and Plain Billet-Steel Bars for Concrete Reinforcement

A 33 Concrete Aggregates

C 129 Specification for Non-Load Bearing Concrete Masonry Units C

144 Specification for Aggregate for Masonry Mortar

C 270 Mortar for Unit Masonry

MATERIAL REQUIREMENTS

Materials shall conform to the respective specifications and other requirements specified below

CONCRETE HOLLOW BLOCKS (CHB)

CHB shall be of standard manufacture, machine vibrated with fine and even texture and well-defined edges and conforming with the requirements of ASTM C 129. Unless otherwise specified on the Drawings, It shall have a minimum compressive strength of 4.14 MPa (600 psi). CHB shall be non-load bearing uniform and essentially smooth as normally achieves by standard molding methods and shall be free from any cracks, flaws or other defects.

BEDDING MORTAR

Mortar shall be composed of 1 part of Portland cement, 3 parts of sand and ½ part of lime. It shall have a compressive strength of [14 MPa (2,000 psi)] at 28 days and shall comply with property specifications for type N mortar set forth in ASTM Specification C 270 and as modified herein, proportioned and tested in an approved laboratory at the expense of the Contractor. When tested

for water retention, the mortar shall have a flow after suction, of 75 percent or more when mixed to an initial flow of 125 to 140 percent. When tested for compressive strength, mortar shall be mixed to a flow of 100 to 115 percent. Aggregate for mortar shall conform to ASTM C 144.

PLASTER

Plaster shall comply with the same specification as those for bedding mortar and will include the use of synthetic fibrous reinforcement of type and dosage recommended by the manufacturer.

REINFORCING STEEL BARS AND RODS

Minimum yield strength of reinforcement shall conform with the specifications in Section of Reinforced Concrete.

SAMPLES AND TESTING

1. The following shall be submitted for approval and in addition, representative samples shall be taken periodically from on-the-site stockpiles as required for testing or checking during the progress of the work.

Anchors and ties : Two of each type proposed for use

Concrete Hollow Blocks : Shapes, sizes and kinds in sufficient numbers to show full range of quality and texture.

2. Sampling and testing, unless otherwise specified, shall be performed by an approved independent commercial testing laboratory at the expense of the Contractor. Certified copies of laboratory test reports, including all test data, shall be submitted at least 10 days before delivery of the units or mortar materials represented by the tests to the project site.
3. Mortar shall be laboratory-proportioned and tested. Certified copies of approved laboratory-established proportions shall be submitted with the required test reports and test data. Approved laboratory-established proportions shall not be changed and materials with different physical or chemical characteristics shall not be used in mortar for the work unless additional evidence is furnished that the mortar meets the specified requirements.

EXECUTION

1. GENERAL

No unit having a film of water on its surface shall be laid. Masonry shall be laid plumb, true to line, with level courses accurately spaced. Bond pattern shall be kept plumb throughout. Corners and reveals shall be plumb and true. Vertical joints shall be shoved tight. Each unit shall be adjusted to final position while mortar is still soft and plastic. Any unit that is disturbed after mortar has stiffened shall be removed and relaid with fresh mortar. Courses shall be so spaced that backing masonry will level off, flush with the face work at all joints where ties occur. Chases and rake-out joints shall be kept free from mortar or other debris.

2. Anchorage to concrete. Anchorage to abutting columns shall be provided only where indicated. Details shall be as indicated including anchorage to underside of beams and slabs.
3. Cutting and fitting, including that required to accommodate the work of others shall be done by masonry mechanics. Wherever possible, full units of the proper size shall be used in lieu of cut units. Cut edges shall be clean, true and sharp. Openings shall be carefully cut,

formed or otherwise neatly made for recessed items and for electrical, plumbing, or other mechanical installations so that wall plates, cover plates, or escutcheons required by the installation will completely conceal the openings and will have bottoms in alignment with lower edge of masonry joints. Webs of hollow masonry units shall be cut to the minimum required for the installation. Reinforced masonry lintels shall be provided as indicated above openings over 300mm wide, for pipes, ducts and cable trays, unless steel sleeves are used.

4. Embedded Items

Spaces around built-in items shall be filled with mortar. Openings around flush-mounted electrical outlet boxes in wet locations shall be pointed flush with mortar including flush joints above the boxes. Anchors, ties, accessories, flashing, pipe sleeves and other items required to be built-in shall be built-in as the masonry work progresses. Anchors, ties, and joint reinforcement shall be fully embedded in mortar.

- 5. Unfinished work shall be stepped back for jointing with new work. Toothing may be resorted to only when specifically approved. Before laying new work, loose mortar shall be removed and the exposed joint shall be thoroughly cleaned.**

6. Protection

Surfaces of masonry not being worked on shall be properly protected at all times. At the end of each workday period and when rain is imminent, the top of exposed masonry shall be covered with a strong non-staining waterproof membrane well secured in place and in a manner that will prevent moisture. Adequate provisions shall be made during construction to prevent damages by wind.

7. Mortar

Materials shall be accurately measured in laboratory-established proportions and mixed with as much water as may be necessary to produce the wettest workable consistency possible. Mortar shall be placed in final position within one hour after mixing. Mortar not used or that has started to set within this time interval shall be discarded.

8. Jointing

Joints in exposed-to-view except control joints, joints to be pointed or caulked or sealed, and openings around flush-mounted electrical outlet boxes in wet locations shall be tooled slightly concave with the mortar thoroughly compacted and pressed against the edges of the units. Tooling shall be done when the mortar has been thumbprint hard. The tooled joint shall be finished to uniformly straight and true lines and surfaces, smooth and free of tool marks.

9. Placing Reinforcing Steel

Prior to placing grout, all reinforcement shall be cleaned of loose, flaky rust, scale, grease, mortar, grout or other coating which might destroy or reduce its bond with grout. Details of reinforcement shall be as indicated in the drawings. Reinforcing shall not be bent or straightened in a manner injurious to the steel. Bars with kinks or bends not shown on the drawings shall not be used. Placement of reinforcement shall be inspected and approved prior to placing grout. One piece vertical bars extending from floor to floor or roof above shall be provided. Vertical bars shall be spliced only where indicated.

a. **Positioning Bars**

Vertical bars shall be positioned accurately at the centerline of the wall. A minimum clearance between the bars and masonry units of 12mm and between parallel bars of one diameter of the reinforcement shall be maintained. Vertical reinforcing shall be held in place using metal supports, centering clips, spacers, ties or caging devices located near the ends of each bar and at intermediate intervals of not more than 192 diameters of the reinforcement.

b. **Splices**

Splices shall be located only as indicated. Splices shall be staggered in adjacent bars at least 600mm. Bars shall be lapped a minimum of 40 diameters of the reinforcement.

PAINTING AND CLEANING

Mortar daubs or splashing, before setting or hardening, shall be completely removed from masonry unit surfaces that will be exposed or painted. Before completion of the work, all defects in joints or masonry to be exposed or painted shall be raked out as necessary, filled with mortar, and tooled to match existing joints. Masonry surfaces shall not be cleaned, other than removing excess surface mortar until mortar in joints has hardened. Masonry hardened surfaces shall be left clean, free of mortar daubs, dirt, stain and discoloration, including scum from cleaning operations and with tight mortar joints throughout. Metal tools and metal brushes shall not be used for cleaning.

ITEM 16 : PLUMBING AND SANITARY WORKS**SCOPE OF WORK**

The work covered for this section shall consist of furnishing all labor, tools, equipment, materials, and incidentals necessary for the complete installation, testing, and operation of the plumbing and sanitary system within the buildings and premises in accordance with these Specifications and as shown on the drawings or as directed by the Engineer. The septic tank and its effluent and discharge pipelines shall be part of other sections of these specifications.

MATERIAL REQUIREMENTS**SUBMITTAL**

1. The Contractor shall submit his work method statement with necessary shop drawings to the Engineer for approval twenty-eight (28) days before the start of the works.

Shop drawings shall be dated and shall contain the name of the project and location of the subject item in the shop drawing which is to be installed.

The Engineer will review and approve or return for correction all shop drawings with reasonable promptness. The Contractor shall make any corrections required and file with the Engineer three (3) corrected copies of the shop drawings.

2. The drawings shall indicate the general arrangement of all piping, however, where actual conditions necessitate re-arrangement in the opinion of the Contractor and/or the Engineer, the Contractor shall prepare and submit to the Engineer for approval, within twenty-eight (28) days before placing the order for materials, shop drawings of the proposed re-arrangement. Because of the small scale of the drawings, shop drawings to indicate all offsets, fittings and accessories shall be prepared. The Contractor shall carefully examine the drawings and shall carefully investigate actual structural and finish conditions affecting all his work.
3. The Contractor shall be responsible for the proper fitting of materials, equipment and accessories without substantial alteration and at no cost to the Employer.
4. The Contractor shall be responsible for the proper coordination of the work and shall provide all necessary clearance where necessary.

STANDARDS

Use of materials shall further be governed by other requirement imposed on other sections of these Specifications. Materials shall be subject to tests necessary to ascertain their fitness if the Engineer so requires. All works shall comply with the pertinent provisions of the Plumbing Code of the concerned city or town, the Code on Sanitation of the Philippines, and/or the National Plumbing Code of the Philippines.

MATERIALS

1. Identification of Materials

Each length of pipe, fittings, traps, fixtures and devices used in the plumbing work shall have cast, stamped or indelibly marked on it, the approved manufacturer's trademark or name, the weight, type and class of product when so required by the standards mentioned above.

2. Alternative Materials

Use of any material not specified in this Specification may be allowed provided such alternate has been approved by the Engineer and provided further that a test, if required, shall be done by an approved agency in accordance with generally accepted standards.

3. Soil, Waste, Drain, Vent Pipes and Fittings

Soil, waste and vent pipes shall be unplasticized Polyvinyl Chloride (uPVC) pipes. Diameter shall be as indicated on the Drawings. It shall conform to ASTM D 1784 or ASTM D 2729.

Drainage pipes shall be reinforced concrete pipes (RCP), diameter shall be as indicated on the Drawings.

4. Jointing Material

The joint material for uPVC pipes shall be PVC solvent cement as recommended by the approved pipe manufacturer.

5. Water Supply Pipes

Water supply pipes shall be polypropylene random-80 (PPR-80) pipes PN 20 conforming to DIN Standards DIN 1988/DIN 8078. Jointing shall be fusion welded.

6. Cleanouts, Plugs and Tee

Cleanouts shall be of the same material as the pipe to be fitted. Cleanouts installed in connection with uPVC hubs and spigot pipes shall consist of a long sweep quarter bend of $\frac{1}{4}$ as shown on the drawings.

7. Pipe Sleeves

Pipe sleeves shall be installed and properly secured in place at all points where pipes passes through masonry or concrete. Pipe sleeves shall be uPVC pipe, Schedule 40.

8. Downspout

All downspouts shall be unplasticized polyvinyl chloride (uPVC) pipe class DWV conforming to ASTM D2729 or ASTM D1784 for sanitary pipes, Series 1000.

9. Splash Block

Provide splash blocks at the outlet of downspout emptying at grade which shall be made of pre-cast concrete, with smooth finished counter sunk dishes sloped to drain away from the building. Dimensions as shown on the Drawings.

10. Roof Strainers

The Contractor shall provide fittings and install 100mm G.I. mesh wire strainers where shown or indicated on the drawings and/or where the Engineer directs. Each strainer shall fit the size of the corresponding downspout which is to be installed.

11. Shower, Floor and Urinal Drain

Shower and floor drains shall be made of stainless steel non-tilting grate, perforated or slotted. Urinal drains shall be cast iron dome type drain.

12. Pipe hangers, Inserts and Support

- a. Pipe hangers shall be wrought iron, malleable iron pipe hangers spaced not over 1.5 meters apart for uPVC pipes and 3.0 meters apart for iron pipes. Chain straps, perforated bars or wire hangers will not be permitted.

Hangers shall have short turnbuckles or other approved means of adjustment. Turnbuckles may be omitted on hangers where space does not permit their use. Trapeze hangers may be used in lieu of separate hangers for pipes running parallel to each other and close together.

- b. Inserts shall be of cast iron or cast steel and shall be of a type to receive a machine bolt head or nut after installation.
- c. Wrought iron clamps or collars shall be used to support vertical runs of pipes.

13. Unions

Union pipe 50mmØ and smaller shall be malleable iron. Union on water piping 63mmØ and larger shall be a flanged pattern and shall be of galvanized (zinc-coated) cast iron. Gaskets for flange unions shall be of the best quality fiber plastic or leather.

14. Valves

Valves shall be cast bronze or brass body. Chrome plated finish for all fixture taps and faucets and natural finish for all others, like hose bibbs, gate valves, and which are not tapped directly to a plumbing fixture. Concrete valve boxes shall be installed where required and will be of sufficient size for operating the valve.

15. Fixtures

a. Water Closets

All water closets for toilets as shown on the drawings shall be FLUSH VALVE TYPE, white with complete fittings and mounting accessories.

b. Lavatories

b. 1. Lavatory (Wall Hung)

Shall be vitreous china, wall-hung lavatory with rear overflow holes, fitting ledge suitable for single faucet holes on centers complete with faucet, standard fittings, trap and lavatory brackets, and other accessories.

b. 2. Lavatory (Countertop Lavatory)

Shall be vitreous china, oval or round shaped countertop lavatory with front overflow hole, complete with faucet, supply valve, and fittings with P-trap. Fitting ledge suitable for single hole on center.

c. Soap Holder

Soap holder and toilet paper holder shall be vitreous china, wall mounted. All toilet/bath rooms will be provided with soap holder, toilet paper holder and chrome plated towel racks.

d. Faucet for lavatory

Faucet for lavatory shall be in chrome-finish.

e. Bidet Spray Combination

Installed in every cubicle near on the water closet, colored white or its equivalent

16. Concrete, Reinforcing Steel, Pipe and Steel Plate

Materials for wash pits, catch basins, and manholes shall conform to the requirements as follows:

- a. Concrete materials shall conform to the requirements in "Concrete Works" and shall be Class C concrete with a 28-day minimum compressive strength of 21 MPa (3,000 psi).
- b. Reinforcing steel shall be as shown on the drawings and shall conform with the requirements of reinforcing steel bars in "Concrete Works."
- c. Pipes shall be as shown on the drawings and shall comply with the relevant item of the particular pipe.
- d. Steel plates shall be as shown on the Drawings and shall comply with Section "Steel and Metal Works".

17. Non-reinforced Concrete Pipe

Non-reinforced concrete pipe shall be as shown on the Drawings and shall conform with the requirements of non-reinforced concrete pipes AIC latest edition. Concrete shall be with a 28-day minimum compressive strength of 20.7 MPa.

EXECUTION

All installation works shall be in conformity with the National Plumbing Code of the Philippines (NPCP).

EXCAVATION, TRENCHES AND BACKFILLING

1. Trenches for all underground pipelines shall be excavated to the required depth. The bottom of trenches shall be tamped hard and graded to secure the required fill. Bell holes shall be excavated so that pipes will rest on solid ground for their entire length.

Rocks where encountered, shall be excavated to a depth of 150mm below the bottom of the pipe and before the pipe is laid, the space between the bottom of the pipe and the rock shall be filled with sand. Sewer and water pipes shall be laid in separate trenches.

2. After pipelines have been tested, inspected and approved by the Engineer and prior to backfilling, all forms shall be removed and the excavation shall be cleaned of all trash and debris.

Materials for backfilling shall consist of acceptable excavated soil, borrow of sand, gravel or other materials approved by the Engineer and shall be free from trash, lumber or other debris. Backfilling shall be placed in horizontal layers not exceeding 150 mm in thickness and properly moistened to approximate optimum requirements. Each layer shall be compacted by hand or machine tamper or by other suitable equipment to a density that will prevent excessive settlement or shrinkage.

Backfilling shall be brought to a suitable elevation above grade to provide for anticipated settlement and shrinkage thereof.

Water pipes shall have a sand cushion 150mm below and above the pipes.

INSTALLATION OF SOIL, WASTE DRAINS OR VENT PIPES

1. Horizontal Drainage Pipe and Vent Piping

Horizontal waste pipes 75mmØ and smaller shall have a minimum grade of 6.5mm per 0.30m and for 100mmØ and larger, 3.2mm per 0.30m. All main vertical soil and waste stacks shall be extended full size above the roof line as vents, except where otherwise specifically shown.

Where practicable, two (2) or more vent pipes shall be connected together and extended as one pipe through the roof. Vent pipes in roof spaces shall be run as close as possible to the underside of roof with horizontal piping pitched to stacks using fittings as required without forming traps in pipes.

Vertical pipe vents may be connected to a vent line carrying other fixtures. The connection shall be at least 1.20m above the floor on which the fixtures are located to prevent the use of vent lines as waste. Horizontal waste lines receiving the discharge from two (2) or more fixtures shall be provided with vents, unless separate venting of fixtures is noted.

2. Fittings

All changes in pipe sizes on soil waste lines shall be made with reducing fittings or recessed reducers. All changes in direction shall be made by the appropriate use of forty five (45) degree wyes. Long sweep quarter bends or elbows may be used in soil and waste lines where the change in direction of flow is from the horizontal to the vertical and on the discharge from water closets.

Where it becomes necessary to use short radius fittings in any location, the approval of the Engineer shall be obtained before they are installed.

3. Joints

a. PVC Soil Pipe

All joints in uPVC soils, waste, and vent pipe shall be accomplished by the use of PVC solvent cement.

b. All joints for uPVC shall be accomplished by applying the manufacturer's recommended solvent before connection to the pipe.

4. Cleanouts

Cleanouts at the bottom of each soil stack, waste stack, and where else indicated shall be the same size as the pipe.

Cleanouts on floors shall be by uPVC plug adapter fit into the hub and fitted with uPVC screw plugged flush with the floor.

Cleanout shall be provided at every change in direction greater than 45 degrees.

5. Flashings

All pipes passing through the roof shall be provided with lead flashings. All flashings shall be built to 40 lbs. bituminous felts and shall extend up to the pipe and down-over to top of pipe at least 150mm and along the roof not less than 300mm and shall lap over flashing to make a weatherproof joint.

6. Traps

Each fixture and piece of equipment requiring connections to the drainage system, except fixtures with continuous waste, shall be equipped with a trap. Traps shall be specified to be supplied with the fixtures. Each trap shall be placed as near to the fixtures as possible.

Traps installed on threaded pipes shall be recessed drainage pattern.

7. Pipe Sleeves, Hangers, and Supports

Pipe sleeves shall be installed and properly secured in place at all points where pipes pass through masonry or concrete except unframed floors on earth.

Pipes shall not be permitted to pass through footings or beams unless noted on the drawings.

Pipe sleeves in floors shall extend not less than 25mm and not more than 50mm above the finished floor. After installation of the pipe, the space around the pipe shall be packed with plastic material and made watertight. Flashing shields for sleeves passing through the waterproofing membrane shall be thoroughly mopped into the membrane. The space between the pipe and sleeves shall be made watertight by inserting approved sealing and caulking materials.

INSTALLATION OF WATER PIPES, FITTINGS, AND CONNECTIONS

1. Gate Valves and Outlets

Gate valves shall be installed close to the point of connection to the existing service line outside the building. The piping shall be extended to all fixture outlets and equipment from the gate valves. Outlets where indicated shall be capped or plugged and left ready for future connections.

2. Mains, Branches, and Runouts

All runs of piping shall be installed as shown on the drawings. The piping shall be cut accurately to measurements, and installed at the building site by the Contractor and shall be worked into place without springing or forcing. Care shall be taken not to weaken the structural portions of the buildings.

All pipes above ground shall be run parallel with the lines of the building unless otherwise shown on the drawings. Branch pipes from service lines may be taken off on top of mains, bottom of mains, or side of mains, using such cross-over fittings as may be required by structural or installation conditions.

All service pipes, valves, and fittings shall be kept at a sufficient distance from the other work to permit finished covering not less than 6.5mm from such other work and not less than 13mm between finished covering on different services. No water piping shall be buried in floors unless specifically indicated on the drawings or approved. Changes in pipe sizes shall be made with reducing fittings.

The use of long screws and bushings is prohibited.

3. Joints

Joints and connections in the plumbing system shall be gas-tight and watertight for the pressures required by the test.

After cutting and before threading all pipes shall be reamed and shall have burrs removed. All screwed joints shall be applied with an approved graphite compound or TEFLON tape to facilitate connections. Threads shall be full cut and not more than three threads on the pipe shall remain exposed.

Caulking of threaded joints or top to prevent leaks shall not be permitted.

Unions shall be provided where required for disconnection. Threaded swing bolts shall be used for branch connections to risers and mains.

4. Unions

Where required unions shall not be concealed in walls, ceilings or partitions.

5. Tests

The following tests shall be conducted by the Contractor at his expense under the supervision of the Engineer.

a. Tests for Drainage and Venting System

The entire drainage and venting system shall have necessary openings plugged to permit the entire system to be filled with water to the level of the highest vent stack above the roof. The system shall hold the water for 30 minutes with a drop not greater than 100mm.

b. Sterilization

The entire water supply piping system shall be sterilized with a solution containing not less than fifty (50) parts per million of available chlorine, either liquid chlorine or a solution of sodium hypochlorite. The sterilizing solution shall remain in the system for a period of not less than 8 hours during which time all valves and faucets shall be opened and closed several times. After sterilization, the solution shall be flushed from the system with clean water until the residual chloride content is not more than 0.2 parts per million.

c. Pressure Test for Water Lines

1. After the pipe has been installed, the joints are completed and with joints exposed for examination, all newly installed pipe or any valve section, thereof, shall be subjected to hydrostatic pressure one and one half (1½) the designed working pressure of the system or as specified by the Engineer.
2. The duration of each pressure test shall be at least 20 minutes unless otherwise specified by the Engineer.
3. Each section of the pipeline shall be slowly filled with water and the specified test pressure, measured at the point of lowest elevation, shall be applied by means of a pump connected to the pipe in a manner satisfactory to the Engineer. During the filling of the pipe and before applying the test pressure, all air shall be expelled from the pipeline. To accomplish this, tap shall be made if necessary, at the highest point of the pipe under test and after completion of the test, the taps shall be tightly plugged unless otherwise specified. During the test, all exposed pipes, fittings, valves, joint and couplings will be carefully examined. If found to be cracked or defective, they shall be removed and replaced by the Contractor with sound materials at his expense. The test shall then be repeated until satisfactory results are obtained.

d. Leakage Test for Water Lines

1. Leakage test shall be conducted after satisfactory completion of the pressure test and shall consist of an examination of all exposed joints for leakage as well as an overall leakage test of the completed pipeline.
2. The pressure to be maintained during the test shall be the designed working pressure of the system.
3. Leakage test shall be made only after a minimum of 24 hours after the pipe to be tested has been filled with water.
4. The duration of each leakage test shall be two hours unless otherwise specified by the Engineer.
5. Each section of pipeline shall be slowly filled with water and the specified test pressure, measured at the point of lowest elevation shall be applied by means of a positive displacement type pump and reservoir connected to the pipe in a manner satisfactory to the Engineer.
6. Before starting the leakage test, all air shall be expelled from the pipe. All exposed pipes, fittings, valves and joints shall be examined for leakage during the test.
7. Allowable leakage rate per 100 joints per inch of Pipe Diameter at Pressure Stipulated.

PRESSURE		LEAKAGE RATE	
psi	kg/cm ²	liters/hr.	liters/2 hrs.
50	3.50	1.45	2.90
75	5.30	1.75	3.50
100	7.00	2.05	4.10

125	8.80	2.30	4.60
150	10.50	2.50	5.00
200	14.00	2.90	5.80

e. **Defective Work**

1. If the inspection or test shows any defect, such defective work or material shall be replaced and the test shall be repeated until satisfactory to the Engineer.
2. All repairs to piping shall be made with new materials at the expense of the Contractor.
3. No caulking of screwed joints or holes will be accepted.

ASSEMBLY, INSTALLATION AND CONNECTION OF FIXTURES

Fixtures shall be supported and fastened in a satisfactory manner. Where secured to concrete or masonry work walls, fixtures and equipment shall be fastened with brass bolts or machine screws in lead-sleeve type anchorage units or with brass expansion bolts. Expansion bolts shall enter 7.5 cm into solid concrete or masonry works and shall be fitted with loose tubing or sleeves of proper length to bring expansion sleeves into the solid concrete masonry walls.

Where wood screws are used, screws shall go into solid pieces set between studs. Where through-bolts are used, bolts shall be provided with plates or washers at back set, so that they will be concealed by plaster. Bolts and nuts shall be hexagonal and exposed nuts, cap nuts, and screw heads shall be provided with chromium plated brass washers.

PROTECTION OF FIXTURES

Pipe openings shall be closed with caps or plugs during installation. Fixtures shall be tightly covered and protected against dirt, water and chemical injury. At the completion of all works, all fixtures shall be thoroughly cleaned and delivered in a condition satisfactory to the Engineer.

FIXTURES AND FASTENING

All fixtures shall be supported and fastened in a satisfactory manner as follows:

1. Where secured to concrete or concrete hollow block walls, they shall be fastened with one quarter inch brass bolts with twenty threads to the inch and of sufficient length to extend at least 7.5 cm into solid concrete or hollow block work, fitted with loose tubing or sleeve insert and shall be securely anchored and installed flush with the finished wall and shall be completely concealed when the fixtures are installed.
2. Where through-bolts are used, they shall be provided with plates or washers back set so that heads, nuts and washers will be concealed by plaster. Bolts and nuts shall be hexagonal. Exposed bolts, nuts, capnuts and screw heads shall be provided with chromium plated brass washers.

GUARANTEE

Upon completion and before final acceptance of the equipment installation, the Contractor shall furnish the Engineer a written guarantee stating that all equipment installed under this Section free from defects. The guarantee shall be for a period of one (1) year from the date of final acceptance of

the work. Any part of the equipment that becomes defective during the term of the guarantee shall be replaced, renewed and/or made good by the Contractor, at his own expense and in a manner satisfactory to the Engineer.

Guarantees made by the approved manufacturers or suppliers beyond one year, shall be transferred to PPA without any expense on his part.

CLEANING UP

Upon completion of the work, all parts of the installation shall be thoroughly cleaned of grease, metal cuttings and sludge which may have accumulated during the testing operation.

PLUMBING, FIXTURES AND TOILET ACCESSORIES INSTALLATION

All installation works shall be as shown on the drawings and shall conform to the applicable standards set forth by the Philippine National Plumbing Code. All fixtures shall be fastened and/or supported in accordance with the given requirements.


ITEM 17 : PROJECT BILLBOARD**SPECIFICATION**


The Project Billboard shall be installed at location(s) designated by the Engineer.

The size and specifications of materials for the standard billboard shall be 4ft. x 8ft. (1,200mm x 2,400mm) using ½ inch (12mm) marine plywood or tarpaulin poster on 3/16 inch (5mm) marine plywood.

Project billboards shall not contain Name(s) and/or picture(s) of any personages.

See attached drawings for further details of the standard billboard.

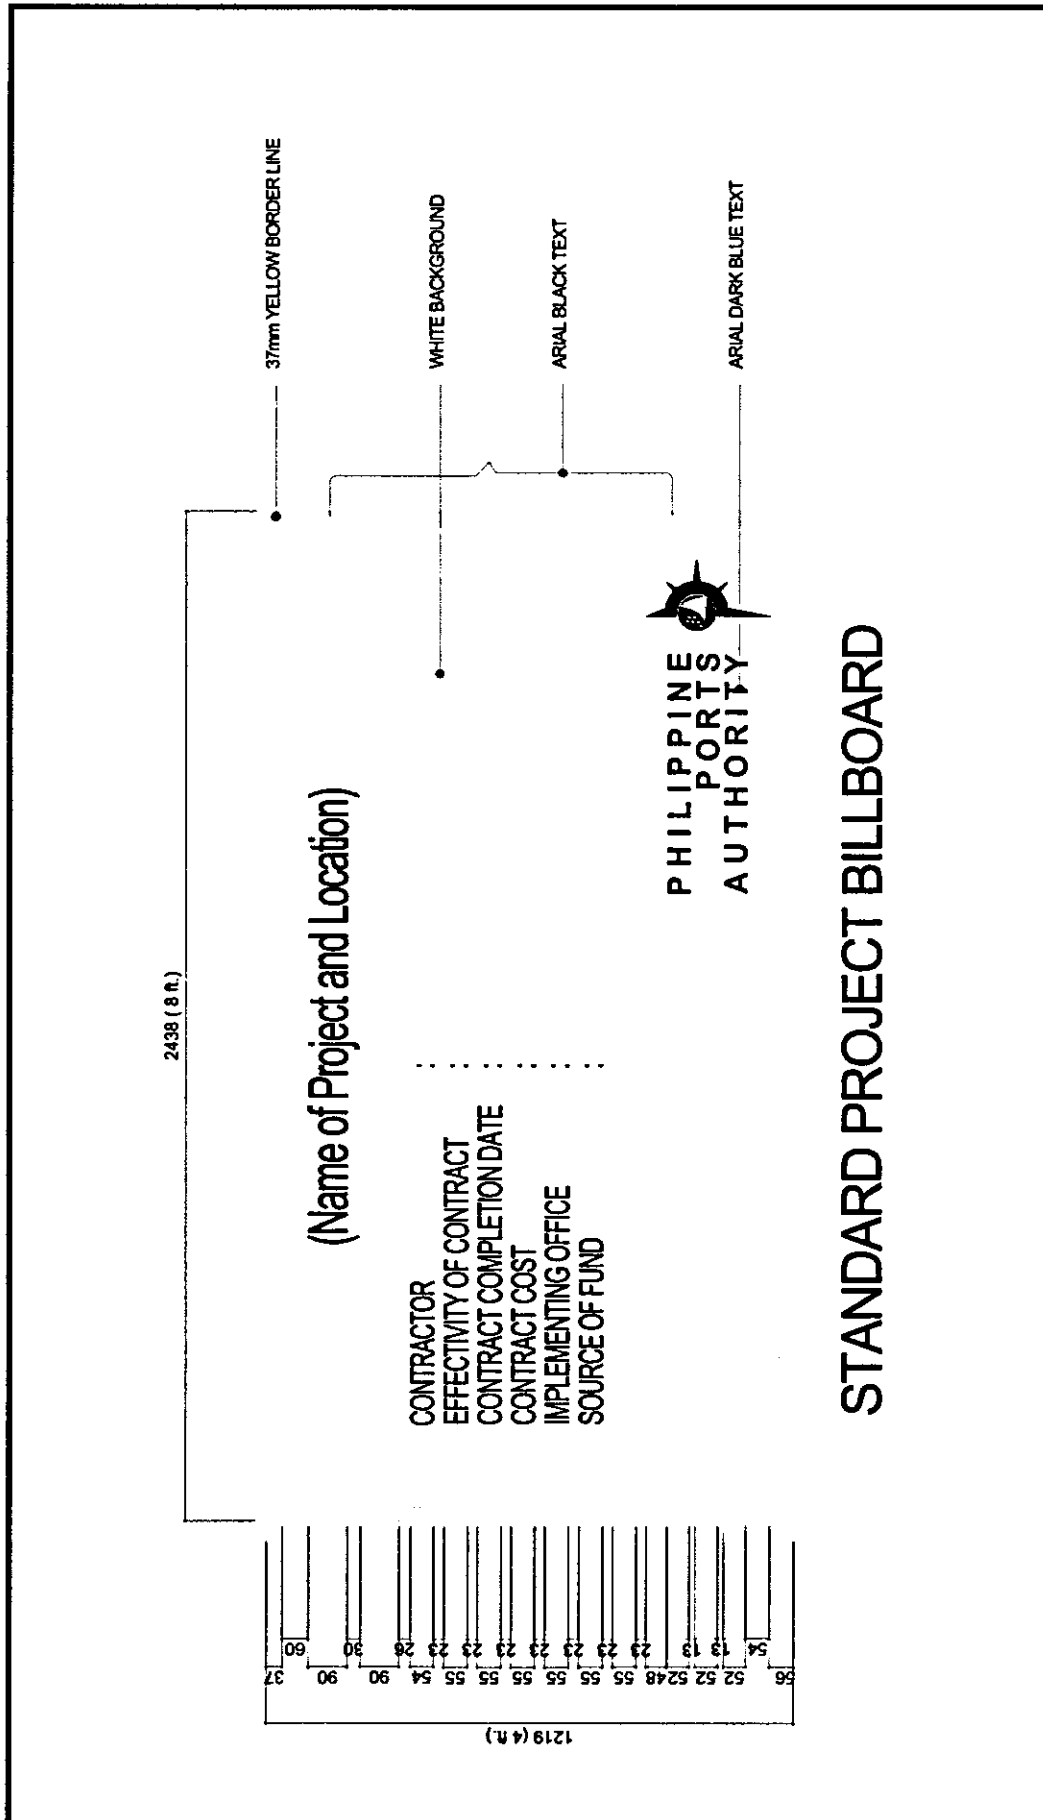

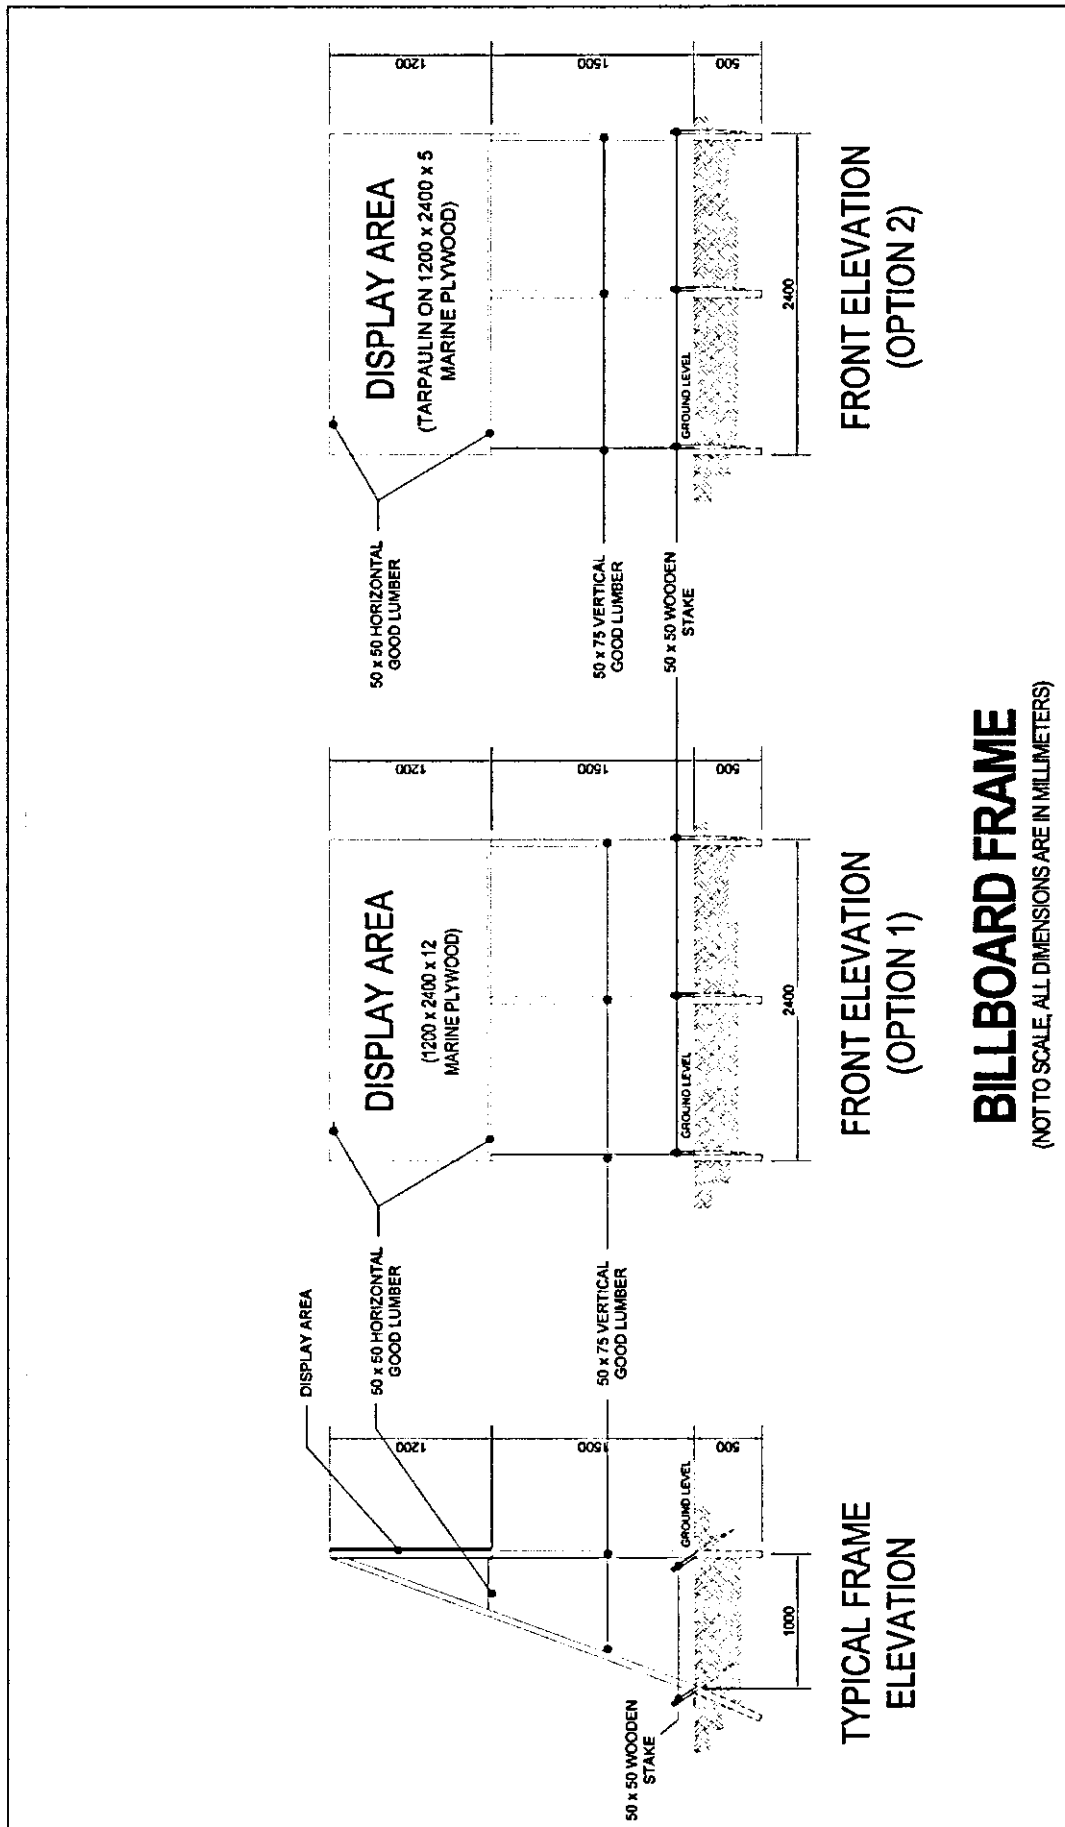

ITEM 18 : SAFETY SIGNAGES AND BARRICADES

DESCRIPTION

This work includes the furnishing and installing of safety signages and barricades in accordance with the specifications and to the details shown below in the drawings, or as directed by the Engineer.


SPECIFICATION

The Signage's and Barricades shall be installed at location(s) designated by the Engineer.

The sizes of the standard signages shall be 2-2/3ft x 4ft (800mm X 1,200mm) for fixed type and 2ft x 2-2/3ft (600mm x 800mm) for mobile type. For barricade standard 2ft x 2-2/3ft (600mm x 800mm) shall be provided.

The materials to be used for signages and barricades are ½ inch (12mm) marine plywood or tarpaulin poster on 2" x 2" (50mm x 50mm) good lumber frame (see drawing below).

The printing or painting shall be the discretion of the Engineer.



STANDARD PLAN FOR SIGNAGES AND BARRICADES

SECTION VII

*DRAWINGS
(APPROVED PLANS)*

DRAWINGS AND APPROVED PLANS (SEE ISSUED APPROVED PLANS)

LIST OF DRAWINGS:

WIDENING AND UPGRADING:

01 of	11	-	Vicinity Map, Development Plan, General Notes, List of Drawings
02 of	11	-	General Plan
03 of	11	-	General Plan (Blow-Up)
04 of	11	-	Drainage Layout Plan
05 of	11	-	Section A-A, Section B-B, Section C-C, Section D-D
06 of	11	-	Section E-E, Section F-F, Section G-G, Section H-H
07 of	11	-	Section I-I
08 of	11	-	Section X-X, Typical Pavement Joint, Detailed Section of Stair Landing Detail of Retaining Wall, Detail of Concrete Block, Detail of Drainage Outfall
09 of	11	-	Detail of Fence-1
10 of	11	-	Detail of Fence-2
11 of	11	-	Detail of Catch Drain Manhole, Detail of Lateral Drainage

Gate and Guard House:

G-01 of	09	-	Perspective, Floor Plan, Side Elevation, Front Elevation, Roof Plan Signage Framing Detail, PPA Logo Detail, Schedule of Gates
G-02 of	09	-	Floor Plan, Roof Plan, Reflected Ceiling Plan, Front Elevation, Rear Elevation Right Side Elevation, Left Side Elevation, Section Thru F-F', Section Thru G-G' Section Thru H-H'
G-03 of	09	-	Schedule of Doors and Windows, Blow-Up Detail 03, Blow-Up Detail 04 Drip Mold Plan, Drip Mold Section
G-04 of	09	-	General Notes
G-05 of	09	-	Miscellaneous Structures Location Tag, Cross Section & Front Elevation of Gate C-1 Section, B-1 Section, B-2 Section, Detail A, CS-1 Section
G-06 of	09	-	Foundation Plan (F-1, F-2), C-1 Section, C-2 Section, F-3 Detail

- G-07 of 09 - Foundation Plan (Guard House), Step-Up Section, Detail of Concrete Pedestal Framing Elevation, Framing Plan, Roof Layout Plan, Typical Detail of Concrete Edging, Wall Footing -1
- G-08 of 09 - Lighting and Power Layout Plan, Load Schedule, Riser Diagram
Detail of Concrete Pedestal Post, Legend
- G-09 of 09 - Sewer and Storm Water Drainage Layout Plans, Cold Water Supply Layout Plans, Details of Septic Tank, Details of Catch Basin, Detail of Trenching Bedding & Backfilling of Pipes, Schedule of Pipe (Sewer Line), Schedule of Pipe (Water Line), General Notes and Specifications, Material Specifications

Covered Walkway and Battery Storage:

- GW-01 of 11 - Perspective, Site Development Plan
- GW-02 of 11 - Covered Walkways: Floor Plan, Reflected Ceiling Plan, Roof Plan
Blow-Up Floor Plan, Blow-Up Reflected Ceiling Plan, Typical Front Elevation
Typical Side Elevation, Typical Blow-Up Cross Section
- GW-03 of 11 - Detail of Battery Storage: Perspective, Location Plan, Floor Plan
Reflected Ceiling Plan, Roof Plan, Roof Framing Plan, Front Elevation
Side Elevation, Section
- GW-04 of 11 - General Notes
- GW-05 of 11 - Typ. Foundation Plan, Typ. Roof Framing Plan, Schedule of Steel Section
Detail of Column/Footing (C1-F1)
- GW-06 of 11 - Lighting and Power Layout Plan, Blow-Up Cross Section, Legend
- GW-07 of 11 - Detail of Single Angle Bar Floodlight Steel Tapered & Lamp Post Foundation
Single Angle Bar Floodlight Steel Tapered Lamp Post, Floodlight Post
Connection Details, Led Floodlight Fixture 150-Watt, Specification
- GW-08 of 11 - Port Lighting Layout Plan, Service Entrance Layout Plan, General Notes, Legend
- GW-09 of 11 - Solar Panel Layout Plan, PV Module Specification, Legend
- GW-10 of 11 - Site Plumbing System/Storm Drainage Layout Plan
- GW-11 of 11 - Covered Walkway Storm Water Drainage Plan, Covered Walkway Storm Water
Drainage Isometric Layout, Typical Detail of Downspout

SECTION VIII

*BILL OF QUANTITIES
and
ATTACHMENTS*

BID SUMMARY
LAMAO (LIMAY) PORT IMPROVEMENT PROJECT
 Port of Lamao, Limay, Bataan



NO.	DESCRIPTION OF WORK	AMOUNT (Pesos)
BILL NO. 1	GENERAL EXPENSES	
BILL NO. 2	WIDENING OF ROCK CAUSEWAY	
	BID PRICE	

 Name of Firm

 Name of Bidder/Authorized Representative
 (Signatory's Legal Capacity)

 Date

BILL OF QUANTITIES
LAMAO (LIMAY) PORT IMPROVEMENT PROJECT
 Port of Lamao, Limay, Bataan



NO. (1)	DESCRIPTION OF WORK (2)	UNIT (3)	QTY. (4)	UNIT PRICE (Pesos) (5)	AMOUNT (Pesos) (4) x (5)
BILL NO. 1	GENERAL EXPENSES				
1.01	Mobilization, demobilization and cleaning	lot	1		
1.02	Rental of temporary site office and residence for the Engineer and staff	mo.	8		
1.03	Maintain temporary site office and residence for the Engineer and staff	mo.	8		
1.04	Provide Construction Safety and Health Program in the execution of the project	mo.	8		
TOTAL FOR BILL NO. 1					

 Name of Bidder/Authorized Representative
 (Signatory's Legal Capacity)

BILL OF QUANTITIES
LAMAO (LIMAY) PORT IMPROVEMENT PROJECT
 Port of Lamao, Limay, Bataan



NO. (1)	DESCRIPTION OF WORK (2)	UNIT (3)	QTY. (4)	UNIT PRICE (Pesos) (5)	AMOUNT (Pesos) (4) x (5)
BILL NO.	2 WIDENING OF ROCK CAUSEWAY				
2.01	Chip-off portion of existing R.C. Curb, flush to required elevation and smoothen with mortar	l.m.	70		
2.02	Remove existing lamp post and turn-over to the authority	no.	1		
2.03	Remove and dispose existing concrete pavement	sq.m.	287		
2.04	Supply and place gravel bedding	cu.m.	7		
2.05	Supply and place 50-100 kg. Core rocks	cu.m.	785		
2.06	Supply and place 1,000 kg. Armour rocks	cu.m.	644		
2.07	Supply and install Geotextile Fabric	sq.m.	1,495		
2.08	Supply and place Sand and Gravel fill	cu.m.	809		
2.09	Supply and place 3,500 psi concrete for the retaining wall, RC block stairlanding, outfall, pedestal post, and lamp post foundation	cu.m.	126		
2.10	Supply and install steel reinforcement for the retaining wall, RC block stairlanding, outfall, pedestal post, and lamp post foundation	kg.	10,552		
2.11	Supply, spread and compact aggregate sub-base course	cu.m.	1,011		

 Name of Bidder/Authorized Representative
 (Signatory's Legal Capacity)

BILL OF QUANTITIES
LAMAO (LIMAY) PORT IMPROVEMENT PROJECT
 Port of Lamao, Limay, Bataan



NO. (1)	DESCRIPTION OF WORK (2)	UNIT (3)	QTY. (4)	UNIT PRICE (Pesos) (5)	AMOUNT (Pesos) (4) x (5)
2.12	Supply, spread and compact aggregate base course	cu.m.	218	-	-
2.13	Construct portland cement concrete pavement (300mm thk) including dowel bars and construction joint	sq.m.	1,091	-	-
2.14	Construct security fence including painting and accessories	l.m.	109	-	-
2.15	Supply deliver and install port lighting system including floodlight steel lamp post, electrical of guardhouse and other accessories	lot	1	-	-
2.16	Supply deliver and install 10.8 kw off-grid solar panel at covered walkway roofing including framing and other accessories	lot	1	-	-
2.17	Construct lateral drainage including hot-dipped galvanized steel gratings and other accessories	l.m.	14	-	-
2.18	Construct catch drain manhole including hot-dipped galvanized steel gratings and other accessories	no.	10	-	-
2.19	Supply and lay 600mm dia. reinforced concrete pipe including accessories	l.m.	80	-	-
2.20	Construct Battery storage for solar panel including accessories	lot	1	-	-
2.21	Construct Guardhouse and Gate including other apurtenances	lot	1	-	-
2.22	Construct Covered Walkway including painting and other apurtenances	lot	1	-	-
TOTAL FOR BILL NO. 2					

 Name of Bidder/Authorized Representative
 (Signatory's Legal Capacity)

BASIS OF PAYMENT FOR WORK ITEMS INCLUDED IN THE PROPOSAL

The work items included in the proposal and the basis of payments are as follows:

BILL NO. 1

GENERAL EXPENSES

Item 1.01 Mobilization, demobilization, and cleaning

The quantity to be paid for shall be the minimum equipment requirement enumerated in the bid documents mobilized, demobilized and cleaning of the site and accepted by the Engineer. The contract lump sum price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to mobilize and demobilize all the minimum equipment requirement enumerated in the bid documents including cleaning of the site. Fifty percent (50%) of the total amount shall be payable after the mobilization activity while the remaining (50%) payable after demobilization and cleaning.

Item 1.02 Rental of temporary site office and residence for the Engineer and staff

The quantity to be paid for shall be the actual rental of site office and residence for the engineer and staff and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary for the provision of temporary site office and residence for the engineer and staff.

Item 1.03 Maintain temporary site office and residence for the Engineer and staff

The quantity to be paid for shall be the actual services rendered in maintaining the site office and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the maintenance of the temporary site office and residence as well as other expenses such as provision for electric power, telephone bill, potable water supply, janitorial and security services.

Item 1.04 Provide construction safety and Health Program in the execution of the project

The quantity to be paid for shall be the actual implementation of construction safety and health program and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the implementation of the Construction Safety and Health Program, as required and approved by the Department of Labor and Employment (DOLE).

BILL NO. 2

WIDENING OF ROCK CAUSEWAY

Item 2.01 Chip-off portion of existing R.C. Curb, flush to required elevation and smoothen with mortar

The quantity to be paid for shall be the actual length in linear meter of existing RC curb to be chipped off, flushed to required elevation, and smoothened with mortar in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 2.02 Remove existing lamp post and turn-over to the authority

The quantity to be paid for shall be the actual number of existing lamp post to be removed and turned over to the authority in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 2.03 Remove and dispose existing concrete pavement

The quantity to be paid for shall be the actual area of existing concrete pavement to be removed and disposed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 2.04 Supply and place gravel bedding

The quantity to be paid for shall be the actual volume in cubic meter of gravel bedding to be supplied and set-in-place in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 2.05 Supply and place 50-100 kg. core rocks

The quantity to be paid for shall be the actual volume in cubic meter of 50-100 kg. core rocks, supplied and set-in-place in accordance with the plans and specifications and accepted by the Engineer. Hydrographic/Topographic Surveys before and after placing of core rocks shall be made to determine the actual elevations along the cross sections and the actual quantities for payment. Volume due to settlement as established using settlement plates shall also be considered for payment. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 2.06 Supply and place 1,000 kg. armour rocks

The quantity to be paid for shall be the actual volume in cubic meter of 1,000 kg. armour rocks, supplied and set-in-place in accordance with the plans and specifications and accepted by the Engineer. Hydrographic/Topographic Surveys before and after placing of armour rocks shall be made to determine the actual elevations along the cross sections and the actual quantities for payment. Volume due to settlement as established using settlement plates shall also be considered for

payment. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 2.07 Supply and install geotextile fabric

The quantity to be paid for shall be the actual area in square meter of geotextile fabric, supplied and installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 2.08 Supply and place sand and gravel fill

The quantity to be paid for shall be the actual volume in cubic meter of sand and gravel fill to be supplied and set-in-place in accordance with the plans and specifications and accepted by the Engineer. Hydrographic/Topographic Surveys before and after placing and compacting of aggregate subbase course rocks shall be made to determine the actual elevations along the cross sections and the actual quantities for payment. Volume due to settlement as established using settlement plates shall also be considered for payment. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 2.09 Supply & place 3,500 psi. concrete for retaining wall, RC block, stair landing, outfall, pedestal post, and lamp post foundation

The quantity to be paid for shall be the actual volume in cubic meter of 3,500 psi. concrete to be supplied and set-in-place for retaining wall, RC block, stair landing, outfall, pedestal post, and lamp post foundation in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 2.10 Supply and install steel reinforcements for retaining wall, RC block, stair landing, outfall, pedestal post, and lamp post foundation

The quantity to be paid for shall be the actual weight in kilogram of reinforcing steel bars to be supplied and installed for retaining wall, RC block, stair landing, outfall, pedestal post, and lamp post foundation in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 2.11 Supply, spread and compact aggregate sub-base course

The quantity to be paid for shall be the actual volume in cubic meter of aggregate sub-base course to be supplied, spread, and compacted in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 2.12 Supply, spread and compact aggregate base course

The quantity to be paid for shall be the actual volume in cubic meter of aggregate base course to be supplied, spread, and compacted in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 2.13 Construct Portland cement concrete pavement (300mm thick) including dowel bars and construction joint

The quantity to be paid for shall be the actual area in square meter of Portland cement concrete pavement (300mm thick) including dowel bars and construction joint, to be constructed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 2.14 Construct security fence including painting and accessories

The quantity to be paid for shall be the actual length in linear meter of security fence including painting and accessories to be constructed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 2.15 Supply, deliver and install port lighting system including floodlight steel lamp post, electrical of guardhouse and other accessories

The quantity to be paid for shall be the actual lot of port lighting system including floodlight steel lamp post, electrical of guardhouse and other accessories to be supplied, delivered, and installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 2.16 Supply deliver and install 10.8 kw off-grid solar panel at covered walkway roofing including framing and other accessories

The quantity to be paid for shall be the actual lot of 10.8 kw off-grid solar panel at covered walkway roofing including framing and other accessories to be supplied, delivered, and installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 2.17 Construct lateral drainage including hot-dipped galvanized steel gratings and other accessories

The quantity to be paid for shall be the actual length in linear meter of lateral drainage including hot-dipped galvanized steel gratings and other accessories to be constructed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 2.18 Construct catch drain manhole including hot-dipped galvanized steel gratings and other accessories

The quantity to be paid for shall be the actual number of catch drain manhole to be constructed hot-dipped galvanized steel gratings and other accessories in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 2.19 Supply and lay 600mm dia. reinforced concrete pipe including accessories

The quantity to be paid for shall be the actual length in linear meter of 600mm dia. reinforced concrete pipe including concrete mortar and sand bedding, to be supplied and laid-in-place in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 2.20 Construct Battery storage for solar panel including accessories

The quantity to be paid for shall be the actual lot of Battery storage for solar panel including accessories to be constructed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 2.21 Construct Guardhouse and Gate including other appurtenances

The quantity to be paid for shall be the actual lot of Covered Walkway including painting and other appurtenances to be constructed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 2.22 Construct Covered Walkway including painting and other appurtenances

The quantity to be paid for shall be the actual lot of Covered Walkway including painting and other appurtenances to be constructed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

FACILITIES TO BE PROVIDED FOR THE ENGINEER & HIS STAFF

RENTAL OF SITE OFFICE AND RESIDENCE FOR THE ENGINEER & STAFF

The Contractor shall provide a temporary site office and residence (rental) with an area of at least 48 square meters for use of the Engineer and his staff for the whole duration of the project.

MINIMUM MAJOR EQUIPMENT REQUIREMENTS

1	unit/s	Air Compressor (250 cfm, minimum), owned
1	unit/s	Backhoe (0.40 cu.m., 94.30hp, minimum), owned
1	unit/s	Clamshell, owned
1	unit/s	Concrete cutter, owned
1	unit/s	Concrete Mixer (1 bagger, minimum), owned
1	unit/s	Concrete bucket, owned
1	unit/s	Concrete Screeder, owned
1	unit/s	Concrete Vibrator (3.5 hp, minimum), owned
1	unit/s	Crawler Crane (30T, minimum), owned/leased
1	unit/s	Dump Truck (8 cu.m., minimum), owned
2	unit/s	Bar Bender (electric, 25mm dia min.), owned
2	unit/s	Bar Cutter (electric, 25mm dia min.), owned
1	unit/s	Jackhammer, owned
1	unit/s	Oxy/Acetylene cutting outfit, owned
1	unit/s	Payloader (80 hp, minimum), owned/leased
1	unit/s	Plate Compactor (5 hp, minimum), owned
1	unit/s	Road Grader (125 hp, minimum), owned/leased
1	unit/s	Road Roller (12.05T, vibratory, minimum), owned/leased
2	unit/s	Transit Mixer (5-6 cu.m. cap., minimum), owned/leased
1	unit/s	Water Truck with pump (1,000 gal., minimum), owned
2	unit/s	Welding Machine (400 amp., minimum), owned
1	unit/s	Cargo Truck (2-5T, capacity), owned

CONSTRUCTION SAFETY AND HEALTH REQUIREMENT

The Contractor shall implement the construction safety and health program in accordance with the applicable provisions of the Occupational Safety and Health Standards (OSHS) of the Department of Labor and Employment (DOLE).

The Contractor, subject to the approval of the Engineer shall provide and maintain throughout the duration of the contract a medical room with at least 15 square meters together with all necessary supplies to be sited in the Contractor's main area.

The Contractor shall provide the following minimum requirements:

LABOR

1	no.	Safety Engineer / Officer
1	no.	Nurse / Health Officer

EQUIPMENT / MATERIALS

Personnel Protective Equipment

45	pcs.	Hard Hats
45	pairs	Gloves (rubberized)
45	pcs.	Safety Glasses/Goggles (clear)
90	pcs.	Long sleeve T-shirt
4	pc.	Aprons
45	pairs	Safety Shoes

Safety Devices

1	lot	Barricades
1	lot	Warning signs
2	unit/s	Fire extinguisher (10kg)

Medical and First Aid System	-	Eight (8) mos.
Temporary shelter for workers	-	1 lot

NOTE:

The Contractor shall provide the above-cited minimum construction safety and health requirements or as required by the Engineer.

PPA MEMORANDUM CIRCULAR
No. 02
Series of 2016
Attachment

Page 1 of 10

REVISED SCHEDULE OF MINIMUM TEST REQUIREMENTS OF CONSTRUCTION MATERIALS FOR PPA INFRASTRUCTURE PROJECTS

<i>Materials/Items of Work</i>	<i>Required Tests</i>	<i>Minimum Incremental Frequency of Tests</i>
I. Construction of Pier/Wharf, Platform and Ramp		
Structural Concrete (SC)		
A Portland Cement	Quality Test	For every 2,000 bags (40kg) or fraction thereof
B Fine Aggregate	Quality Test for Grading, Elutriation (wash), Bulk Specific Gravity, Absorption, Mortar Strength, Soundness, Organic Impurities, Unit Weight, % Clay Lumps and Shale	For every 1,500 cubic meter or fraction thereof
C Coarse Aggregate	Quality Test for Grading, Bulk Specific Gravity, Absorption and Abrasion	For every 1,500 cubic meter or fraction thereof
D Water	Certificate from the Engineer or Quality Test for Density and Chloride Content	One per source
E Steel Bars	Mil Certificate and Quality Test for Chemical Composition and Mechanical Properties	For every 10,000 kg or fraction thereof
F Concrete	Compressive Strength on cylinder samples	1 set consisting of 3 concrete cylinder samples shall be taken from each day's pouring and to represent not more than 75 cu m of concrete or fraction thereof
	Slump Test	For every mix
G Admixture and Concrete Curing Materials	Quality Test	One per shipment
Piling (P)		
A Concrete Piles	Fabrication Report	One per fabrication
1 Concrete	Same test as for SC (F)	Same frequency as SC (F)
2 Steel Bars	Same test as for SC (E)	Same frequency as SC (E)
3 High Tension Strand	Test for Chemical Composition and Mechanical Properties	For every 20000kg or fraction thereof

PPA MEMORANDUM CIRCULAR
No. 02
Series of 2016
Attachment

Page 2 of 10

Materials/Items of Work	Required Tests	Minimum Incremental Frequency of Tests
4 Coarse Aggregates	Same Test as for SC (C)	Same frequency as SC (C)
5 Fine Aggregates	Same Test as for SC (B)	Same frequency as SC (B)
B Steel Pipe Piles	Fabrication Report, Mill Certificate and Quality Test for Chemical and Mechanical properties	One per fabrication
1 Steel	Chemical Composition (refer below) <ul style="list-style-type: none"> - Under 14" (355 60mm) Outside Diameter - 14" to 36" (355 6 to 914mm) Outside Dia - Over 36" (914mm) Outside Diameter Mechanical/Tensile	2 from 200 pipe of fraction thereof 2 from 100 pipe or fraction thereof 2 from 3000ft (914m) or fraction thereof One (1) tension test shall be made on one length or fraction thereof of each size, or one piece of skelp representing each lot of 200 lengths or fraction thereof of each size
2 Polyurethane Coating	Mill Certificate and Quality Test	One per fabrication
3 Concrete	Same test as for SC (F)	Same frequency as SC (F)
4 Fine Aggregate	Same test as for SC (B)	Same frequency as SC (B)
5 Coarse Aggregate	Same test as for SC (C)	Same frequency as SC (C)
6 Steel Bars	Same Test as SC (E)	Same frequency as SC (E)
7 Water	Same Test as SC (D)	Same frequency as SC (D)
Rubber Dock Fenders (RDF)	Physical Test Performance Test for Energy Absorption and Reaction Force	All units All units
Accessories		
Washer and Fixing Bolt, Anchor Bolt	Physical Test Quality Test for Chemical Composition and Mechanical Properties	All units One per fabrication

PPA MEMORANDUM CIRCULAR
No. 02
Series of 2016
Attachment

Page 3 of 10

Materials/Items of Work	Required Tests	Minimum Incremental Frequency of Tests
Mooring Bollard (MB) and Accessories (Hexagon Nuts, Plain Washer, Anchor Ring and Anchor Bolt)	Physical Test Quality Test for Chemical Composition and Mechanical Properties	All Units One per fabrication
II. Construction of Back-Up Area, Causeway and Pavement		
Sheet Piling (SP)		
A Concrete Sheet Piles		
1 Concrete	Same test as for SC (F)	Same frequency as SC (F)
2 Steel Bars	Same test as for SC (E)	Same frequency as SC (E)
3 High Tension Strands	Same test as for P (A 3)	Same frequency as P (A 3)
4 Fine Aggregates	Same test as for SC (B)	Same frequency as SC (B)
5 Coarse Aggregates	Same Test as for SC (C)	Same frequency as SC (C)
B Steel Pipe Piles		
1 Steel	Same test as for P (B1)	Same frequency as P (B1)
2 Concrete	Same test as for SC (F)	Same frequency as SC (F)
3 Fine Aggregate	Same test as for SC (B)	Same frequency as SC (B)
4 Steel Bars	Same test as for SC (E)	Same frequency as SC (E)

PPA MEMORANDUM CIRCULAR
No. 02
Series of 2016
Attachment

Page 4 of 10

Materials/Items of Work	Required Tests	Minimum Incremental Frequency of Tests
Rocks	Test for Apparent Specific Gravity and Abrasion	For every 1,500 cubic meter or fraction thereof
Geotextile Filter	Physical and Mechanical Test Mill Certificate	One per batch One per batch
Sand and Gravel Fill	Quality Test for Organic Impurities and Grading	For every 1,500 cubic meter or fraction thereof
Selected Fill	Quality Test for Grading, Plasticity and Laboratory Compaction Test Laboratory California Bearing Ratio (CBR) Field Density Test	For every 1,500 cubic meter or fraction thereof For every 2,500 cubic meter or fraction thereof For every layer of 150mm of compacted depth at least one group of three in-situ density test for every 500 sq m or fraction thereof
Aggregate Base Course	Quality Test for Grading and Plasticity Quality Test for Grading, Plasticity, Abrasion and Laboratory Compaction Test Laboratory California Bearing Ratio (CBR) Field Density Test	For every 300 cubic meter or fraction thereof For every 1,500 cubic meter or fraction thereof Same frequency as Selected Fill Same frequency as Selected Fill
Portland Cement Concrete Pavement (PCCP)		
A Portland Cement	Same test as for SC (A)	Same frequency as SC (A)
B Fine Aggregate	Same test as for SC (B)	Same frequency as SC (B)
C Coarse Aggregate	Same test as for SC (C)	Same frequency as SC (C)
D Water	Same test as for SC (D)	Same frequency as SC (D)
E Steel Bars (Dowels)	Same test as for SC (E)	Same frequency as SC (E)
F Joint Filler	Quality Test	One (1) per shipment

PPA MEMORANDUM CIRCULAR
No. 02
Series of 2016
Attachment

Page 5 of 10

Materials/Items of Work	Required Tests	Minimum Incremental Frequency of Tests
G Admixture and Concrete Curing Material	Same test as for SC (G)	Same frequency as SC (G)
H Concrete	Same test as for SC (F) Flexural Test	Same frequency as SC (F) 3 beam samples for every 330 sq m or fraction thereof
I Completed Pavement	Core Test	1 set (3 specimen) for every 2,500 sq m and fraction thereof
Interlocking Concrete Blocks		
A Cement	Same test as for SC (A)	Same frequency as SC (A)
B Fine Aggregate	Same test as for SC (B)	Same frequency as SC (B)
C Coarse Aggregate	Same test as for SC (C)	Same frequency as SC (C)
D Water	Same test as for SC (D)	Same frequency as SC (D)
E Admixture & Concrete Curing Materials	Same test as for SC (G)	Same frequency as SC (G)
F Completed Blocks	Physical Test and Compressive Strength	6 blocks per day of fabrication
Cement Treated Base Course (CTB)		
A Portland Cement	Same test as for SC (A)	Same frequency as SC (A)
B Fine & Coarse Aggregates	Quality Test for Grading, Abrasion and Soundness	For every 1,500 cubic meter or fraction thereof
C Water	Same test as for SC (D)	Same frequency as SC (D)
D Completed CTB	Field Density Test	For every layer of 150mm of compacted depth at least one group of three in-situ density test every 500 sq m or fraction thereof
Retaining Wall/Coping Wall/RC Curb/RC Ditch/Shear Key/Concrete Blocks/Lean Concrete		
A Portland Cement	Same test as for SC (A)	Same frequency as SC (A)
B Fine Aggregate	Same test as for SC (B)	Same frequency as SC (B)

PPA MEMORANDUM CIRCULAR
No. 02
Series of 2016
Attachment

Page 6 of 10

Materials/Items of Work	Required Tests	Minimum Incremental Frequency of Tests
C Coarse Aggregates	Same test as for SC (C)	Same frequency as SC (C)
D Water	Same test as for SC (D)	Same frequency as SC (D)
E Steel Bars	Same test as for SC (E)	Same frequency as SC (E)
F Admixture and Concrete Curing	Same test as for SC (G)	Same frequency as SC (G)
G Concrete	Same test as for SC (F)	Same frequency as SC (F)
Tie Rod		
A Steel	Same test as for SC (E)	One per batch
B Assembly	Performance Test (Tension)	One per batch
Tie Bars and Dowels	Same test as for SC (E)	For every 10,000 kg or fraction thereof per Tie bars and Dowels
Pipe Culverts and Storm Drains		
A Pipes	Test for Strength, Absorption and Physical	For every 50 pieces
B Mortar or Joint	Same Test as for SC (A,B and D) Alternative Test Same test as for SC (F) and Inspection Report	For every 25 pieces
Concrete Hollow Blocks		
A Portland Cement	Same test as for SC (A)	Same frequency as SC (A)
B Fine Aggregates	Same test as for SC (B)	Same frequency as SC (B)
C Water	Same test as for SC (D)	Same frequency as SC (C)
D Concrete	Same test as for SC (F)	Same frequency as SC (F)
E Completed CHB	Quality Test	One for every 500 pieces or fraction thereof
Construction Joints (CJ)		
A Angle Bars	Test for Physical and Mechanical Properties	One per batch
B Steel Bars	Same test as for SC (E)	One per batch
C Zinc (Hot Dip Galvanizing) Coatings	Physical Test for Appearance, Stripping, Weighing, Adherence and Adhesion Coating Thickness Magnetic Thickness Measurement	All units 1 set (3 specimen) for every 100,000 sq mm or fraction thereof

PPA MEMORANDUM CIRCULAR
No. 02
Series of 2016
Attachment

Page 7 of 10

Materials/Items of Work	Required Tests	Minimum Incremental Frequency of Tests
Sacked Concrete		
A Cement	Same test as for SC (A)	Same frequency as SC (A)
B Fine Aggregates	Same test as for SC (B)	Same frequency as SC (B)
C Coarse Aggregates	Same test as for SC (C)	Same frequency as SC (C)
D Water	Same test as for SC (D)	Same frequency as SC (D)
E Concrete	Same test as for SC (F)	Same frequency as SC (F)
F Sack (jute)	Physical Test	One for every 50 pieces
Rubble Concrete		
A Cement	Same test as for SC (A)	Same frequency as SC (A)
B Fine Aggregates	Same test as for SC (B)	Same frequency as SC (B)
C Coarse Aggregates	Same test as for SC (C)	Same frequency as SC (C)
D Water	Same test as for SC (D)	Same frequency as SC (D)
E Concrete	Same test as for SC (F)	Same frequency as SC (F)
F Rocks	Same test as for ROCKS	Same frequency as ROCKS
Earthworks		
A Sub-grade preparation	Grading Test Plasticity Test (LL, PL, PI) Laboratory Compaction Test Density Test	For every 1,500 cubic meter or fraction thereof For every layer of 150mm of compacted depth at least one group of three In-situ density test every 500 sq m or fraction thereof
B Structure Excavation	If excavated materials shall be used as Backfill Grading Test Plasticity Test (LL, PL, PI) Laboratory Compaction Test Density Test	For every 1,500 cubic meter or fraction thereof For every layer of 150mm of compacted depth at least one group of three In-situ density test every 500 sq m or fraction thereof

TAC

PPA MEMORANDUM CIRCULAR
No. 02
Series of 2016
Attachment

Page 8 of 10

Materials/Items of Work	Required Tests	Minimum Incremental Frequency of Tests
III Port Operations Building/Passenger Terminal Building/Transit Shed/Warehouse		
STRUCTURAL WORKS		
Refer to Structural Concrete (SC) and Piling Works (P)		
ARCHITECTURAL WORKS		
Ceramic – Filled Liquid Membrane / Water Proofing, Hydrophobic Poreblocking Ingredients with Superplasticizer	Physical Property, Mechanical and Chemical Property, Leak Test / Flood Test	One per shipment
Paint	Quality Test	One 4-L can for every 100 cans or fraction thereof
Ceramic Tile	Inspection and Evaluation Report from the Engineer	One per shipment
Stainless Steel	Inspection and Evaluation Report from the Engineer	One per shipment
Roofing Materials	Inspection and Evaluation Report from the Engineer	One per shipment
Ceiling Materials	Inspection and Evaluation Report from the Engineer	One per shipment
ELECTRICAL AND MECHANICAL WORKS		
Wires / Cables	Inspection and Evaluation Report from the Engineer Testing and Commissioning	One per shipment
Electrical Devices	Inspection and Evaluation Report from the Engineer Testing and Commissioning	One per shipment
Fire Alarm System	Inspection and Evaluation Report from the Engineer Testing and Commissioning	One per item
Wiring Devices	Inspection and Evaluation Report from the Engineer Testing and Commissioning	One per shipment

PPA MEMORANDUM CIRCULAR
No. 02
Series of 2016
Attachment

Page 9 of 10

Materials/Items of Work	Required Tests	Minimum Incremental Frequency of Tests
Protective Devices	Inspection and Evaluation Report from the Engineer Testing and Commissioning	One per shipment
Telephone System	Inspection and Evaluation Report from the Engineer Testing and Commissioning	One per item
CCTV System	Inspection and Evaluation Report from the Engineer Testing and Commissioning	One per item
CATV System	Inspection and Evaluation Report from the Engineer Testing and Commissioning	One per item
Background Music and Paging System	Inspection and Evaluation Report from the Engineer, Testing and Commissioning	One per item
Air Conditioning Units & Ventilation	Inspection and Evaluation Report from the Engineer Testing and Commissioning	One per item
Conduit Pipes	Inspection and Evaluation Report from the Engineer Testing and Commissioning	One per item
Lighting Fixtures	Inspection and Evaluation Report from the Engineer Testing and Commissioning	One per item
PLUMBING WORKS		
Pipes	Inspection and Evaluation Report from the Engineer Testing and Commissioning	One per item


PPA MEMORANDUM CIRCULAR
No. 02
Series of 2016
Attachment


Page 10 of 10

Materials/Items of Work	Required Tests	Minimum Incremental Frequency of Tests
Fixtures	Inspection and Evaluation Report from the Engineer Testing and Commissioning	One per item
Pipe Culverts	Compression Strength Inspection and Evaluation Report from the Engineer	For every size not more than 25 pipes cast in the field
IV Miscellaneous Materials Fencing A Barbed Wire, Cyclone Wire Mesh, Chain Link B Concrete Post	Physical Test (Dimensions and Coatings) Refer to Superstructure (SC)	One per Batch Refer to Superstructure (SC)
Lamp Post A Structural Steel B Zinc (Hot Dip Galvanizing) Coatings	Physical Test (Dimensions) Same test as for SC (E) Same test as for CJ (C)	All units One per batch
Drainage Steel Grating	Same test as for SC (E) Inspection Report	One (1) batch
Metal Pipe (Cast Iron Galvanized, etc.)	Physical Test (Dimensions and Coatings)	1 per delivery
Welding Works	Destructive and Non Destructive Test	One (1) per lot

- NOTES**
1. Testing of RDF shall be performed only by an independent Testing Laboratory duly accredited by BRS, DOST and PPA
 2. Testing of other materials shall be performed only by an independent Testing Laboratory duly accredited by BRS and PPA.
 3. All other issuances which are otherwise inconsistent herewith are hereby revoked or otherwise amended.

Approved


RAUL T. SANTOS
Officer-In-Charge,
Office of the General Manager



SECTION IX

CHECKLIST OF TECHNICAL AND FINANCIAL DOCUMENTS

Checklist of Technical and Financial Documents

I. TECHNICAL COMPONENT ENVELOPE

Class "A" Documents

Legal Documents

- ☐ (a) Valid PhilGEPS Registration Certificate (Platinum Membership) (all pages)

Technical Documents

- ☐ (b) Statement of the prospective bidder of all its ongoing government and private contracts, including contracts awarded but not yet started, if any, whether similar or not similar in nature and complexity to the contract to be bid; **and**
- ☐ (c) Statement of the bidder's Single Largest Completed Contract (SLCC) similar to the contract to be bid, except under conditions provided under the rules; **and**
- ☐ (d) Special PCAB License in case of Joint Ventures; **and** registration for the type and cost of the contract to be bid; **and**
- ☐ (e) Original copy of Bid Security. If in the form of a Surety Bond, submit also a certification issued by the Insurance Commission;
or
Original copy of Notarized Bid Securing Declaration; **and**
- ☐ (f) Project Requirements, which shall include the following:
 - ☐ a. Organizational chart for the contract to be bid;
 - ☐ b. List of contractor's key personnel (e.g., Project Manager, Project Engineers, Materials Engineers, and Foremen), to be assigned to the contract to be bid, with their complete qualification and experience data;
 - ☐ c. List of contractor's major equipment units, which are owned, leased, and/or under purchase agreements, supported by proof of ownership or certification of availability of equipment from the equipment lessor/vendor for the duration of the project, as the case may be; **and**
- ☐ (g) Original duly signed Omnibus Sworn Statement (OSS); **and** if applicable, Original Notarized Secretary's Certificate in case of a corporation, partnership, or cooperative; or Original Special Power of Attorney of all members of the joint venture giving full power and authority to its officer to sign the OSS and do acts to represent the Bidder.

Financial Documents

- ☐ (h) The prospective bidder's computation of Net Financial Contracting Capacity (NFCC).

Class "B" Documents

- ☐ (i) If applicable, duly signed joint venture agreement (JVA) in accordance with RA No. 4566 and its IRR in case the joint venture is already in existence;
or
duly notarized statements from all the potential joint venture partners stating that they will enter into and abide by the provisions of the JVA in the instance that the bid is successful.

II. FINANCIAL COMPONENT ENVELOPE

- ☐ (j) Original of duly signed and accomplished Financial Bid Form; and

Other documentary requirements under RA No. 9184

- ☐ (k) Original of duly signed Bid Prices in the Bill of Quantities; and
☐ (l) Duly accomplished Detailed Estimates Form, including a summary sheet indicating the unit prices of construction materials, labor rates, and equipment rentals used in coming up with the Bid; and
☐ (m) Cash Flow by Quarter.

SECTION X

BIDDING FORM

Bid Form for the Procurement of Infrastructure Projects

[shall be submitted with the Bid]

BID FORM

Date : _____
Project Identification No. : _____

To: **Philippine Ports Authority**
PPA Building, Bonifacio Drive,
South Harbor, Port Area, Manila

Having examined the Philippine Bidding Documents (PBDs) including the Supplemental or Bid Bulletin Numbers _____, the receipt of which is hereby duly acknowledged, we, the undersigned, declare that:

- a. We have no reservation to the PBDs, including the Supplemental or Bid Bulletins, for the Procurement Project: **Lamiao (Limay) Port Improvement Project, Port of Lamiao, Limay, Bataan**;
- b. We offer to execute the Works for this Contract in accordance with the PBDs;
- c. The total price of our Bid in words and figures, excluding any discounts offered below is: _____;
- d. The discounts offered and the methodology for their application are: _____;
- e. The total bid price includes the cost of all taxes, such as, but not limited to: *[specify the applicable taxes, e.g. (i) value added tax (VAT), (ii) income tax, (iii) local taxes, and (iv) other fiscal levies and duties]*, which are itemized herein and reflected in the detailed estimates,
- f. Our Bid shall be valid within the period stated in the PBDs, and it shall remain binding upon us at any time before the expiration of that period;
- g. If our Bid is accepted, we commit to obtain a Performance Security in the amount of _____ percent of the Contract Price for the due performance of the Contract, or a Performance Securing Declaration in lieu of the the allowable forms of Performance Security, subject to the terms and conditions of issued GPPB guidelines¹ for this purpose;
- h. We are not participating, as Bidders, in more than one Bid in this bidding process, other than alternative offers in accordance with the Bidding Documents;
- i. We understand that this Bid, together with your written acceptance thereof

¹ currently based on GPPB Resolution No. 09-2020

included in your notification of award, shall constitute a binding contract between us, until a formal Contract is prepared and executed; and

- j. We understand that you are not bound to accept the Lowest Calculated Bid or any other Bid that you may receive.
- k. We likewise certify/confirm that the undersigned, is the duly authorized representative of the bidder, and granted full power and authority to do, execute and perform any and all acts necessary to participate, submit the bid, and to sign and execute the ensuing contract for the **Lamiao (Limay) Port Improvement Project, Port of Lamiao, Limay, Bataan of the Philippine Ports Authority**.
- l. We acknowledge that failure to sign each and every page of this Bid Form, including the Bill of Quantities, shall be a ground for the rejection of our bid.

Name: _____

Legal Capacity: _____

Signature: _____

Duly authorized to sign the Bid for and behalf of: _____

Date: _____

STATEMENT OF THE BIDDER'S ALL ONGOING GOVERNMENT AND PRIVATE CONTRACTS, INCLUDING CONTRACTS AWARDED BUT NOT YET STARTED

I hereby declare that all ongoing contracts, including awarded contracts yet to be started coinciding with the contract to be bid are listed below:

Name of outstanding Contracts 1]	Owner's Name and Address	Scope of Work 2]	Contractor's Role and Percentage of Participation 3]	Total Contract Amount or Value 4]	Date of Contract and NOA 5]	Value of Outstanding Works 6]	Accomplishment (in percentage, %) 7]		Contract Duration 8]	
							Planned	Actual	Start of Project	Estimated Completion Date
A) Government Contracts i. On-going ii. Awarded but not yet started B) Private Contracts i. On-going ii. Awarded but not yet started										

NOTE:

- 1] As appearing in the contract executed by the parties.
- 2] With special reference to the Scope of Works of the Project as described/enumerated in the Contract.
- 3] Indicate the percentage of participation and whether as Sole Contractor, Sub-Contractor or Member in a Joint Venture / Consortium.
- 4] Indicate the FOREX used if Contract Value is expressed in a currency other than the Philippine Peso.
- 5] As appearing in the Contract and Notice of Award (NOA).
- 6] Amount or value of all outstanding or uncompleted portions of the projects under ongoing contracts, including awarded contracts yet to be started coinciding with the contract to be bid.
- 7] Percentage of Accomplishment as of the preceding month which should not be earlier than two (2) months from the date of bid submission.
- 8] As appearing in the Notice to Proceed and Contract.

This Statement shall be supported by:

- a) Notice of Award
- b) Notice to Proceed and Contract

Name of Firm

Name of Bidder/Authorized Representative
(Signatory's Legal Capacity)

Date

Revised: September 2021

STATEMENT OF THE BIDDER'S SINGLE LARGEST COMPLETED CONTRACT (SLCC) SIMILAR TO THE CONTRACT TO BE BID

Name of the completed Contract 1]	Owner's Name and Address	Scope of Work 2]	Contractor's Role and Percentage of Participation 3]	Total Contract Value At 4]			Date of Award 5]	Contract Duration 6]	
				Award	Completion	Escalated Value to Present Prices		Start	Completed

NOTE :

- 1] As appearing in the contract executed by the parties.
- 2] With special reference to the Scope of Works of the Project as described/enumerated in the Contract.
- 3] Indicate the percentage of participation and whether as Sole Contractor, Sub-Contractor or Member in a Joint Venture / Consortium.
- 4] Indicate the FOREX used if Contract Value is expressed in a currency other than the Philippine Peso. Attached the computation for the escalated contract value.
- 5] As appearing in the Notice of Award.
- 6] As appearing in the Notice to proceed and Certificate of Completion.

A. The bidder must have an experience of having completed a SLCC that is similar to the contract to be bid equivalent to at least fifty percent (50%) of the ABC, adjusted if necessary, by the Bidder to current prices using the PSA consumer price indices. A contract is considered to be "similar" to the contract to be bid if it has the same Major Categories of Work as stated in the Bid Data Sheet (BDS).

B. This Statement shall be supported by:

- a. Notice of Award, Notice to Proceed and Contract.
- b. Project Owner's Certificate of Final Acceptance issued by the owner and/or Constructors Performance Evaluation System (CPES) Final Rating, which must be at least Satisfactory. The said Certificate of Acceptance shall contain the following: 1) Name of project owner that issued the certificate,
- 2) Name of Contractor/ Constructor, 3) Name of Contract, and 4) Contract Duration.
- c. Recapitulation or Final Bill of Quantities.

Name of Firm

Name of Bidder/Authorized Representative
(Signatory's Legal Capacity)

Date

Revised: September 2021

**STATEMENT OF THE BIDDER'S EXPERIENCE ON MAJOR CATEGORIES OF WORK OF THE SLCC INCLUDING OTHER COMPLETED CONTRACTS
SIMILAR TO THE CONTRACT TO BE BID**

Major Categories of Work 1]	Unit of Measure 1]	Quantity 1]	SLCC similar to the contract to be bid 2]	Other completed contracts similar to the contract to be bid 2]		Unit of Measure 2]	Quantity 2]
				Name of the contract	Name of the contract		
1. Reinforced Concrete Works	cu.m.	63					
2. Rockworks (50 to 1,000 kg/pc.)	cu.m.	715					
3. Placing of Fill Materials	cu.m.	910					
4. Construction of Portland Cement Concrete Pavement	sq.m.	546					

NOTE:

1] As stated in the Bid Data Sheet.

2] As appearing in the Recapitulation and/ or Final Bill of Quantities.

This statement shall be supported by:

a. Notice of Award, Notice to Proceed and Contract.

b. Project Owner's Certificate of Final Acceptance issued by the owner and/ or Constructors Performance Evaluation System (CPES) Final Rating, of at least satisfactory.

The said Certificate of Acceptance shall contain the following: 1) Name of project owner that issued the certificate, 2) Name of Contractor/Constructor, 3) Name of Contract, and 4) Contract Duration.

c. Recapitulation and/ or Final Bill of Quantities.

Name of Firm

Name of Bidder/Authorized Representative
Signatory's Legal Capacity

Date

Revised: September 2021

FINANCIAL DATA

- A. The prospective bidder's audited Financial Statements, showing, among others, the prospective bidder's total and current assets and liabilities, stamped "RECEIVED" by the Bureau of Internal Revenue (BIR), or its duly accredited and authorized institutions, for the preceding calendar year which should not be earlier than two (2) years from the date of bid submission.

	Year
1. Total Assets	
2. Current Assets	
3. Total Liabilities	
4. Current Liabilities	
5. Net worth (1-3)	
6. Net Working Capital (2-4)	

- B. The computation of the bidders Net Financial Contracting Capacity (NFCC) must be at least equal to the ABC to be bid, as follows:

NFCC = [(Current assets minus current liabilities) (15)] minus the value of all outstanding or uncompleted portions of the projects under ongoing contracts, including awarded contracts yet to be started coinciding with the contract to be bid.

NFCC = _____

Attached herewith are certified true copies of the audited financial statements stamped received by the BIR or BIR authorized collecting agent for the latest/immediately preceding calendar year.

Name of Firm/Applicant

Authorized Signing Official

Date: _____

NOTES:

If Partnership or Joint Venture, each Partner or Member Firm of Joint venture shall submit separate financial statements.

STATEMENT OF THE BIDDER'S KEY PERSONNEL PLEDGED FOR THE CONTRACT TO BE BID

I hereby declare that the following key personnel are qualified and available for the duration of the contract to be bid:

Position of Key Personnel 1]	Name	No. of Key Personnel	Similar Experience in the Position (Years) 2]	Total Experience in the Position (Years)	Attachment(s)	Annex(es)
Project Manager					PRC License (CE Preferred) Complete Qualification and Experience Data Certificate of Commitment	Annex " " _
Project Engineer					PRC License (CE Preferred) Complete Qualification and Experience Data Certificate of Commitment	Annex " " _
Materials Engineer I					PRC License (CE Preferred) Submit Valid and Renewed DPWH Certificate of Accreditation Submit Accreditation Identification Card as Materials Engineer Complete Qualification and Experience Data Certificate of Commitment	Annex " " _
Construction Safety and Health Officer					Certificate of Safety and Health Construction Related Course Issued by DOLE Accredited Trainings Complete Qualification and Experience Data Certificate of Commitment	Annex " " _
Foreman					Complete Qualification and Experience Data Certificate of Commitment	Annex " " _
Other Position(s)					Complete Qualification and Experience Data Certificate of Commitment	Annex " " _

NOTE: 1] As stated in the Bid Data Sheet

2] The number of years of experience of the key personnel shall be as indicated in the qualification and experience data or curriculum vitae.

Minimum qualification requirements: The key personnel must have a work experience that is similar in nature and complexity to the contract to be bid.

Project Manager - Five (5) years
Project Engineer - Three (3) years
Foreman - Five (5) years
Construction Safety and Health Officer - One (1) year
Materials Engineer - One (1) year
Materials Engineer I - for projects costing up to 100M
Materials Engineer II - for projects costing more than 100M

Name of Firm

Name of Bidder/Authorized Representative
(Signatory's Legal Capacity)

Date

Revised: September 2021

STATEMENT OF THE BIDDER'S EQUIPMENT PLEDGED FOR THE CONTRACT TO BE BID

I hereby declare that the following equipment are in good operating condition and available for the duration of the contract to be bid:

DESCRIPTION (Type, Model, Make)	No. of Unit(s)	Capacity/ Output 1]	Owned, Leased, and/or under purchased agreement 2]	Proof of Ownership/ Leased/ Under Purchase Agreement (Mark as Annex "A.....Z") 3]	OTHER INFORMATION (As Applicable)				
					Manufacturer	Engine Serial No.	Chassis No./ Name of Vessel	Location	Status

NOTE:

- The unit of capacity of the pledged equipment shall be as indicated in the Proof of Ownership, i.e. GW (for crane barge), DWT (for deck barge and hopper barge), Ton (for crane, road roller and drop hammer), kg.-m/blow (for diesel hammer), cu.m. (for dump truck), hp (for tugboat, road grader, bulldozer and concrete vibrator), cfm (for compressor), gal (for water truck with pump), amp (for welding machine), bagger (for concrete mixer), if the capacity of the pledged equipment is not indicated in the Proof of Ownership/Leased Contract/Purchased Agreement, submit other proof of capacity such as specifications, brochures or other verifiable printouts indicating the model name, model number and other details of the equipment.
- Indicate if the pledged equipment are owned, leased or under purchase agreement.
- If the pledged equipment is owned, it should be in the name of the bidder. Submit proof of ownership, i.e. deed of sale, sales invoice, official receipt; For owned Water Truck, Dump Truck and Transit Mixer submit LTO Certificate of Registration and valid Official Receipt; For owned barge/tugboat, submit Marina Certificate of Ownership and valid Cargo Ship Safety Certificate.

If the pledged equipment is leased/under purchased agreement, submit certification of availability of equipment from the equipment lessor/vendor for the duration of the project, and duly Notarized copy of leased contract/purchased agreement.

If the pledged barge/tugboat is leased/under purchase agreement, submit certification of availability of barge/tugboat from the equipment lessor/vendor for the duration of the project, and duly Notarized copy of leased contract/purchased agreement together with a copy of the Marina Certificate of Ownership and valid Cargo Ship Safety Certificate.

The Minimum Major Equipment Requirements are listed in Section 8, Annex 3.

Name of Firm

Name of Bidder/Authorized Representative
(Signatory's Legal Capacity)

Date

Revised: September 2021

Omnibus Sworn Statement for Sole Proprietorship
[shall be submitted with the Bid]

REPUBLIC OF THE PHILIPPINES)
CITY/MUNICIPALITY OF _____) S.S.

AFFIDAVIT

I, _____, of legal age, [Civil Status], [Nationality], and residing at _____, after having been duly sworn in accordance with law, do hereby depose and state that:

1. I am the sole proprietor or authorized representative of _____ with office address at _____;
2. As the owner and sole proprietor, or authorized representative of _____, I have full power and authority to do, execute and perform any and all acts necessary to participate, submit the bid, and to sign and execute the ensuing contract for **Lamao (Limay) Port Improvement Project, Port of Lamao, Limay, Bataan**, as shown in the attached duly notarized Special Power of Attorney;
3. [Name of Bidder] is not "blacklisted" or barred from bidding by the Government of the Philippines or any of its agencies, offices, corporations, or Local Government Units, foreign government/foreign or international financing institution whose blacklisting rules have been recognized by the Government Procurement Policy Board, **by itself or by relation, membership, association, affiliation, or controlling interest with another blacklisted person or entity as defined and provided for in the Uniform Guidelines on Blacklisting;**
4. Each of the documents submitted in satisfaction of the bidding requirements is an authentic copy of the original, complete, and all statements and information provided therein are true and correct;
5. [Name of Bidder] is authorizing the Head of the Procuring Entity or its duly authorized representative(s) to verify all the documents submitted;
6. The owner or sole proprietor is not related to the Head of the Procuring Entity, members of the Bids and Awards Committee (BAC), the Technical Working Group, and the BAC Secretariat, the head of the Project Management Office or the end-user unit, and the project consultants by consanguinity or affinity up to the third civil degree;
7. [Name of Bidder] complies with existing labor laws and standards; and
8. [Name of Bidder] is aware of and has undertaken the responsibilities as a Bidder in compliance with the Philippine Bidding Documents, which includes:
 - a. Carefully examining all of the Bidding Documents;
 - b. Acknowledging all conditions, local or otherwise, affecting the implementation of the Contract;
 - c. Making an estimate of the facilities available and needed for the contract to be bid, if any; and
 - d. Inquiring or securing Supplemental/Bid Bulletin(s) issued for the [Name of the Project].

9. [Name of Bidder] did not give or pay directly or indirectly, any commission, amount, fee, or any form of consideration, pecuniary or otherwise, to any person or official, personnel or representative of the government in relation to any procurement project or activity.
10. In case advance payment was made or given, failure to perform or deliver any of the obligations and undertakings in the contract shall be sufficient grounds to constitute criminal liability for Swindling (Estafa) or the commission of fraud with unfaithfulness or abuse of confidence through misappropriating or converting any payment received by a person or entity under an obligation involving the duty to deliver certain goods or services, to the prejudice of the public and the government of the Philippines pursuant to Article 315 of Act No. 3815 s. 1930, as amended, or the Revised Penal Code.

IN WITNESS WHEREOF, I have hereunto set my hand this ___ day of ___, 20___ at _____, Philippines.

Name of Bidder/ Authorized Representative
(Signatory's Legal Capacity)
AFFIANT

[Jurat]
[Format shall be based on the latest Rules on Notarial Practice]

Omnibus Sworn Statement for Partnership or Cooperative
[shall be submitted with the Bid]

REPUBLIC OF THE PHILIPPINES)
CITY/MUNICIPALITY OF _____) S.S.

AFFIDAVIT

I, _____, of legal age, [Civil Status], [Nationality], and residing at _____, after having been duly sworn in accordance with law, do hereby depose and state that:

1. I am the duly authorized and designated representative of _____ with office address at _____;
2. I am granted full power and authority to do, execute and perform any and all acts necessary to participate, submit the bid, and to sign and execute the ensuing contract for **Lamao (Limay) Port Improvement Project, Port of Lamao, Limay, Bataan of the Philippine Ports Authority**, as shown in the attached [state title of attached document showing proof of authorization (e.g., duly notarized Secretary's Certificate, Board/Partnership Resolution, or Special Power of Attorney, whichever is applicable)];
3. [Name of Bidder] is not "blacklisted" or barred from bidding by the Government of the Philippines or any of its agencies, offices, corporations, or Local Government Units, foreign government/foreign or international financing institution whose blacklisting rules have been recognized by the Government Procurement Policy Board, by itself or by relation, membership, association, affiliation, or controlling interest with another blacklisted person or entity as defined and provided for in the Uniform Guidelines on Blacklisting;
4. Each of the documents submitted in satisfaction of the bidding requirements is an authentic copy of the original, complete, and all statements and information provided therein are true and correct;
5. [Name of Bidder] is authorizing the Head of the Procuring Entity or its duly authorized representative(s) to verify all the documents submitted;
6. None of the officers and members of [Name of Bidder] is related to the Head of the Procuring Entity, members of the Bids and Awards Committee (BAC), the Technical Working Group, and the BAC Secretariat, the head of the Project Management Office or the end-user unit, and the project consultants by consanguinity or affinity up to the third civil degree;
7. [Name of Bidder] complies with existing labor laws and standards; and
8. [Name of Bidder] is aware of and has undertaken the responsibilities as a Bidder in compliance with the Philippine Bidding Documents, which includes:
 - a. Carefully examining all of the Bidding Documents;
 - b. Acknowledging all conditions, local or otherwise, affecting the implementation of the Contract;
 - c. Making an estimate of the facilities available and needed for the contract to be bid, if any; and
 - d. Inquiring or securing Supplemental/Bid Bulletin(s) issued for the [Name of the Project].

9. [Name of Bidder] did not give or pay directly or indirectly, any commission, amount, fee, or any form of consideration, pecuniary or otherwise, to any person or official, personnel or representative of the government in relation to any procurement project or activity.
10. In case advance payment was made or given, failure to perform or deliver any of the obligations and undertakings in the contract shall be sufficient grounds to constitute criminal liability for Swindling (Estafa) or the commission of fraud with unfaithfulness or abuse of confidence through misappropriating or converting any payment received by a person or entity under an obligation involving the duty to deliver certain goods or services, to the prejudice of the public and the government of the Philippines pursuant to Article 315 of Act No. 3815 s. 1930, as amended, or the Revised Penal Code.

IN WITNESS WHEREOF, I have hereunto set my hand this ___ day of ___, 20___ at _____, Philippines.

Name of Bidder/ Authorized Representative
(Signatory's Legal Capacity)
AFFIANT

[Jurat]

[Format shall be based on the latest Rules on Notarial Practice]

Omnibus Sworn Statement for Corporation or Joint Venture*[shall be submitted with the Bid]*

REPUBLIC OF THE PHILIPPINES)
CITY/MUNICIPALITY OF _____) S.S.

AFFIDAVIT

I, _____, of legal age, [Civil Status], [Nationality], and residing at _____, after having been duly sworn in accordance with law, do hereby depose and state that:

1. I am the duly authorized and designated representative of _____ with office address at _____;
2. I am granted full power and authority to do, execute and perform any and all acts necessary to participate, submit the bid, and to sign and execute the ensuing contract for **Lamao (Limay) Port Improvement Project, Port of Lamao, Limay, Bataan**, as shown in the attached [state title of attached document showing proof of authorization (e.g., duly notarized Secretary's Certificate, Board/Partnership Resolution, or Special Power of Attorney, whichever is applicable)];
3. [Name of Bidder] is not "blacklisted" or barred from bidding by the Government of the Philippines or any of its agencies, offices, corporations, or Local Government Units, foreign government/foreign or international financing institution whose blacklisting rules have been recognized by the Government Procurement Policy Board, by itself or by relation, membership, association, affiliation, or controlling interest with another blacklisted person or entity as defined and provided for in the Uniform Guidelines on Blacklisting;
4. Each of the documents submitted in satisfaction of the bidding requirements is an authentic copy of the original, complete, and all statements and information provided therein are true and correct;
5. [Name of Bidder] is authorizing the Head of the Procuring Entity or its duly authorized representative(s) to verify all the documents submitted;
6. None of the officers, directors, and controlling stockholders of [Name of Bidder] is related to the Head of the Procuring Entity, members of the Bids and Awards Committee (BAC), the Technical Working Group, and the BAC Secretariat, the head of the Project Management Office or the end-user unit, and the project consultants by consanguinity or affinity up to the third civil degree;
7. [Name of Bidder] complies with existing labor laws and standards; and
8. [Name of Bidder] is aware of and has undertaken the responsibilities as a Bidder in compliance with the Philippine Bidding Documents, which includes:
 - a. Carefully examining all of the Bidding Documents;
 - b. Acknowledging all conditions, local or otherwise, affecting the implementation of the Contract;
 - c. Making an estimate of the facilities available and needed for the contract to be bid, if any; and
 - d. Inquiring or securing Supplemental/Bid Bulletin(s) issued for the [Name of the Project].
9. [Name of Bidder] did not give or pay directly or indirectly, any commission, amount, fee, or any form of consideration, pecuniary or otherwise, to any person or official, personnel or

representative of the government in relation to any procurement project or activity.

10. In case advance payment was made or given, failure to perform or deliver any of the obligations and undertakings in the contract shall be sufficient grounds to constitute criminal liability for Swindling (Estafa) or the commission of fraud with unfaithfulness or abuse of confidence through misappropriating or converting any payment received by a person or entity under an obligation involving the duty to deliver certain goods or services, to the prejudice of the public and the government of the Philippines pursuant to Article 315 of Act No. 3815 s. 1930, as amended, or the Revised Penal Code.

IN WITNESS WHEREOF, I have hereunto set my hand this __ day of __, 20__ at _____, Philippines.

Name of Bidder/ Authorized Representative
(Signatory's Legal Capacity)
AFFIANT

[Jurat]

[Format shall be based on the latest Rules on Notarial Practice]

Bid Securing Declaration Form
[shall be submitted with the Bid if bidder opts to provide this form of bid security]

REPUBLIC OF THE PHILIPPINES)
CITY OF _____) S.S.

BID SECURING DECLARATION
Project Identification No.: _____

To: Philippine Ports Authority
PPA Building, Bonifacio Drive,
South Harbor, Port Area, Manila

I/We, the undersigned, declare that:

1. I/We understand that, according to your conditions, bids must be supported by a Bid Security, which may be in the form of a Bid Securing Declaration.
2. I/We accept that: (a) I/we will be automatically disqualified from bidding for any procurement contract with any procuring entity for a period of two (2) years upon receipt of your Blacklisting Order; and, (b) I/we will pay the applicable fine provided under Section 6 of the Guidelines on the Use of Bid Securing Declaration, within fifteen (15) days from receipt of the written demand by the procuring entity for the commission of acts resulting to the enforcement of the bid securing declaration under Sections 23.1(b), 34.2, 40.1 and 69.1, except 69.1(f), of the IRR of RA No. 9184; without prejudice to other legal action the government may undertake.
3. I/We understand that this Bid Securing Declaration shall cease to be valid on the following circumstances:
 - a. Upon expiration of the bid validity period, or any extension thereof pursuant to your request;
 - b. I am/we are declared ineligible or post-disqualified upon receipt of your notice to such effect, and (i) I/we failed to timely file a request for reconsideration or (ii) I/we filed a waiver to avail of said right; and
 - c. I am/we are declared the bidder with the Lowest Calculated Responsive Bid, and I/we have furnished the performance security and signed the Contract.

IN WITNESS WHEREOF, I/We have hereunto set my/our hand/s this ____ day of [month] [year] at [place of execution].

Name of Bidder/ Authorized Representative
(Signatory's Legal Capacity)
AFFIANT

[Jurat]
[Format shall be based on the latest Rules on Notarial Practice]

CONSTRUCTION METHODOLOGY

Name of Project : _____
Project Description : _____
Location : _____

MINIMUM SCOPE OF CONSTRUCTION METHODOLOGY

A. WIDENING OF ROCK CAUSEWAY

1. Removal, chipping and disposal works
2. Supply & placing of gravel bedding
3. Supply & placing of 50 to 100 kg. rocks
4. Supply & placing of 1,000 kg. rocks
5. Supply & installation of geotextile fabric
6. Supply & placing of fill materials
7. Supply & placing of 3,500 psi concrete
8. Supply & installation of reinforcing steel bars
9. Supply & placing of aggregate base course
10. Construction of PCC Pavement
11. Construction of security fence
12. Supply & Installation of Port lighting and solar panel
13. Construction of Drainage system
14. Construction of Battery Storage
15. Construction of Guardhouse and Gate
16. Construction of Covered Walkway

NOTES:

The narrative construction method will guide and familiarize the contractor and the PPA on how the project shall be carried out in accordance with the highest standard of workmanship.

The construction method shall be consistent with the Bar Chart / S-Curve Schedule, Equipment Schedule and Manpower Schedule.

Name of Bidder/Authorized Representative
(Signatory's Legal Capacity)

Revised: September 2021

MANPOWER SCHEDULE

Name of Project : _____

Project Description : _____

Location : _____

MANPOWER (Minimum)	CONTRACT DURATION (_____ Calendar Days)							
	M O N T H L Y							
	1	2	3	4	5	6	7	8
Project Manager								
Project Engineer								
Materials Engineer I								
Construction Safety and Health Officer								
Foreman								
Specify other applicable positions, ie.:								
- Carpenter								
- Steelman								
- Mason								
- Electrician								
- Rigger								
- Others								

Name of Bidder/Authorized Representative
(Signatory's Legal Capacity)

Revised: September 2021

CASHFLOW BY QUARTER AND PAYMENT SCHEDULE

Name of Project: : _____

Project Description : _____

Location : _____

Project Duration (days or months)	Payment Schedule (Monthly, in Pesos)	Cash flow (Quarterly, in Pesos)
TOTAL		

NOTES

- The cash flow by quarter and payment schedule should be consistent with the Bar Chart and S-curb.
- Payment schedule shall not be more than once a month.

Name of Bidder/Authorized Representative
(Signatory's Legal Capacity)

Revised: September 2021

Contract Agreement Form for the Procurement of Infrastructure Projects (Revised)

[not required to be submitted with the Bid, but it shall be submitted within ten (10) days after receiving the Notice of Award]

CONTRACT AGREEMENT

THIS AGREEMENT, made this _____ day of _____, _____ between Philippine Ports Authority with principal office at PPA Building, Bonifacio Drive, South Harbor, Port Area, Manila (hereinafter called the "Entity") and [name and address of Contractor] (hereinafter called the "Contractor").

WHEREAS, the Entity is desirous that the Contractor execute [name and identification number of contract] (hereinafter called "the Works") and the Entity has accepted the Bid for [contract price in words and figures in specified currency] by the Contractor for the execution and completion of such Works and the remedying of any defects therein.

NOW THIS AGREEMENT WITNESSETH AS FOLLOWS:

1. In this Agreement, words and expressions shall have the same meanings as are respectively assigned to them in the Conditions of Contract hereinafter referred to.
2. The following documents as required by the 2016 revised Implementing Rules and Regulations of Republic Act No. 9184 shall be deemed to form and be read and construed as part of this Agreement, viz.:
 - a. Philippine Bidding Documents (PBDs);
 - i. Drawings/Plans;
 - ii. Specifications;
 - iii. Bill of Quantities;
 - iv. General and Special Conditions of Contract;
 - v. Supplemental or Bid Bulletins, if any;
 - b. Winning bidder's bid, including the Eligibility requirements, Technical and Financial Proposals, and all other documents or statements submitted;

Bid form, including all the documents/statements contained in the Bidder's bidding envelopes, as annexes, and all other documents submitted (e.g., Bidder's response to request for clarifications on the bid), including corrections to the bid, if any, resulting from the Procuring Entity's bid evaluation;
 - c. Performance Security;
 - d. Notice of Award of Contract and the Bidder's conforme thereto; and

- e. Other contract documents that may be required by existing laws and/or the Procuring Entity concerned in the PBDs. Winning bidder agrees that additional contract documents or information prescribed by the GPPB that are subsequently required for submission after the contract execution, such as the Notice to Proceed, Variation Orders, and Warranty Security, shall likewise form part of the Contract.
3. In consideration for the sum of [total contract price in words and figures] or such other sums as may be ascertained, [Named of the bidder] agrees to [state the object of the contract] in accordance with his/her/its Bid.
4. The Philippine Ports Authority agrees to pay the above-mentioned sum in accordance with the terms of the Bidding.

IN WITNESS whereof the parties thereto have caused this Agreement to be executed the day and year first before written.

JAY DANIEL R. SANTIAGO
General Manager

for:

Philippine Ports Authority

**Name of Bidder/ Authorized
Representative
(Signatory's Legal Capacity)**

for:

Contractor

Acknowledgment

[Format shall be based on the latest Rules on Notarial Practice]