

ASTM C 1751 Preformed Expansion Joint Fillers for Concrete Paving and Structural Construction.(Non-extruding and Resilient Bituminous Types).

ASTM D 1179 Fluoride Ion in Water

ASTM D 1190 Standard Specification for Concrete Joint Sealer, Hot-Applied Elastic Type

ASTM D 1751 Standard Specification for Preformed Expansion Joint Filler for Concrete Paving and Structural Construction (Non-extruding and Resilient Bituminous Types)

ASTM E 329 Standard Specification for Agencies Engaged in the Testing and/ or Inspection of Materials used in Construction

c. American Welding Society (AWS)

D 12 Welding Reinforcing Steel, Metal Inserts and Connections in Reinforced Concrete Construction.

d. Philippine National Standard (PNS)

PNS 49 Steel Bars for Concrete Reinforcement

e. DPWH Standard Specifications

e. All other standards hereinafter indicated.

f. The edition or the revised version of such codes and standards current at the date twenty eight (28) days prior to date of bid submission shall apply. During Contract execution, any changes in such codes and standards shall be applied after approval by the Owner.

SUBMITTALS

1. Test Reports and Certificates shall be furnished and approval received before delivery of certified or tested materials to the Project Sites.

a. Submit Test Reports for the following:

a.1 Concrete mixture proportions

Submit copies of test reports by independent test labs conforming to ASTM C 1077 showing that the mixture has been successfully tested to produce concrete with the properties specified and that mixture will be suitable for the job conditions. Test reports shall be submitted along with the concrete mixture proportions. Obtain approval before concrete placement. Fully describe the processes and methodology whereby mixture proportions were developed and tested and how proportions will be adjusted during progress of the work to achieve, as closely as possible, the designated levels of relevant properties.

a.2 Aggregates

Submit test results for aggregate quality in accordance with ASTM C 33. Where there is potential for alkali-silica reaction, provide results of tests conducted in accordance with ASTM C 227 or ASTM C 1260. Submit results of all tests during progress of the work in tabular and graphical form as noted above, describing the cumulative combined aggregate grading and the percent of the combined aggregate retained on each sieve.

a.3 Admixtures

Submit test results in accordance with ASTM C 494 and ASTM C 1017 for concrete admixtures, ASTM C 260 for air-entraining agent, and manufacturer's literature and test reports for corrosion inhibitor and anti-washout admixture. Submitted data shall be based upon tests performed within 6 months of submittal.

a.4 Cement

Submit test results in accordance with ASTM C 150 Portland cement. Submit current mill data.

a.5 Water

Submit test results in accordance with ASTM D 512 and ASTM D 516.

b. Submit Certificates for the following:

b.1 Curing concrete elements

Submit proposed materials and methods for curing concrete elements.

b.2 Form removal schedule

Submit proposed materials and methods for curing concrete elements.

b.3 Concrete placement and compaction

Submit technical literature for equipment and methods proposed for use in placing concrete. Include pumping or conveying equipment including type, size and material for pipe, valve characteristics, and the maximum length and height concrete will be pumped. No adjustments shall be made to the mixture design to facilitate pumping.

Submit technical literature for equipment and methods proposed for vibrating and compacting concrete. Submittal shall include technical literature describing the equipment including vibrator diameter, length, frequency, amplitude, centrifugal force, and manufacturer's description of the radius of influence under load. Where flat work is to be cast, provide similar information relative to the proposed compacting screed or other method to ensure dense placement.

b.4 Mixture designs

Provide a detailed report of materials and methods used, test results, and the field test strength (fcr) for marine concrete required to meet durability

requirements.

2. The Contractor shall submit shop drawings and erection drawings for formwork and scaffolding at least 14 days prior to commencing the work.

Each shop drawing and erection drawing shall bear the signature of a Contractor's qualified Engineer. Details of all proposed formwork to be prefabricated and formwork to produce special finishes shall be submitted to the Engineer for approval before any materials are ordered. If the Engineer so requires, samples of proposed formworks shall be constructed and concrete placed at the Contractor's expense so that the proposed methods and finished effect can be demonstrated.

The Contractor shall submit shop drawings showing reinforcing bar placing and bar lists for the Engineer's approval. Such shop drawings shall show also supplemental bars for forming, strengthening frames of bars of sufficient rigidity to withstand forces during placing concrete. If necessary, shaped steel may be added to improve rigidity of the frame of bar.

Such shop drawings shall clearly indicate bar sizes, spacing, location and quantities of reinforcement, mesh, chairs, spacers and other details to be as per ACI Manual of Standard Practice for Detailing Reinforced Concrete Structures.

Details shall be prepared for placement of reinforcement where special conditions occur, including most congested areas and connection between pre-cast concrete and concrete in-situ.

All shop drawings shall be reviewed by the Engineer within seven (7) days after receiving them. At least two (2) days prior to pouring concrete, the Contractor shall submit to the Engineer a pouring permit for his inspection and approval.

MATERIAL REQUIREMENTS

CEMENT

Unless otherwise specified in the Drawings, only one (1) brand of cement shall be used for any individual structure. In determining the approved mix, only Portland cement shall be used as the cementitious material.

1. Portland Cement: ASTM C 150

Type II (for general use, more especially when moderate Sulfate resistance is desired)

ADMIXTURE (IF NECESSARY)

Unless otherwise required by field conditions, admixture may be used subject to the expressed approval of the Engineer. The cost of which shall already be included in the unit cost bid of the Contractor for the concrete.

1. Air Entraining Admixture shall conform to ASTM C 260.
2. Admixture other than air entraining agent shall conform to ASTM C 494.
3. Admixture containing chloride ions, or other ions producing deleterious effect shall not be used.

AGGREGATES

1. Crushed Coarse Aggregate

Conforming to ASTM C 33 and having nominal sizes passing 38.0 mm to 19.0 mm, 19.0 mm to 9.5 mm to No. 4 sieve. The material shall be well graded between the limits indicated and individually stockpiled. It shall be the Contractor's responsibility to blend the materials to meet the gradation requirements for various types of concrete as specified herein.

Nominal sizes for combined gradation shall be as follows:

ASTM Sieves	Nominal Size of Coarse Aggregates			
	% by Weight Passing			
	40mm	25mm	19mm	10mm
50.0mm (2")	100	-	-	-
38.0mm (1 1/2")	95 - 100	100	-	-
31.8mm (1 1/4")	-	90 - 100	100	-
25.0mm (1")	-	-	90 - 100	-
19.0mm (3/4")	35 - 70	25 - 90	-	100
16.0mm (5/8")	-	-	20 - 55	85 - 100
9.5mm (3/8")	10 - 30	0 - 10	0 - 10	0 - 20
No. 4	0 - 5			

2. Fine Aggregate

ASTM C 33 except for gradation which has been revised to meet local conditions unless otherwise required by the Engineer, grading of fine aggregate shall be as follows:

ASTM Sieves	% by Weight Passing
9.5mm (3/8")	100
No.4	90 - 100
No. 8	80 - 100
No. 16	50 - 90
No. 30	25 - 60
No. 50	5 - 30
No. 100	0 - 10

- a. Grading of fine aggregates shall be reasonably uniform and fineness modulus thereof shall not vary more than 0.2 from that of the representative sample in which mix proportions of concrete are based.

- b. Due care shall be taken to prevent segregation.

WATER

The mixing water shall be clear and apparently clean. If it contains quantities or substances that discolor it or make it smell or taste unusual or objectionable, or cause suspicion, it shall not be used unless service records of concrete made with it (or other information) indicated that it is not injurious to the quality, shall be subject to the acceptance criteria as shown in Table 6.3 and Table 6.4 or as designated by the purchaser.

When wash water is permitted, the producer will provide satisfactory proof or data of non-detrimental effects if potentially reactive aggregates are to be used. Use of wash water will be discontinued if undesirable reactions with admixtures or aggregates occur.

Table 6.3 Acceptance Criteria for Questionable Water Supplies

Test	Limits
Compressive strength, min. % Control at 7 days	90
Time of Setting deviation from control	from 1:00 earlier to 1:30 later
Time of Setting (Gillmore Test) Initial Final Set	No marked change No marked change
Appearance	Clear
Color	Colorless
Odor	Odorless
Total Solids	500 parts/million max.
PH value	4.5 to 8.5

Table 6.4 Chemical Limitation for Wash Water

	Limits
Chemical Requirements, Minimum Concentration	
Chloride as $\text{Cl}^{(-)}$ expressed as a mass percent of cement when added to the $\text{Cl}^{(-)}$ in the other components of the concrete mixtures shall not exceed the following levels:	
1. Prestressed Concrete	0.06 percent
2. Conventionally reinforced concrete in a moist environment and exposed to chloride	0.10 percent
3. Conventionally reinforced concrete in a moist environment but not exposed to chloride	0.15 percent
4. Above ground building construction where the concrete will stay dry	No limit for corrosion
Sulfate as SO_4 , ppm ^A	3,000
Alkalies as $(\text{Na}_2\text{O} + 0.658 \text{ K}_2\text{O})$, ppm	600
Total Solids, ppm	50,000

Wash water reused as mixing water in concrete may exceed the listed concentrations of sulfate if it can be shown that the concentration calculated in the total mixing water, including mixing water on the aggregate and other sources, does not exceed that stated limits.

Water will be tested in accordance with, and shall meet the suggested requirements of AASHTO T 26.

Water known to be of potable quality may be used without test.

CURING MATERIALS

1. Impervious Sheet Materials

ASTM C 171 type, optional, except that polyethylene film, if used, shall be white opaque.

2. Burlap of commercial quality, non-staining type, consisting of 2 layers minimum.

3. Membrane Forming Curing Compound

ASTM C 309; submit evidence that product conforms to specifications.

JOINTING MATERIALS

1. Sealant

Sealant shall be multi-component, polyurethane base compound, gray in color, self-leveling for horizontal joints, 2 part polythremdyne, terpolymer compound, gray in color; non-sag for vertical joints.

Sealant shall be compatible with materials in contact and to perform satisfactorily under salt water and traffic conditions, and be capable of making joint watertight and allow movement 25% of the width of joint in any direction.

Sealant shall be guaranteed against leakage, cracking, crumbling, melting, shrinkage, running, loss of adhesion for a period of five years from the date of acceptance of work.

2. Joint backing shall be expanded extruded polyethylene, low density, oval in shape to fit the joints as indicated on the drawings and to be compatible with sealant.
3. Where required, primer shall be compatible with joint materials and installed in accordance with manufacturer's instructions.
4. Joint filler shall conform to ASTM D1751 (AASHTO M213) non-extruding, resilient bituminous type. Filler shall be furnished for each joint in single piece for depth and width required for joint, unless otherwise authorized by the Engineer. When more than one piece is authorized for a joint, abutting ends shall be fastened and hold securely to shape by stapling or other positive fastening.

EPOXY BONDING COMPOUND

ASTM C 881. Provide Type I for bonding hardened concrete to hardened concrete; Type II for bonding freshly mixed concrete to hardened concrete; and Type III as a binder in epoxy mortar or concrete, or for use in bonding skid-resistant materials to hardened concrete. Provide Class B if placement temperature is between 4 and 16°C; or Class C if placement temperature is above 16°C.

REINFORCEMENT

Steel reinforcement, other than Steel for Pre-stressing, used in Reinforced Concrete, shall conform to ASTM and PNS as follows:

ASTM Designation A615 - Deformed Billet Steel Bars for Concrete Reinforcement.
Minimum yield strength of 276 MPa (40,000 psi).

PNS 49 - Steel Bars for Concrete Reinforcement

TIE WIRE

Tie wire shall be plain, cold drawn annealed steel wire 1.6 mm diameter.

SAMPLES AND TESTING

1. Cement

Sampled either at the mill or at the site of work and tested by an independent commercial or government testing laboratory duly accredited by the Bureau of Research and Standards (BRS) of the DPWH, Department of Science and Technology (DOST) or the Department of Trade and Industry (DTI) at no additional cost to PPA. Certified copies of laboratory test reports shall be furnished for each lot of cement and shall include all test data, results, and certificates that the sampling and testing procedures are in conformance with the Specifications. No cement shall be used until notice has been given by the Engineer that the test results are satisfactory. Cement that has been stored, other than in bins at the mills, for more than 3 months after delivery to the Site shall be re-tested before use. Cement delivered at the Site and later found after test to be unsuitable shall not be incorporated into the permanent works.

2. Aggregates: Tested as prescribed in ASTM C 33

At least 28 days prior to commencing the work, the Contractor shall inform the Engineer of the proposed source of aggregates and provide access for sampling.

Gradation tests will be made on each sample without delay. All other aggregates tests required by these Specifications shall be made on the initial source samples, and shall be repeated whenever there is a change of source. The tests shall include an analysis of each grade of material and an analysis of the combined material representing the aggregate part of the mix.

3. Reinforcement

Certified copies of mill certificates shall accompany deliveries of steel bar reinforcement. If requested by the Engineer additional testing of the materials shall be made at the Contractor's expense.

4. Concrete Tests

For test purposes, provide 1 set of three (3) concrete cylinder samples taken from each day's pouring and to represent not more than 75 cu.m. of concrete class or fraction thereof of concrete placed. Samples shall be secured in conformance with ASTM C 172. Tests specimens shall be made, cured, and packed for shipment in accordance with ASTM C 31. Cylinders will be tested by and at the expense of the Contractor in accordance with ASTM C 39. Test specimens will be evaluated separately by the Engineer, for meeting strength level requirements for each with concrete quality of ACI 318. When samples fail to conform to the requirements for strengths, the Engineer shall have the right to order a change in the proportions of the concrete mix for the remaining portions of the work at no additional cost to the Authority.

5. Test of Hardened Concrete in or Removed from the Structure

When the results of the strength tests of the concrete specimens indicates the concrete as placed does not meet the Specification requirements or where there are other evidences that the quality of concrete is below the specification requirement in the opinion of the Engineer, tests on cores of in-place concrete shall be made in conformance with ASTM C 42.

Core specimens shall be obtained by the Contractor and shall be tested. Any deficiency shall be corrected or if the Contractor elects, he may submit a proposal for approval before the load test is made. If the proposal is approved, the load test shall be made by the Contractor and the test results evaluated by the Engineer in conformance with Chapter 20 of ACI 318. The cost of the load tests shall be borne by the Contractor. If any concrete shows evidence of failure during the load test, or fails the load test as evaluated, the deficiency be corrected in a manner approved by the Engineer at no additional cost to the Authority.

6. Chemical Admixtures/Additives

The admixtures/additives if approved shall conformed to ASTM C 494 and ASTM C 1017. The testing shall be conducted with cement and aggregate proposed for the Project. The admixtures/additives shall be tested and those that have been in storage at the Project Site for longer than six (6) months shall not be used until proven by retest to be satisfactory.

Samples of any admixtures/additives proposed by the Contractor shall be submitted for testing at least 56 days in advance of use, which shall require approval of the Engineer. Testing of admixtures/additives proposed by the Contractor including test mixing and cylinder

test shall be at the Contractor's expense.

7. Jointing Materials and Curing Compound Samples

At least 28 days prior to commencing the work, the Contractor shall submit to the Engineer for his approval samples of the following materials proposed for use together with manufacturer's certificate.

- a. 10 kg of joint sealant
- b. 1m length of joint filler
- c. 5 li. of curing compound
- d. 1m length of joint backing

The Engineer shall deliver to the Contractor his assessment on the materials within seven (7) days after receiving them.

EXECUTION

DELIVERY, STORAGE AND HANDLING OF MATERIALS

1. Cement

Do not deliver concrete until vapor barrier, forms, reinforcement, embedded items, and chamfer strips are in place and ready for concrete placement. ACI 301 and ASTM A 934 for job site storage of materials. Protect materials from contaminants such as grease, oil, and dirt. Ensure materials can be accurately identified after bundles are broken and tags removed.

Immediately upon receipt at the Site, the cement shall be stored separately in a dry weathertight, properly ventilated structures with adequate provisions for prevention of absorption of moisture. Storage accommodations for concrete materials shall be subject to approval and shall afford easy access for inspection and identification of each shipment in accordance with test reports.

Cement shall be delivered to the Site in bulk or in sound and properly sealed bags and while being loaded or unloaded and during transit to the concrete mixers whether conveyed in vehicles or in mechanical means, cement shall be protected from weather by effective coverings. Efficient screens shall be supplied and erected during heavy winds.

If the cement is delivered in bulk, the Contractor shall provide, at his own cost, approved silos of adequate size and numbers to store sufficient cement to ensure continuity of work and the cement shall be placed in these silos immediately after it has been delivered to the Site. Approved precautions shall be taken into consideration during unloading to ensure that the resulting dust does not constitute a nuisance.

If the cement is delivered in bags, the Contractor shall provide, at his own cost, perfectly waterproofed and well ventilated sheds having a floor of wood or concrete raised at least 0.5m above the ground. The sheds shall be large enough to store sufficient cement to ensure continuity of the work and each consignment shall be stacked separately therein to permit easy access for inspection, testing and approval. Upon delivery, the cement shall at once be placed in these sheds and shall be used in the order in which it has been delivered.

Cement bags should not be stacked more than 13 bags high. All cement shall be used within two months of the date of manufacture. If delivery conditions render this impossible, the Engineer may permit cement to be used up to three (3) month after manufacturing, subject to such conditions including addition of extra cement as he shall stipulate.

2. Aggregate

All fine and coarse aggregate for concrete shall be stored on close fitting, steel or concrete stages design with drainage slopes or in bins of substantial construction in such a manner as to prevent segregation of sizes and to avoid the inclusion of dirt and other foreign materials in the concrete. All such bins shall be emptied and cleaned at intervals of every six (6) months or as required by the Engineer. Each size of aggregate shall be stored separately unless otherwise approved by the Engineer.

Stockpiles of coarse aggregate shall be built in horizontal layers not exceeding 1.2 m in depth to minimize segregation.

FORMWORK

1. Forms

Designed, constructed, and maintained so as to insure that after removal of forms the finished concrete members will have true surfaces free of offset, waviness or bulges and will conform accurately to the indicated shapes, dimensions, lines, elevations and positions. Form surfaces that will be in contact with concrete shall be thoroughly cleaned before each use.

2. Design

Studs and wales shall be spaced to prevent deflection of form material. Forms and joints shall be sufficiently tight to prevent leakage of grout and cement paste during placing of concrete. Juncture of formwork panels shall occur at vertical control joints, and construction joints. Forms placed on successive units for continuous surfaces shall be fitted in accurate alignment to assure smooth completed surfaces free from irregularities and signs of discontinuity. Temporary opening shall be arranged to wall and where otherwise required to facilitate cleaning and inspection. Forms shall be readily removable without impact, shock, or damage to the concrete.

3. Form Ties

Factory fabricated, adjustable to permit tightening of the forms, removable or snap-off metal of design that will not allow form deflection and will not spall concrete upon removal. Bolts and rods that are to be completely withdrawn shall be coated with a non-staining bond breaker. Ties shall be of the type which provide watertight concrete.

4. Chamfering

External corners that will be exposed shall be chamfered, beveled, or rounded by mouldings placed in the forms or as indicated in the drawings.

5. Coatings

Forms for exposed surfaces shall be coated with form oil or form-release agent before reinforcement is placed. The coating shall be a commercial formulation of satisfactory and proven performance that will not bond with, stain, or adversely affect concrete surfaces, and shall not impair subsequent treatment of concrete surfaces depending upon bond or adhesion nor impede the wetting of surfaces to be cured with water or curing compounds. The coating shall be used as recommended in the manufacturer's printed or written instructions. Forms for unexposed surfaces may be wet with water in lieu of coating immediately before

placing of concrete. Surplus coating on form surfaces and coating on reinforcement steel and construction joints shall be removed before placing concrete.

6. Removal of Forms shall be done in a manner as to prevent injury to the concrete and to insure complete safety of the structure after the following conditions have been met. Where the structure as a whole is supported on shores, forms for beam and girder sides, and similar vertical structural members may be removed before expiration of curing period. Care shall be taken to avoid spalling the concrete surface or damaging concrete edges. Wood forms shall be completely removed.

Minimum stripping and striking time shall be as follows unless otherwise approved by the Engineer.

Vertical sides of beams, walls, and columns, lift not 12 hours exceeding 1.2 m

Vertical sides of beams and walls, lift exceeding 1.2 m 36 hours Softlifts of main slabs and beams (props left under) 5 days

Removal of props from beams and mains slabs and other work 10 days

7. Control Test

If the Contractor proposes to remove forms earlier than the period stated above, he shall be required to submit the results of control tests showing evidence that concrete has attained sufficient strength to permit removal of supporting forms. Cylinders required for control tests shall be provided in addition to those otherwise required by this Specification. Test specimens shall be removed from molds at the end of 24 hours and stored in the structure as near the points as practicable, the same protection from the elements during curing as is given to those portions of the structure which they represent, and shall not be removed from the structure for transmittal to the laboratory prior to expiration of three fourths of the proposed period before removal of forms. Cylinders will be tested by and at the expense of the Contractor. Supporting forms or shoring shall not be removed until control test specimens have attained strength of at least 160 kg/sq cm. The newly unsupported portions of the structure shall not be subjected to heavy construction or material loading.

REINFORCEMENT

1. Reinforcement

Fabricated to shapes and dimensions shown and shall be placed where indicated. Reinforcement shall be free of loose or flaky rust and mill scale, or coating, and any other substance that would reduce or destroy the bond. Reinforcing steel reduced in section shall not be used. After any substantial delay in the work, previously placed reinforcing steel for future bonding shall be inspected and cleaned. Reinforcing steel shall not be bent or straightened in a manner injurious to the steel or concrete. Bars with kinks or bends not shown in the drawings shall not be placed. The use of heat to bend or straighten reinforcing steel shall not be permitted. Bars shall be moved as necessary to avoid interference with other reinforcing steel, conduits, or embedded items. If bars are moved more than one bar diameter, the resulting arrangement of bars including additional bars necessary to meet structural requirements shall be approved before concrete is placed. In slabs, beams and girders, reinforcing steel shall not be spliced at points of maximum stress unless otherwise indicated. Unless otherwise shown in the drawings, laps or splices shall be 40 times the reinforcing bar diameter.

2. The nominal dimensions and unit weights of bars shall be in accordance with the following table:

Nominal Diameter (mm)	Nominal Perimeter (mm)	Nominal Sectional Area (sq. mm)	Unit Weight (kg/m)
10	31.4	78.54	0.616
12	37.7	113.10	0.888
16	50.3	201.10	1.579
20	62.8	314.20	2.466
25	78.5	490.90	3.854
28	88.0	615.70	4.833
32	100.5	804.20	6.313
36	113.1	1,017.60	7.991
40	125.7	1,256.60	9.864
50	157.1	1,963.50	15.413

3. Welding of reinforcing bars shall only be permitted where shown; all welding shown shall be performed in accordance with AWS D 12.1.
4. Exposed reinforcement bars, dowels and plates intended for bonding with future extensions shall be protected from corrosion.
5. Supports shall be provided in conformance with ACI 315 and ACI 318, unless otherwise indicated or specified.
6. Concrete Protection for Reinforcement
- The minimum concrete cover of reinforcement shall be as shown below unless otherwise indicated in the drawings.
 - Tolerance for Concrete Cover of Reinforcing Steel other than Tendons.

Minimum Cover

7.5cm or more (marine structures and concrete cast against and permanently exposed to earth)

DESIGN STRENGTH OF CONCRETE

Concrete for structural parts or members such as beams, slabs, curtain wall, pile caps and fender/mooring blocks shall develop a minimum 28-day compressive cylinder strength of 24 MPa (3,500 psi) as indicated in the drawings. While for pre-stressed concrete piles a compressive strength of 35 MPa (5,000psi).

TRIAL BATCH FOR CONCRETE

Thirty (30) calendar days before the start of concreting works, the Contractor shall submit design mixes and the corresponding test result made on sample thereof. Sampling and testing shall be in

accordance with the ASTM Standard procedures for sampling and testing for the particular design strength(s) required.

The particulars of the mix such as the slump and the proportionate weights of cement, saturated surface dry aggregates and water used shall be stated.

The design mix for concrete to be used shall be submitted together with at least three (3) standard cylinder samples for approval at least one (1) month prior to the start of each concreting schedule. Such samples shall be prepared in the presence of the Engineer.

Standard laboratory strength tests for the 7, 14 and 28 days periods shall be taken to all concrete samples in addition to routine field tests, at cost to the Contractor. Only design mixes represented by test proving the required strength for 7, 14 and 28 days tests shall be allowed.

The cost of sampling, handling and transporting samples from jobsite to the laboratory and the cost of subsequent tests made until the desired mix is attained shall be for the account of the Contractor.

Slump Test shall be made in conformance with ASTM C143, and unless otherwise specified by the Engineer, slump shall be within the following limits:

Structural Element	Slump for Vibrated Concrete	
	Minimum	Maximum
Pavement Concrete	25mm	50mm
Pre-cast Concrete	50mm	70mm
Lean Concrete	100mm	200mm
Sacked Concrete	25mm	50mm
All other Concrete	50mm	90mm

Sampling : Provide suitable facilities and labor for obtaining representative samples of concrete for the Contractor's quality control and the Engineer's quality assurance testing. All necessary platforms, tools and equipment for obtaining samples shall be furnished by the Contractor.

MIXING CONCRETE

1. GENERAL

- a. Concrete shall be thoroughly mixed in a mixer of an approved size and type that will insure a uniform distribution of the materials throughout the mass.
- b. All concrete shall be mixed in mechanically operated mixers. Mixing plant and equipment for transporting and placing concrete shall be arranged with an ample auxiliary installation to provide a minimum supply of concrete in case of breakdown of machinery or in case the normal supply of concrete is disrupted. The auxiliary supply of concrete shall be sufficient to complete the casting of a section up to a construction joint that will meet the approval of the Engineer.
- c. Equipment having components made of aluminum or magnesium alloys, which would be in contact with plastic concrete during mixing, transporting or pumping of

Portland cement concrete, shall not be used.

- d. Concrete mixers shall be equipped with adequate water storage and a device for accurately measuring and automatically controlling the amount of water used.
- e. Materials shall be measured by weighing. The apparatus provided for weighing the aggregates and cement shall be suitably designed and constructed for this purpose. The accuracy of all weighing devices except that for water shall be such that successive quantities can be measured to within one percent of the desired amounts. The water measuring device shall be accurate to plus or minus 0.5 percent. All measuring devices shall be subject to the approval of the Engineer. Scales and measuring devices shall be tested at the expense of the Contractor as frequently as the Engineer may deem necessary to insure their accuracy.
- f. Weighing equipment shall be insulated against vibration or movement of other operating equipment in the plant. When the entire plant is running, the scale reading at cut-off shall not vary from the weight designated by the Engineer by more than one percent for cement, 1-½ percent for any size of aggregate, or one percent for the total aggregate in any batch.
- g. Manual mixing of concrete shall not be permitted unless approved by the Engineer.

2. MIXING CONCRETE AT SITE

- a. Concrete mixers may be of the revolving drum or the revolving blade type and the mixing drum or blades shall be operated uniformly at the mixing speed recommended by the manufacturer.

The pick-up and throw-over blades of mixers shall be restored or replaced when any part or section is worn 20 mm or more below the original height of the manufacturer's design. Mixers and agitators which have an accumulation of hard concrete or mortar shall not be used.

- b. When bulk cement is used and the volume of the batch is 0.5 m³ or more, the scale and weigh hopper for Portland cement shall be separate and distinct from the aggregate hopper or hoppers.

The discharge mechanism of the bulk cement weigh hopper shall be interlocked against opening before the full amount of cement is in the hopper. The discharging mechanism shall be interlocked against opening when the amount of cement in the hopper is underweight by more than one percent or overweight by more than 3 percent of the amount specified.

- c. When the aggregates contain more water than the quantity necessary to produce a saturated surface dry condition, representative samples shall be taken and the moisture content determined for each kind of aggregate.
- d. The batch shall be so charged into the mixer that some water enter in advance of cement and aggregates. All water shall be in the drum by the end of the first quarter of the specified mixing time.
- e. Cement shall be batched and charged into the mixer by such means that it will not result in loss of cement due to the effect of wind, or in accumulation of cement on surfaces of conveyors or hoppers, or in other conditions which reduce or vary the required quantity of cement in the concrete mixture.

- f. Where required, synthetic fibrous reinforcement shall be added directly to the concrete mixer after placing the sufficient amount of mixing water, cement and aggregates.
- g. The entire contents of a batch mixer shall be removed from the drum before materials for a succeeding batch are placed therein. The materials composing a batch except water shall be deposited simultaneously into the mixer.
- h. All concrete shall be mixed for a period of not less than 3 minutes after all materials, including water, are in the mixer. During the period of mixing, the mixer shall operate at the speed for which it has been designed.
- i. Mixers shall be operated with an automatic timing device that can be locked by the Engineer. The time device and discharge mechanism shall be so interlocked that during normal operation no part of the batch will be discharged until the specified mixing time has elapsed.
- j. The first batch of concrete materials placed in the mixer shall contain a sufficient excess of cement, sand, and water to coat the inside of the drum without reducing the required mortar content of the mix. When mixing is to cease for a period of one hour or more, the mixer shall be thoroughly cleaned.
- k. In case of rubble concrete, proper mixture and placing of concrete and stones/rocks shall be in accordance to the approved plan. Methodology of work shall be approved by the Engineer.

3. MIXING CONCRETE IN TRUCKS

- a. Truck mixers, unless otherwise authorized by the Engineer, shall be of the revolving drum type, watertight, and so constructed that the concrete can be mixed to insure a uniform distribution of materials throughout the mass. All solid materials for the concrete shall be accurately measured and charged into the drum at the proportioning plant. Except as subsequently provided, the truck mixer shall be equipped with a device by which the quantity of water added can be readily verified. The mixing water may be added directly to the batch, in which case a tank is not required. Truck mixers may be required to be provided with a means by which the mixing time can be readily verified by the Engineer.
- b. The maximum size of batch in truck mixers shall not exceed the minimum rated capacity of the mixer as stated by the manufacturer and stamped in metal on the mixer. Truck mixing shall, unless otherwise directed, be continued for not less than 100 revolutions after all ingredients, including water, are in the drum. The mixing speed shall not be less than 4 rpm, nor more than 6 rpm.
- c. Mixing shall begin within 30 minutes after the cement has been added either to the water or aggregate, but when cement is charged into a mixer drum containing water or surface-wet aggregate and when the temperature is above 32 °C, this limit shall be reduced to 15 minutes. The limitation in time between the introduction of the cement to the aggregate and the beginning of the mixing may be waived when, in the judgment of the Engineer, the aggregate is sufficiently free from moisture, so that there will be no harmful effects on the cement.
- d. When a truck mixer is used for transportation, the mixing time in stationary mixer may be reduced to 30 seconds and the mixing completed in a truck mixer. The mixing time in truck mixer shall be as specified for truck mixing.

JOINTS

1. No reinforcement, corner protection angles or other fixed metal items shall be run continuously through joints containing expansion-joint filler, through crack-control joints in slabs on grade and vertical surfaces.

2. **Prefomed Expansion Joint Filler**

- a. **Joints with Joint Sealant**

At expansion joints in concrete slabs to be exposed, and at other joints indicated to receive joint sealant, prefomed expansion-joint filler strips shall be installed at the proper level below the elevation with a slightly tapered, dressed-and-oiled wood strip temporarily secured to the top thereof to form a groove. When surface dry, the groove shall be cleaned of foreign matter, loose particles, and concrete protrusions, then filled flush approximately with joint sealant so as to be slightly concave after drying.

- b. **Finish of concrete at joints**

Edges of exposed concrete slabs along expansion joints shall be neatly finished with a slightly rounded edging tool.

- c. **Construction Joints**

Unless otherwise specified herein, all construction joints shall be subject to approval of the Engineer. Concrete shall be placed continuously so that the unit will be monolithic in construction. Fresh concrete may be placed against adjoining units, provided the set concrete is sufficiently hard not to be injured thereby. Joints not indicated shall be made and located in a manner not to impair strength and appearance of the structure. Placement of concrete shall be at such rate that the surface of concrete not carried to joint levels will not have attained initial set before additional concrete is placed thereon. Lifts shall terminate at such levels as are indicated or as to conform to structural requirements as directed. If horizontal construction joints are required, a strip of 25mm square-edged lumber, beveled to facilitate removal shall be tacked to the inside of the forms at the construction joint. Concrete shall be placed to a point 25mm above the underside of the strip. The strip shall be removed one hour after the concrete has been placed. Any irregularities in the joint line shall be leveled off with a wood float, and all laitance removed. Prior to placing additional concrete, horizontal construction joints shall be prepared.

Construction Joint which is not indicated in the Drawings shall be located as to least affect the strength of the structure. Such locations will be pointed out by the Engineer.

PREPARATION FOR PLACING

Hardened concrete, debris and foreign materials shall be removed from the interior of forms and from inner surfaces of mixing and conveying equipment. Reinforcement shall be secured in position, and shall be inspected, and approved before placing concrete. Runways shall be provided for wheeled concrete-handling equipment. Such equipment shall not be wheeled over reinforcement nor shall runways be supported on reinforcement.

Notice of any concreting operations shall be served to the Engineer at least three (3) days ahead of each schedule.

PLACING CONCRETE

1. Handling Concrete

Concrete shall be handled from mixers and transported to place for final deposit in a continuous manner, as rapidly as practicable, and without segregation or loss of ingredients until the approved unit of work is completed. Placing will not be permitted when the sun, heat, wind or limitations of facilities furnished by the Contractor prevent proper finishing and curing of the concrete. Concrete shall be placed in the forms, as close as possible in final position, in uniform approximately horizontal layers not over 40cm deep. Forms splashed with concrete and reinforcement splashed with concrete or form coating shall be cleaned in advance of placing subsequent lifts. Concrete shall not be allowed to drop freely more than 1.5m in unexposed work nor more than 1.0 m in exposed work; where greater drops are required, tremie or other approved means shall be employed.

2. Time Interval between Mixing and Placing

Concrete mixed in stationary mixers and transported by non-agitating equipment shall be placed in the forms within 30 minutes from the time ingredients are charged into the mixing drum. Concrete transported in truck mixers or truck agitators shall be delivered to the site of work, discharged in the forms within 45 minutes from the time ingredients are discharged into the mixing drum. Concrete shall be placed in the forms within 15 minutes after discharged from the mixer at the jobsite.

3. Hot Weather Requirements

The temperature of concrete during the period of mixing while in transport and/or during placing shall not be permitted to rise above 36 °C. Any batch of concrete which had reached a temperature greater than 36 °C at any time in the aforesaid period shall not be placed but shall be rejected, and shall not thereafter be used in any part of the permanent works.

a. Control Procedures

Provide water cooler facilities and procedures to control or reduce the temperature of cement, aggregates and mixing handling equipment to such temperature that, at all times during mixing, transporting, handling and placing, the temperature of the concrete shall not be greater than 36 °C.

b. Cold Joints and Shrinkage

Where cold joints tend to form or where surfaces set and dry too rapidly or plastic shrinkage cracks tend to appear, concrete shall be kept moist by fog sprays, or other approved means, applied shortly after placement, and before finishing.

c. Supplementary Precautions

When the aforementioned precautions are not sufficient to satisfy the requirements herein above, they shall be supplemented by restricting work during evening or night. Procedure shall conform to American Concrete Institute Standard ACI 305.

4. Conveying Concrete by Chute, Conveyor or Pump

Concrete may be conveyed by chute, conveyor, or pump if approved in writing. In requesting approval, the Contractor shall submit his entire plan of operation from the time of discharge of concrete from the mixer to final placement in the forms, and the steps to be taken to prevent the formation of cold joints in case the transporting of concrete by chute, conveyor or pump is disrupted. Conveyors and pumps shall be capable of expeditiously placing concrete at the rate most advantageous to good workmanship. Approval will not be given for chutes or conveyors requiring changes in the concrete materials or design mix for efficient operation.

a. Chutes and Conveyors

Chutes shall be of steel or steel lined wood, rounded in cross section rigid in construction, and protected from overflow. Conveyors shall be designed and operated and chute sections shall be set, to assure a uniform flow of concrete from mixer to final place of deposit without segregation of ingredients, loss of mortar, or change in slump. The discharged portion of each chute or conveyor shall be provided with a device to prevent segregation. The chute and conveyor shall be thoroughly cleaned before and after each run. Waste material and flushing water shall be discharged outside the forms.

- b. Pumps shall be operated and maintained so that a continuous stream of concrete is delivered into the forms without air pockets, segregation or changes in slump. When pumping is completed, concrete remaining in the pipeline shall be ejected and wasted without contamination of concrete already placed. After each operation, equipment shall be thoroughly cleaned and the flushing water shall be splashed outside the forms.

5. Wall and Abutments

No load shall be placed upon finished walls, foundations or abutments until authorized by the Engineer. Minimum time before loading shall be 7 days.

6. Concrete Placing on Wharf

When placing concrete on wharf decks, the Contractor shall:

Ensure that rate of placing is sufficient to complete proposed placing, finishing and curing operations within the scheduled time; that experienced finishing machine operators and concrete finishers are provided to finish the deck; that curing equipment and finishing tools and equipment are at the site of work and in satisfactory condition for use.

Immediately prior to placing, the Contractor shall place scaffolding and wedges and make necessary adjustments. Care shall be taken to ensure that settlement and deflection due to added weight of concrete will be minimal. The Contractor shall provide suitable means to readily permit measurement of settlement deflection as it occurs.

Should any event occur which, in opinion of the Engineer, would prevent the concrete conforming to specified requirements, the Contractor shall discontinue placing of concrete until corrective measures are provided satisfactory to the Engineer. If satisfactory measures are not provided prior to initial set of concrete in affected areas, the Contractor shall discontinue placing concrete and install a bulkhead at a location determined by the Engineer. Concrete in place beyond bulkheads shall be removed. The Contractor shall limit the size of casting to that which can be

finished before beginning of initial set.

COMPACTION

1. Immediately after placing, each layer of concrete shall be completed by internal concrete vibrators supplemented by hand-spading, rodding, and tamping. Tapping or other external vibration of forms will not be permitted unless specifically approved by the Engineer. Vibrators shall not be used to transport concrete inside the forms. Internal vibrators submerged in concrete shall maintain a speed of not less than 7,000 impulses per minute. The vibrating equipment shall at all times be adequate in number of units and power to properly consolidate all concrete.
2. Spare units shall be on hand as necessary to insure such adequacy. The duration of vibrating equipment shall be limited to the time necessary to produce satisfactory consolidation without causing objectionable segregation. The vibrator shall not be inserted into the lower courses that have begun to set. Vibrator shall be applied vertically at uniformly spaced points not further apart than the visible effectiveness of the machine.

EPOXY BONDING COMPOUND

Before depositing new concrete on or against concrete that has set, the surfaces of the set concrete shall be thoroughly cleaned so as to expose the coarse aggregate and be free of laitance, coatings, foreign matter and loose particles. Forms shall be re-tightened. The cleaned surfaces shall be moistened, but shall be without free water when concrete is placed. ASTM C 881. Provide Type I for bonding hardened concrete to hardened concrete; Type II for bonding freshly mixed concrete to hardened concrete; and Type III as a binder in epoxy mortar or concrete, or for use in bonding skid-resistant materials to hardened concrete. Provide Class B if placement temperature is between 4 to 16 °C; or Class C if placement temperature is above 16°C.

FINISHES OF CONCRETE

Within 12 hours after the forms are removed, surface defects shall be remedied as specified herein. The Temperature of the concrete, ambient air and mortar during remedial work including curing shall be above 10 °C. Fine and loose material shall be removed. Honeycomb, aggregate pockets, voids over 13mm in diameter, and holes left by the rods or bolts shall be cut out to solid concrete, reamed, thoroughly wetted, brush-coated with neat cement grout, and filled with mortar. Mortar shall be a stiff mix of one part Portland cement to not more than 2 parts fine aggregate passing the No. 16 mesh sieve, with a minimum amount of water. The color of the mortar shall match the adjoining concrete color. Mortar shall be thoroughly compacted in place. Holes passing entirely through walls shall be completely filled from the inside face by forcing mortar through the outside face. Holes which do not pass entirely through wall shall be packed full. Patchwork shall be finished flush and in the same plane as adjacent surfaces. Exposed patchwork shall be finished to match adjoining surfaces in texture and color. Patchwork shall be damp-cured for 72 hours. Dusting of finish surfaces with dry material or adding water to concrete surfaces will not be permitted.

CONCRETE FINISHING DETAILS

1. Concrete Paving

After concrete is placed and consolidated, slabs shall be screeded or struck off. No further finish is required.

2. Smooth Finish

Required only where specified; screed concrete and float to required level with no coarse aggregate visible. After surface moisture has disappeared and laitance has been removed,

the surface shall be finished by float and steel trowel. Smooth finish shall consist of thoroughly wetting and then brush coating the surfaces with cement to not more than 2 parts fine aggregate passing the no. 30 mesh sieve and mixed with water to the consistency of thick paint.

3. Broom Finish

Required for paving; the concrete shall be screeded and floated to required finish level with no coarse aggregate visible. After the surface moisture has disappeared and laitance has been removed, surface shall be float-finished to an even, smooth finish. The floated surfaces shall be broomed with a fiber bristle brush in a direction transverse to the direction of the main traffic.

ITEM 07 : INTERLINK/ CYCLONE WIRE MESH FENCE

SCOPE

This work covers all the following requirements regarding the construction of CHB wall, cyclone wire mesh or chain link fences and manufacturing and installation of steel angle frames as all other accessories in accordance with the lines, grades and dimensions shown in the drawings.

PHYSICAL PROPERTIES

1. All steel, angle frames and accessories shall be inside and out in accordance with international standards for galvanizing BS EN1460.
2. The stiffeners of the steel fences shall be attached to the steel panels using the Welding Process.
3. The allowable tolerances on dimensions on the angular bars shall not exceed the following:
 - a. Thickness - 0.2mm
(i.e. for 3mm required load bar thickness, the allowable thickness is from 2.8mm to above 3.0 mm only)
 - b. Height - 0.5mm
(i.e. for 25mm required load bar height, the allowable height is from 24.5 to above 25mm only)
4. Welding shall be in accordance with the AWS Code and as herein specified or any other welding standard, approved by the Engineer.

MECHANICAL PROPERTIES

The steel fence, barbed wire, steel gratings and angle framing supplier shall be required to submit test certificates for steel materials for the fence panel used in its manufacture; and for hot dip galvanizing which shall meet or exceed the following properties:

ASTM A36 Carbon Steel (Yield Strength = 250 Mpa; Tensile Strength = 400 Mpa)

DELIVERY, STORAGE, INSTALLATION AND MEASUREMENT

1. Upon delivery at site, the hot dip galvanized steel fence panels, steel gratings and angle frames shall not be subjected to the following activities:
 - a. Re-fabrication
 - b. Cutting
 - c. Grinding
 - d. Welding
 - e. Sawing
 - f. Any hot works or similar activities
2. Stainless steel nuts and bolts may be tack welded using stainless steel welding rods.
3. The steel fence panels steel gratings and angle frames shall not be exposed to sea water and other corrosive chemicals or substances prior to installation.

Installation of the steel fence panels, steel gratings and angle frames shall be in accordance with the Engineer.

MATERIALS

1. Concrete Post

Concrete post shall be made of Class A concrete in accordance with Item 9, Reinforced Concrete. The post shall be cast to the length shown on the detailed Plans, and shall have a smooth surface finish.

2. Steel Reinforcement

Steel reinforcement for concrete post shall be deformed steel bars conforming to the provisions of Item 409, Reinforced Concrete.

3. Concrete Hollow Blocks (CHB)

Concrete hollow blocks shall be standard machine vibrated, and shall have fine and even texture and well defined edges. Units shall be non-load bearing unless otherwise indicated in the drawings. Samples shall be submitted to the Engineer for approval.

4. Angular Bar

The steel angular bar shall be ASTM A36 Carbon Steel with yield strength of 250MPa and Tensile Strength of 400MPa.

5. Cyclone Wire Mesh

Cyclone Wire Mesh shall conform to the requirements of ASTM A 121, Class I.

SHOP DRAWING

Prior to fabrication, the Contractor shall submit for the Engineer's approval shop drawings details of the proposed fencing.

CONSTRUCTION

The Contractor shall perform such clearing and grubbing as may be necessary to construct the fence to required grade and alignment. Fence shall generally follow the contour of the ground. Grading shall be performed where necessary to provide a neat appearance.

The post shall be erected vertically in position inside the formwork of the foundation block prior to the placing of concrete shall be adequately supported by bracing to prevent movement of the post during the placing and setting of the concrete. The post shall be erected to the height and location shown on the Plans, or as ordered by the Engineer.

ITEM 08 : ROCKWORKS

SCOPE OF WORK

The work includes the furnishing of all labor, materials and equipment required for the rock works including armour rocks, underlayer and rock fill in accordance with the Specifications and as indicated in the drawings or as directed by the Engineer.

SETTING OUT OF WORKS

1. Topographic/Hydrographic Survey

Prior to commencement of Works, the Contractor together with the Engineer shall conduct topographic and hydrographic surveys in order to establish the actual field condition or bathymetry of the project site. The said survey shall be used as the basis of quantity measurement.

2. The Contractor shall set out the Works and shall solely be responsible for the accuracy of such undertaking. Visible construction markers shall be used to clearly define horizontal limits prior to placing of any material.

MATERIAL REQUIREMENTS

1. All rocks to be used shall be angular, hard, durable and not likely to disintegrate in seawater. Rock layers to be installed should more or less be "global in shape", "angular in surface" and should avoid "river run rocks". Rocks that are sub-angular may be subject to the approval of the Engineer. Rounded or well rounded pieces will not be accepted.
2. All rocks shall have a minimum unit weight of 2,650 kg per cubic meter (specific gravity 2.65) of solid materials when measured dry.
3. Rocks with specific gravity higher than the above specified is preferable and will readily be accepted. But no adjustment (increase) in the contract price will be made on this account.
4. Rocks of the primary cover layer shall be sound, durable and hard. It shall be free from laminations, weak cleavages, and undesirable weathering, and shall be of such character that it will not disintegrate from the action of the air, seawater, or in handling and placing. All stone shall be angular quarry stone.
5. All rocks shall conform to the following test designations:

Apparent specific gravity	ASTM C 127
Abrasion	ASTM C 535

EXECUTION

QUARRY SITE AND ROCK QUANTITY

1. It is the Contractor's responsibility to make necessary surveys / investigations on quarry sites applicable to the Works, taking into consideration the nature of the rock works required under the Contract such as required quality, total quantity and daily required quantity, transportation method and route etc.,
2. The Contractor shall submit data on characteristics of proposed quarry sites together with the location of sites, test results of their products and samples for the approval of the Engineer.

3. When the Contractor intends to operate a quarry for the Works, the Contractor shall take all the responsibilities in connection with its operation including, but not limited to, obtaining all necessary permits and approvals, payment of safety measures or like (if any), provisions and maintenance of safety measures and temporary access roads, all of private and public roads and temporary jetties to be used to transport quarried materials and the compliance with all regulations etc. required by the authorities having jurisdiction over any part of the operation.

Should any explosive be used in the quarry operations, the Contractor shall be responsible to meet laws and regulations, wherever applicable, established by the Local Government and Central Government Department concerned.

4. Despite the Engineer's previous approval of the natural rock and borrow pits, the Engineer reserves the right to suspend any operation in connection with the rock, if, in its opinion, such rock is not suitable for the work. In such case, the Contractor shall comply with the Engineer's instructions.
5. The finish bulkhead shall be true to grade and section. The spaces/voids between rocks shall be filled/sealed with 2 kg. to 16 kg. rocks and shall be approved by the Engineer before placing geotextile filter thereon to prevent the filling materials (soil and sand) from escaping to cause scouring and settlement of finished surface.

STORAGE OF MATERIALS

Quarried rock materials shall be stored by weight/class or in a manner approved by the Engineer and in a yard kept clean, free from undesirable materials.

SAMPLING TEST

1. Thirty (30) days prior to commencement of rock works, samples and test results of rock material which conforms to the Specifications called for in the Contract shall be submitted to the Engineer for evaluation and approval.
2. Rock samples from different sources and of different classes shall also be submitted, together with test results and its corresponding certificates, for the Engineer's approval.
3. Rocks accepted at the quarries before shipments or at the site before placement shall not be used as a waiver. The Engineer has the right to reject any inferior rock quality.
4. Samples for each class of approved materials are to be kept in the field for comparison/checking of delivered rock materials. A test shall be required for every 1,500 cu.m.

CROSS-SECTIONS OF COMPLETED ROCKWORK

Cross-sections showing the elevations of the completed rock works and the terrain of the existing seabed prior to construction shall go together with every progress report and request for progress or final payment.

Rock works which was previously paid should be easily identified from sections being requested for payment.

ITEM 09 : GEOTEXTILE FABRIC**SCOPE OF WORK**

This work covers all the following requirements regarding the installation of geotextile (filter fabric) in accordance with the lines, grades, and dimensions shown in the drawings.

MATERIAL REQUIREMENTS

The geotextile fabric shall meet the following requirements in full. If required, a sample of 1.0 sq.m. shall be supplied to the Engineer for approval and retention for purposes of comparative testing against materials randomly sampled from the site.

1. PHYSICAL PROPERTIES

- a. The geotextile material shall be a nonwoven needle punched type comprising of needle punched polypropylene fibers or its equivalent.
- b. The geotextile material shall be UV stabilized to ensure retention of minimum 70% original tensile strength after 90 days exposure to sunlight. The manufacturer shall submit test results to the Engineer for approval.
- c. The geotextile must be highly resistant to long term contact with damp cementitious substances or acid or alkali solutions in the pH range 2-13. The manufacturer shall submit test data to ensure resistance of the polymer.

2. MECHANICAL AND HYDRAULIC PROPERTIES

The geotextile supplier is required to certify that the materials delivered to site will be proven to meet or exceed the following properties:

TECHNICAL PROPERTIES	UNIT	MINIMUM	TEST STANDARD
A. Physical Characteristics:			
Minimum Mass (per unit area)	(g/m ²)	540	ASTM D5261
Thickness (F=2 kpa)	mm	4.5	ASTM D5199
B. Mechanical Properties:			
Tensile Strength (md/cd)	kN/m	13/22	ASTM D4595
Tensile elongation (md/cd)	%	90/40	ASTM D4595
CBR Puncture Resistance	N	3000	ASTM D6241
C. Hydraulic Properties:			
Effective Opening Size (O ₉₀ Wet Sieving)	(mm)	0.08	ASTM D4751
Water Permeability: Permittivity	(s ⁻¹)	0.5	ASTM D4491

Note:**Tolerances:**

Mechanical Properties	-1.0% of the Minimum Value
Hydraulic Properties	-1.0% of the Minimum Value

EXECUTION

1. The geotextile shall be delivered to site with an outer wrapper to protect it from exposure to the elements.
2. Prior to laying of geotextile filter, stone filler shall be placed between gaps or voids of armour / core rocks as likewise mentioned in the requirements of Item "Rock Works".
3. The non-wooven geotextile filter shall be installed and lay manually at site as per design drawings. The filter shall be laid lengthwise down slopes and appropriately anchored along the top edge.
4. The Engineer reserves the right to sample geotextile delivered to site for individual quality control testing at the contractor's expense. A material not meeting the manufacturer's certified values will be rejected from the site.
5. The geotextile shall be proven to resist dynamic puncture damage when subject to impact stress from stone armour (200-400 kg.) dropped from a minimum height of 2.0 m. and should be laid on at least 1-foot sand and gravel bedding. Geotextile failing to resist puncture shall not be accepted.
6. To facilitate site Quality Assurance, each roll of geotextile delivered to site shall be clearly labeled with brand name, grade, and production batch number.
7. Geotextile overlaps shall be at least 1.0 m unless otherwise stated on the drawings. Alternatively, geotextile overlaps are to be heat-welded or sewn using appropriate polypropylene or other synthetic thread and portable hand sewing equipment.

ITEM 10 : CONSTRUCTION JOINTS

SCOPE OF WORK

This item shall consist of the manufacturing and installation of construction joints / expansion joints in accordance with the details, and at the locations, lines, grades and dimensions shown in the drawings.

MATERIAL REQUIREMENTS

1. All construction joints / expansion joints shall be hot-dipped galvanized inside and out in accordance with international standards for galvanizing BS EN1460.
2. Painted finish shall be rejected.
3. All steel gratings and angle bars for construction joints / expansion joints shall be hot-dipped galvanized except for the nuts, washers and bolts which shall be stainless steel.
4. Welding shall be in accordance with the AWS Code and as herein specified or any other welding standard, approved by the Engineer.

The Contractor shall be required to submit test certificates for steel materials for the construction / expansion joints used in its manufacture; and for hot-dip galvanizing which shall meet or exceed the specifications under "Zinc Coating".

EXECUTION

DELIVERY, STORAGE AND INSTALLATION

1. Upon delivery at site, the hot-dipped galvanized construction joints / expansion joints shall not be subjected to the following activities:
 - a. Re-fabrication
 - b. Cutting
 - c. Grinding
 - d. Welding
 - e. Sawing
 - f. Any hot works or similar activities
2. Stainless steel nuts and bolts may be tack welded using stainless steel welding rods.
3. The construction joints / expansion joints shall not be exposed to sea water and other corrosive chemicals or substances prior to installation.

ITEM 11 : ZINC (HOT-DIP GALVANIZED) COATINGS ON IRON AND STEEL

SCOPE OF WORK

This specification covers the requirements for zinc coating (galvanizing) by the hot-dip process on iron and steel products made from rolled pressed and forged shapes, casting, plates, bars and strips.

This specification covers both fabricated and un-fabricated products, for example, assembled steel products, structural steel fabrications, large tubes already bent or welded before galvanizing, and wire work fabricated from uncoated steel wire. It also covers steel forgings and iron castings incorporated into pieces fabricated before galvanizing or which are too large to be centrifuged (or otherwise handled to remove excess galvanizing bath metal).

MATERIAL REQUIREMENTS

STEEL OR IRON

The specification, grade or designation, and type and degree of surface contamination of the iron or steel in articles to be galvanized shall be supplied by the purchaser to the hot-dip galvanizer prior to galvanizing.

The presence in steels and weld metal, in certain percentages, of some elements such as silicon, carbon and phosphorus tends to accelerate the growth of the zinc-iron alloy layer so that the coating may have a matte finish with a little or no outer zinc layer.

EXECUTION

FABRICATION

The design and fabrication of the product to be galvanized shall be in accordance to the plans and specifications. ASTM Practices A 143, A 384 and A 385 provide guidance for steel fabrication for optimum hot-dip galvanizing and shall be complied with in both design and fabrication.

CASTINGS

The composition of heat treatment of iron and steel castings shall conform to specifications designated by the purchaser. Some types of castings have been known to show potential problems being embrittled during normal thermal cycle of hot-dip galvanizing. The requirements for malleable iron castings to be galvanized are stipulated in ASTM specification A 47.

ZINC

The zinc used in the galvanizing bath shall conform to ASTM Specification B 6. If a zinc alloy is used as the primary feed to the galvanizing bath, then the base material used to make that alloy shall conform to ASTM Specification B 6.

BATH COMPOSITION

The molten metal in the working volume of the galvanizing bath shall contain not less than an average value of 98.0% zinc by weight.

COATING PROPERTIES

Table 1 – Minimum Average Coating Thickness Grade by Material Category

Material Category	All Specimens Tested Steel Thickness Range (Measured), mm (in.)				
	< 1/16 (<1.6)	1/16 to < 1/8 (1.6 to < 3.2)	1/8 to < 3/16 (3.2 to 4.8)	> 3/16 to < 1/4 (> 4.8 to < 6.4)	≥ 1/4 (≥ 6.4)
Structural Shapes & Plate	45	65	75	85	100
Strip and Bar	45	65	75	85	100
Pipe and Tubing	45	45	75	75	75
Wire	35	50	60	65	80

COATING THICKNESS

The average thickness of coating for all specimens tested shall conform to the requirements of Table 1 for the categories and thickness of the material being galvanized. Minimum average thickness of coating for any individual specimen is one coating grade less than that required in Table 1. Where products consisting of various material thicknesses or categories are galvanized, the coating thickness grades of each thickness range and material category of material shall be shown in Table 1. The specification of coating thickness heavier than those required by Table 1 shall be subject to mutual agreement between the galvanizer and Engineer.

For articles whose surface area is greater than 100,000 mm² (160 in.²) (multi-specimen articles), each test article in the sample must meet the appropriate minimum average coating thickness grade requirements of Table 1. Each specimen coating thickness grade comprising that overall average for each test article shall average not less than one coating grade below that required in Table 1.

For articles whose surface area is equal to or less than 100,000 mm² (160 in.²) (single-specimen articles), the average of all test articles in the sample must meet the appropriate minimum average coating thickness grade requirements of Table 1. For each test article, its specimen coating thickness shall not be less than one coating grade below that required in Table 1.

No individual measurement or cluster of measurements at the same general location on a test specimen shall be cause for rejection under this specification provided that when those measurements are averaged with the other dispersed measurements to determine the specimen coating thickness grade for that specimen, the requirements of the above specifications as appropriate are met.

The coating thickness grades in Table 1 represent the minimum value obtainable with a high level of confidence for the ranges typically found in each material category. While most coating thicknesses will be in excess of those values, some materials in each category may be less reactive (for example, because of chemistry or surface condition) than other materials of the steel category spectrum. Therefore, some articles may have a coating grade at or close to the minimum requirements shown in Table 1. In such cases, the precision and accuracy of the coating thickness measuring technique should be taken into consideration when rejecting such articles for coating thickness below that is required by this specification.

FINISH

The coating shall be continuous (except as provided below), and as reasonably smooth and uniform in thickness as the weight size and shape of the item. Except for local excess coating thickness which would interfere with the use of the product or make it dangerous to handle (edge tears or spikes), rejection for non-uniform coating shall be made only for plainly visible excess coating not related to design factors such as holes, joints, or special drainage problems. Since surface smoothness is a relative term, minor roughness that does not interfere with the intended use of the product, or roughness that is related to the as-received (un-galvanized) surface condition, steel chemistry to zinc shall not be grounds for rejection.

Surfaces that remain uncoated after galvanizing may be renovated in accordance with the methods in ASTM Practice A 780 provided that the following conditions are met:

1. Each area subject to renovation shall be 25mm (1 in.) or less in its narrowest dimension.
2. The total area subject to renovation on each article shall be no more than $\frac{1}{2}$ of 1% of the accessible surface area to be coated on that article, or 22,500mm² (36 in.²) per ton of piece weight, whichever is less. Inaccessible surface areas are those which cannot be reached for appropriate surface preparation and application of repair materials as described in ASTM Practice A 780.
3. The thickness of renovation shall be that is required by the thickness grade for the appropriate material category and thickness range in Table 1 in accordance with the coating thickness requirements, except that for renovation using zinc paints, the thickness of renovation shall be 50% higher than that required by table 1, but not greater than 0.0254mm (4.0 mils).
4. When areas requiring renovation exceed the criteria previously provide, or are inaccessible for repair, the coating shall be rejected.

THREADED COMPONENTS IN ASSEMBLIES

The zinc coating on external threads shall not be subjected to a cutting, rolling or finishing tool operation, unless specifically authorized by the purchaser. Internal threads may be tapped or retapped after galvanizing. Coatings shall conform to the requirements of ASTM Specification A 153/A 153 M.

APPEARANCE

Upon shipment from the galvanizing facility, galvanized articles shall be free from uncoated areas, blisters, flux deposits and gross dross inclusions. Lumps, projections, globules or heavy deposits of zinc which will interfere with the intended use of the material will not be permitted. Plain holes of 12.5mm (1/2 in.) diameter or more shall be clean and reasonably free from excess zinc. Marks in the zinc coating caused by tongs or other items used in handling the article during the galvanizing operation shall not be cause for rejection unless such marks have exposed the base metal, and the bare metal areas exceed the criteria provided in number 1 and 2 of Subsection "Finish".

Whenever dross is present in a form other than finely dispersed pimples in the coating and is present in such amount as to be susceptible to mechanical damage, it will be considered as "gross".

ADHERENCE

The zinc coating shall withstand handling consistent with the nature and thickness of the coating and the normal use of the article, without peeling or flaking. Although some material may be formed after galvanizing, in general the zinc coating on the articles covered by this specification is too heavy to permit severe bonding without damaging the coating.

SAMPLING

A lot is a unit of production or shipment from which a sample may be taken for testing. Unless otherwise agreed upon between the galvanizer and the purchaser, or established within this specification, the lot shall be as follows:

1. For testing at a galvanizer's facility, a lot is one or more articles of the same type and size comprising a single order or a single delivery load, whichever is smaller, or any number of articles identified as a lot by the galvanizer, when these have been galvanized within a single production shift and in the same bath.
2. For test by the purchaser after delivery, the lot consists of the single order or the single delivery load, whichever is smaller, unless the lot identify, established in accordance with the above, is maintained and clearly indicated in the shipment by the galvanizer.

The method of selection and number of test specimens shall be agreed upon between the galvanizer and the purchaser. Otherwise, the test specimens shall be selected random from each lot. In this case, the minimum number of specimens from each lot shall be as follows:

Number of Pieces in Lot	Number of Specimens
3 or less	All
4 to 500	3
501 to 1,200	5
1,201 to 3,200	8
3,201 to 10,000	13
10,001 and over	20

A test specimen which fails to conform to any requirement of this specifications shall not be used to determine the conformance to other requirements.

TEST REQUIREMENTS

Magnetic Thickness Measurements:

The thickness of the coating shall be determined by magnetic thickness gauge measurements in accordance with ASTM Practice E 376. For each specimen, five or more measurements shall be made at points widely dispersed throughout the volume occupied by the specimen so as to represent as much as practical, the entire surface area of the test specimen. The average of the five or more measurements thus made for each specimen is the specimen coating thickness.

For articles whose surface area is greater than 100,000 mm² (160 in²), in the average of the three specimen coating thickness grades comprising each test article is the average coating thickness for that test article. A specimen must be evaluated for each steel category and material thickness within the requirements for each specimen of the test article

For articles whose surface area is equal to or less than 100,000 mm² (160 in²), the average of all specimen coating thickness grades is the average coating thickness for the sample.

The use of magnetic measurement method is appropriate for larger articles, and may be appropriate for smaller articles when such is practical using ASTM Practice E 376.

Stripping Method

The average weight of coating may be determined by stripping a test article, a specimen removed from a test article, or group of test articles in the case of very small items such as nails, etc., in accordance with Test method ASTM A 90/A 90m. The weight of coating per unit area thus determined is converted to equivalent coating thickness values in accordance with Table 2, Coating Thickness Grade (rounding up or down as appropriate). The thickness of coating thus obtained is the test article coating thickness, or in the case of a specimen removed from a test article, is the specimen average coating thickness.

Table 2 – Coating Thickness Grade ^A

Coating Grade	mils	oz/ft ²	μm	g/m ²
35	1.4	0.8	35	245
40	1.4	1.0	45	320
50	2.0	1.2	50	355
55	2.2	1.3	55	390
60	2.4	1.4	60	425
65	2.6	1.5	65	460
75	3.0	1.7	75	530
80	3.1	1.9	80	565
85	3.3	2.0	85	600
100	3.9	2.3	100	705

^A Conversions in Table 2 are based on the metric thickness value equivalents from the next earlier version, using conversion factors consistent with Table X 2.1 in Specification A 653/A 653M, rounded to the nearest 5 μm (0.0002 in.). The conversion factors used are: mils = μm x 0.03937; oz/ft² = μm x 0.002316; g/m² = μm x 7.067.

Weighing Before or After Galvanizing

The average of coating may be determined by weighing articles before and after galvanizing, subtracting the first weigh from the second and dividing the result by the surface area. The first weigh shall be determined after pickling and drying, and the second after cooling to ambient temperature. The weight of coating per unit area thus determined is converted to equivalent coating thickness values according to Table 2 (rounding up or down as appropriate). The thickness of coating thus obtained is the test article coating thickness.

Microscopy

The thickness of coating may be determined by cross-sectional and optical measurement in accordance with ASTM Test Method B 487. The thickness thus determined is a point value. No less than five such measurements shall be made at locations on the test article which are as widely dispersed as practical, so as to be representative of the whole surface of the test article. The average of no less than five such measurement is the specimen coating thickness.

Adhesion

Determine adhesion of the zinc coating to the surface of the base metal by cutting or prying with the point of a stout knife, applied with considerable pressure in a manner tending to remove a portion of the coating. The adhesion shall be considered inadequate if the coating flakes off in the form of a layer of the coating so as to expose the base metal in advance of the knife point. Do not use testing carried out at edges or corners (points of lowest coating adhesion) to determine adhesion of the coating. Likewise, do not use removal of small particles of the coating by paring or whittling to determine failure.

Embrittlement

Test for embrittlement may be made in accordance with ASTM Practice A 143

The galvanized article should withstand a degree of bending substantially the same as the ungalvanized article. Flaking or spalling of the galvanized coating is not be constructed as an embrittlement failure.

Inspection, Rejection and Retest

The material shall be inspected at the galvanizer's plant prior to shipment. However, by agreement the purchaser may make the tests which govern the acceptance or rejection of the materials in his own laboratory or elsewhere.

When inspection of materials to determine conformity with the visual requirements of Subsection "Finish" warrants rejection of a lot, the galvanizer may sort the lot and submit it once again for acceptance after he has removed any nonconforming articles and replace them with conforming articles.

Materials have been rejected for reasons other than embrittlement may be stripped and regalvanized, and again submitted for inspection and test at which time they shall conform to the requirements of this inspection.

Transport and Storage

Galvanized components shall, wherever possible, be transported and stored under dry, well-ventilated conditions to prevent the formation of wet storage staining.

Either zinc phosphate or chromate passivation treatment after galvanizing may be used to minimize the wet storage staining which may occur on articles unable to be stored in dry, well-ventilated conditions.

Provided the coating thickness complies with the requirements of Subsection "Coating Thickness", no further remedial action is required to the stained areas.

ITEM 12 : PILING WORKS (PRE-STRESSED CONCRETE PILES)

SCOPE OF WORK

This section covers the minimum requirements for the fabrication, hauling, spotting, driving and finishing of all foundation piles to be used in wharves/piers/platforms.

The Contractor may however, adopt, in addition to this minimum requirements additional provisions as may be necessary to insure the successful prosecution of the work related to foundation piling.

METHOD STATEMENT

Before the commencement of any piling works, the Contractor shall submit (allowing sufficient time for consideration) to the Engineer for approval a Safety Policy and a Method Statement which shall include the following information:

1. Program of Works detailing sequence and timing of individual portions of works.
2. Maximum proposed lead at any stage of driving between a pile and its neighbor and the limitations of same if hard driving is encountered.
3. Contingency plan in the event of encountering obstructions or reaching driving refusal to minimize disruption/delay especially when using pitch and drive methods.

MATERIAL REQUIREMENTS

TYPE OF FOUNDATION PILES

Pre-stressed concrete foundation piles to be used shall be in accordance with the design as shown on the Drawings and called for in the proposal.

PRE-STRESSED CONCRETE PILES

Pre-stressed concrete piles shall be constructed in accordance with the standard practice employed for the particular system specified and as directed by the Engineer subject to the following clauses.

1. Pre-stressed concrete piles shall be of readymade products of approved fabricator regularly engaged in the production of pre-stressed concrete piles.
2. If an alternative system of pre-stressing to that shown in the Drawings is proposed by the Contractor, full details, procedures and explanations shall be submitted in writing to the Engineer for his approval. When approved for the work, the provisions of this Specification and such other provisions as he may require shall be fully satisfied.
3. Concrete strength, high tension wires/strands, reinforcing bars to be used for pre-stressed concrete work shall be as specified in the Drawings.
4. The Contractor shall submit the casting method including pre-stressing, application of stress and casting schedule and shall obtain the approval of the Engineer before commencement of fabrication of the piles.
5. The Contractor shall arrange for the Engineer to have free access to the place of manufacture of the piles.

6. Piles shall be cast on a horizontal platform in approved steel moulds and details of the formwork and methods of concreting shall be as specified. The concreting of each pile shall be completed on one continuous operation and no interruption shall be permitted.

The pile butt must be formed truly square to the axis of the pile. Provision for standard splicing shall be provided unless otherwise ordered by the Engineer.

7. Anchorages shall be made from steel of a suitable quality to withstand permanently the forces imposed upon them, and shall in general be in accordance with the normal practice of the proprietors of the pre-stressing system in use.
8. Application of stress, grouting of pre-stressing cables, protection of pre-stressing cable anchorages and other necessary steps to complete the pre-stressing process shall conform to the standard practice of the pre-stressing system in use or as directed by the Engineer.
9. When the stress has been transferred to the pile, the pile shall exhibit no curvature in its length on any face greater than 3 millimeters deviation along a chord of 15 meters (1 in 500).
10. Pre-cast pre-stressed units shall be lifted only by lifting holes/hook as indicated in the Drawings, or when not provided can be lifted by slings placed securely at corresponding points. Units shall be kept in the upright position at all times and shock shall be avoided. Any unit considered by the Engineer to have become sub-standard in any way shall be rejected and replaced by an acceptable unit.
11. Each pre-stressed member is to be uniquely and permanently marked to show its type, date of casting, length of pile and any control markings as ordered by the Engineer
12. Forms shall conform to the geometry of the pile with the provision of chamfer as shown on the Drawings.
13. Not less than five (5) cylindrical specimens shall be made for each casting batch of which at least two (2) shall be reserved for 28-day test, one (1) for 7-day, one (1) for 14-day, and one (1) test prior to lifting of pre-stressed concrete piles from the casting bed. Lifting of piles shall only be done if the result of the compressive strength has reached at least 60% of the specified compressive strength.
14. Wires/strands specifications shall be in accordance with ASTM A 416.

EXECUTION

HANDLING OF PILES

All piles shall be carefully lifted at the location of the lifting points as indicated in the Drawings. Other practical and convenient methods may be used subject to the approval of the Engineer.

DRIVING OF PILES

A diesel pile hammer shall be used for driving the pre-stressed concrete piles.

The required weight of ram for the diesel pile hammer is 4.5 tons.

Piles driven shall be held firmly in position in axial alignment with the hammer by means of leads of adequate length. Approved cushions shall be provided to the pile butts.

PILE SPLICING

General Provision

1. The alignment of piles shall be plumb and the length of upper and lower segment shall be in accordance in the approved plans.
2. The splice shall be embedded at least 4m from the design depth elevation.

Surface Preparation

Concrete piles to be bonded must be thoroughly cleaned, free of dirt, paint, grease, oil, curing compound and other contaminants. The concrete surface must be dry. Clean the dowels with steel brush to removed rust and other impurities. Blow compressed air to the dowel holes.

Pile Splicing Epoxy

Piling splicing epoxy is a two components, low viscosity, rapid cure, chemical resistant epoxy with high physical strength.

Preparation and Application of Epoxy Mortar

Mixing and ratio of pile splicing epoxy and dry silica sand, application and curing of epoxy mortar shall refer to product manual.

Compressive Strength

The compressive strength of epoxy mortar (Pile Splicing Epoxy + Dry Silica Sand) shall be at least 1.2 times the design compressive strength of pile or 6,000psi.

Mechanical Properties of Epoxy

Cured state at 27° C (80° F) for 24 hours

Mechanical Properties	Specification (Test Methods)
Ultimate Tensile Strength	ASTM D 638
Ultimate Flexural Strength	ASTM D 790
Hardness	ASTM D 2240
Compressive Strength at 1 hour cure	ASTM D 695
Compressive Strength with Silica Sand	ASTM D 695

PILE CHIPPING

Each pile shall be chipped-off to required elevation as indicated in the drawing. The contractor shall ensure that no damaged/cracked on the main pile will occurred after each chipping. Reinforcement from driven piles (dowels and strand) shall not be cut and will be incorporated to the construction of deck. Splicing of dowels are allowed in case of pile cutting due to early refusal.

BEARING POWER OF PILES

Each pile shall be driven to attain not less than the required minimum bearing power shown in the pile schedule, as determined by the Hiley's Formula as follows:

$$\text{For Diesel Pile Hammer : } R = \frac{1}{6} \times \frac{2WH}{S + 2.54}$$

INTERRUPTED DRIVING

When driving is stopped before final penetration is reached and/or refusal is attained, the record of pile penetration shall be taken only after a minimum of 30 cm. (12 in.) total penetration has been obtained on resumption of driving.

ALIGNMENT TOLERANCE

Piles driven shall be within the allowable tolerance in alignment of 10 cm. (4 in.) in any direction.

DAMAGED AND MISDRIVEN PILES

1. Piles shall not be more than 10 cm. (4 in.) out of place at cut-off level. All vertical piles shall not be more than 2% out of plumb.
2. Any pile damaged by improper driving or driven out of its proper location, or driven out of elevation fixed on the plans, shall be corrected correspondingly at the Contractor's expense by any of the following methods:
 - a. Withdrawal of the pile and replacement by a new pile.
 - b. Driving a second pile adjacent to the defective one.
 - c. Splicing an additional length.

The method to be adopted in each case shall be at the discretion of the Engineer.

OBSTRUCTION

Where boulders or other obstructions make it impossible to drive certain piles in the location shown and to the required bearing strata, the Engineer may order additional pile or piles driven at other suitable location.

RECORDS

The Contractor shall keep records of each pile driven and shall furnish the Engineer two (2) signed typewritten/computerized copies. The records shall show the number of blows per 0.50 m. of initial penetration taken from the free fall elevation of the pile down to penetration depth of 5.0 m., the penetration under the last 10 blows, and the calculated safe load according to the Hiley's Formula as stated in bearing power of piles.

ITEM 13 : MOORING AND FENDERING SYSTEM

SCOPE OF WORK

1. The work includes furnishing of all labor, materials and equipment to complete the installation of mooring bollards and fenders in piers/wharves.
2. The work shall include the supply, transport, handling, storage and installation of fenders systems in the newly constructed piers.
3. The Contractor shall furnish and install the necessary fittings as shown on the drawings and/or specified.

Supplementary parts necessary to complete and install each item of works shall be included whether or not shown or specified. The Contractor shall furnish to relevant trades all anchors, fastenings, inserts, fittings, fixtures or the like to be installed on or required for securing the works.

The Contractor shall submit shop drawings of all fitting works prior to placing orders and commencement of any fabrication.

MATERIAL REQUIREMENTS

MOORING SYSTEM

Designated load capacity of mooring bollards shall be as shown in the drawings, and shall be referred to as the maximum load capacity. The mooring bollards shall be at rupture stage upon reaching the maximum load capacity.

Mooring bollards shall be of the dimensions, weights, capacities and designs as shown in the drawings and shall be fabricated by approved manufacturer with cast steel conforming to the requirements indicated in the plan/drawings, or approved equivalent.

The size of the bolts, nuts and washers shall be in accordance with the specifications provided in the plans/drawings. The anchor plate shall be connected to the holding down bolt as shown in the plans/drawings. All bolts, nuts, washers etc., that are exposed shall be hot-dip galvanized.

Samples of the bolts, nuts, washers and anchor plates shall be submitted to the Engineer for approval before being used in the Works.

The upper part of bollards and base plates which are not embedded in concrete shall be painted. The surface of bollards shall be cleaned thoroughly by wire brush or other means prior to painting to remove rust or any other contamination which may interfere with bond of paint to metal.

The exposed surface shall be coated with rust proof paint and finishing paint, which shall be coal-tar epoxy of 120m micron thickness in accordance with JIS K5623 or the approved standard.

Base Steel:

Chemical composition and mechanical properties of base metal to be used for fabrication of mooring bollard and its accessories shall comply with ASTM A36 and other required standard stated therein.

Concrete Foundation :

Concrete foundation for mooring bollards shall conform to the requirements of the Section concerning "Reinforced Concrete".

Visual Inspection :

All mooring bollards delivered to Site shall be inspected by the Engineer for any signs of flaws or defect inimical to usage.

Mill Test Certificates:

Two (2) copies of mill test reports shall be submitted certifying that materials meet the specified standards.

Test Inspection:

Inspection of all materials and methods of fabrication shall be carried out by the Contractor. However, the Engineer reserves the right to inspect all facilities at any time during the manufacture to ensure that the materials and workmanship are in accordance with Specifications and the best of workmanship.

FENDER SYSTEM

The rubber fenders should comply with the performance requirements specified in the table provided on the plan/drawings of RDF.

PHYSICAL PROPERTIES OF MATERIALS

The rubber for the fenders shall be of high quality natural rubber, synthetic rubber or mixed rubber blended with carbon black used in the rubber industry and shall have sufficient resilience and anti-ageing, weathering, abrasion, wear and oil resistant properties. The rubber dock fenders shall be free from bubbles, cracks and other harmful defects.

The physical properties of the rubber compound used for the fenders shall comply with the following requirements:

Physical Properties and Test Method

Test Item		Properties	Test Method	
Physical Test	Before Aging	Tensile Strength	Test piece: Dumbell No. 3	ASTM D412
		Elongation		ASTM D1456
		Hardness	Spring Type hardness test (Type A)	ASTM D2240
	After Aging	Tensile Strength	Aging by air heating: 70±1°C x 96 hours.	ASTM D412
		Elongation		ASTM D1456
		Hardness		ASTM D2240
	Compression Test		Heat treatment: 70±1°C x 22 hours.	ASTM D395

Note: Equivalent Standards are acceptable.

FITTINGS AND ANCHORAGE

Anchor bolts and connecting hardware shall be fabricated using type of steel specified (ASTM A36) and to the required shapes and sizes shown on the approved plan/drawings.

TESTING, SAMPLING, INSPECTION, ACCEPTANCE, MARKING AND PACKAGING

Testing

Sample rubber dock fenders that shall be incorporated in the project shall be subjected to tests. It shall pass the required energy absorption and reaction force at a certain deflection as indicated in the plan.

The Contractor shall be required to submit test certificates showing compliance to the above requirements. The test certificates shall be certified by an independent testing institute / organization recognized by the Authority.

Ten percent (10%) of the total number of fenders to be supplied and rounded to a unit shall be tested for performance. The fender shall be compressed repeatedly three (3) times to the maximum deflection at the speed from 2 to 8 cm. per minute. The load and deflection values shall be recorded with the precision of 0.1tf and 0.5mm respectively. The results shall be plotted in the form of load-deflection-energy absorption curves. The average data obtained in the second and third test loading shall be considered as performance values.

Inspection

All fenders of each type shall be inspected for compliance to specified dimensions and all fenders shall be inspected for any sign of flaw or defect inimical to its use.

All anchor bolts and fittings shall be inspected. The material used for the fabrication of bolts and fittings shall be covered by the manufacturer's certified mill certificate and shall be verified by the Authority.

Acceptance Tolerance

The acceptance tolerance shall be based on the following:

1. Fender Dimension

Length	:	-2% to +4%
Width	:	-2% to +4%
Height	:	-2% to +4%
Thickness	:	-2% to +8%

2. Anchor Bolt Holes in Fender

Diameter of the Hole	:	+2.0mm
Pitch of the Hole	:	+4.0mm

3. Acceptance tolerance for all fenders supplied shall be as follows:

E = Energy absorption,	$E \geq$ Specified E but not less than 10% of the specified E
R = Reaction force,	$R \leq$ Specified R but not more than 10% of the specified R

Marking

All fender units shall be clearly numbered and marked. Each fender shall have the following markings.

1. Fender type and manufacturer's name or trade mark
2. Production serial number
3. Date of manufacture or its abbreviation
4. Main dimensions
5. Project identification as follows:

Name of Port/Project : _____

Year supplied : _____

Packaging

The fenders shall be packaged on wooden crate or wrapped individually with Polypropylene sheets except when shipped containerized. The bolts and fittings should be placed in crates and suitably treated for protection when transported by sea and stored in port areas.

EXECUTION

MOORING / FENDERING SYSTEM

All units shall be installed at the locations shown on the drawings and as directed by the Engineer.

ITEM 17 : ELECTRICAL WORKS

SCOPE OF WORK

The work to be done shall consist of fabricating, trenching, furnishing, delivering and installing electrical materials/fixtures completed in accordance with all the details of the electrical works as shown on the drawings including materials, labor, tools and equipment and all incidental works as found necessary.

Refer to electrical plans/drawings for location and extent of work involved.

GENERAL REQUIREMENTS

- a) All works shall be done in accordance with the requirements of the publications and agencies having jurisdiction, as well as the requirements of the approved standards.
 1. National Fire Protection Association - (NFPA)
 2. National Electrical Manufacturer Association - (NEMA)
 3. Underwriter Laboratories, Inc. - (UL)
 4. Philippine Electrical Code - (PEC)
Philippine National Standard - (PNS)
 5. Federation Specification:
Circuit Breaker, Molded Case, Branch
Circuit and Service
 6. American National Standard Institute - (ANSI)
 7. American Society for Testing and Materials - (ASTM)
 8. Illuminating Engineering Society - (IES)
 9. Light Emitting Diode - (LED)
- b) The electrical power will be connected to the existing local cooperative supply. The supply voltages shall be 220 volt, single phase (1Ø), and 60 hertz.
- c) The Contractor shall employ a licensed Registered Electrical Engineer or Master electrician to perform or to supervise and to conduct the continuous inspection of all electrical work.
- d) The Contractor shall first obtain approval from the Authority before procurement, fabrication or delivery of electrical materials to the site. Partial submittals will not be acceptable and will be returned without review. Submittals shall include the Manufacturer's Name, Trade Name, Place of Manufacture, Catalog Model or Number, Nameplate Data, Size, Layout Dimensions, Capacity, Project Specification and Paragraph Reference, Technical Society Publication References and other information necessary to establish contract compliance of each item to be furnished.
- e) All excavations fill and backfill and concrete works involved herein, shall be carried to the required elevations and shall conform to the provisions of specification under Earthwork and Concrete Construction of this tender document.

- f) The materials and equipment to be furnished shall be standard products of reputable manufacturer engaged in the reproduction of such materials and equipment.
- g) All permits and electrical fees required for this work shall be obtained at the expense of the Contractor. The Contractor shall furnish the Engineer-in-Charge, the final Certificates of Inspections and approval from the proper government authorities after the completion of work. The Contractor shall prepare all as-built plans and all other paper works as required by the enforcing authorities.
- h) The Contractor shall furnish and install electrical materials as shown in the drawings. A licensed Electrical Engineer or Master Electrician is required to implement the installation of the electrical system. A licensed electrical contractor shall oversee/conduct the installation of the main circuit breaker.
- i) Electrical installation shall conform to the requirements of Philippine Electrical Code (PEC) and the other approved standards.
- j) The contractor shall install all electrical works with the supervision of the qualified Registered Electrical Engineer (REE) or Master Electrician. All electrical installation applications regardless of capacity and voltage whether new, addition or revision shall be accompanied by electrical plans signed and sealed by a duly licensed Professional Electrical Engineer (PEE).

MATERIAL REQUIREMENTS

All materials shall be brand new and shall be of the approved type meeting all the requirements of the Philippine Electrical Code and bearing the Philippine Standard Agency (PSA) mark.

PRODUCTS

WIRES AND CABLES

The conductor material to be furnished and installed shall be copper wire Heat-Resistant Thermoplastic (THHN/THWN-2). All conductors shall be rated 600 volts insulation and shall be standard for all sizes.

CONDUIT AND FITTINGS

Underground PVC conduit shall be polyvinyl chloride with concrete covered. It shall be manufactured to schedule 40 outside diameter. All fittings and bends shall be solvent bonded using manufacturers recommended product.

LED FLOODLIGHT FIXTURE 100 WATT

Specifications:

Rated	: 100 Watt or equivalent
Color Temperature	: Warm white
Driver	: Bridgelux
Beam Angle	: 120 degrees
IP Grade	: IP 65, Slim Type Series
Lumen	: 9000 -10000 lm
Input Voltage	: AC 100 -277 VAC Meanwell w/ Power Surge Protection

PANEL BOARD

Panel board shall conform to the schedule of panel board as shown on the approved plans with respect to supply characteristics, rating of main lugs or main circuit breaker, number and ratings and capacities of branch circuit breakers.

Panel board shall consist of a factory completed dead front assembly mounted in an enclosing NEMA 3R cabinet consisting of code gauge galvanized sheet steel box with trim and door.

Main and branch circuit breakers for panel board shall have the rating, capacity and number of poles as shown on the approved plans. Breakers shall be thermal magnetic type solid state-type with interrupting capacity of 10,000 amperes symmetrical minimum. Breaker terminal shall be UL listed as suitable for type of conductor provided. Breaker shall be the bolt-in type (that is, bolted to the current carrying bus). Plug-in circuit breakers are not acceptable

SINGLE ANGLE BAR FLOODLIGHT STEEL TAPERED LAMP POST

Lamp Post shall be 10.0 m ht. single angle bar steel tapered, furnished installed and tested as shown on the approved plans. The post/s shall be dimensioned for a wind velocity of 185 km/hr. It shall be locally fabricated or manufactured. The post shall be Hot -Dipped Galvanized, prime-coated with red lead and shall be painted at site with the final coating preferably aluminum paint to be approved by the Engineer.

EXECUTION

INSTALLATION

Lamp Post shall be installed as shown on the approved plans.

Pole Setting: Depth as shown on the approved plans.

Construction of reinforced concrete lamp post foundation shall be in accordance with the shape and dimensions as shown on the approved plans.

Excavations / backfilling required before /after installation of lamp post with the trench shall conform to the provisions of Earthwork and Concrete construction.

Concrete Pedestal Post shall be reinforced concrete with appropriate weatherproof fittings as constructed as shown in the approved plan. Reinforced concrete materials shall conform to the requirements of concrete. Concrete shall be of 21 Mpa (3000 psi) compressive strength.

Metering: the local utility company of Surigao del Norte Electric Cooperative is responsible for the supply and installation of metering equipment, and its accessories, but it is part of the contractor responsibility and expense to coordinate with them on this regard.

WORKMANSHIP

The work throughout shall be executed in the best and most thorough manner under the direction of and at the satisfaction of the Registered Electrical Engineer or Master Electrician, who will interpret the intent meaning of the drawings and specification and shall have the power to reject any work and materials which in his judgment, are not in full accordance therewith.

TESTING OPERATIONS

When the electrical installation is completed, the Contractor shall test the installed electrical materials and equipment in the presence of Registered Electrical Engineer or Master Electrician. The system shall be free from any defects, shorts or grounds. The Contractor at no extra cost shall furnish all necessary instruments and personnel required for the testing.

GUARANTEE

Upon completion and before final acceptance of the work, the Contractor shall furnish the Engineer a written guarantee stating that all works executed are free from defects on materials and workmanship. The guarantee shall be for a period of one year from the date of the final acceptance. Any work that becomes defective during the said period shall be corrected / replaced by the Contractor at his own expense in a manner satisfactory to the Authority.

ITEM 15 : PROJECT BILLBOARD


SPECIFICATION


The Project Billboard shall be installed at location(s) designated by the Engineer.

The size and specifications of materials for the standard billboard shall be 4ft. x 8ft. (1,200mm x 2,400mm) using ½ inch (12mm) marine plywood or tarpaulin poster on 3/16 inch (5mm) marine plywood.

Project billboards shall not contain Name(s) and/or picture(s) of any personages.

See attached drawings for further details of the standard billboard.

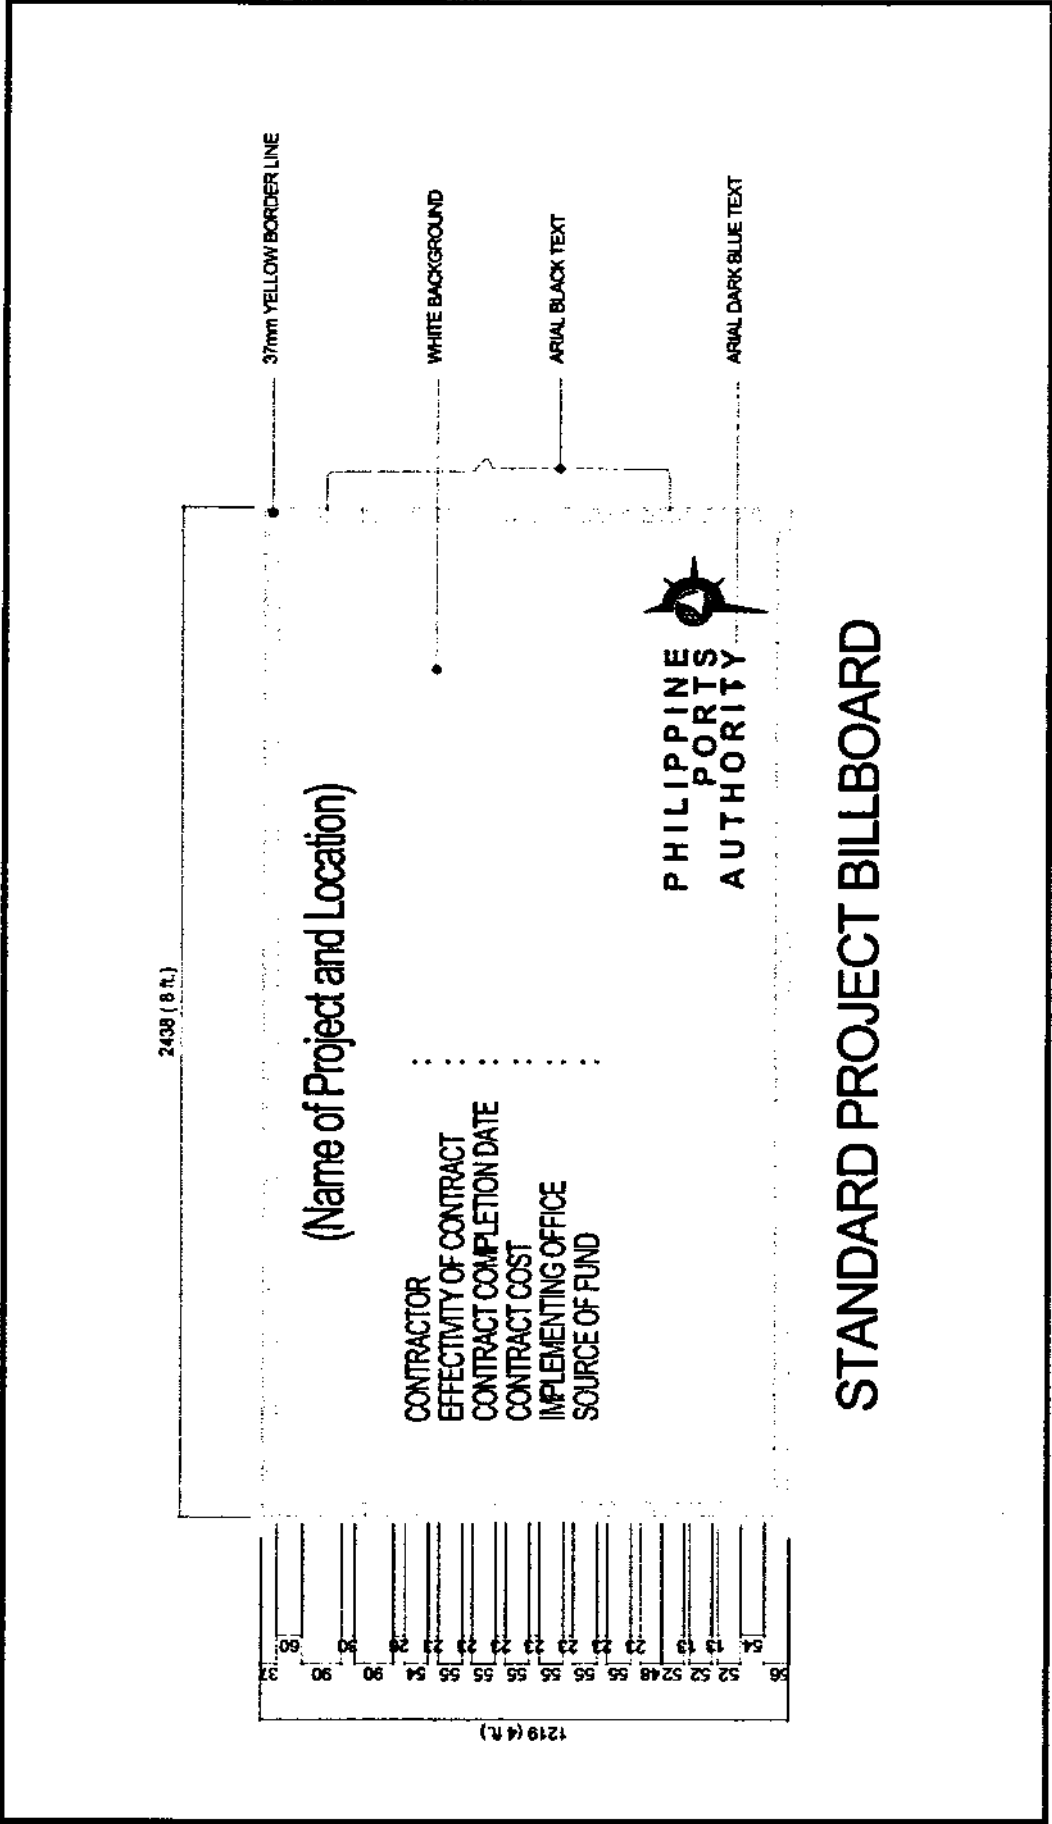



BILLBOARD FRAME

(NOT TO SCALE, ALL DIMENSIONS ARE IN MILLIMETERS)

ITEM 16 : SAFETY SIGNAGES AND BARRICADES

DESCRIPTION

This work includes the furnishing and installing of safety signages and barricades in accordance with the specifications and to the details shown below in the drawings, or as directed by the Engineer.


SPECIFICATION

The Signage's and Barricades shall be installed at location(s) designated by the Engineer.

The sizes of the standard signages shall be 2-2/3ft x 4ft (800mm X 1,200mm) for fixed type and 2ft x 2-2/3ft (600mm x 800mm) for mobile type. For barricade standard 2ft x 2-2/3ft (600mm x 800mm) shall be provided.

The materials to be used for signages and barricades are ½ inch (12mm) marine plywood or tarpaulin poster on 2" x 2" (50mm x 50mm) good lumber frame (see drawing below).

The printing or painting shall be the discretion of the Engineer.



STANDARD PLAN FOR SIGNAGES AND BARRICADES

SECTION VII

PROJECT DRAWINGS

SECTION VII

PROJECT DRAWINGS

(SEE ISSUED APPROVED PLANS)

LIST OF DRAWINGS:

01 of 17	Vicinity Map, Development Plan, General Notes and List of Drawings
02 of 17	General Plan
03 of 17	Paving Plan
04 of 17	Section A-A, Section B-B, Section C-C, Section D-D, Section E-E
05 of 17	Section F-F, Section G-G, Section H-H, Section I-I, Section J-J
06 of 17	Section K-K, Section L-L, Section M-M, Detail of Retaining Wall-1 & 2, Detailed Section of Stair Landing, Typical Pavement Joint, Reinforcement Detail of Mooring Cleat
07 of 17	Piling Plan (Proposed Platform and Roro Ramp), Typical Reinforcement of R.C. Deck (Proposed Platform), Pile Schedule (Proposed Platform and Roro Ramp)
08 of 17	Section Detail (Proposed Platform), Detail of Construction Joint
09 of 17	Typical Detail of Mooring Tee Head Block, Typical Detail of Pile Cap for Vertical & Batter Piles
10 of 17	Detail of Roro-Ramp
11 of 17	Detail of Breasting Dolphin
12 of 17	Detail of Pre-Stress Concrete Pile (450mm X 450mm)
13 of 17	Detail of Rubber Dock Fender (V-500H X 1500L), Detail of 35 Tons Mooring Bollard (Tee Head)
14 of 17	Detail of Fence
17 of 17	Port Lighting Layout Plan, General Notes, Legend
16 of 17	Detail of Single Angle Bar Floodlight Steel Tapered & Lamp Post Foundation, Single Angle Bar Floodlight Steel Tapered Lamp Post, Floodlight Post Connection Details, LED Floodlight Fixture 100 Watt, Specification
17 of 17	Schedule of Load, Riser Diagram, Detail of Concrete Pedestal Post

SECTION VIII

BILL OF QUANTITIES
and
ATTACHMENTS

BILL OF QUANTITIES
DONA HELENE PORT EXPANSION PROJECT
Port of Dona Helene, Socorro, Surigao del Norte

NO. (1)	DESCRIPTION OF WORK (2)	UNIT (3)	QTY. (4)	UNIT PRICE (Pesos) (5)	AMOUNT (Pesos) (4) x (5)
BILL NO. 1	GENERAL EXPENSES				
1.01	Mobilization, demobilization and cleaning	lot	1		
1.02	Rental of temporary site office and residence for the Engineer and staff	mo.	12		
1.03	Maintain temporary site office and residence for the Engineer and staff	mo.	12		
1.04	Provide Construction Safety and Health Program in the execution of the project	mo.	12		
TOTAL FOR BILL NO. 1					.

BILL OF QUANTITIES

DONA HELENE PORT EXPANSION PROJECT
Port of Dona Helene, Socorro, Surigao del Norte

NO. (1)	DESCRIPTION OF WORK (2)	UNIT (3)	QTY. (4)	UNIT PRICE (Pesos) (5)	AMOUNT (Pesos) (4) x (5)
BILL NO. 2	UPGRADING OF EXISTING BACK-UP AREA AND ROCK CAUSEWAY				
2.01	Excavate, backfill and compaction of existing fill materials for retaining wall and electrical post foundation	cu.m.	77		
2.02	Demolish and dispose of existing building structure	sq.m.	124		
2.03	Demolish and dispose foundation of existing rc curb up to required elevation	cu.m.	76		
2.04	Demolish and dispose existing concrete pavement	sq.m.	431		
2.05	Subgrade preparation	sq.m.	1,422		
2.06	Scrape/cut and dispose existing materials	cu.m.	285		
2.07	Supply, spread and compact selected fill materials	cu.m.	411		
2.08	Supply, spread and compact aggregate base course	cu.m.	274		
2.09	Supply and place portland cement concrete pavement (PCCP, 250mm thk.)	sq.m.	1,369		
2.10	Supply and place 3,500 psi concrete for retaining wall and perimeter fence column	cu.m.	98		
2.11	Supply and install steel reinforcement for retaining wall, perimeter fence column and CHB	kg	8,951		
2.12	Construct CHB wall (150mm thk.) for perimeter fence	sq.m.	194		

BILL OF QUANTITIES
DONA HELENE PORT EXPANSION PROJECT
Port of Dona Helene, Socorro, Surigao del Norte

NO. (1)	DESCRIPTION OF WORK (2)	UNIT (3)	QTY. (4)	UNIT PRICE (Pesos) (5)	AMOUNT (Pesos) (4) x (5)
2.13	Supply and place plain cement plaster finish for CHB wall and column	sq.m.	525		
2.14	Supply, fabricate and install various materials for cyclone wire mesh fence	sq.m.	319		
2.15	Supply and place gravel bedding	cu.m.	44		
TOTAL FOR BILL NO. 2					-

BILL OF QUANTITIES
DONA HELENE PORT EXPANSION PROJECT
Port of Dona Helene, Socorro, Surigao del Norte

NO. (1)	DESCRIPTION OF WORK (2)	UNIT (3)	QTY. (4)	UNIT PRICE (Pesos) (5)	AMOUNT (Pesos) (4) x (5)
BILL NO. 3	CONSTRUCTION OF BACK-UP AREA				
3.01	Chipoff existing rc curb, flush to deck level and smoothened with mortar	l.m.	30		
3.02	Supply and place 1000 kg rocks	cu.m.	866		
3.03	Supply and place 50-100 kg rocks	cu.m.	1,571		
3.04	Supply and place 3,500 psi concrete for retaining wall, mooring cleat attachment, stairlanding, rc curb and perimeter fence column	cu.m.	141		
3.05	Supply and install steel reinforcement for retaining wall, mooring cleat attachment, stairlanding, rc curb, perimeter fence column and CHB	kg	11,271		
3.06	Supply and install geotextile fabric	sq.m.	850		
3.07	Supply and place sand and gravel fill	cu.m.	2,084		
3.08	Supply, spread and compact selected fill materials	cu.m.	578		
3.09	Supply, spread and compact aggregate base course	cu.m.	134		
3.10	Supply and place portland cement concrete pavement (PCCP, 250mm thk.)	sq.m.	668		
3.11	Construct CHB wall (150mm thk.) for perimeter fence	sq.m.	26		
3.12	Supply and place plain cement plaster finish for CHB wall and column	sq.m.	64		

BILL OF QUANTITIES
DONA HELENE PORT EXPANSION PROJECT
Port of Dona Helene, Socorro, Surigao del Norte

NO. (1)	DESCRIPTION OF WORK (2)	UNIT (3)	QTY. (4)	UNIT PRICE (Pesos) (5)	AMOUNT (Pesos) (4) x (5)
3.13	Supply, fabricate and install various materials for cyclone wire mesh fence	sq.m.	42		
3.14	Supply and deliver to site mooring cleat including accessories.	set	5		
3.15	Install mooring cleat including accessories	set	5		
3.16	Supply and install hot-dipped galvanized 100mm x 100mm x 10mm angle bar for construction joints including dowel bars	I.m.	15		
TOTAL FOR BILL NO. 3					-

BILL OF QUANTITIES
DONA HELENE PORT EXPANSION PROJECT
Port of Dona Helene, Socorro, Surigao del Norte

NO. (1)	DESCRIPTION OF WORK (2)	UNIT (3)	QTY. (4)	UNIT PRICE (Pesos) (5)	AMOUNT (Pesos) (4) x (5)
BILL NO. 4	CONSTRUCTION OF RC PLATFORM AND RORO RAMP				
4.01	Supply and deliver to site 0.45m x 0.45m PSC piles	l.m.	1,546		
4.02	Handle, pitch and drive 0.45m x 0.45m PSC vertical piles	l.m.	594		
4.03	Handle, pitch and drive 0.45m x 0.45m PSC batter piles	l.m.	952		
4.04	Chipping and cutting of driven PSC piles up to cut-off elevation including disposal of debris	no.	56		
4.05	Supply and place 3,500 psi concrete for superstructure	cu.m.	199		
4.06	Supply and install steel reinforcement for superstructure	kg	35,761		
4.07	Supply and deliver to site rubber dock fender (V-type 500H x 1500L)	set	4		
4.08	Install rubber dock fender including accessories	set	4		
4.09	Supply and deliver to site mooring bollard (35T, T-head) including accessories.	set	2		
4.10	Install mooring bollard including accessories	set	2		
4.11	Supply and install hot-dipped galvanized 100mm x 100mm x 10mm angle bar for construction joints including dowel bars	l.m.	37		
TOTAL FOR BILL NO. 4					-

BILL OF QUANTITIES
DONA HELENE PORT EXPANSION PROJECT
Port of Dona Helene, Socorro, Surigao del Norte

NO. (1)	DESCRIPTION OF WORK (2)	UNIT (3)	QTY. (4)	UNIT PRICE (Pesos) (5)	AMOUNT (Pesos) (4) x (5)
BILL NO. 5	CONSTRUCTION OF BREASTING DOLPHIN				
5.01	Supply and deliver to site 0.45m x 0.45m PSC piles	l.m.	518		
5.02	Handle, pitch and drive 0.45m x 0.45m PSC vertical piles	l.m.	112		
5.03	Handle, pitch and drive 0.45m x 0.45m PSC batter piles	l.m.	406		
5.04	Chipping and cutting of driven PSC piles up to cut-off elevation including disposal of debris	no.	18		
5.05	Supply and place 3,500 psi concrete for breasting dolphin	cu.m.	33		
5.06	Supply and install steel reinforcement for breasting dolphin	kg	1,070		
5.07	Supply and deliver to site rubber dock fender (V-type 500H x 1500L)	set	2		
5.08	Install rubber dock fender including accessories	set	2		
5.09	Supply and deliver to site mooring bollard (35T, T-head) including accessories.	set	2		
5.10	Install mooring bollard including accessories	set	2		
TOTAL FOR BILL NO. 5					-

BILL OF QUANTITIES
DONA HELENE PORT EXPANSION PROJECT
Port of Dona Helene, Socorro, Surigao del Norte

NO. (1)	DESCRIPTION OF WORK (2)	UNIT (3)	QTY. (4)	UNIT PRICE (Pesos) (5)	AMOUNT (Pesos) (4) x (5)
BILL NO. 6	PORT LIGHTING SYSTEM				
6.01	Supply, deliver and install electrical works for port lighting system as shown in the plan	lot	1		
6.02	Construct lamp post foundation	no.	4		
6.03	Construct pedestal post	no.	1		
TOTAL FOR BILL NO. 6					-

BILL OF QUANTITIES
DONA HELENE PORT EXPANSION PROJECT
Port of Dona Helene, Socorro, Surigao del Norte

NO. (1)	DESCRIPTION OF WORK (2)	UNIT (3)	QTY. (4)	UNIT PRICE (Pesos) (5)	AMOUNT (Pesos) (4) x (5)
BILL NO. 7	REIMBURSABLE ITEMS				
7.01	Provide reimbursable items necessary in the implementation of the project as determined by the Authority	lot	1	1,385,810.44	1,385,810.44
TOTAL FOR BILL NO. 7					1,385,810.44

BASIS OF PAYMENT FOR WORK ITEMS INCLUDED IN THE PROPOSAL

The work items included in the proposal and the basis of payments are as follows:

BILL NO. 1

GENERAL EXPENSES

Item 1.01 Mobilization, demobilization and cleaning

The quantity to be paid for shall be the minimum equipment requirement enumerated in the bid documents mobilized, demobilized and cleaning of the site and accepted by the Engineer. The contract lump sum price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to mobilize and demobilize all the minimum equipment requirement enumerated in the bid documents including cleaning of the site. Fifty percent (50%) of the total amount shall be payable after the mobilization activity while the remaining (50%) payable after demobilization and cleaning.

Item 1.02 Rental of temporary site office and residence for the Engineer and staff

The quantity to be paid for shall be the actual rental for temporary site office and residence for the engineer and staff and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary for the provision of temporary site office and residence for the engineer and staff at least 48.00 m²

Item 1.03 Maintain temporary site office and residence for the Engineer and staff

The quantity to be paid for shall be the actual services rendered in maintaining the site office and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the maintenance of the temporary site office and residence as well as other expenses such as provision for electric power, telephone bill, potable water supply, janitorial and security services.

Item 1.04 Provide construction safety and Health Program in the execution of the project

The quantity to be paid for shall be the actual implementation of construction safety and health program and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the implementation of the Construction Safety and Health Program, as required and approved by the Department of Labor and Employment (DOLE).

BILL NO. 2

UPGARDING OF EXISTING BACK-UP AREA AND ROCK CAUSEWAY

Item 2.01 Excavate, backfill and compaction of existing fill materials for retaining wall and electrical post foundation

The quantity to be paid for shall be the actual volume in cubic meter of existing fill materials for retaining wall and electrical post foundation to be excavated, backfilled and compacted in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 2.02 Demolish and dispose existing building structure

The quantity to be paid for shall be the actual area in square meter of existing building structure, demolished and disposed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 2.03 Demolish and dispose foundation of existing rc curb up to required elevation

The quantity to be paid for shall be the actual volume in cubic meter of foundation of existing rc curb, demolished and disposed up to required elevation in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 2.04 Demolish and dispose existing concrete pavement

The quantity to be paid for shall be the actual area in square meter of existing concrete pavement, demolished and disposed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 2.05 Subgrade preparation

The quantity to be paid for shall be the actual area in square meter of subgrade preparation in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 2.06 Scrape/cut and dispose existing materials

The quantity to be paid for shall be the actual volume in cubic meter of existing materials to be scraped/cut and disposed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 2.07 Supply, spread and compact selected fill materials

The quantity to be paid for shall be the actual volume in cubic meter of selected fill materials to be supplied, spread and compacted in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 2.08 Supply, spread and compact aggregate base course

The quantity to be paid for shall be the actual volume in cubic meter of aggregate base course, to be supplied, spread and compacted in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 2.09 Supply and place portland cement concrete pavement (PCCP, 250mm thk.)

The quantity to be paid for shall be the actual area in square meter of portland cement concrete pavement (PCCP, 250mm thk.) to be supplied and set-in-place in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 2.10 Supply and place 3,500 psi concrete for the retaining wall and perimeter fence column

The quantity to be paid for shall be the actual volume in cubic meter of 3,500 psi concrete for the retaining wall and perimeter fence column, supplied and set-in-place in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 2.11 Supply and install steel reinforcements for the retaining wall, perimeter fence column and CHB

The quantity to be paid for shall be the actual weight in kilogram of reinforcing steel bars for the retaining wall, perimeter fence column and CHB, supplied and installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 2.12 Construct CHB wall (150mm thk.) for perimeter fence

The quantity to be paid for shall be the actual area in square meter of CHB wall (150mm thk.) for perimeter fence, constructed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 2.13 Supply and place plain cement plaster finish for CHB wall and column

The quantity to be paid for shall be the actual area in square meter of plain cement plaster finish and column, supplied and set-in place in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full

compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 2.14 Supply, fabricate and install various materials for cyclone wire mesh fence

The quantity to be paid for shall be the actual area in square meter of various materials for cyclone wire mesh fence, supplied, fabricated and installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 2.15 Supply and place gravel bedding

The quantity to be paid for shall be the actual volume in cubic meter of gravel bedding, supplied and set-in-place in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

BILL NO. 3

CONSTRUCTION OF BACK-UP AREA

Item 3.01 Chip off of existing RC curb, flush to deck level and smoothened with mortar

The quantity to be paid for shall be the actual length in linear meter of existing RC curb, flushed to deck level and smoothened with mortar in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 3.02 Supply and place 1000 kg. rocks

The quantity to be paid for shall be the actual volume in cubic meter of 1,000 kg. rocks, supplied and set-in-place in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 3.03 Supply and place 50-100 kg. rocks

The quantity to be paid for shall be the actual volume in cubic meter of 50-100 kg. rocks, supplied and set-in-place in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 3.04 Supply and place 3,500 psi concrete for the retaining wall, mooring cleat attachment, stair landing, rc curb and perimeter fence column

The quantity to be paid for shall be the actual volume in cubic meter of 3,500 psi concrete for the retaining wall, mooring cleat attachment, stair landing, rc curb and perimeter fence column, supplied and set-in-place in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 3.05 Supply and install steel reinforcements for the retaining wall, mooring cleat attachment, stair landing, rc curb, perimeter fence column and CHB

The quantity to be paid for shall be the actual weight in kilogram of reinforcing steel bars for the retaining wall, mooring cleat attachment, stair landing, rc curb, perimeter fence column and CHB, supplied and installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 3.06 Supply and install geotextile fabric

The quantity to be paid for shall be the actual area in square meter of geotextile filter fabric, supplied and installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 3.07 Supply and place sand and gravel fill

The quantity to be paid for shall be the actual volume in cubic meter of sand and gravel fill, supplied and set-in-place in accordance with the plans and specifications and accepted by the Engineer. Hydrographic/Topographic Surveys before and after placing of sand and gravel fill shall be made to determine the actual elevations along the cross sections and the actual quantities for payment. Volume due to settlement as established using settlement plates shall also be considered for payment. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 3.08 Supply, spread and compact selected fill materials

The quantity to be paid for shall be the actual volume in cubic meter of selected fill materials to be supplied, spread and compacted in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 3.09 Supply, spread and compact aggregate base course

The quantity to be paid for shall be the actual volume in cubic meter of aggregate base course, to be supplied, spread and compacted in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 3.10 Supply and place portland cement concrete pavement (PCCP, 250mm thk.)

The quantity to be paid for shall be the actual area in square meter of portland cement concrete pavement (PCCP, 250mm thk.) to be supplied and set-in-place in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 3.11 Construct CHB wall (150mm thk.) for perimeter fence

The quantity to be paid for shall be the actual area in square meter of CHB wall (150mm thk.) for perimeter fence, constructed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 3.12 Supply and place plain cement plaster finish for CHB wall and column

The quantity to be paid for shall be the actual area in square meter of plain cement plaster finish and column, supplied and set-in place in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 3.13 Supply, fabricate and install various materials for cyclone wire mesh fence

The quantity to be paid for shall be the actual area in square meter of various materials for cyclone wire mesh fence, supplied, fabricated and installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 3.14 Supply and deliver to site mooring cleat including accessories

The quantity to be paid for shall be the actual quantity in set of mooring cleat including accessories, supplied and delivered to site in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 3.15 Install mooring cleat including accessories

The quantity to be paid for shall be the actual quantity in set of mooring cleat including accessories, installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 3.16 Supply and install hot-dipped galvanized 100mm x 100mm x 10mm angle bar for construction joints including dowel bars

The quantity to be paid for shall be the actual length in linear meter of hot-dipped galvanized 100mm x 100mm x 10mm angle bar for construction joints including dowel bars, supplied and installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

BILL NO. 4

CONSTRUCTION OF RC PLATFORM AND RORO RAMP

Item 4.01 Supply and deliver to site 0.45m x 0.45m PSC piles

The quantity to be paid for shall be the actual length in linear meter of PSC piles (0.45m x 0.45m), supplied and delivered to site in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 4.02 Handle, pitch and drive 0.45m x 0.45m PSC vertical piles

The quantity to be paid for shall be the actual length in linear meter of 0.45m x 0.45m PSC vertical piles, handled, pitched and driven in accordance with the plans and specifications, measured from the tip of piles to cut-off elevation and accepted by the Engineers. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 4.03 Handle, pitch and drive 0.45m x 0.45m PSC batter piles

The quantity to be paid for shall be the actual length in linear meter of 0.45m x 0.45m PSC batter piles, handled, pitched and driven in accordance with the plans and specifications, measured from the tip of piles to cut-off elevation and accepted by the Engineers. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 4.04 Chipping and cutting of driven PSC piles up to cut off elevation including disposal of debris

The quantity to be paid for shall be the actual number of driven PSC piles to be chipped and cut off up to required elevation including disposal of debris in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 4.05 Supply and place 3,500 psi concrete for superstructure

The quantity to be paid for shall be the actual volume in cubic meter of 3,500 psi concrete, supplied and set-in-place in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 4.06 Supply and install steel reinforcements for superstructure

The quantity to be paid for shall be the actual weight in kilogram of reinforcing steel bars, supplied and installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 4.07 Supply and deliver to site rubber dock fender (V-type 500H x 1500L) including accessories

The quantity to be paid for shall be the actual quantity in set of rubber dock fender (V-type 500H x 1500L) including accessories, supplied and delivered to site in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 4.08 Install rubber dock fender including accessories

The quantity to be paid for shall be the actual quantity in set of rubber dock fender including accessories, installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 4.09 Supply and deliver to site mooring bollard (35T, T-head) including accessories

The quantity to be paid for shall be the actual quantity in set of mooring bollard (35 Tons, T-head) including accessories, supplied and delivered to site in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 4.10 Install mooring bollard including accessories

The quantity to be paid for shall be the actual quantity in set of mooring bollard including accessories, installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 4.11 Supply and install hot-dipped galvanized 100mm x 100mm x 10mm angle bar for construction joints including dowel bars

The quantity to be paid for shall be the actual length in linear meter of hot-dipped galvanized 100mm x 100mm x 10mm angle bar for construction joints including dowel bars, supplied and installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

BILL NO. 5

CONSTRUCTION OF BREASTING DOLPHIN

Item 5.01 Supply and deliver to site 0.45m x 0.45m PSC piles

The quantity to be paid for shall be the actual length in linear meter of PSC piles (0.45m x 0.45m), supplied and delivered to site in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 5.02 Handle, pitch and drive 0.45m x 0.45m PSC vertical piles

The quantity to be paid for shall be the actual length in linear meter of 0.45m x 0.45m PSC vertical piles, handled, pitched and driven in accordance with the plans and specifications, measured from the tip of piles to cut-off elevation and accepted by the Engineers. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 5.03 Handle, pitch and drive 0.45m x 0.45m PSC batter piles

The quantity to be paid for shall be the actual length in linear meter of 0.45m x 0.45m PSC batter piles, handled, pitched and driven in accordance with the plans and specifications, measured from the tip of piles to cut-off elevation and accepted by the Engineers. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 5.04 Chipping and cutting of driven PSC piles up to cut off elevation including disposal of debris

The quantity to be paid for shall be the actual number of driven PSC piles to be chipped and cut off up to required elevation including disposal of debris in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 5.05 Supply and place 3,500 psi concrete for breasting dolphin

The quantity to be paid for shall be the actual volume in cubic meter of 3,500 psi concrete, supplied and set-in-place in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 5.06 Supply and install steel reinforcements for breasting dolphin

The quantity to be paid for shall be the actual weight in kilogram of reinforcing steel bars, supplied and installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 5.07 Supply and deliver to site rubber dock fender (V-type 500H x 1500L) including accessories

The quantity to be paid for shall be the actual quantity in set of rubber dock fender (V-type 500H x 1500L) including accessories, supplied and delivered to site in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 5.08 Install rubber dock fender including accessories

The quantity to be paid for shall be the actual quantity in set of rubber dock fender including accessories, installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 5.09 Supply and deliver to site mooring bollard (35 Tons, T-head) including accessories

The quantity to be paid for shall be the actual quantity in set of mooring bollard (35 Tons, T-head) including accessories, supplied and delivered to site in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 5.10 Install mooring bollard including accessories

The quantity to be paid for shall be the actual quantity in set of mooring bollard including accessories, installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

BILL NO. 6

PORT LIGHTING SYSTEM

Item 6.01 Supply, deliver and install electrical works for port lighting system as shown in the plan

The quantity to be paid for shall be the actual quantity in lot of electrical works for port lighting system as shown in the plan to be supplied, delivered and installed in accordance with the plans and specifications accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 6.02 Construct lamp post foundation

The quantity to be paid for shall be the actual number of lamp post foundation, constructed in accordance with the plans and specifications accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 6.03 Construct pedestal post

The quantity to be paid for shall be the actual number of pedestal post, constructed in accordance with the plans and specifications accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

BILL NO. 7

REIMBURSABLE ITEMS

- Item 7.01 Provide reimbursable items necessary in the implementation of the project as determined by the Authority.**

The quantity to be paid for shall be the actual quantity of determined items by the Authority deemed necessary in the implementation of the project, supplied, delivered and accepted by the Authority. Payment for said items shall be made only upon complete delivery/acceptance of such. The contract lump sum price shall be full compensation for providing all determined items. The Contractor's Profit and Overhead, Contingencies and Miscellaneous (OCM) should not be included in the cost of said items. The amount of bid should be fixed as indicated in the amount stated in the Bid Data Sheet [ITB Clause 13.1(a)] and as provided in the Bill of Quantities (BOQ). Claims for payment shall be supported by Official Receipt(s) (OR) and at least three (3) canvasses. The amount to be paid for shall be the price indicated in the OR but should not exceed the contract lump sum price. The determined items shall be the property of PPA. Operation and maintenance shall be borne by PPA.

FACILITIES TO BE PROVIDED FOR THE ENGINEER & HIS STAFF

TEMPORARY FACILITIES OF THE CONTRACTOR

The Contractor shall provide and maintain such temporary offices, stores, workshops, latrines, housing and messing accommodations as are necessary. The location, dimension and layout of such buildings and places shall be subject to the approval in writing of the Engineer. By the end of the contract, the Contractor shall remove all buildings and the area shall be cleared and graded as required by the Engineer.

SITE OFFICE AND RESIDENCE FOR THE ENGINEER & STAFF

The Contractor shall provide and maintain a temporary site office and residence with an area of at least 48 square meters for use of the Engineer and staff, including all the necessary electricity, water, communication services and consumables.

MINIMUM EQUIPMENT REQUIREMENTS

1	unit	Crane Barge (319 GW, minimum) with 60T crane, owned
1	unit	Crawler Crane (30T, minimum), owned
1	unit	Pile Hammer (Diesel, 13,500 kg.m.), owned
1	unit	Drop Hammer (2T, minimum), owned/leased
1	unit	Clamshell, owned
2	units	Concrete Mixer (1-bagger, minimum), owned
2	units	Concrete Vibrator (3.5 hp, minimum), owned
1	unit	Concrete Screeder, owned
1	unit	Concrete Cutter (5 hp, minimum), owned
2	units	Bar Cutter (electric, 25mm dia min.), owned
2	units	Bar Bender (electric, 25mm dia min.), owned
2	units	Dump Truck (8 cu.m., minimum), owned
1	unit	Water Truck with pump (1,000 gal., minimum), owned
1	unit	Air-Compressor (250 cfm, minimum), owned
2	units	Jack Hammer, owned
1	unit	Welding Machine (400 amp., minimum), owned
2	units	Oxy/Acetylene Cutting Outfit, owned
1	unit	Tugboat (500hp, minimum), owned/leased
1	unit	Road Roller (12.05T, vibratory, minimum), owned/leased
1	unit	Road Grader (125 hp, minimum), owned/leased
1	unit	Payloader (1.06cu.m., 93 hp, minimum), owned/leased
1	unit	Backhoe (0.40 cu.m., 94.30 hp, minimum), owned/leased
1	unit	Concrete Bucket, owned/ leased
2	units	Transit Mixer (5-6 cu.m. cap., minimum), owned/leased
2	units	Plate Compactor (5 hp, minimum), owned

CONSTRUCTION SAFETY AND HEALTH REQUIREMEN

The Contractor shall implement the construction safety and health program in accordance with the applicable provisions of the Occupational Safety and Health Standards (OSHS) of the Department of Labor and Employment (DOLE).

The Contractor, subject to the approval of the Engineer shall provide and maintain throughout the duration of the contract a medical room with at least 15 square meters together with all necessary supplies to be sited in the Contractor's main area.

The Contractor shall provide the following minimum requirements:

LABOR

1	no.	Safety Engineer / Officer
1	no.	Nurse / Health Officer

EQUIPMENT / MATERIALS

Personnel Protective Equipment

75	pcs.	Hard Hats
75	pcs.	Gloves
4	pcs.	Goggles
2	pcs.	Aprons
8	pcs.	Safety Belts
75	pcs.	Safety Shoes
8	pcs.	Life Lines

Safety Devices

1	lot	Barricades
1	lot	Warning signs
2	units	Fire extinguisher

Medical and First Aid System - For twelve (12) mos.

NOTE:

The Contractor shall provide the above-cited minimum construction safety and health requirements or as required by the Engineer.

SECTION IX

BIDDING FORMS

Bid Form

Date: _____

ITB No: _____

To: Philippine Ports Authority
Bonifacio Drive, South Harbor,
Port Area, Manila

We, the undersigned, declare that:

- (a) We have examined and have no reservation to the Bidding Documents, including Addenda, for the Contract **Dña Helene Port Expansion Project, Port of Dña Helene, Socorro, Surigao del Norte**;
- (b) We offer to execute the Works for this Contract in accordance with the Bid and Bid Data Sheet, General and Special Conditions of Contract accompanying this Bid;

The total price of our Bid, excluding any discounts offered below is:

BILL NO	DESCRIPTION	TOTAL AMOUNT
1	General Expenses	P
2	Upgrading of Existing Back-up Area and Rock Causeway	
3	Construction of Back-up Area	
4	Construction of RC Platform and Roro Ramp	
5	Construction of Breasting Dolphin	
6	Port Lighting System	
7	Reimbursable Items	
	TOTAL AMOUNT OF BID (including VAT)	P

The discounts offered and the methodology for their application are: insert information;

- (c) Our Bid shall be valid for a period of 120 days from the date fixed for the Bid submission deadline in accordance with the Bidding Documents, and it shall remain binding upon us and may be accepted at any time before the expiration of that period;

- (d) If our Bid is accepted, we commit to obtain a Performance Security in the amount of *[insert percentage amount]* percent of the Contract Price for the due performance of the Contract;
- (e) Our firm, including any subcontractors or suppliers for any part of the Contract, have nationalities from the following eligible countries: *[insert information]*;
- (f) We are not participating, as Bidders, in more than one Bid in this bidding process, other than alternative offers in accordance with the Bidding Documents;
- (g) Our firm, its affiliates or subsidiaries, including any subcontractors or suppliers for any part of the Contract, has not been declared ineligible by the Funding Source;
- (h) We understand that this Bid, together with your written acceptance thereof included in your notification of award, shall constitute a binding contract between us, until a formal Contract is prepared and executed; and
- (i) We understand that you are not bound to accept the Lowest Calculated Bid or any other Bid that you may receive.
- (j) We likewise certify/confirm that the undersigned, is the duly authorized representative of the bidder, and granted full power and authority to do, execute and perform any and all acts necessary to participate, submit the bid, and to sign and execute the ensuing contract for the **Dofia Helene Port Expansion Project, Port of Dofia Helene, Socorro, Surigao del Norte of the Philippine Ports Authority.**
- (k) We acknowledge that failure to sign each and every page of this Bid Form, including the Bill of Quantities, shall be a ground for the rejection of our bid.

Name: _____

In the capacity of: _____

Signed: _____

Duly authorized to sign the Bid for and on behalf of: _____

Date: _____

**STATEMENT OF ALL ON-GOING GOVERNMENT AND PRIVATE CONTRACTS,
INCLUDING CONTRACTS AWARDED BUT NOT YET STARTED, WHETHER SIMILAR OR NOT SIMILAR IN NATURE**

Name of the Contract or Title Of the Project 1]	Owner's Name and Address	Nature/ Scope of Work 2]	Contractor's Role (in percentage) 3]	Total Contract Value At		Date of Award 5]	Value of Outstanding Works	Estimated Time of Completion	% of Accomplishment		Contract Duration 5]	
				Award	Project Completion				Planned	Actual	Start	Completed
A) Government Contracts I. On-going ii. Awarded but not yet started B) Private Contracts I. On-going ii. Awarded but not yet started												

NOTE:

- 1] As appearing or defined in the contract entered/executed by the parties
- 2] With special reference to the Scope of Works as described/enumerated in the advertised Invitation To Bid.
- 3] Indicate whether as Sole Contractor, Sub-Contractor or Member in a Joint Venture / Consortium
- 4] Indicate the FOREX used if Contract Value is expressed in a currency other than the Philippine Peso. Specify the "Escalation Factor" used to escalate the Contract Value from completion date to the advertisement date of the Invitation to Bid per section 23.11.2 (3) of R.A. 9184.
- 5] State Month and Year.

This Statement shall be supported by:

- a) Notice of Award and/or Contract
- b) Notice to Proceed

Name of Firm/Applicant

Authorized Signing Official

Date

STATEMENT OF THE BIDDER'S SINGLE LARGEST COMPLETED CONTRACT (SLCC) SIMILAR TO THE CONTRACT TO BE BID

Name of the Contract or Title Of the Project	Owner's Name and Address	Nature/Scope of Work	Contractor's Role and Percentage Of Participation	Total Contract Value At		Date of Award	Value of Outstanding Works	Contract Duration	
				Award	Completion			Start	Completed

NOTE :

1. The prospective bidder must have completed an SLCC that is similar to the contract to be bid, and whose value, adjusted to current prices using the PSA consumer price indices, must be at least fifty percent (50%) of the ABC to be bid.
2. This Statement shall be supported by:
 - a. Notice of Award and / or Notice to Proceed.
 - b. Project Owner's Certificate of Final acceptance issued by the owner other than the Contractor or Constructors Performance Evaluation System (CPES) Final Rating, which must be at least satisfactory.

Name of Firm/Applicant

Authorized Signing Official

Date

EXPERIENCE RECORD ON SIMILARLY COMPLETED PROJECTS

Similar Major Operations of Work 1]	Unit of Measure	Quantity	Title of the Project				Unit of Measure	Quantity
			Title of the Project	Title of the Project	Title of the Project	Title of the Project		
1. Off-shore pile driving of concrete piles	l.m.	1,032						
2. Reinforced Concrete Works	cu.m.	236						
3. Rock Works a) 1000 kg./pc. b) 50-100 kg./pc.	cu.m. cu.m.	433 786						
4. Fill Materials	cu.m.	1,537						
5. Construction of Portland Cement Concrete Pavement (PCCP)	sq.m.	1,019						

NOTE: 1] Submit the Certificate of Completion/Certificate of Acceptance by the project owner, Final Recapitulation/Bill of Quantities and/or Constructor Performance Evaluation System (CPES) ratings, 1st, 2nd & Final visit (if applicable). Projects with no Certificate of Completion/Acceptance and Recapitulation/Bill of Quantities shall not be considered.

2] The Owner's Certificate of Final Acceptance; or the Constructors Performance Evaluation Summary (CPES) Final Rating and/or the Certificate of Completion, must be satisfactory.

Name of Firm/Applicant

Authorized Signing Official

Date

(Revised Form : September 2012)

FINANCIAL DATA

- A. The prospective bidder's audited Financial Statements, showing, among others, the prospective bidder's total and current assets and liabilities, stamped "RECEIVED" by the Bureau of Internal Revenue (BIR), or its duly accredited and authorized institutions, for the preceding calendar year which should not be earlier than two (2) years from the date of bid submission.

	Year
1. Total Assets	
2. Current Assets	
3. Total Liabilities	
4. Current Liabilities	
5. Net worth (1-3)	
6. Net Working Capital (2-4)	

- B. The computation of the bidders Net Financial Contracting Capacity (NFCC) must be at least equal to the ABC to be bid, as follows:

NFCC = [(Current assets minus current liabilities) (15)] minus the value of all outstanding or uncompleted portions of the projects under ongoing contracts, including awarded contracts yet to be started coinciding with the contract to be bid.

NFCC = _____

Attached herewith are certified true copies of the audited financial statements stamped received by the BIR or BIR authorized collecting agent for the latest/immediately preceding calendar year.

Name of Firm/Applicant

Authorized Signing Official

Date: _____

NOTES:

If Partnership or Joint Venture, each Partner or Member Firm of Joint venture shall submit separate financial statements.

LIST OF CONTRACTOR'S PERSONNEL

I hereby declare that the following key personnel enumerated below, with attached resume/bio-data, including valid PRC License, for the various positions / functions, are available for the project applied for:

Position of Key Personnel	Name	No. of Key Personnel	Similar Experience in the Position (Years) ¹⁾	Total Experience in the Position (Years)	Attachment(s)	Annex(es)
Project Manager					PRC License (CE Preferred) Complete Qualification and Experience Data Certificate of Commitment	Annex "A"
Project Engineer					PRC License (CE Preferred) Complete Qualification and Experience Data Certificate of Commitment	Annex "A"
Materials Engineer					PRC License (CE Preferred) Submit Valid and Renewed DPWH Certificate of Accreditation Submit Accreditation Identification Card as Materials Engineer Complete Qualification and Experience Data Certificate of Commitment	Annex "A"
Construction Safety and Health Officer					Certificate of Safety and Health Construction Related Course issued by DOLE Accredited Trainings Complete Qualification and Experience Data Certificate of Commitment	Annex "A"
Foreman					Complete Qualification and Experience Data Certificate of Commitment	Annex "A"
Other Position(s)					Complete Qualification and Experience Data Certificate of Commitment	Annex "A"

NOTE: 1. Minimum qualification requirements: (work experience is similar in nature and complexity to the project to be bid with regard to Registration Particulars of the Contractor's License)

Project Manager - Five (5) years	Materials Engineer - One (1) year
Project Engineer - Three (3) years	Materials Engineer I - for projects costing up to 100M
Foreman - Five (5) years	Materials Engineer II - for projects costing more than 100M

Name of Firm/Applicant

Authorized Signing Official

Date

REVISED FORM (September 2012)

LIST OF CONTRACTOR'S EQUIPMENT UNITS

I hereby declare that the following equipment listed below which are owned, leased or under purchase agreement are in good operating condition and are available for the duration of the project:

DESCRIPTION (Type, Model, Make)	No. of Unit(s)	Capacity Output 2]	Owned, Leased and/or under purchase agreement 1]	Submitted Proof of Ownership/Leased/ Purchase Agreement (Mark as Annex "A.....Z")	OTHER INFORMATION(S) (As Applicable)				
					Manufacturer	Engine Serial No.	Chassis No./ Name of Vessel	Location	Status

1] Indicate if owned or leased as listed in the Checklist/Bidding Documents. For owned equipment, as required, submit proof of ownership (i.e. deed of sale, sales invoice, official receipt). For Water Truck, Dump Truck and Transit Mixer submit LTO Certificate of Registration and valid Official Receipt. For owned barge/tugboat, submit Marina Certificate of Ownership and valid Cargo Ship Safety Certificate. For newly purchased barge/tugboat, submit Deed of Sale together with an application for Marina Certificate of Ownership duly received/authenticated by Marina with corresponding valid Cargo Ship Safety Certificate. For leased equipment, submit duly notarized copy of lease contract together with a copy of the Marina Owner's (Lessor's) Certificate and valid Cargo Ship Safety Certificate.

2] The unit of each equipment shall be as indicated in the Checklist/Bidding Documents, i.e GW (for crane barge), DWT (for deck barge and hopper barge), TON (for crane, road roller and drop hammer), kg.-m/blow (for diesel hammer), cu.m (for dump truck), hp. (for tugboat, road grader, bulldozer and concrete vibrator), cfm (for compressor), gal. (for water truck with pump), amp. (for welding machine), bagger (for concrete mixer).

Name of Firm/Applicant

Authorized Signing Official

Date

REVISED FORM (January 2011)

OMNIBUS SWORN STATEMENT FOR SOLE PROPRIETORSHIP

REPUBLIC OF THE PHILIPPINES)
CITY OF _____)SS

AFFIDAVIT

I (Name), of legal age, (Civil Status), (Nationality), and residing at (Address), after having been duly sworn in accordance with law, do hereby depose and state that:

1. I am the sole proprietor or authorized representative of (Name of Bidder) with office address at _____;
2. As the owner and sole proprietor or authorized representative of (Name of Bidder), I have full power and authority to do, execute and perform any and all acts necessary to participate, submit the bid, and to sign and execute the ensuing contract for (Name of Project) of the Philippine Ports Authority, (as shown in the attached duly notarized "Special Power of Attorney" for the authorized representative);
3. (Name of Bidder) is not "blacklisted" or barred from bidding by the Government of the Philippines or any of its agencies, offices, corporations, or Local Government Units, foreign government / foreign or international financing institution whose blacklisting rules have been recognized by the Government Procurement Policy Board;
4. Each of the documents submitted in satisfaction of the bidding requirements is an authentic copy of the original, complete, and all statements and information provided therein are true and correct;
5. (Name of Bidder) is authorizing the Head of the Procuring Entity or its duly authorized representative(s) to verify all the documents submitted;
6. The owner or sole proprietor is not related to the Head of Procuring Entity, members of the Bids and Awards Committee (BAC), the Technical Working Group, and the BAC Secretariat, the head of the Project Management office or the end – user unit, and the project consultants by consanguinity or affinity up to the third civil degree;
7. (Name of Bidder) complies with existing labor laws and standards; and
8. (Name of Bidder) is aware of and has undertaken the following responsibilities as a Bidder:
 - a) Carefully examine all of the Bidding Document;
 - b) Acknowledge all conditions, local or otherwise, affecting the implementation of the contract;
 - c) Made an estimate of the facilities available and needed for the contract to be bid, if any; and
 - d) Inquire or secure Supplemental / Bid Bulletin(s) issued for the *Doña Helene Port Expansion Project, Port of Doña Helene, Socorro, Surigao del Norte*.

9. (Name of Bidder) did not give or pay directly or indirectly, any commission, amount, fee, or any form of consideration, pecuniary or otherwise, to any person or official, personnel or representative of the government in relation to any procurement project or activity.

IN WITNESS WHEREOF, I have hereunto set my hand this ____ day of ____ 20__ at _____, Philippines.

Bidder's Representative / Authorized Signatory

SUBSCRIBED AND SWORN to before me this ____ day of [month] [year] at [place of execution], Philippines. Affiant/s is/are personally known to me and was/were identified by me through competent evidence of identity as defined in the 2004 Rules on Notarial Practice (A.M. No. 02-8-13-SC). Affiant/s exhibited to me his/her [insert type of government identification card used], with his/her photograph and signature appearing thereon, with no. _____ and his/her Community Tax Certificate No. _____ issued on ____ at _____.

Witness my hand and seal this ____ day of [month] [year].

NAME OF NOTARY PUBLIC

Serial No. of Commission _____
Notary Public for _____ until _____
Roll of Attorneys No. _____
PTR No. _____ [date issued], [place issued]
IBP No. _____ [date issued], [place issued]

Doc. No. _____
Page No. _____
Book No. _____
Series of _____

OMNIBUS SWORN STATEMENT FOR PARTNERSHIP OR COOPERATIVE

REPUBLIC OF THE PHILIPPINES)
CITY OF _____)SS

AFFIDAVIT

I (Name), of legal age, (Civil Status), (Nationality), and residing at (Address), after having been duly sworn in accordance with law, do hereby depose and state that:

1. I am the duly authorized and designated representative of (Name of Bidder) with office address at (Address);
2. I am granted full power and authority to do, execute and perform any and all acts necessary to participate, submit the bid, and to sign and execute the ensuing contract for (Name of Project) of the Philippine Ports Authority, accompanied by the duly notarized Special Power of Attorney, Board/Partnership Resolution or Secretary's Certificate (whichever is applicable);
3. (Name of Bidder) is not "blacklisted" or barred from bidding by the Government of the Philippines or any of its agencies, offices, corporations, or Local Government Units, foreign government / foreign or international financing institution whose blacklisting rules have been recognized by the Government Procurement Policy Board;
4. Each of the documents submitted in satisfaction of the bidding requirements is an authentic copy of the original, complete, and all statements and information provided therein are true and correct;
5. (Name of Bidder) is authorizing the PPA General Manager or its duly authorized representative(s) to verify all the documents submitted;
6. None of the officers and members of (Name of Bidder) is related to the PPA General Manager, members of the Bids and Awards Committee (BAC), the Technical Working Group, and the BAC Secretariat, the head of the Project Management office or the end- user unit, and the project consultants by consanguinity or affinity up to the third civil degree;
7. (Name of Bidder) complies with existing labor laws and standards; and
8. (Bidder) is aware of and has undertaken the following responsibilities as a Bidder:
 - a) Carefully examine all of the Bidding Document;
 - b) Acknowledge all conditions, local or otherwise, affecting the implementation of the contract;
 - c) Made an estimate of the facilities available and needed for the contract to be bid, if any; and
 - d) Inquire or secure Supplemental / Bid Bulletin(s) issued for the *Dofia Helene Port Expansion Project, Port of Dofia Helene, Socorro, Surigao del Norte*.

9. (Name of Bidder) did not give or pay directly or indirectly, any commission, amount, fee, or any form of consideration, pecuniary or otherwise, to any person or official, personnel or representative of the government in relation to any procurement project or activity.

IN WITNESS WHEREOF, I have hereunto set my hand this ____ day of ____ 20__ at _____, Philippines.

Bidder's Representative / Authorized Signatory

SUBSCRIBED AND SWORN to before me this ____ day of [month] [year] at [place of execution], Philippines. Affiant/s is/are personally known to me and was/were identified by me through competent evidence of identity as defined in the 2004 Rules on Notarial Practice (A.M. No. 02-8-13-SC). Affiant/s exhibited to me his/her [insert type of government identification card used], with his/her photograph and signature appearing thereon, with no. _____ and his/her Community Tax Certificate No. _____ issued on ____ at _____.

Witness my hand and seal this ____ day of [month] [year].

NAME OF NOTARY PUBLIC

Serial No. of Commission _____

Notary Public for _____ until _____

Roll of Attorneys No. _____

PTR No. _____ [date issued], [place issued]

IBP No. _____ [date issued], [place issued]

Doc. No. _____

Page No. _____

Book No. _____

Series of _____

OMNIBUS SWORN STATEMENT FOR CORPORATION OR JOINT VENTURE

REPUBLIC OF THE PHILIPPINES)
CITY OF _____)SS

AFFIDAVIT

I (Name), of legal age, (Civil Status), (Nationality), and residing at (Address), after having been duly sworn in accordance with law, do hereby depose and state that:

1. I am the duly authorized and designated representative of (Name of Bidder) with office address at _____:
2. I am granted full power and authority to do, execute and perform any and all acts necessary to participate, submit the bid, and to sign and execute the ensuing contract for (Name of Project) of the Philippine Ports Authority, accompanied by the duly notarized Special Power of Attorney, Board Resolution or Secretary's Certificate;
3. (Name of Bidder) is not "blacklisted" or barred from bidding by the Government of the Philippines or any of its agencies, offices, corporations, or Local Government Units, foreign government / foreign or international financing institution whose blacklisting rules have been recognized by the Government Procurement Policy Board;
4. Each of the documents submitted in satisfaction of the bidding requirements is an authentic copy of the original, complete, and all statements and information provided therein are true and correct;
5. (Name of Bidder) is authorizing the PPA General Manager or its duly authorized representative(s) to verify all the documents submitted;
6. None of the officers, directors, and controlling stockholders of (Name of Bidder) is related to the PPA General Manager, members of the Bids and Awards Committee (BAC), the Technical Working Group, and the BAC Secretariat, the head of the Project Management office or the or end- user unit, and the project consultants by consanguinity or affinity up to the third civil degree;
7. (Name of Bidder) complies with existing labor laws and standards; and
8. (Name of Bidder) is aware of and has undertaken the following responsibilities as a Bidder:
 - a) Carefully examine all of the Bidding Document;
 - b) Acknowledge all conditions, local or otherwise, affecting the implementation of the contract;
 - c) Made an estimate of the facilities available and needed for the contract to be bid, if any; and
 - d) Inquire or secure Supplemental / Bid Bulletin(s) issued for the *Dofia Helene Port Expansion Project, Port of Dofia Helene, Socorro, Surigao del Norte*.

9. (Name of Bidder) did not give or pay directly or indirectly, any commission, amount, fee, or any form of consideration, pecuniary or otherwise, to any person or official, personnel or representative of the government in relation to any procurement project or activity.

IN WITNESS WHEREOF, I have hereunto set my hand this ____ day of ____ 20__ at _____, Philippines.

Bidder's Representative / Authorized Signatory

SUBSCRIBED AND SWORN to before me this ____ day of [month] [year] at [place of execution], Philippines. Affiant/s is/are personally known to me and was/were identified by me through competent evidence of identity as defined in the 2004 Rules on Notarial Practice (A.M. No. 02-8-13-SC). Affiant/s exhibited to me his/her [insert type of government identification card used], with his/her photograph and signature appearing thereon, with no. _____ and his/her Community Tax Certificate No. _____ issued on ____ at _____.

Witness my hand and seal this ____ day of [month] [year].

NAME OF NOTARY PUBLIC

Serial No. of Commission _____

Notary Public for _____ until _____

Roll of Attorneys No. _____

PTR No. _____ [date issued], [place issued]

IBP No. _____ [date issued], [place issued]

Doc. No. _____

Page No. _____

Book No. _____

Series of _____

REPUBLIC OF THE PHILIPPINES)
CITY OF _____)S.S.

BID-SECURING DECLARATION
Invitation to Bid No. _____

To : Philippine Ports Authority
Bonifacio Drive, South Harbor,
Port Area, Manila

I, the undersigned, declare that:

1. I understand that, according to your conditions, bids must be supported by a Bid Security, which may be in the form of a Bid-Securing Declaration.
2. I/We accept that: (a) I/we will be automatically disqualified from bidding for any contract with any procuring entity for a period of two (2) years upon receipt of your Blacklisting Order; and, (b) I/we will pay the applicable fine provided under Section 6 of the Guidelines on the Use of Bid Securing Declaration, within fifteen (15) days from receipt of the written demand by procuring entity for the commission of acts resulting to the enforcement of the bid securing declaration under Sections 23.1 (b), 34.2, 40.1 and 69.1, except 69.1(f), of the IRR of RA 9184; without prejudice to other legal action the government may undertake:
3. I understand that this Bid-Securing Declaration shall cease to be valid on the following circumstances:
 - (a) Upon expiration of the bid validity period, or any extension thereof pursuant to your request;
 - (b) I am declared ineligible or post-disqualified upon receipt of your notice to such effect, and (i) I failed to timely file a request for reconsideration or (ii) I filed a waiver to avail of said right;
 - (c) I am declared as the bidder with the Lowest Calculated Responsive Bid, and I have furnished the performance security and signed the Contract.

IN WITNESS WHEREOF, I have hereunto set my hand this _____ day of _____ 20 ____ at _____, Philippines.

Name of Bidder's Authorized Representative
(Signatory's Legal Capacity)
AFFIANT

SUBSCRIBED AND SWORN to before me this ____ day of *[month]* *[year]* at *[place of execution]*, Philippines. Affiant/s is/are personally known to me and was/were identified by me through competent evidence of identity as defined in the 2004 Rules on Notarial Practice (A.M. No. 02-8-13-SC). Affiant/s exhibited to me his/her *[insert type of government identification card used]*, with his/her photograph and signature appearing thereon, with no. _____.

Witness my hand and seal this ____ day of *[month]* *[year]*.

NAME OF NOTARY PUBLIC

Serial No. of Commission _____
Notary Public for _____ until _____
Roll of Attorneys No. _____
PTR No. __, *[date issued]*, *[place issued]*
IBP No. __, *[date issued]*, *[place issued]*
Doc. No. ____
Page No. ____
Book No. ____
Series of ____.

CONSTRUCTION METHODOLOGY

Name of Project : _____
Proposed Project Description : _____
Location : _____

MINIMUM SCOPE OF CONSTRUCTION METHODOLOGY

A. UPGRADING OF EXISTING BACK-UP AREA AND ROCK CAUSEWAY

(Area = 1,421.20 sq.m)

1. Demolish and dispose existing building structure (124 sq.m.), existing concrete pavement (431 sq.m.) and foundation of existing rc curb up to required elevation (76.00 cu.m.)
2. Excavate/backfill and compaction of existing fill materials (77 cu.m.), scarping/cutting of existing materials (285 cu.m.) including subgrade preparation (1,422 sq.m.)
3. Supply and place additional fill materials (411 cu.m.) and reinforced concrete for retaining wall and perimeter fence column (98 cu.m. of concrete and 8,951 kg. of reinforcing steel bars of various sizes)
4. Construction of portland cement concrete pavement (250mm thk., 1,369.00sq.m.) including aggregate base course (274 cu.m.) and gravel bedding (44.00 cu.m.)
5. Construction of CHB wall (194 sq.m.), including plastering (525 sq.m.), and various materials for cyclone wire mesh (319 sq.m.)

B. CONSTRUCTION OF BACK-UP AREA

(Area = 690.00 sq.m)

1. Chipping of existing rc curb, flush to deck level and smoothened with mortar (30 l.m.)
2. Construction of rock bulkhead (2,437 cu.m.), fill materials (2,662 cu.m.), reinforced concrete for retaining wall, mooring cleat attachment, stairlanding, rc curb and perimeter fence column (141 cu.m. of concrete and 11,271 kg of reinforcing steel bars of various sizes)
3. Supply and install geotextile fabric (850 sq.m.) and mooring cleat (5 sets)
4. Construction of portland cement concrete pavement (250mm thk., 668 sq.m.) including aggregate base course (134 cu.m.)
5. Construction of CHB wall (26 sq.m.), including plastering (64 sq.m.), and various materials for cyclone wire mesh (42 sq.m.)

C. CONSTRUCTION OF RC PLATFORM AND RORO RAMP

(Area = 369.00 sq.m)

1. Supply and drive 450mm x 450mm PSC piles (1,546 l.m.), including chipping and cutting of newly driven piles up to required elevation (56 pcs), supply and place 3,500 psi reinforced concrete (199 cu.m.) and steel bars (35,761 kg of various sizes) for superstructure
2. Supply and install rubber dock fenders, V-type, 500H x 1,500L (4 sets) and mooring bollards, 35 Tons, T-head (2 sets)

**D. CONSTRUCTION OF BREASTING DOLPHIN
(Number = 2 sets)**

1. Supply and drive 0.45m x 0.45m PSC piles (518 l.m.), including chipping/cutting (18 pcs.)
2. Construction of reinforced concrete for breasting dolphin (33 cu.m. of concrete and 1,070 kg. of reinforcing bars of various sizes)
3. Supply and install rubber dock fenders, V-type, 500H x 1,500L (2 sets) and mooring bollards, 35 Tons, T-head (2 sets)

E. PORT LIGHTING SYSTEM

1. Supply and installation of single angle bar floodlight steel post, 10.00m ht., hot dipped galvanized (4 sets) with 100 watt LED floodlight fixture (8 sets)

NOTES:

The narrative construction method will guide and familiarize the contractor and the PPA on how the project shall be carried out in accordance with the highest standard of workmanship.

The construction method shall be consistent with the Bar Chart / S-Curve Schedule, Equipment Schedule and Manpower Schedule.

Signature
(Authorized Signing Official)

MANPOWER SCHEDULE

Name of Project : _____

Proposed Project Description : _____

Location : _____

MANPOWER (Minimum)	CONTRACT DURATION (_____ Calendar Days)											
	M O N T H L Y											
	1	2	3	4	5	6	7	8	9	10	11	12
Project Manager												
Project Engineer												
Materials Engineer												
Construction Safety and Health Officer												
Foreman												
Specify other applicable positions, ie.:												
- Carpenter												
- Steelman												
- Mason												
- Electrician												
- Rigger												
- Others												

Signature
(Authorized Signing Official)

EQUIPMENT UTILIZATION SCHEDULE

Name of Project : _____

Proposed Project Description : _____

Location : _____

[illegible]

Signature
(Authorized Signing Official)

CASHFLOW BY QUARTER AND PAYMENT SCHEDULE

Name of Project: : _____

Proposed Project Description : _____

Location : _____

Project Duration (days or months)	Payment Schedule (Monthly, in Pesos)	Cash flow (Quarterly, in Pesos)
TOTAL		

NOTES

- The cash flow by quarter and payment schedule should be consistent with the Bar Chart and S-curb.
- Payment schedule shall not be more than once a month.

Signature
(Authorized Signing Official)

SECTION X

CONTRACT FORM

Republic of the Philippines
PHILIPPINE PORTS AUTHORITY
PPA Building, Bonifacio Drive, South Harbor,
Port Area, Manila, Philippines

CONTRACT
FOR THE DOÑA HELENE PORT EXPANSION PROJECT
PORT OF DOÑA HELENE, SOCORRO SURIGAO DEL NORTE

This Contract made and entered into this _____ day of _____ 2019, in Manila, Philippines, by and between:

PHILIPPINE PORTS AUTHORITY, a government instrumentality created under Presidential Decree No. 857, as amended, with principal office at PPA Building, Bonifacio Drive, South Harbor, Port Area, Manila, represented herein by its duly authorized General Manager, **JAY DANIEL R. SANTIAGO**, and hereinafter referred to as "PPA";

- and -

_____, duly organized and existing in accordance with Philippine laws, with office and business address at _____, represented in this act by its _____, as evidenced by _____, a copy of which is hereto attached and made an integral part hereof as Annex "A", and hereinafter referred to as "CONTRACTOR."

WITNESSETH:

WHEREAS, in accordance with Republic Act No. 9184 and its 2016 Implementing Rules and Regulations (IRR), PPA advertised and posted on the PPA website and PhilGEPS, as well as on its bulletin board, an Invitation to Bid for the _____;

WHEREAS, in response to the said advertisement _____ bidders submitted their respective bids for the foregoing project;

WHEREAS, after the opening of bids on _____ and the conduct of bid evaluation and post-qualification, the bid submitted by the CONTRACTOR at its unit and lump sum prices set forth in its proposal was found to be the _____ Bid in the amount of _____ PESOS (), Philippine Currency;

WHEREAS, pursuant to Head Office BAC Resolution No. _____ Series of _____, award of contract was made to the CONTRACTOR in a Notice of Award dated _____, in the amount of _____ PESOS (), after submission of the required documents within the prescribed period and compliance to the conditions stipulated in the IRR;

WHEREAS, the CONTRACTOR duly accepted the award by signing its Conforme on the said Notice of Award;

NOW, THEREFORE, for and in consideration of the foregoing premises and the mutual stipulations herein contained, PPA and the CONTRACTOR have agreed, as follows:

1. In this Contract, words and expressions shall have the same meanings as are respectively assigned to them in the attached Contract Documents.
2. The following documents shall form part of this Contract:
 - A. Bid Documents consisting of the following:
 - A.1 Invitation to Bid;
 - A.2 Instructions to Bidders;
 - A.3 Bid Data Sheet;
 - A.4 General and Special Conditions of Contract;
 - A.5 Specifications
 - A.6 Drawings/Plans;
 - A.7 Addenda and/or Supplemental/Bid Bulletins, if any;
 - B. Technical and Financial Proposals;
 - C. Performance Security;
 - D. Notice of Award of Contract with the Contractor's Conforme thereto; and
 - E. Other contract documents that may be required by existing laws and PPA, such as:
 - E.1 Construction Schedule and S-Curve;
 - E.2 Manpower Schedule;
 - E.3 Construction Methods;
 - E.4 Equipment Utilization Schedule;
 - E.5 Construction Safety and Health Program approved by the DOLE;
 - E.6 Per/CPM
 - E.7 Duly Approved Program of Works and Cost Estimates;
 - E.8 Certificate of Availability of Funds;
 - E.9 Abstract of Bids; and
 - E.10 Resolution of Award
3. In consideration of the payments to be made by PPA, the CONTRACTOR commits to complete the Works and remedy any defects therein in conformity with the provisions of this Contract and Contract Documents.
4. In consideration of the execution and completion of the Works and remedying any defects therein, PPA commits to pay the Contract Price or such other sum as may become payable under the provisions of this Contract and Contract Documents.

5. This Contract shall become effective after the same shall have been signed by the Parties hereof.

IN WITNESS WHEREOF, the Parties have hereunto signed this Contract on the date and place first hereinabove written.

PHILIPPINE PORTS AUTHORITY

TIN No. _____

By:

JAY DANIEL R. SANTIAGO

General Manager

WITNESSES:

ACKNOWLEDGMENT