

5. Supports shall be provided in conformance with ACI 315 and ACI 318, unless otherwise indicated or specified.
6. Concrete Protection for Reinforcement
 - a. The minimum concrete cover of reinforcement shall be as shown below unless otherwise indicated in the drawings.
 - b. Tolerance for Concrete Cover of Reinforcing Steel other than Tendons.

Minimum Cover

7.5cm or more (marine structures and concrete cast against and permanently exposed to earth)

DESIGN STRENGTH OF CONCRETE

Concrete for structural parts or members such as beams, slabs, curtain wall, pile caps and fender/mooring blocks shall develop a minimum 28-day compressive cylinder strength of 24 MPa (3,500 psi) as indicated in the drawings. While for pre-stressed concrete piles a compressive strength of 35 MPa (5,000psi).

TRIAL BATCH FOR CONCRETE

Thirty (30) calendar days before the start of concreting works, the Contractor shall submit design mixes and the corresponding test result made on sample thereof. Sampling and testing shall be in accordance with the ASTM Standard procedures for sampling and testing for the particular design strength(s) required.

The particulars of the mix such as the slump and the proportionate weights of cement, saturated surface dry aggregates and water used shall be stated.

The design mix for concrete to be used shall be submitted together with at least three (3) standard cylinder samples for approval at least one (1) month prior to the start of each concreting schedule. Such samples shall be prepared in the presence of the Engineer.

Standard laboratory strength tests for the 7, 14 and 28 days periods shall be taken to all concrete samples in addition to routine field tests, at cost to the Contractor. Only design mixes represented by test proving the required strength for 7, 14 and 28 days tests shall be allowed.

The cost of sampling, handling and transporting samples from jobsite to the laboratory and the cost of subsequent tests made until the desired mix is attained shall be for the account of the Contractor.

Slump Test shall be made in conformance with ASTM C143, and unless otherwise specified by the Engineer, slump shall be within the following limits:

Structural Element	Slump for Vibrated Concrete	
	Minimum	Maximum
Pavement Concrete	25mm	50mm
Pre-cast Concrete	50mm	70mm
Lean Concrete	100mm	200mm
Sacked Concrete	25mm	50mm
All other Concrete	50mm	90mm

Sampling: Provide suitable facilities and labor for obtaining representative samples of concrete for the Contractor's quality control and the Engineer's quality assurance testing. All necessary platforms, tools and equipment for obtaining samples shall be furnished by the Contractor.

MIXING CONCRETE

1. GENERAL

- a. Concrete shall be thoroughly mixed in a mixer of an approved size and type that will insure a uniform distribution of the materials throughout the mass.
- b. All concrete shall be mixed in mechanically operated mixers. Mixing plant and equipment for transporting and placing concrete shall be arranged with an ample auxiliary installation to provide a minimum supply of concrete in case of breakdown of machinery or in case the normal supply of concrete is disrupted. The auxiliary supply of concrete shall be sufficient to complete the casting of a section up to a construction joint that will meet the approval of the Engineer.
- c. Equipment having components made of aluminum or magnesium alloys, which would be in contact with plastic concrete during mixing, transporting or pumping of Portland cement concrete, shall not be used.
- d. Concrete mixers shall be equipped with adequate water storage and a device for accurately measuring and automatically controlling the amount of water used.
- e. Materials shall be measured by weighing. The apparatus provided for weighing the aggregates and cement shall be suitably designed and constructed for this purpose. The accuracy of all weighing devices except that for water shall be such that successive quantities can be measured to within one percent of the desired amounts. The water measuring device shall be accurate to plus or minus 0.5 percent. All measuring devices shall be subject to the approval of the Engineer. Scales and measuring devices shall be tested at the expense of the Contractor as frequently as the Engineer may deem necessary to insure their accuracy.

- f. Weighing equipment shall be insulated against vibration or movement of other operating equipment in the plant. When the entire plant is running, the scale reading at cut-off shall not vary from the weight designated by the Engineer by more than one percent for cement, 1-½ percent for any size of aggregate, or one percent for the total aggregate in any batch.
- g. Manual mixing of concrete shall not be permitted unless approved by the Engineer.

2. MIXING CONCRETE AT SITE

- a. Concrete mixers may be of the revolving drum or the revolving blade type and the mixing drum or blades shall be operated uniformly at the mixing speed recommended by the manufacturer.

The pick-up and throw-over blades of mixers shall be restored or replaced when any part or section is worn 20 mm or more below the original height of the manufacturer's design. Mixers and agitators which have an accumulation of hard concrete or mortar shall not be used.

- b. When bulk cement is used and the volume of the batch is 0.5 m³ or more, the scale and weigh hopper for Portland cement shall be separate and distinct from the aggregate hopper or hoppers.

The discharge mechanism of the bulk cement weigh hopper shall be interlocked against opening before the full amount of cement is in the hopper. The discharging mechanism shall be interlocked against opening when the amount of cement in the hopper is underweight by more than one percent or overweight by more than 3 percent of the amount specified.

- c. When the aggregates contain more water than the quantity necessary to produce a saturated surface dry condition, representative samples shall be taken and the moisture content determined for each kind of aggregate.
- d. The batch shall be so charged into the mixer that some water enter in advance of cement and aggregates. All water shall be in the drum by the end of the first quarter of the specified mixing time.
- e. Cement shall be batched and charged into the mixer by such means that it will not result in loss of cement due to the effect of wind, or in accumulation of cement on surfaces of conveyors or hoppers, or in other conditions which reduce or vary the required quantity of cement in the concrete mixture.
- f. Where required, synthetic fibrous reinforcement shall be added directly to the concrete mixer after placing the sufficient amount of mixing water, cement and aggregates.
- g. The entire contents of a batch mixer shall be removed from the drum before materials for a succeeding batch are placed therein. The materials composing a batch except water shall be deposited simultaneously into the mixer.
- h. All concrete shall be mixed for a period of not less than 3 minutes after all materials, including water, are in the mixer. During the period of mixing, the mixer shall operate at the speed for which it has been designed.

- i. **Mixers shall be operated with an automatic timing device that can be locked by the Engineer. The time device and discharge mechanism shall be so interlocked that during normal operation no part of the batch will be discharged until the specified mixing time has elapsed.**
- j. **The first batch of concrete materials placed in the mixer shall contain a sufficient excess of cement, sand, and water to coat the inside of the drum without reducing the required mortar content of the mix. When mixing is to cease for a period of one hour or more, the mixer shall be thoroughly cleaned.**
- k. **In case of rubble concrete, proper mixture and placing of concrete and stones/rocks shall be in accordance to the approved plan. Methodology of work shall be approved by the Engineer.**

3. MIXING CONCRETE IN TRUCKS

- a. **Truck mixers, unless otherwise authorized by the Engineer, shall be of the revolving drum type, watertight, and so constructed that the concrete can be mixed to insure a uniform distribution of materials throughout the mass. All solid materials for the concrete shall be accurately measured and charged into the drum at the proportioning plant. Except as subsequently provided, the truck mixer shall be equipped with a device by which the quantity of water added can be readily verified. The mixing water may be added directly to the batch, in which case a tank is not required. Truck mixers may be required to be provided with a means by which the mixing time can be readily verified by the Engineer.**
- b. **The maximum size of batch in truck mixers shall not exceed the minimum rated capacity of the mixer as stated by the manufacture and stamped in metal on the mixer. Truck mixing shall, unless otherwise directed, be continued for not less than 100 revolutions after all ingredients, including water, are in the drum. The mixing speed shall not be less than 4 rpm, nor more than 6 rpm.**
- c. **Mixing shall begin within 30 minutes after the cement has been added either to the water or aggregate, but when cement is charged into a mixer drum containing water or surface-wet aggregate and when the temperature is above 32 °C, this limit shall be reduced to 15 minutes. The limitation in time between the introduction of the cement to the aggregate and the beginning of the mixing may be waived when, in the judgment of the Engineer, the aggregate is sufficiently free from moisture, so that there will be no harmful effects on the cement.**
- d. **When a truck mixer is used for transportation, the mixing time in stationary mixer may be reduced to 30 seconds and the mixing completed in a truck mixer. The mixing time in truck mixer shall be as specified for truck mixing.**

JOINTS

- 1. **No reinforcement, corner protection angles or other fixed metal items shall be run continuously through joints containing expansion-joint filler, through crack-control joints in slabs on grade and vertical surfaces.**
- 2. **Prefomed Expansion Joint Filler**
 - a. **Joints with Joint Sealant**

At expansion joints in concrete slabs to be exposed, and at other joints indicated to receive joint sealant, preformed expansion-joint filler strips shall be installed at the proper level below the elevation with a slightly tapered, dressed-and-oiled wood strip temporarily secured to the top thereof to form a groove. When surface dry, the groove shall be cleaned of foreign matter, loose particles, and concrete protrusions, then filled flush approximately with joint sealant so as to be slightly concave after drying.

b. **Finish of concrete at joints**

Edges of exposed concrete slabs along expansion joints shall be neatly finished with a slightly rounded edging tool.

c. **Construction Joints**

Unless otherwise specified herein, all construction joints shall be subject to approval of the Engineer. Concrete shall be placed continuously so that the unit will be monolithic in construction. Fresh concrete may be placed against adjoining units, provided the set concrete is sufficiently hard not to be injured thereby. Joints not indicated shall be made and located in a manner not to impair strength and appearance of the structure. Placement of concrete shall be at such rate that the surface of concrete not carried to joint levels will not have attained initial set before additional concrete is placed thereon. Lifts shall terminate at such levels as are indicated or as to conform to structural requirements as directed. If horizontal construction joints are required, a strip of 25mm square-edged lumber, beveled to facilitate removal shall be tacked to the inside of the forms at the construction joint. Concrete shall be placed to a point 25mm above the underside of the strip. The strip shall be removed one hour after the concrete has been placed. Any irregularities in the joint line shall be leveled off with a wood float, and all laitance removed. Prior to placing additional concrete, horizontal construction joints shall be prepared.

Construction Joint which is not indicated in the Drawings shall be located as to least affect the strength of the structure. Such locations will be pointed out by the Engineer.

PREPARATION FOR PLACING

Hardened concrete, debris and foreign materials shall be removed from the interior of forms and from inner surfaces of mixing and conveying equipment. Reinforcement shall be secured in position, and shall be inspected, and approved before placing concrete. Runways shall be provided for wheeled concrete-handling equipment. Such equipment shall not be wheeled over reinforcement nor shall runways be supported on reinforcement.

Notice of any concreting operations shall be served to the Engineer at least three (3) days ahead of each schedule.

PLACING CONCRETE

1. Handling Concrete

Concrete shall be handled from mixers and transported to place for final deposit in a continuous manner, as rapidly as practicable, and without segregation or loss of ingredients until the approved unit of work is completed. Placing will not be permitted when the sun, heat, wind or limitations of facilities furnished by the Contractor prevent proper finishing and

curing of the concrete. Concrete shall be placed in the forms, as close as possible in final position, in uniform approximately horizontal layers not over 40cm deep. Forms splashed with concrete and reinforcement splashed with concrete or form coating shall be cleaned in advance of placing subsequent lifts. Concrete shall not be allowed to drop freely more than 1.5m in unexposed work nor more than 1.0 m in exposed work; where greater drops are required, tremie or other approved means shall be employed.

2. Time Interval between Mixing and Placing

Concrete mixed in stationary mixers and transported by non-agitating equipment shall be placed in the forms within 30 minutes from the time ingredients are charged into the mixing drum. Concrete transported in truck mixers or truck agitators shall be delivered to the site of work, discharged in the forms within 45 minutes from the time ingredients are discharged into the mixing drum. Concrete shall be placed in the forms within 15 minutes after discharged from the mixer at the jobsite.

3. Hot Weather Requirements

The temperature of concrete during the period of mixing while in transport and/or during placing shall not be permitted to rise above 36 °C. Any batch of concrete which had reached a temperature greater than 36 °C at any time in the aforesaid period shall not be placed but shall be rejected, and shall not thereafter be used in any part of the permanent works.

a. Control Procedures

Provide water cooler facilities and procedures to control or reduce the temperature of cement, aggregates and mixing handling equipment to such temperature that, at all times during mixing, transporting, handling and placing, the temperature of the concrete shall not be greater than 36 °C.

b. Cold Joints and Shrinkage

Where cold joints tend to form or where surfaces set and dry too rapidly or plastic shrinkage cracks tend to appear, concrete shall be kept moist by fog sprays, or other approved means, applied shortly after placement, and before finishing.

c. Supplementary Precautions

When the aforementioned precautions are not sufficient to satisfy the requirements herein above, they shall be supplemented by restricting work during evening or night. Procedure shall conform to American Concrete Institute Standard ACI 305.

4. Conveying Concrete by Chute, Conveyor or Pump

Concrete may be conveyed by chute, conveyor, or pump if approved in writing. In requesting approval, the Contractor shall submit his entire plan of operation from the time of discharge of concrete from the mixer to final placement in the forms, and the steps to be taken to prevent the formation of cold joints in case the transporting of concrete by chute, conveyor or pump is disrupted. Conveyors and pumps shall be capable of expeditiously placing concrete at the rate most advantageous to good workmanship. Approval will not be given for chutes or conveyors requiring changes in the concrete materials or design mix for efficient operation.

a. **Chutes and Conveyors**

Chutes shall be of steel or steel lined wood, rounded in cross section rigid in construction, and protected from overflow. Conveyors shall be designed and operated and chute sections shall be set, to assure a uniform flow of concrete from mixer to final place of deposit without segregation of ingredients, loss of mortar, or change in slump. The discharged portion of each chute or conveyor shall be provided with a device to prevent segregation. The chute and conveyor shall be thoroughly cleaned before and after each run. Waste material and flushing water shall be discharged outside the forms.

- b. Pumps shall be operated and maintained so that a continuous stream of concrete is delivered into the forms without air pockets, segregation or changes in slump. When pumping is completed, concrete remaining in the pipeline shall be ejected and wasted without contamination of concrete already placed. After each operation, equipment shall be thoroughly cleaned and the flushing water shall be splashed outside the forms.

5. **Wall and Abutments**

No load shall be placed upon finished walls, foundations or abutments until authorized by the Engineer. Minimum time before loading shall be 7 days.

6. **Concrete Placing on Wharf**

When placing concrete on wharf decks, the Contractor shall:

Ensure that rate of placing is sufficient to complete proposed placing, finishing and curing operations within the scheduled time; that experienced finishing machine operators and concrete finishers are provided to finish the deck; that curing equipment and finishing tools and equipment are at the site of work and in satisfactory condition for use.

Immediately prior to placing, the Contractor shall place scaffolding and wedges and make necessary adjustments. Care shall be taken to ensure that settlement and deflection due to added weight of concrete will be minimal. The Contractor shall provide suitable means to readily permit measurement of settlement deflection as it occurs.

Should any event occur which, in opinion of the Engineer, would prevent the concrete conforming to specified requirements, the Contractor shall discontinue placing of concrete until corrective measures are provided satisfactory to the Engineer. If satisfactory measures are not provided prior to initial set of concrete in affected areas, the Contractor shall discontinue placing concrete and install a bulkhead at a location determined by the Engineer. Concrete in place beyond bulkheads shall be removed. The Contractor shall limit the size of casting to that which can be finished before beginning of initial set.

COMPACTION

1. Immediately after placing, each layer of concrete shall be completed by internal concrete vibrators supplemented by hand-spading, rodding, and tamping. Tapping or other external vibration of forms will not be permitted unless specifically approved by the Engineer. Vibrators shall not be used to transport concrete inside the forms. Internal vibrators submerged in concrete shall maintain a speed of not less than 7,000 impulses per minute. The vibrating equipment shall at all times be adequate in number of units and power to properly consolidate all concrete.
2. Spare units shall be on hand as necessary to insure such adequacy. The duration of vibrating equipment shall be limited to the time necessary to produce satisfactory consolidation without causing objectionable segregation. The vibrator shall not be inserted into the lower courses that have begun to set. Vibrator shall be applied vertically at uniformly spaced points not further apart than the visible effectiveness of the machine.

EPOXY BONDING COMPOUND

Before depositing new concrete on or against concrete that has set, the surfaces of the set concrete shall be thoroughly cleaned so as to expose the coarse aggregate and be free of laitance, coatings, foreign matter and loose particles. Forms shall be re-tightened. The cleaned surfaces shall be moistened, but shall be without free water when concrete is placed. ASTM C 881. Provide Type I for bonding hardened concrete to hardened concrete; Type II for bonding freshly mixed concrete to hardened concrete; and Type III as a binder in epoxy mortar or concrete, or for use in bonding skid-resistant materials to hardened concrete. Provide Class B if placement temperature is between 4 to 16 °C; or Class C if placement temperature is above 16°C.

FINISHES OF CONCRETE

Within 12 hours after the forms are removed, surface defects shall be remedied as specified herein. The Temperature of the concrete, ambient air and mortar during remedial work including curing shall be above 10 °C. Fine and loose material shall be removed. Honeycomb, aggregate pockets, voids over 13mm in diameter, and holes left by the rods or bolts shall be cut out to solid concrete, reamed, thoroughly wetted, brush-coated with neat cement grout, and filled with mortar. Mortar shall be a stiff mix of one part Portland cement to not more than 2 parts fine aggregate passing the No. 16 mesh sieve, with a minimum amount of water. The color of the mortar shall match the adjoining concrete color. Mortar shall be thoroughly compacted in place. Holes passing entirely through walls shall be completely filled from the inside face by forcing mortar through the outside face. Holes which do not pass entirely through wall shall be packed full. Patchwork shall be finished flush and in the same plane as adjacent surfaces. Exposed patchwork shall be finished to match adjoining surfaces in texture and color. Patchwork shall be damp-cured for 72 hours. Dusting of finish surfaces with dry material or adding water to concrete surfaces will not be permitted.

CONCRETE FINISHING DETAILS

1. Concrete Paving

After concrete is placed and consolidated, slabs shall be screeded or struck off. No further finish is required.

2. Smooth Finish

Required only where specified; screed concrete and float to required level with no coarse aggregate visible. After surface moisture has disappeared and laitance has been removed,

the surface shall be finished by float and steel trowel. Smooth finish shall consist of thoroughly wetting and then brush coating the surfaces with cement to not more than 2 parts fine aggregate passing the no. 30 mesh sieve and mixed with water to the consistency of thick paint.

3. Broom Finish

Required for paving; the concrete shall be screeded and floated to required finish level with no coarse aggregate visible. After the surface moisture has disappeared and laitance has been removed, surface shall be float-finished to an even, smooth finish. The floated surfaces shall be broomed with a fiber bristle brush in a direction transverse to the direction of the main traffic.

ITEM 04 : BACKFILLING WORKS

SCOPE OF WORK

This item shall consist of the filling works in accordance with the Specifications and in conformity with the lines, grades, and dimensions shown on the Plans or established by the Engineer.

The area to be upgraded shall be as indicated on the Drawings.

The works includes furnishing of all labor, materials and equipment required to complete/finish the upgrading of the area in accordance with the Drawings and the Specifications.

MATERIAL REQUIREMENTS

1. Filling Materials

General

All sources of filling materials shall be approved by the Engineer.

Appropriate quantities of sample of all materials to be used in the Works shall be submitted for acceptance and approval by the Engineer thirty (30) days before the commencement of work.

General filling shall consist of approved material from approved sources of suitable grading obtained from excavation, quarries or borrow pits, without excess fines, clay or silt, free from vegetation and organic matter.

Sample of approved materials shall be kept/stored in the field for ready reference/comparison of the delivered materials.

The Contractor shall ensure that adequate quantities of required materials that comply with the specifications and quality approved by the engineer are available at all times.

EXECUTION

Backfilling Works

a. General

The Contractor shall be responsible for all ancillary earthworks that are necessary for the reception of the fill material and including, all spout handling, temporary dike or shoring construction where necessary, temporary protection to dikes in the sea and drainage of excess water.

The arrangements of these ancillary earthworks shall be laid out in consultation with the Engineer and to the Engineer's satisfaction and care shall be taken to minimize the loss of fill.

- b. Replacement, backfilling and reclamation may be done by any method acceptable to the Engineer. Prior to start of Work, the Contractor shall submit his method and sequence of performing the works to the Engineer for approval. However, the Engineer's approval of the method and sequence of construction shall not release the Contractor from the responsibility for the adequacy of labor and equipment.
- c. The Engineer shall approve the type of material to be used as fill prior to its placement. If the material is rejected, such material shall be deposited into areas designated or as directed by the Engineer.
- d. Fill material shall be placed in horizontal layers not exceeding 200mm (8 inches), loose measurement, and shall be compacted as specified before the next layer is placed. Effective spreading equipment shall be used on each lift to obtain uniform thickness prior to compacting. As the compaction of each layer progresses, continuous leveling and manipulating will be required to assure uniform density. Water shall be added or removed, if necessary, in order to obtain the required density. Removal of water shall be accomplished through aeration by plowing, blading, dicing, or other methods satisfactory to the Engineer.

Dumping and rolling areas shall be kept separate, and no lift shall be covered by another until the necessary compaction is obtained.

Hauling and leveling equipment shall be so routed and distributed over each layer of the fill in such a manner as to make use of compaction effort afforded thereby and to minimize rutting and uneven compaction.

TRIAL SECTION

Before finish grade construction is started, the Contractor shall spread and compact trial sections as directed by the Engineer. The purpose of the trial sections is to check the suitability of the materials and the efficiency of the equipment and construction method which is proposed to be used by the Contractor. Therefore, the Contractor must use the same material, equipment and procedures that he proposes to use for the main work. One trial section of about 500 m² shall be made for every type of material and/or construction equipment/procedure proposed for use.

After final compaction of each trial section, the Contractor shall carry out such field density tests and other tests required as directed by the Engineer.

If a trial section shows that the proposed materials, equipment or procedures in the Engineer's opinion are not suitable for sub-base, the material shall be removed at the Contractor's expense, and a new trial section shall be constructed.

If the basic conditions regarding the type of material or procedure change during the execution of the work, new trial sections shall be constructed.

CROSS-SECTIONS OF COMPLETED RECLAMATION

Cross-sections showing the elevations of the completed reclamation and the terrain of the existing seabed prior to construction shall go together with every progress report and request for progress or final payment.

FIELD COMPACTION TEST

Field Density tests to determine the percent of compaction of the material (selected fill, aggregate base course, etc) shall be conducted. Compaction of each layer thereafter shall continue until a field density of 95 percent of the maximum dry density in accordance with AASHTO T/180 Method D has been achieved. In place density determination shall be made in accordance with AASHTO T191/ ASTM D 1556.

TOLERANCE

Elevation : plus 5 cm.

ITEM 05 : AGGREGATE BASE COURSE

SCOPE OF WORK

This Item shall consist of furnishing, placing and compacting an aggregate base course on a prepared subgrade/subbase in accordance with this Specification and lines, grades, thickness and typical cross-sections shown on the Plans or as established by the Engineer.

MATERIAL REQUIREMENTS

Aggregate base course shall consist of hard, durable particles or fragments of crushed stone, crushed slag or crushed or natural gravel and filler of natural or crushed sand or other finely divided mineral matter. The composite material shall be free from vegetable matters and lumps or balls of clay, and shall be of such nature that it can be compacted readily to form a firm, stable base.

In some areas where the conventional base course materials are scarce or non-available, the use of 40% weathered limestone blended with 60% crushed stones or gravel shall be allowed, provided that the blended materials meet the requirements of this Item.

The base material shall conform to the grading requirements of Table 3.1, whichever is called for in the Bill of Quantities.

Table 3.1 Grading Requirements

Sieve Designation		Mass Percent Passing	
Standard mm	Alternate US Standard	Grading A	Grading B
50	2"	100	
37.5	1 - 1/2"	-	100
25.0	1"	60 - 85	-
19.0	3/4"	-	60 - 85
12.5	1/2"	35 - 65	-
4.75	No. 4	20 - 50	30 - 55
0.425	No. 40	5 - 20	8 - 25
0.075	No. 200	0 - 12	2 - 14

The portion of the material passing the 0.075mm (No. 200) sieve shall not be greater than 0.66 (two-thirds) of the fraction passing the 0.425mm (No. 40) sieve.

The portion of the material passing the 0.425mm (No. 40) sieve shall have a liquid limit of not greater than 25 and a plasticity index of not more than 6 as determined by AASHTO T89 and T90, respectively.

The coarse aggregate retained on a 2.00mm (No. 10) sieve shall have a mass percent of wear not exceeding 50 by the Los Angeles Abrasion Test as determined by AASHTO T 96.

The material passing the 19mm (3/4 inch) sieve shall have a minimum soaked CBR-value of 80% tested according to AASHTO T 193. The CBR-value shall be obtained at the maximum dry density determined according to AASHTO T 180, Method D.

If filler, in addition to that naturally present, is necessary for meeting the grading requirements or for satisfactory bonding, it shall be uniformly blended with the crushed base course material on the road or in a pugmill unless otherwise specified or approved. Filler shall be obtained from sources approved by the Engineer, free from hard lumps and shall not contain more than 15 percent of material retained on the 4.75mm (NO. 4) sieve.

EXECUTION

PLACING

The aggregate base material shall be placed at a uniform mixture on a prepared sub-base (selected fill) in a quantity which will provide the required compacted thickness. When more than one layer is required, each layer shall be shaped and compacted before the succeeding layer is placed.

The placing of material shall begin at the point designated by the Engineer. Placing shall be from vehicles especially equipped to distribute the material in a continuous uniform layer or windrow.

The layer or windrow shall be of such size that when spread and compacted the finished layer be in reasonably close conformity to the nominal thickness shown on the Plans.

When hauling is done over previously placed material, hauling equipment shall be dispersed uniformly over the entire surface of the previously constructed layer, to minimize rutting or uneven compaction.

SPREADING AND COMPACTING

When uniformly mixed, the mixture shall be spread to the plan thickness, for compaction.

Where the required thickness is 150mm or less, the material may be spread and compacted in one layer. Where the required thickness is more than 150 mm, the aggregate base shall be spread and compacted in two or more layers of approximately equal thickness, and the maximum compacted thickness of any layer shall not exceed 150 mm. All subsequent layers shall be spread and compacted in a similar manner.

The moisture content of sub-base material shall, if necessary, be adjusted prior to compaction by watering with approved sprinklers mounted on trucks or by drying out, as required in order to obtain the required compaction.

Immediately following final spreading and smoothing, each layer shall be compacted to the full width by means of approved compaction equipment. Rolling shall progress gradually from the sides to the center, parallel to the centerline of the road and shall continue until the whole surface has been rolled. Any irregularities or depressions that develop shall be corrected by loosening the material at these places and adding or removing material until surface is smooth and uniform. Along curbs, headers, and walls, and at all places not accessible to the roller, the base material shall be compacted thoroughly with approved tampers or compactors.

If the layer of base material, or part thereof, does not conform to the required finish, the Contractor shall, at his own expense, make the necessary corrections.

Compaction of each layer shall continue until a field density of at least 100 percent of the maximum dry density determined in accordance with AASHTO T 180, Method D has been achieved. In-place density determination shall be made in accordance with AASHTO T 191/ASTM D 1556.

TRIAL SECTION

Before finish grade construction is started, the Contractor shall spread and compact trial sections as directed by the Engineer. The purpose of the trial sections is to check the suitability of the materials and the efficiency of the equipment and construction method which is proposed to be used by the Contractor. Therefore, the Contractor must use the same material, equipment and procedures that he proposes to use for the main work. One trial section of about 500 m² shall be made for every type of material and/or construction equipment/procedure proposed for use.

After final compaction of each trial section, the Contractor shall carry out such field density tests and other tests required as directed by the Engineer.

If a trial section shows that the proposed materials, equipment or procedures in the Engineer's opinion are not suitable for subbase, the material shall be removed at the Contractor's expense, and a new trial section shall be constructed.

If the basic conditions regarding the type of material or procedure change during the execution of the work, new trial sections shall be constructed.

SURVEYS AND SETTING OUT WORKS

Before the commencement of the pavement works, the Contractor together with the Engineer shall conduct topographic survey which will form the basis of quantity measurement.

The Contractor shall set out the works and shall be solely responsible for the accuracy of such setting-out.

Prior to placement of any material, the Contractor shall establish visible construction markers to clearly define horizontal limits of the Work.

TOLERANCES

The aggregate base course shall be laid to the designed level and transverse slopes shown on the Plans. The allowable tolerances shall be in accordance with following:

Permitted variation from design THICKNESS OF LAYER	± 10 mm
Permitted variation from design LEVEL OF SURFACE	+ 5 mm -10 mm
Permitted SURFACE IRREGULARITY Measured by 3-m straight-edge	5 mm
Permitted variation from design CROSSFALL OR CAMBER	± 0.2%
Permitted variation from design LONGITUDINAL GRADE over 25 m in length	± 0.1%

ITEM 06 : PORTLAND CEMENT CONCRETE PAVEMENT

SCOPE OF WORK

The works include the furnishing of all labor, materials and equipment required for the construction of gravel base course and concrete pavement. The works shall be in accordance with the lines and grades shown on the Drawings and in conformity with the Specifications.

MATERIAL REQUIREMENTS

Cement

Portland cement shall conform to the requirements of the Section "Reinforced Concrete".

Fine Aggregate

The fine aggregate shall be well-graded from coarse to fine and shall conform to the requirements of the Section "Reinforced Concrete".

Coarse Aggregate

Coarse aggregate shall conform to the requirements of the Section "Reinforced Concrete".

Water

Clean, fresh, potable water shall be used for the mixing of all concrete and mortar and shall be from a source approved by the Engineer. Sea water or brackish water shall not be used.

Admixture

Admixture shall only be used with the written permission of the Engineer. If air-entraining agents, water reducing agents, set retarders or strength accelerators are permitted to be used, they shall not be used in greater dosages than those recommended by the manufacturer, or as permitted by the Engineer. The cost shall be considered as already in the Contractor's unit cost bid for concrete.

TIE BARS AND SLIP BARS

Tie bars shall be deformed bars conforming to the requirements specified in AASHTO M 31 or M 42, except that rail steel shall not be used for tie bars that are to be bent and re-straightened during construction, sizes as indicated on the Drawings. The deformed bars shall be Grade 40 and shall be shipped in standard bundles, tagged and marked in accordance with the Code of Standard practice of the Concrete Reinforcement Steel Institute.

Slip bars shall be smooth round steel bars conforming to the requirements specified in AASHTO M 31 or plain M 42.

Joint Filler

Poured filler for joint shall conform to the requirements of AASHTO M173.

EXECUTION

Concrete Class

The concrete for pavement shall satisfy the following requirements:

Minimum 28-day comprehensive strength	:	24 MPa
Minimum Flexural Strength	:	3.8 MPa
Maximum Aggregate size	:	25 mm
Maximum water cement ratio	:	0.52

Proportioning, Consistency and Mixing of Concrete

The proportioning, consistency and mixing of concrete shall conform to the requirements of the Section "Reinforced Concrete".

Preparation

The base shall be watered and thoroughly moistened prior to placing of the concrete.

Formwork Construction

Formwork shall comply with the requirements of the Section "Reinforced Concrete". Forms shall be of steel, of an approved section and shall be straight and of a depth equal to thickness of the pavement at the edge. The base of the forms shall be of sufficient width to provide necessary stability in all directions. The flange braces must extend outward on the base not less than $\frac{2}{3}$ the height of the form.

All forms shall be rigidly supported on a bed of thoroughly compacted material during the entire operation of placing and finishing the concrete. They shall be set with their faces vertical so as to produce a surface complying with the required tolerance.

Adjacent lanes may be used in lieu of forms for supporting finishing equipment provided that proper protection is afforded to the concrete of the adjacent lanes to prevent damage, and provided further that the surface of the concrete carrying the finishing equipment does not vary by more than 3mm in each meter length. Adjacent lanes in lieu of forms may not be used until the concrete is at least seven (7) days old. Flanged wheels of the finishing equipment shall not be operated on the concrete surface. The inside edge of supporting wheels of the finishing machine shall not operate closer than 100mm from the edge of the concrete lane.

Alternative to placing forms, slip-forming may be used. Slip-form paving equipment shall be equipped with the traveling side forms of sufficient dimensions, shape and strength to support the concrete laterally for a sufficient length of time during placement to produce pavement of the required cross section. No abrupt changes in longitudinal alignment of the pavement will be permitted. The horizontal deviation shall not exceed 20mm from the proper alignment established by the Engineer.

Joints

All joints, longitudinal, transverse, etc., shall be constructed as shown on the Drawings and shall be clean and free of all foreign material after completion of shoulder work prior to acceptance of the work and in accordance with the following provisions:

Longitudinal and Transverse Contact Joints:

Longitudinal contact joints are joints formed between lanes that are poured separately. Transverse contact joints are joints formed between segments of a lane that are poured separately. Transverse contact joints shall be formed perpendicular to pavement centerline at the end of each day of concrete placing, or where concreting has been stopped for 30 minutes or longer but not nearer than 1.5 meters from sawed contraction joints. All contact joints shall have faces perpendicular to the surface of the pavement. Tie bars of the size, length and spacing shown on the Drawings shall be placed across longitudinal and transverse contact joints.

Placing Concrete

The concrete shall be deposited and spread in order that segregation will not occur and place a uniform layer of concrete whose thickness is approximately 20 mm greater than that required for the finished pavement is placed. Rakes shall not be used for handling concrete.

In order to prevent the introduction into the concrete of earth and other foreign materials, the men whose duties require them to work in the concrete, shall in general, confine their movements to the area already covered with fresh concrete. Whenever it becomes necessary for these men to step out of the concrete, their footwear shall be washed or otherwise thoroughly cleaned before returning to the concrete. Repeated carelessness with regard to this detail will be deemed sufficient cause for removing and replacing such worker.

During the operation of striking off the concrete, a uniform ridge of concrete at least 70 mm in height shall be maintained ahead of the strike-off screed for its entire length. Except when making a construction joint, the finishing machine shall at no time be operated beyond that point where this surplus can be maintained in front of the strike-off screed.

After the first operation of the finishing machine, additional concrete shall be added to all low places and honeycombed spots and the concrete rescreeded. In any rescreeding, a uniform head of concrete shall be maintained ahead of the strike-off for its entire length. Honeycombed spots shall not be eliminated by tamping or grouting.

Workers on the job shall have mobile footbridges at their disposal so that they need not walk on the wet concrete.

In conjunction with the placing and spreading, the concrete shall be thoroughly spaded and vibrated along the forms, bulkhead, and joints.

The internal vibrators shall be of pneumatic, gas-driven, or electric type, and shall operate at a frequency of not less than 3,200 pulsations per minute.

Whenever the placing of the concrete is stopped or suspended for any reason, for a period of 30 minutes or longer, a suitable bulkhead shall be placed so as to produce a vertical transverse joint. If an emergency stop occurs within 2.5 meters of the contraction or an expansion joint the concrete shall be removed back to the joint. When the placing of the concrete is resumed, the bulkhead shall be removed and a new concrete placed and vibrated evenly and solidly against the face of previously deposited concrete. Any concrete

in excess of the amount needed to complete a given section or that has been deposited outside the forms shall not be used in the work.

The Contractor shall provide suitable equipment for protecting the fresh concrete in case of rain, such as screens which will cause the rain water to run off beyond the edges of the paving, rain proof tarpaulins or other methods approved by the Engineer. The equipment shall be sufficient to shelter from rain all areas equal to that paved in two hours of work.

Finishing Concrete

The concrete shall be compacted and finished by a mechanical, self-propelled finishing machine of approved type, having two independently operated screeds. If a machine possessing only one screed is approved, the screed will not be less than 450 mm wide and shall be equipped with compensating springs to minimize the effect of the momentum of the screed on the side forms. The number of driving wheels, the weight of the machine and the power of the motor shall be so coordinated as to prevent slippage. The top of the forms and the surface of the finishing machine wheels shall be kept free from concrete or dirt.

The machine shall at all times be in first-class mechanical condition and shall be capable of compacting and finishing the concrete as herein described. Any machine which causes displacement of the side forms from the line or grade to which they have been properly set, or causes undue delay due to mechanical difficulties, shall be removed from the work and replaced by a machine meeting the Specifications.

The finishing machine shall be operated over each section of pavement two or more times and at such intervals as will produce the desired results. Generally, two passes of the finishing machine are considered the maximum desirable.

The concrete shall be vibrated, compacted, and finished by a vibratory finishing machine. The vibratory machine shall meet the requirements for ordinary finishing, and shall be one of the following type:

1. The machine shall have two independently operated screeds; the front screed shall be equipped with vibratory units with a frequency of not less than 3,500 pulsations per minute. There shall be not less than one vibratory unit for each 2.5 meters length or portion thereof, of vibratory screed surface. The front screed shall not be less than 300mm wide and shall be equipped with a "bull nose" front edge built on a radius of not less than 50mm. This type of vibratory finishing machine shall be operated in such manner that each section of pavement will receive at least one vibratory pass, but not more than two passes, unless otherwise directed, or ;
2. The machine shall be equipped with an independently operated vibratory "pan" (or pans) and two (2) independently operated screeds, the "pan" shall be mounted in a manner that will permit it to come in contact with the forms and will permit vibration of the full width of lane simultaneously.

There shall be not less than one vibratory unit for each 2 m. length or portion thereof, of vibrating pan surface. The vibratory units in any individual pan shall be synchronized and have a frequency of not less than 3,500 pulsations per minute. The front screed shall be capable of operating in a position that will strike off the concrete at a sufficient height above the top of the forms to allow for proper compaction with the vibrating pan. This type of vibratory finishing machine shall be operated in such manner than each section of pavement will receive at least one vibratory pass but not more than two passes, unless otherwise directed.

After the final pass of the finishing machine and when the concrete has started to dry, the surface of the pavement shall be finished with an approved longitudinal float. The float may be operated either manually or by mechanical means. The float may be either of wood or metal shall be straight and smooth and light in weight so as not to displace or sink into the concrete surface.

To be effective, the float shall be at least 300mm wide and 3m long. When manually operated, the float shall be moved from edge to edge with a wiping motion and advance one (1) meter or more.

The succeeding trip shall overlap the previous trip. A light smoothing lute at least 3 meters long may be used provided approved by the Engineer.

The surface of the pavement shall be tested by the Contractor, before the final belting, with an approved standard straightedge 3 meter in length. Irregularities so detected shall be corrected immediately. Special attention shall be given to the concrete adjacent to transverse joints to insure that the edges thereof are not above the grade specified or the adjacent concrete below grade. All depressions or projections shall be corrected before any initial set has developed in the concrete.

After the concrete has been brought to the required grade, contour and smoothness, it shall be finished by passing over the concrete a drag of one or two burlap clothes, which give the surface the required roughness. The vehicles used to carry these cloths may be independent of the concrete-laying machine or may be incorporated with it and may be operated either by hand or mechanically.

Hand finishing will be permitted only on variable width sections of the pavement and other places where the use of the finishing machine would be impractical. Hand finishing shall be accomplished by means of the hand-operated strike-off template of either steel or steel-shod wood construction. The striking template shall be operated forward with a combined longitudinal and transverse motion and shall be so manipulated that neither end will be raised off the side forms. A similar tamper shall be used for tamping the concrete.

As soon as the concrete has attained its initial set, the edges of the pavement, the longitudinal joints, the construction dummy and expansion joints not sawn shall be carefully finished with an edging tool having radius of at least 5mm. The tools, the special accessories for cutting impressed joints and methods of workmanship shall be such as will produce a joint whose edges are of the same quality of concrete as the other portion of the pavement. Methods and workmanship which make use of excess mortar or grout in this area shall be eliminated. Unnecessary tool marks shall be eliminated during work, and the edges left smooth and true to line.

Striking Forms

Forms shall remain in place at least 12 hours after the concrete has been placed. When working conditions are such that the early strength gain of the concrete is delayed, the forms shall remain in place for a longer period, as directed by the Engineer. Bars or heavy load shall not be used against the concrete when still in the forms. Any damage to concrete resulting from form removal shall be repaired promptly by the Contractor as directed by the Engineer without any additional payment to the Contractor.

Curing Concrete

Unless otherwise ordered by the Engineer, curing of concrete shall be done by any method specified in the Section "Reinforced Concrete".

Cleaning and Sealing Joints

After completion of the required curing and before opening of the pavement to traffic, all joints shall be thoroughly cleaned of all concrete aggregate fragments or other materials.

After removal of side forms, the ends at transverse expansion joints at the edges of the pavement shall be carefully cleaned of any concrete within the expansion spaces for the entire depth of slab, care being taken not to injure the ends of the joints. Expansion and contraction joints shall then be poured with a hot joint sealer to the depth as indicated on the Drawings. Joint sealer shall be poured using approved hand pouring pots, with liquid at a temperature not less than that recommended by the approved manufacturer.

Opening to Traffic

The pavement shall be closed to traffic, including the vehicles of the Contractor, for a period of 10 days after the concrete is placed or longer if in the opinion of the Engineer, the weather conditions make it necessary to extend this time. The Contractor shall furnish, place and maintain satisfactory barricades and lights as directed, to exclude all traffic from the pavement.

Any damage to the pavement due to traffic shall be repaired or replaced at the expense of the Contractor. Paving mixers, mechanical concrete spreaders and finishers and other heavy paving equipment shall not be operated on completed concrete lanes in order to construct alternate lanes until after the regular curing period is completed. Even then, planks shall be laid on the finished pavement or other precautions taken to prevent damage to the concrete pavement.

Pavement Smoothness, Thickness and Tolerance

Portland cement concrete pavement shall be constructed to the designed level and transverse slope shown on the Drawing. The allowable tolerance shall be as listed hereunder:

- | | | |
|----|--|---------|
| 1. | Permitted variation from design thickness of layer | + - 5mm |
| 2. | Permitted variation from design level of surface | + - 5mm |

The thickness of the pavement will be determined by measurement of cores from the completed pavement in accordance with AASHTO T 148.

The completed pavement shall be accepted on a lot basis. A lot shall be considered as 2,500 sq.m of pavement. The last unit in each slab constitutes a lot in itself when its length is at least ½ of the normal lot length. If the length of the last unit is shorter than ½ of the normal lot length, it shall be included in the previous lot.

Other areas such as intersections, entrances, crossovers, ramp, etc., will be grouped together to form a lot. Small irregular areas may be included with other unit areas to form a lot.

ITEM 07 : MOORING AND FENDERING SYSTEM

SCOPE OF WORK

1. The work includes furnishing of all labor, materials and equipment to complete the installation of mooring bollards and fenders in piers/wharves.
2. The work shall include the supply, transport, handling, storage and installation of fenders systems in the newly constructed piers.
3. The Contractor shall furnish and install the necessary fittings as shown on the drawings and/or specified.

Supplementary parts necessary to complete and install each item of works shall be included whether or not shown or specified. The Contractor shall furnish to relevant trades all anchors, fastenings, inserts, fittings, fixtures or the like to be installed on or required for securing the works.

The Contractor shall submit shop drawings of all fitting works prior to placing orders and commencement of any fabrication.

MATERIAL REQUIREMENTS

MOORING SYSTEM

Designated load capacity of mooring bollards shall be as shown in the drawings, and shall be referred to as the maximum load capacity. The mooring bollards shall be at rupture stage upon reaching the maximum load capacity.

Mooring bollards shall be of the dimensions, weights, capacities and designs as shown in the drawings and shall be fabricated by approved manufacturer with cast steel conforming to the requirements indicated in the plan/drawings, or approved equivalent.

The size of the bolts, nuts and washers shall be in accordance with the specifications provided in the plans/drawings. The anchor plate shall be connected to the holding down bolt as shown in the plans/drawings. All bolts, nuts, washers etc., that are exposed shall be hot-dip galvanized.

Samples of the bolts, nuts, washers and anchor plates shall be submitted to the Engineer for approval before being used in the Works.

The upper part of bollards and base plates which are not embedded in concrete shall be painted. The surface of bollards shall be cleaned thoroughly by wire brush or other means prior to painting to remove rust or any other contamination which may interfere with bond of paint to metal.

The exposed surface shall be coated with rust proof paint and finishing paint, which shall be coal-tar epoxy of 120m micron thickness in accordance with JIS K5623 or the approved standard.

Base Steel:

Chemical composition and mechanical properties of base metal to be used for fabrication of mooring bollard and its accessories shall comply with ASTM A36 and other required standard stated therein.

Concrete Foundation :

Concrete foundation for mooring bollards shall conform to the requirements of the Section concerning "Reinforced Concrete".

Visual Inspection :

All mooring bollards delivered to Site shall be inspected by the Engineer for any signs of flaws or defect inimical to usage.

Mill Test Certificates:

Two (2) copies of mill test reports shall be submitted certifying that materials meet the specified standards.

Test Inspection:

Inspection of all materials and methods of fabrication shall be carried out by the Contractor. However, the Engineer reserves the right to inspect all facilities at any time during the manufacture to ensure that the materials and workmanship are in accordance with Specifications and the best of workmanship.

FENDER SYSTEM

The rubber fenders should comply with the performance requirements specified in the table provided on the plan/drawings of RDF.

PHYSICAL PROPERTIES OF MATERIALS

The rubber for the fenders shall be of high quality natural rubber, synthetic rubber or mixed rubber blended with carbon black used in the rubber industry and shall have sufficient resilience and anti-ageing, weathering, abrasion, wear and oil resistant properties. The rubber dock fenders shall be free from bubbles, cracks and other harmful defects.

The physical properties of the rubber compound used for the fenders shall comply with the following requirements:

Physical Properties and Test Method

Test Item		Properties	Test Method		
Physical Test	Before Aging	Tensile Strength	160kg/sq.m minimum	Test piece: Dumbell No. 3	ASTM D412
		Elongation	350% minimum		ASTM D1456
		Hardness	76Hs maximum	Spring Type hardness test (Type A)	ASTM D2240
	After Aging	Tensile Strength	Not less than 80% of original value	Aging by air heating: 70±1°C x 96 hours.	ASTM D412
		Elongation			ASTM D1456
		Hardness	Not more than original value +8°		ASTM D2240
	Compression Test		30% maximum	Heat treatment: 70±1°C x 22 hours.	ASTM D395

Note: Equivalent Standards are acceptable.

FITTINGS AND ANCHORAGE

Anchor bolts and connecting hardware shall be fabricated using type of steel specified (ASTM A36) and to the required shapes and sizes shown on the approved plan/drawings.

TESTING, SAMPLING, INSPECTION, ACCEPTANCE, MARKING AND PACKAGING

Testing

Sample rubber dock fenders that shall be incorporated in the project shall be subjected to tests. It shall pass the required energy absorption and reaction force at a certain deflection as indicated in the plan.

The Contractor shall be required to submit test certificates showing compliance to the above requirements. The test certificates shall be certified by an independent testing institute / organization recognized by the Authority.

Ten percent (10%) of the total number of fenders to be supplied and rounded to a unit shall be tested for performance. The fender shall be compressed repeatedly three (3) times to the maximum deflection at the speed from 2 to 8 cm. per minute. The load and deflection values shall be recorded with the precision of 0.1tf and 0.5mm respectively. The results shall be plotted in the form of load-deflection-energy absorption curves. The average data obtained in the second and third test loading shall be considered as performance values.

Inspection

All fenders of each type shall be inspected for compliance to specified dimensions and all fenders shall be inspected for any sign of flaw or defect inimical to its use.

All anchor bolts and fittings shall be inspected. The material used for the fabrication of bolts and fittings shall be covered by the manufacturer's certified mill certificate and shall be verified by the Authority.

Acceptance Tolerance

The acceptance tolerance shall be based on the following:

1. Fender Dimension

Length	:	-2% to +4%
Width	:	-2% to +4%
Height	:	-2% to +4%
Thickness	:	-2% to +8%

2. Anchor Bolt Holes in Fender

Diameter of the Hole	:	+2.0mm
Pitch of the Hole	:	+4.0mm

3. Acceptance tolerance for all fenders supplied shall be as follows:

E = Energy absorption,	$E \geq$ Specified E but not less than 10% of the specified E
R = Reaction force,	$R \leq$ Specified R but not more than 10% of the specified R

Marking

All fender units shall be clearly numbered and marked. Each fender shall have the following markings.

1. Fender type and manufacturer's name or trade mark
2. Production serial number
3. Date of manufacture or its abbreviation
4. Main dimensions
5. Project identification as follows:

Name of Port/Project : _____

Year supplied : _____

Packaging

The fenders shall be packaged on wooden crate or wrapped individually with Polypropylene sheets except when shipped containerized. The bolts and fittings should be placed in crates and suitably treated for protection when transported by sea and stored in port areas.

EXECUTION

MOORING / FENDERING SYSTEM

All units shall be installed at the locations shown on the drawings and as directed by the Engineer.

ITEM 08 : PILING WORKS (PRE-STRESSED CONCRETE PILES)

SCOPE OF WORK

This section covers the minimum requirements for the fabrication, hauling, spotting, driving and finishing of all foundation piles to be used in wharves/piers/platforms.

The Contractor may however, adopt, in addition to this minimum requirements additional provisions as may be necessary to insure the successful prosecution of the work related to foundation piling.

METHOD STATEMENT

Before the commencement of any piling works, the Contractor shall submit (allowing sufficient time for consideration) to the Engineer for approval a Safety Policy and a Method Statement which shall include the following information:

1. Program of Works detailing sequence and timing of individual portions of works.
2. Maximum proposed lead at any stage of driving between a pile and its neighbor and the limitations of same if hard driving is encountered.
3. Contingency plan in the event of encountering obstructions or reaching driving refusal to minimize disruption/delay especially when using pitch and drive methods.

MATERIAL REQUIREMENTS

TYPE OF FOUNDATION PILES

Pre-stressed concrete foundation piles to be used shall be in accordance with the design as shown on the Drawings and called for in the proposal.

PRE-STRESSED CONCRETE PILES

Pre-stressed concrete piles shall be constructed in accordance with the standard practice employed for the particular system specified and as directed by the Engineer subject to the following clauses.

1. Pre-stressed concrete piles shall be of readymade products of approved fabricator regularly engaged in the production of pre-stressed concrete piles.
2. If an alternative system of pre-stressing to that shown in the Drawings is proposed by the Contractor, full details, procedures and explanations shall be submitted in writing to the Engineer for his approval. When approved for the work, the provisions of this Specification and such other provisions as he may require shall be fully satisfied.
3. Concrete strength, high tension wires/strands, reinforcing bars to be used for pre-stressed concrete work shall be as specified in the Drawings.
4. The Contractor shall submit the casting method including pre-stressing, application of stress and casting schedule and shall obtain the approval of the Engineer before commencement of fabrication of the piles.
5. The Contractor shall arrange for the Engineer to have free access to the place of manufacture of the piles.

6. Piles shall be cast on a horizontal platform in approved steel moulds and details of the formwork and methods of concreting shall be as specified. The concreting of each pile shall be completed on one continuous operation and no interruption shall be permitted.

The pile butt must be formed truly square to the axis of the pile. Provision for standard splicing shall be provided unless otherwise ordered by the Engineer.

7. Anchorages shall be made from steel of a suitable quality to withstand permanently the forces imposed upon them, and shall in general be in accordance with the normal practice of the proprietors of the pre-stressing system in use.
8. Application of stress, grouting of pre-stressing cables, protection of pre-stressing cable anchorages and other necessary steps to complete the pre-stressing process shall conform to the standard practice of the pre-stressing system in use or as directed by the Engineer.
9. When the stress has been transferred to the pile, the pile shall exhibit no curvature in its length on any face greater than 3 millimeters deviation along a chord of 15 meters (1 in 500).
10. Pre-cast pre-stressed units shall be lifted only by lifting holes/hook as indicated in the Drawings, or when not provided can be lifted by slings placed securely at corresponding points. Units shall be kept in the upright position at all times and shock shall be avoided. Any unit considered by the Engineer to have become sub-standard in any way shall be rejected and replaced by an acceptable unit.
11. Each pre-stressed member is to be uniquely and permanently marked to show its type, date of casting, length of pile and any control markings as ordered by the Engineer
12. Forms shall conform to the geometry of the pile with the provision of chamfer as shown on the Drawings.
13. Not less than five (5) cylindrical specimens shall be made for each casting batch of which at least two (2) shall be reserved for 28-day test, one (1) for 7-day, one (1) for 14-day, and one (1) test prior to lifting of pre-stressed concrete piles from the casting bed. Lifting of piles shall only be done if the result of the compressive strength has reached at least 60% of the specified compressive strength.
14. Wires/strands specifications shall be in accordance with ASTM A 416.

EXECUTION

HANDLING OF PILES

All piles shall be carefully lifted at the location of the lifting points as indicated in the Drawings. Other practical and convenient methods may be used subject to the approval of the Engineer.

DRIVING OF PILES

A diesel pile hammer shall be used for driving the pre-stressed concrete piles.

The required weight of ram for the diesel pile hammer ranges from 2.5 to 3.5 tons.

Piles driven shall be held firmly in position in axial alignment with the hammer by means of leads of adequate length. Approved cushions shall be provided to the pile butts.

PILE SPLICING

General Provision

1. The alignment of piles shall be plumb and the length of upper and lower segment shall be in accordance in the approved plans.
2. The splice shall be embedded at least 4m from the design depth elevation.

Surface Preparation

Concrete piles to be bonded must be thoroughly cleaned, free of dirt, paint, grease, oil, curing compound and other contaminants. The concrete surface must be dry. Clean the dowels with steel brush to removed rust and other impurities. Blow compressed air to the dowel holes.

Splicing Epoxy

Piling splicing epoxy is a two components, low viscosity, rapid cure, chemical resistant epoxy with high physical strength.

Preparation and Application of Epoxy Mortar

Mixing and ratio of pile splicing epoxy and dry silica sand, application and curing of epoxy mortar shall refer to product manual.

Compressive Strength

The compressive strength of epoxy mortar (Pile Splicing Epoxy + Dry Silica Sand) shall be at least 1.2 times the design compressive strength of pile or 6,000psi.

Mechanical Properties of Epoxy

Cured state at 27° C (80° F) for 24 hours

Mechanical Properties	Specification (Test Methods)
Ultimate Tensile Strength	ASTM D 638
Ultimate Flexural Strength	ASTM D 790
Hardness	ASTM D 2240
Compressive Strength at 1 hour cure	ASTM D 695
Compressive Strength with Silica Sand	ASTM D 695

PILE CHIPPING

Each pile shall be chipped-off to required elevation as indicated in the drawing. The contractor shall ensure that no damaged/cracked on the main pile will occurred after each chipping. Reinforcement from driven piles (dowels and strand) shall not be cut and will be incorporated to the construction of deck. Splicing of dowels are allowed in case of pile cutting due to early refusal.

BEARING POWER OF PILES

Each pile shall be driven to attain not less than the required minimum bearing power shown in the pile schedule, as determined by the Hiley's Formula as follows:

$$\text{For Diesel Pile Hammer : } R = \frac{1}{6} \times \frac{2WH}{S + 2.54}$$

INTERRUPTED DRIVING

When driving is stopped before final penetration is reached and/or refusal is attained, the record of pile penetration shall be taken only after a minimum of 30 cm. (12 in.) total penetration has been obtained on resumption of driving.

ALIGNMENT TOLERANCE

Piles driven shall be within the allowable tolerance in alignment of 10 cm. (4 in.) in any direction.

DAMAGED AND MISDRIVEN PILES

1. Piles shall not be more than 10 cm. (4 in.) out of place at cut-off level. All vertical piles shall not be more than 2% out of plumb.
2. Any pile damaged by improper driving or driven out of its proper location, or driven out of elevation fixed on the plans, shall be corrected correspondingly at the Contractor's expense by any of the following methods:
 - a. Withdrawal of the pile and replacement by a new pile.
 - b. Driving a second pile adjacent to the defective one.
 - c. Splicing an additional length.

The method to be adopted in each case shall be at the discretion of the Engineer.

OBSTRUCTION

Where boulders or other obstructions make it impossible to drive certain piles in the location shown and to the required bearing strata, the Engineer may order additional pile or piles driven at other suitable location.

RECORDS

The Contractor shall keep records of each pile driven and shall furnish the Engineer two (2) signed typewritten/computerized copies. The records shall show the number of blows per 0.50 m. of initial penetration taken from the free fall elevation of the pile down to penetration depth of 5.0 m., the penetration under the last 10 blows, and the calculated safe load according to the Hiley's Formula as stated in bearing power of piles.

ITEM 09 : CONSTRUCTION JOINTS

SCOPE OF WORK

This item shall consist of the manufacturing and installation of construction joints / expansion joints in accordance with the details, and at the locations, lines, grades and dimensions shown in the drawings.

MATERIAL REQUIREMENTS

1. All construction joints / expansion joints shall be hot-dipped galvanized inside and out in accordance with international standards for galvanizing BS EN1460.
2. Painted finish shall be rejected.
3. All steel gratings and angle bars for construction joints / expansion joints shall be hot-dipped galvanized except for the nuts, washers and bolts which shall be stainless steel.
4. Welding shall be in accordance with the AWS Code and as herein specified or any other welding standard, approved by the Engineer.

The Contractor shall be required to submit test certificates for steel materials for the construction / expansion joints used in its manufacture; and for hot-dip galvanizing which shall meet or exceed the specifications under "Zinc Coating".

EXECUTION

DELIVERY, STORAGE AND INSTALLATION

1. Upon delivery at site, the hot-dipped galvanized construction joints / expansion joints shall not be subjected to the following activities:
 - a. Re-fabrication
 - b. Cutting
 - c. Grinding
 - d. Welding
 - e. Sawing
 - f. Any hot works or similar activities
2. Stainless steel nuts and bolts may be tack welded using stainless steel welding rods.
3. The construction joints / expansion joints shall not be exposed to sea water and other corrosive chemicals or substances prior to installation.

ITEM 10 : ZINC (HOT-DIP GALVANIZED) COATINGS ON IRON AND STEEL

SCOPE OF WORK

This specification covers the requirements for zinc coating (galvanizing) by the hot-dip process on iron and steel products made from rolled pressed and forged shapes, casting, plates, bars and strips.

This specification covers both fabricated and un-fabricated products, for example, assembled steel products, structural steel fabrications, large tubes already bent or welded before galvanizing, and wire work fabricated from uncoated steel wire. It also covers steel forgings and iron castings incorporated into pieces fabricated before galvanizing or which are too large to be centrifuged (or otherwise handled to remove excess galvanizing bath metal).

MATERIAL REQUIREMENTS

STEEL OR IRON

The specification, grade or designation, and type and degree of surface contamination of the iron or steel in articles to be galvanized shall be supplied by the purchaser to the hot-dip galvanizer prior to galvanizing.

The presence in steels and weld metal, in certain percentages, of some elements such as silicon, carbon and phosphorus tends to accelerate the growth of the zinc-iron alloy layer so that the coating may have a matte finish with a little or no outer zinc layer.

EXECUTION

FABRICATION

The design and fabrication of the product to be galvanized shall be in accordance to the plans and specifications. ASTM Practices A 143, A 384 and A 385 provide guidance for steel fabrication for optimum hot-dip galvanizing and shall be complied with in both design and fabrication.

CASTINGS

The composition of heat treatment of iron and steel castings shall conform to specifications designated by the purchaser. Some types of castings have been known to show potential problems being embrittled during normal thermal cycle of hot-dip galvanizing. The requirements for malleable iron castings to be galvanized are stipulated in ASTM specification A 47.

ZINC

The zinc used in the galvanizing bath shall conform to ASTM Specification B 6. If a zinc alloy is used as the primary feed to the galvanizing bath, then the base material used to make that alloy shall conform to ASTM Specification B 6.

BATH COMPOSITION

The molten metal in the working volume of the galvanizing bath shall contain not less than an average value of 98.0% zinc by weight.

COATING PROPERTIES

Table 1 – Minimum Average Coating Thickness Grade by Material Category

Material Category	All Specimens Tested Steel Thickness Range (Measured), mm (in.)				
	< 1/16 (<1.6)	1/16 to < 1/8 (1.6 to < 3.2)	1/8 to < 3/16 (3.2 to 4.8)	> 3/16 to < 1/4 (> 4.8 to < 6.4)	≥ 1/4 (≥ 6.4)
Structural Shapes & Plate	45	65	75	85	100
Strip and Bar	45	65	75	85	100
Pipe and Tubing	45	45	75	75	75
Wire	35	50	60	65	80

COATING THICKNESS

The average thickness of coating for all specimens tested shall conform to the requirements of Table 1 for the categories and thickness of the material being galvanized. Minimum average thickness of coating for any individual specimen is one coating grade less than that required in Table 1. Where products consisting of various material thicknesses or categories are galvanized, the coating thickness grades of each thickness range and material category of material shall be shown in Table 1. The specification of coating thickness heavier than those required by Table 1 shall be subject to mutual agreement between the galvanizer and Engineer.

For articles whose surface area is greater than 100,000 mm² (160 in.²) (multi-specimen articles), each test article in the sample must meet the appropriate minimum average coating thickness grade requirements of Table 1. Each specimen coating thickness grade comprising that overall average for each test article shall average not less than one coating grade below that required in Table 1.

For articles whose surface area is equal to or less than 100,000 mm² (160 in.²) (single-specimen articles), the average of all test articles in the sample must meet the appropriate minimum average coating thickness grade requirements of Table 1. For each test article, its specimen coating thickness shall not be less than one coating grade below that required in Table 1.

No individual measurement or cluster of measurements at the same general location on a test specimen shall be cause for rejection under this specification provided that when those measurements are averaged with the other dispersed measurements to determine the specimen coating thickness grade for that specimen, the requirements of the above specifications as appropriate are met.

The coating thickness grades in Table 1 represent the minimum value obtainable with a high level of confidence for the ranges typically found in each material category. While most coating thicknesses will be in excess of those values, some materials in each category may be less reactive (for example, because of chemistry or surface condition) than other materials of the steel category spectrum. Therefore, some articles may have a coating grade at or close to the minimum requirements shown in Table 1. In such cases, the precision and accuracy of the coating thickness measuring technique should be taken into consideration when rejecting such articles for coating thickness below that is required by this specification.

FINISH

The coating shall be continuous (except as provided below), and as reasonably smooth and uniform in thickness as the weight size and shape of the item. Except for local excess coating thickness which would interfere with the use of the product or make it dangerous to handle (edge tears or spikes), rejection for non-uniform coating shall be made only for plainly visible excess coating not related to design factors such as holes, joints, or special drainage problems. Since surface smoothness is a relative term, minor roughness that does not interfere with the intended use of the product, or roughness that is related to the as-received (un-galvanized) surface condition, steel chemistry to zinc shall not be grounds for rejection.

Surfaces that remain uncoated after galvanizing may be renovated in accordance with the methods in ASTM Practice A 780 provided that the following conditions are met:

1. Each area subject to renovation shall be 25mm (1 in.) or less in its narrowest dimension.
2. The total area subject to renovation on each article shall be no more than $\frac{1}{2}$ of 1% of the accessible surface area to be coated on that article, or 22,500mm² (36 in.²) per ton of piece weight, whichever is less. Inaccessible surface areas are those which cannot be reached for appropriate surface preparation and application of repair materials as described in ASTM Practice A 780.
3. The thickness of renovation shall be that is required by the thickness grade for the appropriate material category and thickness range in Table 1 in accordance with the coating thickness requirements, except that for renovation using zinc paints, the thickness of renovation shall be 50% higher than that required by table 1, but not greater than 0.0254mm (4.0 mils).
4. When areas requiring renovation exceed the criteria previously provide, or are inaccessible for repair, the coating shall be rejected.

THREADED COMPONENTS IN ASSEMBLIES

The zinc coating on external threads shall not be subjected to a cutting, rolling or finishing tool operation, unless specifically authorized by the purchaser. Internal threads may be tapped or retapped after galvanizing. Coatings shall conform to the requirements of ASTM Specification A 153/A 153 M.

APPEARANCE

Upon shipment from the galvanizing facility, galvanized articles shall be free from uncoated areas, blisters, flux deposits and gross dross inclusions. Lumps, projections, globules or heavy deposits of zinc which will interfere with the intended use of the material will not be permitted. Plain holes of 12.5mm (1/2 in.) diameter or more shall be clean and reasonably free from excess zinc. Marks in the zinc coating caused by tongs or other items used in handling the article during the galvanizing operation shall not be cause for rejection unless such marks have exposed the base metal, and the bare metal areas exceed the criteria provided in number 1 and 2 of Subsection "Finish".

Whenever dross is present in a form other than finely dispersed pimples in the coating and is present in such amount as to be susceptible to mechanical damage, it will be considered as "gross".

ADHERENCE

The zinc coating shall withstand handling consistent with the nature and thickness of the coating and the normal use of the article, without peeling or flanking. Although some material may be formed after galvanizing, in general the zinc coating on the articles covered by this specification is too heavy to permit severe bonding without damaging the coating.

SAMPLING

A lot is a unit of production or shipment from which a sample may be taken for testing. Unless otherwise agreed upon between the galvanizer and the purchaser, or established within this specification, the lot shall be as follows:

1. For testing at a galvanizer's facility, a lot is one or more articles of the same type and size comprising a single order or a single delivery load, whichever is smaller, or any number of articles identified as a lot by the galvanizer, when these have been galvanized within a single production shift and in the same bath.
2. For test by the purchaser after delivery, the lot consists of the single order or the single delivery load, whichever is smaller, unless the lot identify, established in accordance with the above, is maintained and clearly indicated in the shipment by the galvanizer.

The method of selection and number of test specimens shall be agreed upon between the galvanizer and the purchaser. Otherwise, the test specimens shall be selected random from each lot. In this case, the minimum number of specimens from each lot shall be as follows:

Number of Pieces in Lot	Number of Specimens
3 or less	All
4 to 500	3
501 to 1,200	5
1,201 to 3,200	8
3,201 to 10,000	13
10,001 and over	20

A test specimen which fails to conform to any requirement of this specifications shall not be used to determine the conformance to other requirements.

TEST REQUIREMENTS

Magnetic Thickness Measurements:

The thickness of the coating shall be determined by magnetic thickness gauge measurements in accordance with ASTM Practice E 376. For each specimen, five or more measurements shall be made at points widely dispersed throughout the volume occupied by the specimen so as to represent as much as practical, the entire surface area of the test specimen. The average of the five or more measurements thus made for each specimen is the specimen coating thickness.

For articles whose surface area is greater than 100,000 mm² (160 in²), in the average of the three specimen coating thickness grades comprising each test article is the average coating thickness for that test article. A specimen must be evaluated for each steel category and material thickness within the requirements for each specimen of the test article

For articles whose surface area is equal to or less than 100,000 mm² (160 in²), the average of all specimen coating thickness grades is the average coating thickness for the sample.

The use of magnetic measurement method is appropriate for larger articles, and may be appropriate for smaller articles when such is practical using ASTM Practice E 376.

Stripping Method

The average weight of coating may be determined by stripping a test article, a specimen removed from a test article, or group of test articles in the case of very small items such as nails, etc., in accordance with Test method ASTM A 90/A 90m. The weight of coating per unit area thus determined is converted to equivalent coating thickness values in accordance with Table 2, Coating Thickness Grade (rounding up or down as appropriate). The thickness of coating thus obtained is the test article coating thickness, or in the case of a specimen removed from a test article, is the specimen average coating thickness.

Table 2 – Coating Thickness Grade ^A

Coating Grade	mils	oz/ft ²	µm	g/m ²
35	1.4	0.8	35	245
40	1.4	1.0	45	320
50	2.0	1.2	50	355
55	2.2	1.3	55	390
60	2.4	1.4	60	425
65	2.6	1.5	65	460
75	3.0	1.7	75	530
80	3.1	1.9	80	565
85	3.3	2.0	85	600
100	3.9	2.3	100	705

^A Conversions in Table 2 are based on the metric thickness value equivalents from the next earlier version, using conversion factors consistent with Table X 2.1 in Specification A 653/A 653M, rounded to the nearest 5 µm (0.0002 in.). The conversion factors used are: mils = µm x 0.03937; oz/ft² = µm x 0.002316; g/m² = µm x 7.067.

Weighing Before or After Galvanizing

The average of coating may be determined by weighing articles before and after galvanizing, subtracting the first weigh from the second and dividing the result by the surface area. The first weigh shall be determined after pickling and drying, and the second after cooling to ambient temperature. The weight of coating per unit area thus determined is converted to equivalent coating thickness values according to Table 2 (rounding up or down as appropriate). The thickness of coating thus obtained is the test article coating thickness.

Microscopy

The thickness of coating may be determined by cross-sectional and optical measurement in accordance with ASTM Test Method B 487. The thickness thus determined is a point value. No less than five such measurements shall be made at locations on the test article which are as widely dispersed as practical, so as to be representative of the whole surface of the test article. The average of no less than five such measurement is the specimen coating thickness.

Adhesion

Determine adhesion of the zinc coating to the surface of the base metal by cutting or prying with the point of a stout knife, applied with considerable pressure in a manner tending to remove a portion of the coating. The adhesion shall be considered inadequate if the coating flakes off in the form of a layer of the coating so as to expose the base metal in advance of the knife point. Do not use testing carried out at edges or corners (points of lowest coating adhesion) to determine adhesion of the coating. Likewise, do not use removal of small particles of the coating by paring or whittling to determine failure.

Embrittlement

Test for embrittlement may be made in accordance with ASTM Practice A 143

The galvanized article should withstand a degree of bending substantially the same as the ungalvanized article. Flaking or spalling of the galvanized coating is not be constructed as an embrittlement failure.

Inspection, Rejection and Retest

The material shall be inspected at the galvanizer's plant prior to shipment. However, by agreement the purchaser may make the tests which govern the acceptance or rejection of the materials in his own laboratory or elsewhere.

When inspection of materials to determine conformity with the visual requirements of Subsection "Finish" warrants rejection of a lot, the galvanizer may sort the lot and submit it once again for acceptance after he has removed any nonconforming articles and replace them with conforming articles.

Materials have been rejected for reasons other than embrittlement may be stripped and regalvanized, and again submitted for inspection and test at which time they shall conform to the requirements of this inspection.

Transport and Storage

Galvanized components shall, wherever possible, be transported and stored under dry, well-ventilated conditions to prevent the formation of wet storage staining.

Either zinc phosphate or chromate passivation treatment after galvanizing may be used to minimize the wet storage staining which may occur on articles unable to be stored in dry, well-ventilated conditions.

Provided the coating thickness complies with the requirements of Subsection "Coating Thickness", no further remedial action is required to the stained areas.

ITEM 11 : PROJECT BILLBOARD


SPECIFICATION


The Project Billboard shall be installed at location(s) designated by the Engineer.

The size and specifications of materials for the standard billboard shall be 4ft. x 8ft. (1,200mm x 2,400mm) using ½ inch (12mm) marine plywood or tarpaulin poster on 3/16 inch (5mm) marine plywood.

Project billboards shall not contain Name(s) and/or picture(s) of any personages.

See attached drawings for further details of the standard billboard.

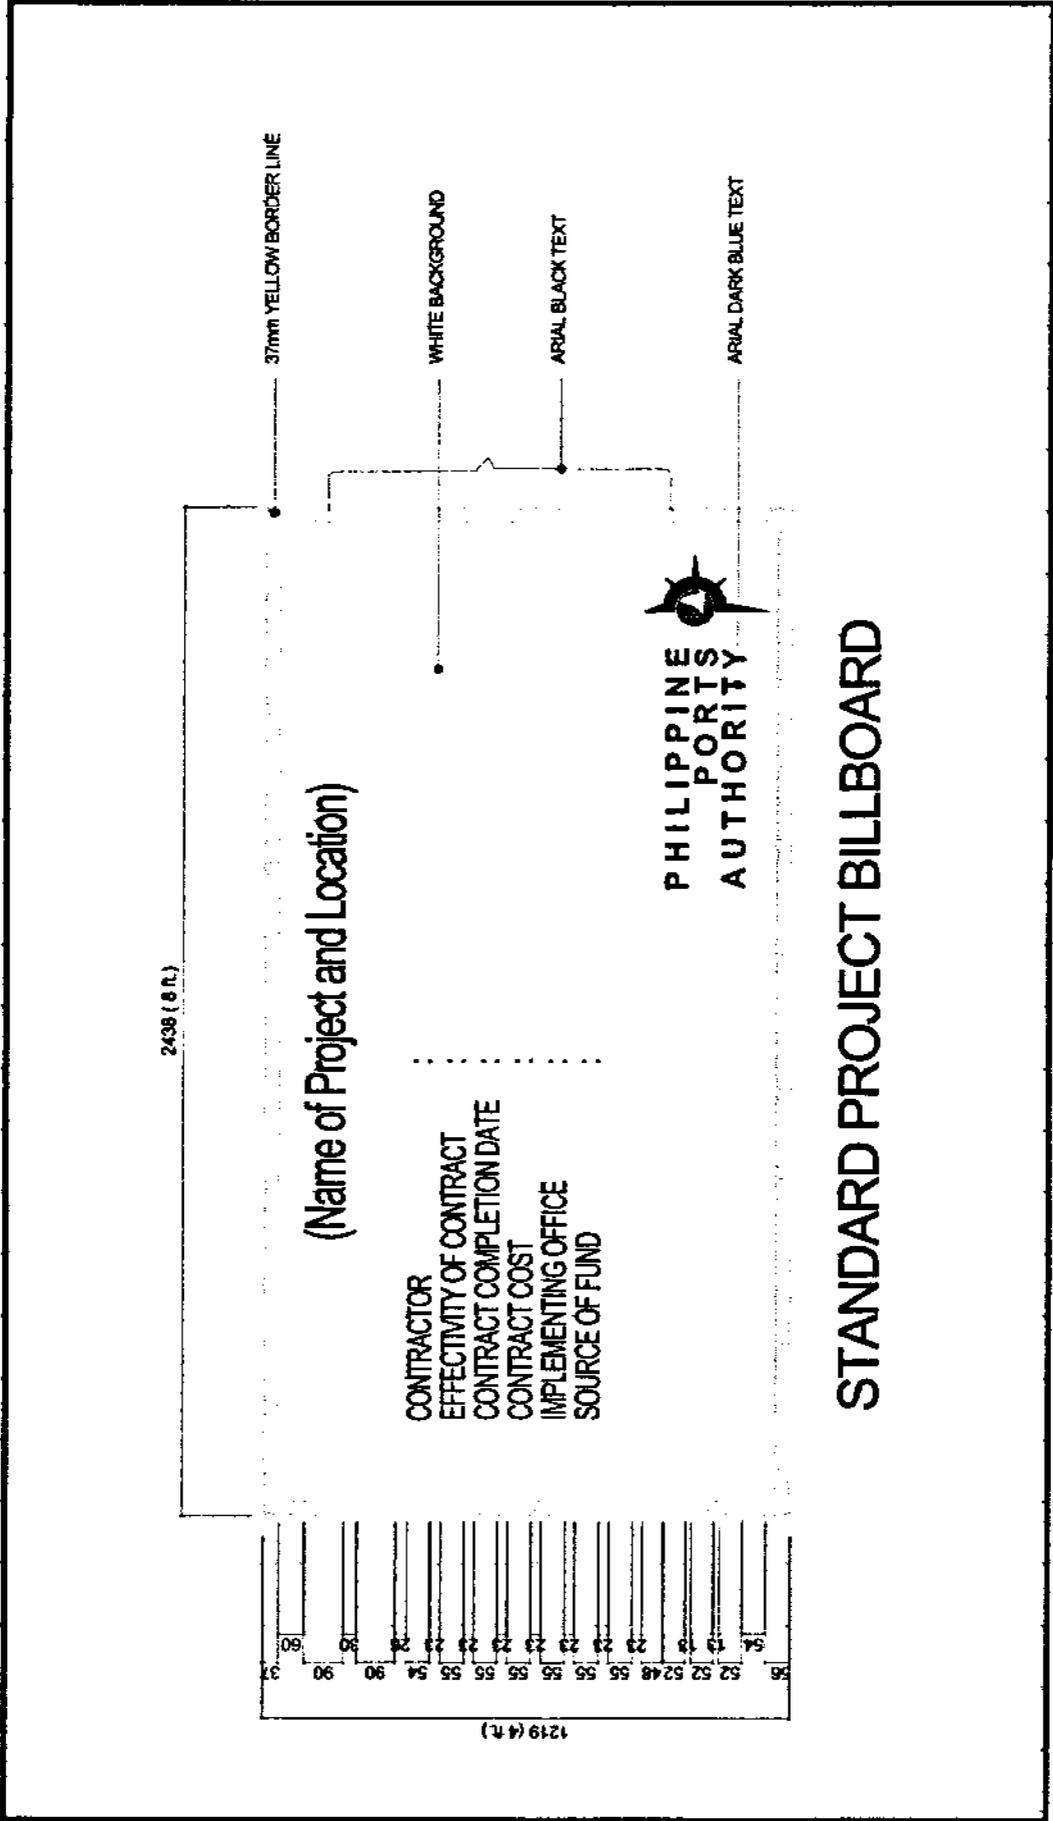

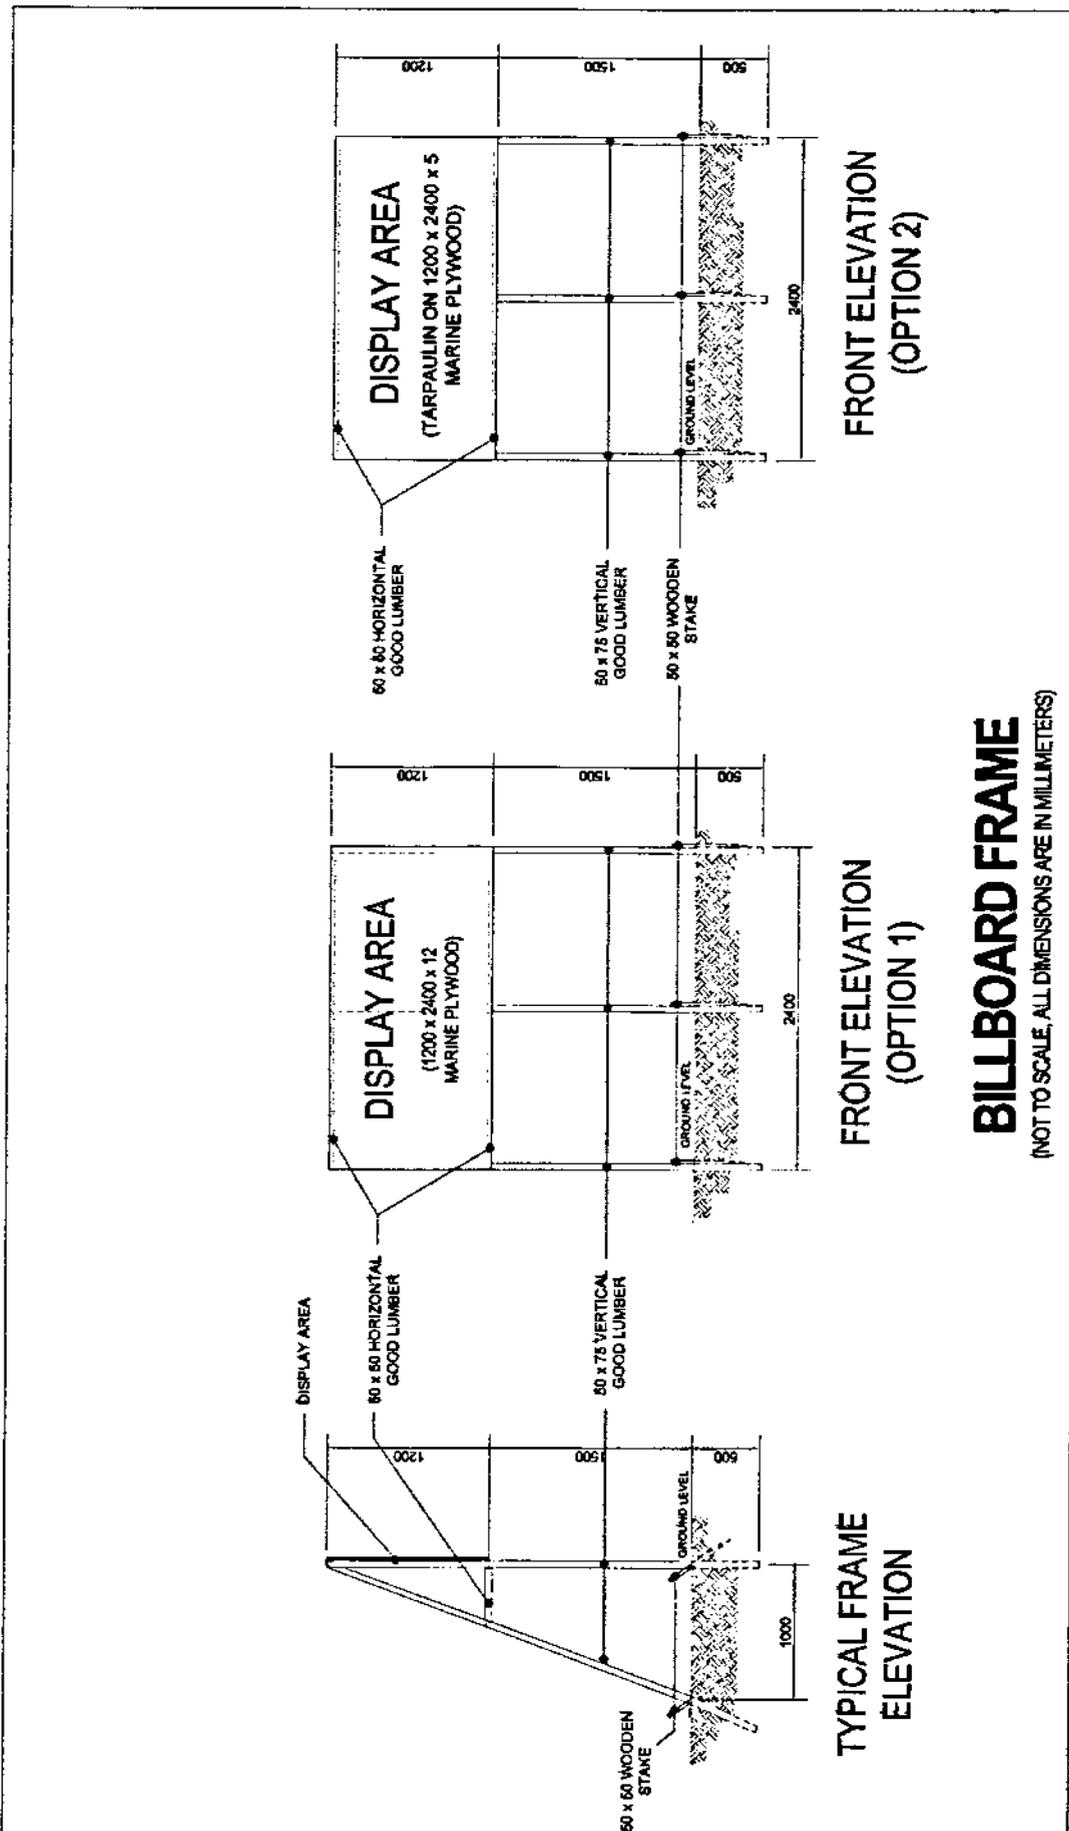

BILLBOARD FRAME
 (NOT TO SCALE, ALL DIMENSIONS ARE IN MILLIMETERS)

ITEM 12 : SAFETY SIGNAGES AND BARRICADES

DESCRIPTION

This work includes the furnishing and installing of safety signages and barricades in accordance with the specifications and to the details shown below in the drawings, or as directed by the Engineer.


SPECIFICATION

The Signage's and Barricades shall be installed at location(s) designated by the Engineer.

The sizes of the standard signages shall be 2-2/3ft x 4ft (800mm X 1,200mm) for fixed type and 2ft x 2-2/3ft (600mm x 800mm) for mobile type. For barricade standard 2ft x 2-2/3ft (600mm x 800mm) shall be provided.

The materials to be used for signages and barricades are ½ inch (12mm) marine plywood or tarpaulin poster on 2" x 2" (50mm x 50mm) good lumber frame (see drawing below).

The printing or painting shall be the discretion of the Engineer.

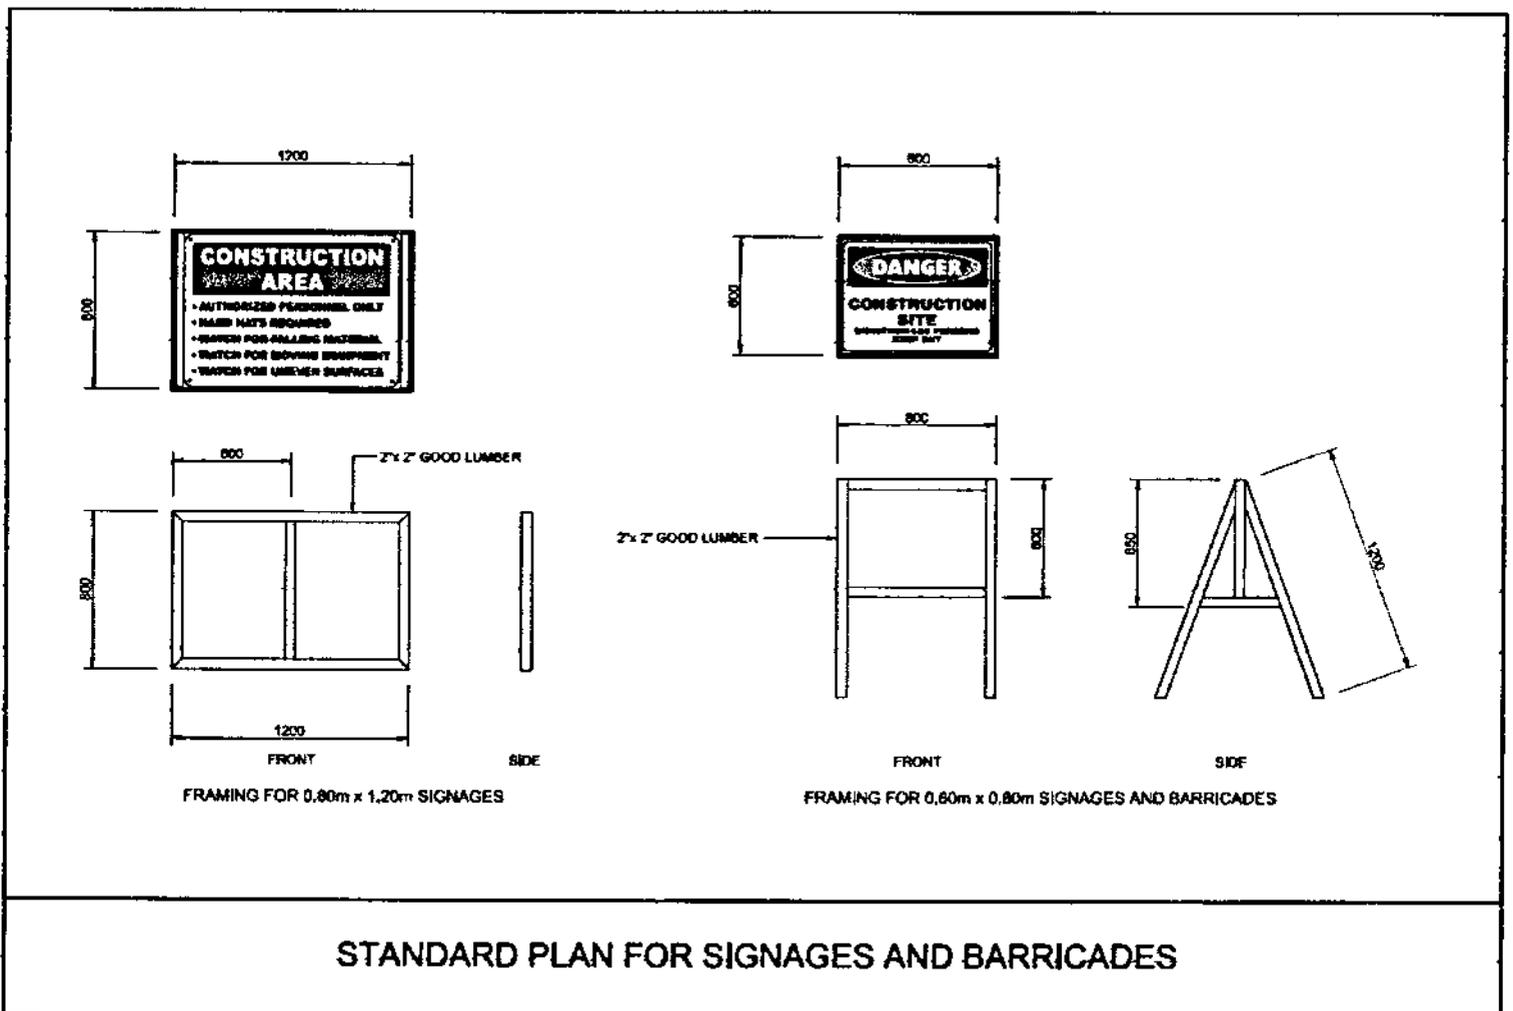

SECTION VII
PROJECT DRAWINGS

SECTION VII

PROJECT DRAWINGS (SEE ISSUED APPROVED PLANS)

LIST OF DRAWINGS:

- | | |
|-----------|--|
| 01 of 19 | Development Plan, Location Map, General Notes, Design Parameters and List of Drawings |
| 02 of 19 | Demolition and Clearing Layout |
| 03 of 19 | Sections of Existing Pier |
| 04 of 19 | General Plan |
| 05 of 19 | Plan Showing Old Piles to Be Cut and New Piles to Be Driven |
| 06 of 19 | Pier Piling and Framing Plan |
| 07 of 19 | Pier offshore Elevation |
| 08 of 19 | Section A-A |
| 09 of 19 | Section B-B, Section C-C, Section D-D, Transition Ramp Pavement Detail and 200mm Thick PCCP. |
| 10 of 19 | Details of 400mm X 400mm Pre-Stressed Concrete Pile, Notes and Specifications |
| 11 of 19 | Detail of Curtain Walls, Detail of Construction Joints, Detail of Pile Caps and Slab Detail |
| 12 of 19 | Longitudinal Beam Details |
| 13 of 19 | Transverse Beam Details. |
| 14 of 19 | Reinforcement Detail of Mooring and Fendering Block and Typical Attachment of 400H X 2000L V-Type RDF and 25T Mooring T-Head |
| 15 of 19 | Detail of V500h X 2000L Rubber Dock Fender and Accessories and Detail of 25 Ton Mooring Tee Head |
| 16 of 19 | Roro Ramp and Transition Ramp Details. |
| Annex - 1 | Borehole Location Plan and Borehole Logs |

SECTION VIII

BILL OF QUANTITIES
and
ATTACHMENTS

APPROVED BUDGET FOR THE CONTRACT
REHABILITATION OF EXISTING R.C. PIER
 Port of Baybay, Leyte



NO. (1)	DESCRIPTION OF WORK (2)	UNIT (3)	QTY. (4)	UNIT PRICE (Pesos) (5)	AMOUNT (Pesos) (4) x (5)
1	GENERAL EXPENSES				
1.01	Mobilization, demobilization and cleaning	lot	1		
1.02	Rental of temporary site office and residence for the Engineer and staff	mo.	14		
1.03	Maintain temporary site office and residence for the Engineer and staff	mo.	14		
1.04	Provide Construction Safety and Health Program in the execution of the project	mo.	14		
TOTAL FOR BILL NO. 1					

APPROVED BUDGET FOR THE CONTRACT
REHABILITATION OF EXISTING R.C. PIER
 Port of Baybay, Leyte



NO. (1)	DESCRIPTION OF WORK (2)	UNIT (3)	QTY. (4)	UNIT PRICE (Pesos) (5)	AMOUNT (Pesos) (4) x (5)
2	DEMOLITION, REMOVAL & EXCAVATION WORKS				
2.01	Demolish and dispose existing RC deck	sq.m.	1,404		
2.02	Demolish and dispose existing Breasting dolphin	cu.m	95		
2.03	Cut & dispose existing piles up to seabed elevation	no.	271		
2.04	Remove existing bollard including accessories	no.	28		
2.05	Remove existing fender including accessories	no.	11		
2.06	Demolish and dispose existing PCCP and ramp	sq.m.	262		
2.07	Chip-off portion of existing R.C. Curb, flush to deck level and smoothen with mortar	l.m.	5		
2.08	Chip/Cut and dispose portion of existing coping wall & retaining wall prior for the construction of ro-ro ramp	cu.m	7		
2.09	Excavate and back-fill existing fill materials prior for the construction of ro-ro ramp and retaining wall	cu.m	149		
TOTAL FOR BILL NO. 2					

APPROVED BUDGET FOR THE CONTRACT
REHABILITATION OF EXISTING R.C. PIER
 Port of Baybay, Leyte



NO. (1)	DESCRIPTION OF WORK (2)	UNIT (3)	QTY. (4)	UNIT PRICE (Pesos) (5)	AMOUNT (Pesos) (4) x (5)
3	TRANSITION RAMP & EXTENSION OF RORO RAMP ON FILL				
3.01	Supply and place 3,500 psi concrete for the retaining wall and R.C. curb.	cu.m.	29		
3.02	Supply and install steel reinforcement for the retaining wall, anchor wall, and R.C. curb.	kg.	2,398		
3.03	Supply and place gravel bedding for retaining wall	cu.m.	6		
3.04	Supply, spread and compact Selected fill	cu.m.	9		
3.05	Supply, spread and compact aggregate base course	cu.m.	52		
3.06	Construct portland cement concrete pavement (300mm thk.) including reinforcements	sq.m.	150		
3.07	Construct portland cement concrete pavement (200mm thk.) including reinforcements	sq.m.	112		
3.08	Re-install old rubber dock fenders (V500H x 1500L) including new accessories	set.	5		
TOTAL FOR BILL NO. 3					

APPROVED BUDGET FOR THE CONTRACT
REHABILITATION OF EXISTING R.C. PIER
 Port of Baybay, Leyte



NO. (1)	DESCRIPTION OF WORK (2)	UNIT (3)	QTY. (4)	UNIT PRICE (Pesos) (5)	AMOUNT (Pesos) (4) x (5)
4	REHABILITATION OF EXISTING R.C. PIER				
4.01	Supply and deliver to site 400mm x 400mm PSC Piles	l.m.	9,388		
4.02	Handle, pitch and drive 400mm x 400mm Vertical PSC Piles	l.m.	5,688		
4.03	Handle, pitch and drive 400mm x 400mm Batter PSC Piles	l.m.	3,700		
4.04	Splice 400mm x 400mm PSC Piles	no.	258		
4.05	Chip/cut & dispose portion of newly driven PSC Piles up to required elevation	no.	258		
4.06	Supply and install steel reinforcements for the superstructure	kg.	146,195		
4.07	Supply and place 3,500 psi concrete for the superstructure	cu.m.	942		
4.08	Supply and install hot dipped galvanized angle bar (L100 x 100 x 10mm) construction joint including dowel bars	l.m.	52		
4.09	Supply and deliver to site rubber dock fender (V-type, 500H x 2000L) including accessories	set	35		
4.10	Install rubber dock fender and accessories	set	35		
4.11	Supply and deliver to site mooring bollard (25 Tons, T-head) including accessories	set	7		

APPROVED BUDGET FOR THE CONTRACT
REHABILITATION OF EXISTING R.C. PIER
 Port of Baybay, Leyte



NO. (1)	DESCRIPTION OF WORK (2)	UNIT (3)	QTY. (4)	UNIT PRICE (Pesos) (5)	AMOUNT (Pesos) (4) x (5)
4.12	Install mooring bollards (25 Tons, T-head type) and accessories	set	7		
4.13	Re-install old mooring bollard (25 Tons) including new accessories	set.	28		
TOTAL FOR BILL NO. 4					

APPROVED BUDGET FOR THE CONTRACT
REHABILITATION OF EXISTING R.C. PIER
 Port of Baybay, Leyte



NO. (1)	DESCRIPTION OF WORK (2)	UNIT (3)	QTY. (4)	UNIT PRICE (Pesos) (5)	AMOUNT (Pesos) (4) x (5)
BILL NO. 5	REIMBURSABLE ITEMS				
5.01	Provide reimbursable items necessary in the implementation of the project as determined by the Authority	lot	1	2,605,711.08	2,605,711.08
TOTAL FOR BILL NO. 5					2,605,711.08

BASIS OF PAYMENT FOR WORK ITEMS INCLUDED IN THE PROPOSAL

The work items included in the proposal and the basis of payments are as follows:

BILL NO. 1

GENERAL EXPENSES

Item 1.01 Mobilization, demobilization and cleaning

The quantity to be paid for shall be the minimum equipment requirement enumerated in the bid documents mobilized, demobilized and cleaning of the site and accepted by the Engineer. The contract lump sum price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to mobilize and demobilize all the minimum equipment requirement enumerated in the bid documents including cleaning of the site. Fifty percent (50%) of the total amount shall be payable after the mobilization activity while the remaining (50%) payable after demobilization and cleaning.

Item 1.02 Rental of temporary site office and residence for the Engineer and staff

The quantity to be paid for shall be the actual rental for temporary site office and residence for the engineer and staff and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary for the provision of temporary site office and residence for the engineer and staff at least 48.00 m²

Item 1.03 Maintain temporary site office and residence for the Engineer and staff

The quantity to be paid for shall be the actual services rendered in maintaining the site office and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the maintenance of the temporary site office and residence as well as other expenses such as provision for electric power, telephone bill, potable water supply, janitorial and security services.

Item 1.04 Provide construction safety and Health Program in the execution of the project

The quantity to be paid for shall be the actual implementation of construction safety and health program and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the implementation of the Construction Safety and Health Program, as required and approved by the Department of Labor and Employment (DOLE).

BILL NO. 2

DEMOLITION AND REMOVAL WORKS

Item 2.01 Demolish and dispose existing RC deck

The quantity to be paid for shall be the actual area in square meter of existing RC deck, demolished and disposed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 2.02 Demolish and dispose existing Breasting Dolphin

The quantity to be paid for shall be the actual volume in cubic meter of existing breasting dolphin, demolished and disposed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 2.03 Cut and dispose existing piles up to seabed elevation

The quantity to be paid for shall be the actual number of existing piles, cut off up to seabed elevation and disposed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 2.04 Remove existing bollard including accessories

The quantity to be paid for shall be the actual quantity in set of existing bollard including accessories, removed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 2.05 Remove existing fender including accessories

The quantity to be paid for shall be the actual quantity in set of existing fender including accessories, removed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 2.06 Demolish and dispose existing PCCP and ramp

The quantity to be paid for shall be the actual area in square meter of existing PCCP and ramp, demolished and disposed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 2.07 Chip-off portion of existing rc curb, flush to deck level and smoothen with mortar

The quantity to be paid for shall be the actual length in linear meter of portion of existing rc curb to be chipped off, flushed to deck level and smoothened with mortar in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 2.08 Excavate and back-fill existing fill materials prior to the construction of roro ramp and retaining wall

The quantity to be paid for shall be the actual volume in cubic meter of existing fill materials, excavated and backfilled prior to the construction of roro ramp and retaining wall in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

BILL NO. 3

TRANSITION RAMP AND EXTENSION OF RORO RAMP ON FILL

Item 3.01 Supply and place 3,500 psi concrete for the retaining wall and rc curb

The quantity to be paid for shall be the actual volume in cubic meter of 3,500 psi concrete for the retaining wall and rc curb, supplied and set-in-place in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 3.02 Supply and install steel reinforcements for the retaining wall, anchor wall and rc curb

The quantity to be paid for shall be the actual weight in kilogram of reinforcing steel bars for the retaining wall, anchor wall and rc curb, supplied and installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 3.03 Supply and place gravel bedding for retaining wall

The quantity to be paid for shall be the actual volume in cubic meter of gravel bedding for retaining wall, supplied and set-in-place in accordance with the plans and specifications and accepted by the Engineer. Hydrographic/Topographic Surveys before and after placing of sand and gravel fill shall be made to determine the actual elevations along the cross sections and the actual quantities for payment. Volume due to settlement as established using settlement plates shall also be considered for payment. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 3.04 Supply, spread and compact selected fill

The quantity to be paid for shall be the actual volume in cubic meter of selected fill to be supplied, spread and compacted in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for

furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 3.05 Supply, spread and compact aggregate base course

The quantity to be paid for shall be the actual volume in cubic meter of aggregate base course, to be supplied, spread and compacted in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 3.06 Construct portland cement concrete pavement (PCCP, 300mm thk.) including reinforcements

The quantity to be paid for shall be the actual area in square meter of portland cement concrete pavement (PCCP, 300mm thk.) including reinforcements to be constructed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 3.07 Construct portland cement concrete pavement (PCCP, 200mm thk.) including reinforcements

The quantity to be paid for shall be the actual area in square meter of portland cement concrete pavement (PCCP, 200mm thk.) including reinforcements to be constructed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 3.08 Re-install old rubber dock fenders (V500H x 1500L) including new accessories

The quantity to be paid for shall be the actual quantity in set of old rubber dock fender (V500H x 1500L) including new accessories, installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

BILL NO. 4

REHABILITATION OF EXISTING RC PIER

Item 4.01 Supply and deliver to site 400mm x 400mm PSC piles

The quantity to be paid for shall be the actual length in linear meter of PSC piles (400mm x 400mm), supplied and delivered to site in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 4.02 Handle, pitch and drive 400mm x 400mm PSC vertical piles

The quantity to be paid for shall be the actual length in linear meter of 400mm x 400mm PSC vertical piles, handled, pitched and driven in accordance with the plans and specifications, measured from the tip of piles to cut-off elevation and accepted by the Engineers. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 4.03 Handle, pitch and drive 400mm x 400mm PSC batter piles

The quantity to be paid for shall be the actual length in linear meter of 400mm x 400mm PSC batter piles, handled, pitched and driven in accordance with the plans and specifications, measured from the tip of piles to cut-off elevation and accepted by the Engineers. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 4.04 Splice 400mm x 400mm PSC piles

The quantity to be paid for shall be the actual number of 400mm x 400mm PSC piles spliced in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 4.05 Chip/cut and dispose portion of newly driven PSC piles up to required elevation

The quantity to be paid for shall be the actual number of portion of newly driven PSC piles to be chipped/cut off up to required elevation and disposed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 4.06 Supply and install steel reinforcements for superstructure

The quantity to be paid for shall be the actual weight in kilogram of reinforcing steel bars, supplied and installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 4.07 Supply and place 3,500 psi concrete for superstructure

The quantity to be paid for shall be the actual volume in cubic meter of 3,500 psi concrete, supplied and set-in-place in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 4.08 Supply and install hot dipped galvanized angle bar (L100 x 100 x 10mm) for construction joint including dowel bars

The quantity to be paid for shall be the actual length in linear meter of hot dipped galvanized angle bar (L100 x 100 x 10mm) for construction joint including dowel bars, supplied and installed in accordance with the plans and specifications, measured from the tip of piles to cut-off elevation and accepted by the Engineers. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 4.09 Supply and deliver to site rubber dock fender (V-type 500H x 2000L) including accessories

The quantity to be paid for shall be the actual quantity in set of rubber dock fender (V-type 500H x 2000L) including accessories, supplied and delivered to site in accordance with the plans and specifications and accepted by the Engineer. The

contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 4.10 Install rubber dock fender including accessories

The quantity to be paid for shall be the actual quantity in set of rubber dock fender including accessories, installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 4.11 Supply and deliver to site mooring bollard (25 Tons, T-head) including accessories

The quantity to be paid for shall be the actual quantity in set of mooring bollard (35 Tons, T-head) including accessories, supplied and delivered to site in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 4.12 Install mooring bollard (25Tons, T-head type) including accessories

The quantity to be paid for shall be the actual quantity in set of mooring bollard (25Tons, T-head type) including accessories, installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 4.13 Re-install old mooring bollard (25 tons) including new accessories

The quantity to be paid for shall be the actual quantity in set of old mooring bollard (25 tons) including new accessories, installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

BILL NO. 5

REIMBURSABLE ITEMS

Item 5.01 Provide reimbursable items necessary in the implementation of the project as determined by the Authority.

The quantity to be paid for shall be the actual quantity of determined items by the Authority deemed necessary in the implementation of the project, supplied, delivered and accepted by the Authority. Payment for said items shall be made only upon complete delivery/acceptance of such. The contract lump sum price shall be full compensation for providing all determined items. The Contractor's Profit and Overhead, Contingencies and Miscellaneous (OCM) should not be included in the cost of said items. The amount of bid should be fixed as indicated in the amount stated in the Bid Data Sheet [ITB Clause 13.1(a)] and as provided in the Bill of Quantities (BOQ). Claims for payment shall be supported by Official Receipt(s) (OR) and at least three (3) canvasses. The amount to be paid for shall be the price indicated in the OR but should not exceed the contract lump sum price. The determined items shall be the property of PPA. Operation and maintenance shall be borne by PPA.

FACILITIES TO BE PROVIDED FOR THE ENGINEER & HIS STAFF

TEMPORARY FACILITIES OF THE CONTRACTOR

The Contractor shall provide and maintain such temporary offices, stores, workshops, latrines, housing and messing accommodations as are necessary. The location, dimension and layout of such buildings and places shall be subject to the approval in writing of the Engineer. By the end of the contract, the Contractor shall remove all buildings and the area shall be cleared and graded as required by the Engineer.

SITE OFFICE AND RESIDENCE FOR THE ENGINEER & STAFF

The Contractor shall provide and maintain a temporary site office and residence with an area of at least 48 square meters for use of the Engineer and staff, including all the necessary electricity, water, communication services and consumables.

MINIMUM EQUIPMENT REQUIREMENTS

2	unit/s	Air-Compressor (250 cfm, minimum), owned
1	unit/s	Backhoe (0.40 cu.m., 94.30 hp, minimum), owned/leased
1	unit/s	Concrete Cutter, owned
2	unit/s	Concrete Mixer (1-bagger, minimum), owned
1	unit/s	Concrete Bucket, owned
1	unit/s	Concrete Screeder, owned
1	unit/s	Concrete Vibrator (3.5 hp, minimum), owned
1	unit/s	Crane Barge (319 GW, minimum) with 60T crane, owned
1	unit/s	Crawler Crane (30T, minimum), owned/leased
1	unit/s	Pile Hammer (Diesel, 10,500 kg.m.), owned
4	unit/s	Diving Equipment (complete), owned/leased
1	unit/s	Drop Hammer (2T, minimum), owned
1	unit/s	Dump Truck (8 cu.m., minimum), owned
2	unit/s	Bar Bender (electric, 25mm dia min.), owned
2	unit/s	Bar Cutter (electric, 25mm dia min.), owned
2	unit/s	Jack Hammer, owned/leased
1	unit/s	Jack Hammer (U/W), owned/leased
2	unit/s	Oxy/Acetylene Cutting Outfit, owned
1	unit/s	Payloader (80 hp, minimum), owned/leased
1	unit/s	Plate Compactor (5 hp, minimum), owned
1	unit/s	Road Grader (125 hp, minimum), owned/leased
1	unit/s	Road Roller (12.5T, vibratory, minimum), owned/leased
2	unit/s	Transit Mixer (5-6 cu.m. cap., minimum), owned/leased
1	unit/s	Tugboat (500hp, minimum), owned/leased
2	unit/s	U/W cutting equipment, owned/leased
1	unit/s	Water Truck with pump (1,000 gal., minimum), owned
2	unit/s	Welding Machine (400 amp., minimum), owned
1	unit/s	Cargo Truck (5T, minimum), owned
1	unit/s	Backhoe Breaker Attachment, owned/leased

CONSTRUCTION SAFETY AND HEALTH REQUIREMENT

The Contractor shall implement the construction safety and health program in accordance with the applicable provisions of the Occupational Safety and Health Standards (OSHS) of the Department of Labor and Employment (DOLE).

The Contractor, subject to the approval of the Engineer shall provide and maintain throughout the duration of the contract a medical room with at least 15 square meters together with all necessary supplies to be sited in the Contractor's main area.

The Contractor shall provide the following minimum requirements:

LABOR

- | | | |
|---|-----|---------------------------|
| 1 | no. | Safety Engineer / Officer |
| 1 | no. | Nurse / Health Officer |

EQUIPMENT / MATERIALS

Personnel Protective Equipment

- | | | |
|----|------|--------------|
| 49 | pcs. | Hard Hats |
| 49 | pcs. | Gloves |
| 7 | pcs. | Goggles |
| 1 | pcs. | Aprons |
| 1 | pcs. | Safety Belts |
| 49 | pcs. | Safety Shoes |
| 1 | pcs. | Life Lines |

Safety Devices

- | | | |
|---|-------|-------------------|
| 1 | lot | Barricades |
| 1 | lot | Warning signs |
| 2 | units | Fire extinguisher |

Medical and First Aid System - For fourteen (14) mos.

NOTE:

The Contractor shall provide the above-cited minimum construction safety and health requirements or as required by the Engineer.

SECTION IX
BIDDING FORMS

Bid Form

Date: _____

ITB No: _____

To: **Philippine Ports Authority**
Bonifacio Drive, South Harbor,
Port Area, Manila

We, the undersigned, declare that:

- (a) We have examined and have no reservation to the Bidding Documents, including Addenda, for the **Contract Rehabilitation of Existing RC Pier, Port of Baybay, Leyte**;
- (b) We offer to execute the Works for this Contract in accordance with the Bid and Bid Data Sheet, General and Special Conditions of Contract accompanying this Bid;

The total price of our Bid, excluding any discounts offered below is:

BILL NO	DESCRIPTION	TOTAL AMOUNT
1	General Expenses	₱
2	Demolition, Removal and Excavation Works	
3	Transition Ramp and Extension of RoRo Ramp on Fill	
4	Rehabilitation of Existing RC Pier	
5	Reimbursable Items	
	TOTAL AMOUNT OF BID (including VAT)	₱

The discounts offered and the methodology for their application are: *insert information*;

- (c) Our Bid shall be valid for a period of 120 days from the date fixed for the Bid submission deadline in accordance with the Bidding Documents, and it shall remain binding upon us and may be accepted at any time before the expiration of that period;
- (d) If our Bid is accepted, we commit to obtain a Performance Security in the amount of *insert percentage amount* percent of the Contract Price for the due performance of the Contract;

- (e) Our firm, including any subcontractors or suppliers for any part of the Contract, have nationalities from the following eligible countries: *[insert information]*;
- (f) We are not participating, as Bidders, in more than one Bid in this bidding process, other than alternative offers in accordance with the Bidding Documents;
- (g) Our firm, its affiliates or subsidiaries, including any subcontractors or suppliers for any part of the Contract, has not been declared ineligible by the Funding Source;
- (h) We understand that this Bid, together with your written acceptance thereof included in your notification of award, shall constitute a binding contract between us, until a formal Contract is prepared and executed; and
- (i) We understand that you are not bound to accept the Lowest Calculated Bid or any other Bid that you may receive.
- (j) We likewise certify/confirm that the undersigned, is the duly authorized representative of the bidder, and granted full power and authority to do, execute and perform any and all acts necessary to participate, submit the bid, and to sign and execute the ensuing contract for the **Rehabilitation of Existing RC Pier, Port of Baybay, Leyte** of the **Philippine Ports Authority**.
- (k) We acknowledge that failure to sign each and every page of this Bid Form, including the Bill of Quantities, shall be a ground for the rejection of our bid.

Name: _____

In the capacity of: _____

Signed: _____

Duly authorized to sign the Bid for and on behalf of: _____

Date: _____

**STATEMENT OF ALL ON-GOING GOVERNMENT AND PRIVATE CONTRACTS,
INCLUDING CONTRACTS AWARDED BUT NOT YET STARTED, WHETHER SIMILAR OR NOT SIMILAR IN NATURE**

Name of the Contract or Title Of the Project 1]	Owner's Name and Address	Nature/ Scope of Work 2]	Contractor's Role (in percentage) 3]	Total Contract Value At		Date of Award 5]	Value of Outstanding Works	Estimated Time of Completion	% of Accomplishment		Contract Duration 5]	
				Award	Escalated Value to Present Prices 4]				Planned	Actual	Start	Completed
A) Government Contracts i. On-going ii. Awarded but not yet started B) Private Contracts i. On-going ii. Awarded but not yet started												

NOTE:

- 1] As appearing or defined in the contract entered/executed by the parties
- 2] With special reference to the Scope of Works as described/enumerated in the advertised Invitation To Bid.
- 3] Indicate whether as Sole Contractor, Sub-Contractor or Member in a Joint Venture / Consortium
- 4] Indicate the FOREX used if Contract Value is expressed in a currency other than the Philippine Peso. Specify the "Escalation Factor" used to escalate the Contract Value from completion date to the advertisement date of the Invitation to Bid per section 23.11.2 (3) of R.A. 9184.
- 5] State Month and Year.

This Statement shall be supported by:

- a) Notice of Award and/or Contract
- b) Notice to Proceed

Name of Firm/Applicant

Authorized Signing Official

Date

STATEMENT OF THE BIDDER'S SINGLE LARGEST COMPLETED CONTRACT (SLCC) SIMILAR TO THE CONTRACT TO BE BID

Name of the Contract or Title Of the Project	Owner's Name and Address	Nature/Scope of Work	Contractor's Role and Percentage Of Participation	Total Contract Value At		Date of Award	Value of Outstanding Works	Contract Duration	
				Award	Completion			Escalated Value to Present Prices	Start

NOTE :

1. The prospective bidder must have completed an SLCC that is similar to the contract to be bid, and whose value, adjusted to current prices using the PSA consumer price indices, must be at least fifty percent (50%) of the ABC to be bid.
2. This Statement shall be supported by:
 - a. Notice of Award and / or Notice to Proceed.
 - b. Project Owner's Certificate of Final acceptance issued by the owner other than the Contractor or Constructors Performance Evaluation System (CPES) Final Rating, which must be at least satisfactory.

Name of Firm/Applicant

Authorized Signing Official

Date

EXPERIENCE RECORD ON SIMILARLY COMPLETED PROJECTS

Similar Major Operations of Work 1]	Unit of Measure	Quantity	Title of the Project				Unit of Measure	Quantity
			Title of the Project					
1. RC pile driving works (Offshore)	l.m.	4,694						
2. Reinforced Concrete Works	cu.m.	486						
3. Construction of Portland Cement Concrete Pavement (PCCP)	sq.m.	150						

NOTE: 1] Submit the Certificate of Completion/Certificate of Acceptance by the project owner, Final Recapitulation/Bill of Quantities and/or Constructor Performance Evaluation System (CPES) ratings, 1st, 2nd & Final visit (if applicable). Projects with no Certificate of Completion/Acceptance and Recapitulation/Bill of Quantities shall not be considered.

2] The Owner's Certificate of Final Acceptance; or the Constructors Performance Evaluation Summary (CPES) Final Rating and/or the Certificate of Completion, must be satisfactory.

Name of Firm/Applicant

Authorized Signing Official

Date

FINANCIAL DATA

- A. The prospective bidder's audited Financial Statements, showing, among others, the prospective bidder's total and current assets and liabilities, stamped "RECEIVED" by the Bureau of Internal Revenue (BIR), or its duly accredited and authorized institutions, for the preceding calendar year which should not be earlier than two (2) years from the date of bid submission.

	Year
1. Total Assets	
2. Current Assets	
3. Total Liabilities	
4. Current Liabilities	
5. Net worth (1-3)	
6. Net Working Capital (2-4)	

- B. The computation of the bidders Net Financial Contracting Capacity (NFCC) must be at least equal to the ABC to be bid, as follows:

NFCC = [(Current assets minus current liabilities) (15)] minus the value of all outstanding or uncompleted portions of the projects under ongoing contracts, including awarded contracts yet to be started coinciding with the contract to be bid.

NFCC = _____

Attached herewith are certified true copies of the audited financial statements stamped received by the BIR or BIR authorized collecting agent for the latest/immediately preceding calendar year.

 Name of Firm/Applicant

 Authorized Signing Official

Date: _____

NOTES:

If Partnership or Joint Venture, each Partner or Member Firm of Joint venture shall submit separate financial statements.

LIST OF CONTRACTOR'S PERSONNEL

I hereby declare that the following key personnel enumerated below, with attached resume/bio-data, including valid PRC License, for the various positions / functions, are available for the project applied for:

Position of Key Personnel	Name	No. of Key Personnel	Similar Experience in the Position (Years) 1)	Total Experience in the Position (Years)	Attachment(s)	Annex(es)
Project Manager					PRC License (CE Preferred) Complete Qualification and Experience Data Certificate of Commitment	Annex "A" --
Project Engineer					PRC License (CE Preferred) Complete Qualification and Experience Data Certificate of Commitment	Annex "B" --
Materials Engineer					PRC License (CE Preferred) Submit Valid and Renewed DPWH Certificate of Accreditation Submit Accreditation Identification Card as Materials Engineer Complete Qualification and Experience Data Certificate of Commitment	Annex "C" --
Construction Safety and Health Officer					Certificate of Safety and Health Construction Related Course issued by DOLE Accredited Trainings Complete Qualification and Experience Data Certificate of Commitment	Annex "D" --
Foreman					Complete Qualification and Experience Data Certificate of Commitment	Annex "E" --
Other Position(s)					Complete Qualification and Experience Data Certificate of Commitment	Annex "F" --

NOTE: 1. Minimum qualification requirements: (work experience is similar in nature and complexity to the project to be bid with regard to Registration Particulars of the Contractor's License)

Project Manager - Five (5) years	Materials Engineer - One (1) year
Project Engineer - Three (3) years	Materials Engineer I - for projects costing up to 100M
Foreman - Five (5) years	Materials Engineer II - for projects costing more than 100M

Name of Firm/Applicant _____ Authorized Signing Official _____ Date _____

REVISED FORM (September 2012)

LIST OF CONTRACTOR'S EQUIPMENT UNITS

I hereby declare that the following equipment listed below which are owned, leased or under purchase agreement are in good operating condition and are available for the duration of the project:

DESCRIPTION (Type, Model, Make)	No. of Unit(s)	Capacity Output 2]	Owned, Leased and/or under purchase agreement 1]	Submitted Proof of Ownership/Leased/ Purchase Agreement (Mark as Annex "A.....Z")	OTHER INFORMATIONS (As Applicable)				
					Manufacturer	Engine Serial No.	Chassis No./ Name of Vessel	Location	Status

1] Indicate if owned or leased as listed in the Checklist/Bidding Documents. For owned equipment, as required, submit proof of ownership (i.e. deed of sale, sales invoice, official receipt). For Water Truck, Dump Truck and Transit Mixer submit LTO Certificate of Registration and valid Official Receipt. For owned barge/tugboat, submit Marina Certificate of Ownership and valid Cargo Ship Safety Certificate. For newly purchased barge/tugboat, submit Deed of Sale together with an application for Marina Certificate of Ownership duly received/authenticated by Marina with corresponding valid Cargo Ship Safety Certificate. For leased equipment, submit duly notarized copy of lease contract together with a copy of the Marina Owner's (Lessor's) Certificate and valid Cargo Ship Safety Certificate.

2] The unit of each equipment shall be as indicated in the Checklist/Bidding Documents, i.e GW (for crane barge), DWT (for deck barge and hopper barge), TON (for crane, road roller and drop hammer), kg.-m/blow (for diesel hammer), cu.m (for dump truck), hp. (for tugboat, road grader, bulldozer and concrete vibrator), cfm (for compressor), gal. (for water truck with pump), amp. (for welding machine), bagger (for concrete mixer).

Name of Firm/Applicant

Authorized Signing Official

Date

OMNIBUS SWORN STATEMENT FOR SOLE PROPRIETORSHIP

REPUBLIC OF THE PHILIPPINES)
CITY OF _____)SS

AFFIDAVIT

I (Name), of legal age, (Civil Status), (Nationality), and residing at (Address), after having been duly sworn in accordance with law, do hereby depose and state that:

1. I am the sole proprietor or authorized representative of (Name of Bidder) with office address at _____;
2. As the owner and sole proprietor or authorized representative of (Name of Bidder), I have full power and authority to do, execute and perform any and all acts necessary to participate, submit the bid, and to sign and execute the ensuing contract for (Name of Project) of the Philippine Ports Authority, (as shown in the attached duly notarized "Special Power of Attorney" for the authorized representative);
3. (Name of Bidder) is not "blacklisted" or barred from bidding by the Government of the Philippines or any of its agencies, offices, corporations, or Local Government Units, foreign government / foreign or international financing institution whose blacklisting rules have been recognized by the Government Procurement Policy Board;
4. Each of the documents submitted in satisfaction of the bidding requirements is an authentic copy of the original, complete, and all statements and information provided therein are true and correct;
5. (Name of Bidder) is authorizing the Head of the Procuring Entity or its duly authorized representative(s) to verify all the documents submitted;
6. The owner or sole proprietor is not related to the Head of Procuring Entity, members of the Bids and Awards Committee (BAC), the Technical Working Group, and the BAC Secretariat, the head of the Project Management office or the end – user unit, and the project consultants by consanguinity or affinity up to the third civil degree;
7. (Name of Bidder) complies with existing labor laws and standards; and
8. (Name of Bidder) is aware of and has undertaken the following responsibilities as a Bidder:
 - a) Carefully examine all of the Bidding Document;
 - b) Acknowledge all conditions, local or otherwise, affecting the implementation of the contract;
 - c) Made an estimate of the facilities available and needed for the contract to be bid, if any; and
 - d) Inquire or secure Supplemental / Bid Bulletin(s) issued for the *Rehabilitation of Existing RC Pier, Port of Baybay, Leyte*.

9. (Name of Bidder) did not give or pay directly or indirectly, any commission, amount, fee, or any form of consideration, pecuniary or otherwise, to any person or official, personnel or representative of the government in relation to any procurement project or activity.

IN WITNESS WHEREOF, I have hereunto set my hand this ___ day of ___ 20__ at _____, Philippines.

Bidder's Representative / Authorized Signatory

SUBSCRIBED AND SWORN to before me this ___ day of [month] [year] at [place of execution], Philippines. Affiant/s is/are personally known to me and was/were identified by me through competent evidence of identity as defined in the 2004 Rules on Notarial Practice (A.M. No. 02-8-13-SC). Affiant/s exhibited to me his/her [insert type of government identification card used], with his/her photograph and signature appearing thereon, with no. _____ and his/her Community Tax Certificate No. _____ issued on ___ at _____.

Witness my hand and seal this ___ day of [month] [year].

NAME OF NOTARY PUBLIC

Serial No. of Commission _____

Notary Public for _____ until _____

Roll of Attorneys No. _____

PTR No. _____ [date issued], [place issued]

IBP No. _____ [date issued], [place issued]

Doc. No. _____
Page No. _____
Book No. _____
Series of _____

OMNIBUS SWORN STATEMENT FOR PARTNERSHIP OR COOPERATIVE

REPUBLIC OF THE PHILIPPINES)
CITY OF _____)SS

AFFIDAVIT

I (Name), of legal age, (Civil Status), (Nationality), and residing at (Address), after having been duly sworn in accordance with law, do hereby depose and state that:

1. I am the duly authorized and designated representative of (Name of Bidder) with office address at (Address);
2. I am granted full power and authority to do, execute and perform any and all acts necessary to participate, submit the bid, and to sign and execute the ensuing contract for (Name of Project) of the Philippine Ports Authority, accompanied by the duly notarized Special Power of Attorney, Board/Partnership Resolution or Secretary's Certificate (whichever is applicable);
3. (Name of Bidder) is not "blacklisted" or barred from bidding by the Government of the Philippines or any of its agencies, offices, corporations, or Local Government Units, foreign government / foreign or international financing institution whose blacklisting rules have been recognized by the Government Procurement Policy Board;
4. Each of the documents submitted in satisfaction of the bidding requirements is an authentic copy of the original, complete, and all statements and information provided therein are true and correct;
5. (Name of Bidder) is authorizing the PPA General Manager or its duly authorized representative(s) to verify all the documents submitted;
6. None of the officers and members of (Name of Bidder) is related to the PPA General Manager, members of the Bids and Awards Committee (BAC), the Technical Working Group, and the BAC Secretariat, the head of the Project Management office or the end- user unit, and the project consultants by consanguinity or affinity up to the third civil degree;
7. (Name of Bidder) complies with existing labor laws and standards; and
8. (Bidder) is aware of and has undertaken the following responsibilities as a Bidder:
 - a) Carefully examine all of the Bidding Document;
 - b) Acknowledge all conditions, local or otherwise, affecting the implementation of the contract;
 - c) Made an estimate of the facilities available and needed for the contract to be bid, if any; and
 - d) Inquire or secure Supplemental / Bid Bulletin(s) issued for the *Rehabilitation of Existing RC Pier, Port of Baybay, Leyte*.

- 9. (Name of Bidder) did not give or pay directly or indirectly, any commission, amount, fee, or any form of consideration, pecuniary or otherwise, to any person or official, personnel or representative of the government in relation to any procurement project or activity.

IN WITNESS WHEREOF, I have hereunto set my hand this ____ day of _____ 20__ at _____, Philippines.

Bidder's Representative / Authorized Signatory

SUBSCRIBED AND SWORN to before me this ____ day of [month] [year] at [place of execution], Philippines. Affiant/s is/are personally known to me and was/were identified by me through competent evidence of identity as defined in the 2004 Rules on Notarial Practice (A.M. No. 02-8-13-SC). Affiant/s exhibited to me his/her [insert type of government identification card used], with his/her photograph and signature appearing thereon, with no. _____ and his/her Community Tax Certificate No. _____ issued on ____ at _____.

Witness my hand and seal this ____ day of [month] [year].

NAME OF NOTARY PUBLIC

Serial No. of Commission _____
 Notary Public for _____ until _____
 Roll of Attorneys No. _____
 PTR No. _____ [date issued], [place issued]
 IBP No. _____ [date issued], [place issued]

Doc. No. _____
 Page No. _____
 Book No. _____
 Series of _____

OMNIBUS SWORN STATEMENT FOR CORPORATION OR JOINT VENTURE

REPUBLIC OF THE PHILIPPINES)
CITY OF _____)SS

AFFIDAVIT

I (Name), of legal age, (Civil Status), (Nationality), and residing at (Address), after having been duly sworn in accordance with law, do hereby depose and state that:

1. I am the duly authorized and designated representative of (Name of Bidder) with office address at _____;
2. I am granted full power and authority to do, execute and perform any and all acts necessary to participate, submit the bid, and to sign and execute the ensuing contract for (Name of Project) of the Philippine Ports Authority, accompanied by the duly notarized Special Power of Attorney, Board Resolution or Secretary's Certificate;
3. (Name of Bidder) is not "blacklisted" or barred from bidding by the Government of the Philippines or any of its agencies, offices, corporations, or Local Government Units, foreign government / foreign or international financing institution whose blacklisting rules have been recognized by the Government Procurement Policy Board;
4. Each of the documents submitted in satisfaction of the bidding requirements is an authentic copy of the original, complete, and all statements and information provided therein are true and correct;
5. (Name of Bidder) is authorizing the PPA General Manager or its duly authorized representative(s) to verify all the documents submitted;
6. None of the officers, directors, and controlling stockholders of (Name of Bidder) is related to the PPA General Manager, members of the Bids and Awards Committee (BAC), the Technical Working Group, and the BAC Secretariat, the head of the Project Management office or the or end- user unit, and the project consultants by consanguinity or affinity up to the third civil degree;
7. (Name of Bidder) complies with existing labor laws and standards; and
8. (Name of Bidder) is aware of and has undertaken the following responsibilities as a Bidder:
 - a) Carefully examine all of the Bidding Document;
 - b) Acknowledge all conditions, local or otherwise, affecting the implementation of the contract;
 - c) Made an estimate of the facilities available and needed for the contract to be bid, if any; and
 - d) Inquire or secure Supplemental / Bid Bulletin(s) issued for the *Rehabilitation of Existing RC Pier, Port of Baybay, Leyte*.

- 9. (Name of Bidder) did not give or pay directly or indirectly, any commission, amount, fee, or any form of consideration, pecuniary or otherwise, to any person or official, personnel or representative of the government in relation to any procurement project or activity.

IN WITNESS WHEREOF, I have hereunto set my hand this ___ day of ____ 20__ at _____, Philippines.

Bidder's Representative / Authorized Signatory

SUBSCRIBED AND SWORN to before me this ___ day of [month] [year] at [place of execution], Philippines. Affiant/s is/are personally known to me and was/were identified by me through competent evidence of identity as defined in the 2004 Rules on Notarial Practice (A.M. No. 02-8-13-SC). Affiant/s exhibited to me his/her [insert type of government identification card used], with his/her photograph and signature appearing thereon, with no. _____ and his/her Community Tax Certificate No. _____ issued on ____ at _____.

Witness my hand and seal this ___ day of [month] [year].

NAME OF NOTARY PUBLIC

Serial No. of Commission _____
 Notary Public for _____ until _____
 Roll of Attorneys No. _____
 PTR No. _____ [date issued], [place issued]
 IBP No. _____ [date issued], [place issued]

Doc. No. _____
 Page No. _____
 Book No. _____
 Series of _____

REPUBLIC OF THE PHILIPPINES)
CITY OF _____)S.S.

BID-SECURING DECLARATION
Invitation to Bid No. _____

To : Philippine Ports Authority
Bonifacio Drive, South Harbor,
Port Area, manila

I, the undersigned, declare that:

1. I understand that, according to your conditions, bids must be supported by a Bid Security, which may be in the form of a Bid-Securing Declaration.
2. I/We accept that: (a) I/we will be automatically disqualified from bidding for any contract with any procuring entity for a period of two (2) years upon receipt of your Blacklisting Order; and, (b) I/we will pay the applicable fine provided under Section 6 of the Guidelines on the Use of Bid Securing Declaration, within fifteen (15) days from receipt of the written demand by procuring entity for the commission of acts resulting to the enforcement of the bid securing declaration under Sections 23.1 (b), 34.2, 40.1 and 69.1, except 69.1(f), of the IRR of RA 9184; without prejudice to other legal action the government may undertake:
3. I understand that this Bid-Securing Declaration shall cease to be valid on the following circumstances:
 - (a) Upon expiration of the bid validity period, or any extension thereof pursuant to your request;
 - (b) I am declared ineligible or post-disqualified upon receipt of your notice to such effect, and (i) I failed to timely file a request for reconsideration or (ii) I filed a waiver to avail of said right;
 - (c) I am declared as the bidder with the Lowest Calculated Responsive Bid, and I have furnished the performance security and signed the Contract.

IN WITNESS WHEREOF, I have hereunto set my hand this _____ day of _____ 20 ____ at _____, Philippines.

Name of Bidder's Authorized Representative
(Signatory's Legal Capacity)
AFFIANT

SUBSCRIBED AND SWORN to before me this ___ day of *[month]* *[year]* at *[place of execution]*, Philippines. Affiant/s is/are personally known to me and was/were identified by me through competent evidence of identity as defined in the 2004 Rules on Notarial Practice (A.M. No. 02-8-13-SC). Affiant/s exhibited to me his/her *[insert type of government identification card used]*, with his/her photograph and signature appearing thereon, with no. _____.

Witness my hand and seal this ___ day of *[month]* *[year]*.

NAME OF NOTARY PUBLIC

Serial No. of Commission _____
 Notary Public for _____ until _____
 Roll of Attorneys No. _____
 PTR No. __, *[date issued]*, *[place issued]*
 IBP No. __, *[date issued]*, *[place issued]*
 Doc. No. ____
 Page No. ____
 Book No. ____
 Series of ____.

CONSTRUCTION METHODOLOGY

Name of Project : _____
Proposed Project Description : _____
Location : _____

MINIMUM SCOPE OF CONSTRUCTION METHODOLOGY

A. DEMOLITION AND REMOVAL WORKS

1. Demolition and disposal of existing RC Deck (1,404sq.m.)
2. Demolition and disposal of existing breasting dolphin (95sq.m.)
3. Cutting and disposal of existing RC piles up to seabed (271 nos.)
4. Removal of existing bollard (28 sets)
5. Removal of existing rubber dock fender (11 sets)
6. Demolition and disposal of existing PCCP and ramp (262 cu.m.)
7. Chipping of existing RC curb (5 l.m.)
8. Chipping/disposal of existing coping wall & retaining wall (7 cu.m.)
9. Excavation/backfilling works (149 cu.m.)

B. TRANSITION RAMP & EXTENSION OF RORO RAMP ON FILL

1. Supply and placing of 3,500 psi concrete (29 cu.m.)
2. Supply and installation of reinforcing steel bar (2,396 kg.)
3. Supply and placing of gravel bedding (6 cu.m.)
4. Supply and placing of selected fill materials (9 cu.m.)
5. Supply and placing of aggregate base course (52 cu.m.)
6. Construction of Portland cement concrete pavement (262 sq.m.)
7. Re-installation of old rubber dock fenders (5 sets)

C. REHABILITATION OF EXISTING RC PIER

1. Supply/driving, chipping and splicing of PSC square piles (9,388 l.m.)
2. Supply and installation of reinforcing steel bar (146,195 kg.)
3. Supply and placing of 3,500 psi concrete (942 cu.m.)
4. Supply and installation of construction joints (52 l.m.)
5. Supply and installation of rubber dock fenders (35 sets)
6. Supply and installation of mooring bollard (7 sets)
7. Re-installation of old mooring bollards (28 sets)

NOTES:

The narrative construction method will guide and familiarize the contractor and the PPA on how the project shall be carried out in accordance with the highest standard of workmanship.

The construction method shall be consistent with the Bar Chart / S-Curve Schedule, Equipment Schedule and Manpower Schedule.

Signature
(Authorized Signing Official)

MANPOWER SCHEDULE

Name of Project : _____

Proposed Project Description : _____

Location : _____

MANPOWER (Minimum)	CONTRACT DURATION (_____ Calendar Days)													
	M O N T H L Y													
	1	2	3	4	5	6	7	8	9	10	11	12	13	14
Project Manager														
Project Engineer														
Materials Engineer														
Construction Safety and Health Officer														
Foreman														
Specify other applicable positions, i.e.:														
- Carpenter														
- Steelman														
- Mason														
- Electrician														
- Rigger														
- Others														

Signature
(Authorized Signing Official)

CASHFLOW BY QUARTER AND PAYMENT SCHEDULE

Name of Project: : _____

Proposed Project Description : _____

Location : _____

Project Duration (days or months)	Payment Schedule (Monthly, in Pesos)	Cash flow (Quarterly, in Pesos)
TOTAL		

NOTES

- The cash flow by quarter and payment schedule should be consistent with the Bar Chart and S-curb.
- Payment schedule shall not be more than once a month.

Signature
(Authorized Signing Official)

SECTION X
CONTRACT FORM

Republic of the Philippines
PHILIPPINE PORTS AUTHORITY
PPA Building, Bonifacio Drive, South Harbor,
Port Area, Manila, Philippines

CONTRACT
FOR THE REHABILITATION OF EXISTING RC PIER
PORT OF BAYBAY, LEYTE

This Contract made and entered into this _____ day of _____ 2019, in Manila, Philippines, by and between:

PHILIPPINE PORTS AUTHORITY, a government instrumentality created under Presidential Decree No. 857, as amended, with principal office at PPA Building, Bonifacio Drive, South Harbor, Port Area, Manila, represented herein by its duly authorized General Manager, **JAY DANIEL R. SANTIAGO**, and hereinafter referred to as "PPA";

- and -

_____, duly organized and existing in accordance with Philippine laws, with office and business address at _____, represented in this act by its _____, as evidenced by _____, a copy of which is hereto attached and made an integral part hereof as Annex "A", and hereinafter referred to as "CONTRACTOR."

WITNESSETH:

WHEREAS, in accordance with Republic Act No. 9184 and its 2016 Implementing Rules and Regulations (IRR), PPA advertised and posted on the PPA website and PhilGEPS, as well as on its bulletin board, an Invitation to Bid for the _____;

WHEREAS, in response to the said advertisement _____ bidders submitted their respective bids for the foregoing project;

WHEREAS, after the opening of bids on _____ and the conduct of bid evaluation and post-qualification, the bid submitted by the CONTRACTOR at its unit and lump sum prices set forth in its proposal was found to be the _____ Bid in the amount of _____ PESOS (), Philippine Currency;

WHEREAS, pursuant to Head Office BAC Resolution No. _____ Series of _____, award of contract was made to the CONTRACTOR in a Notice of Award dated _____, in the amount of _____ PESOS (), after submission of the required documents within the prescribed period and compliance to the conditions stipulated in the IRR;

WHEREAS, the CONTRACTOR duly accepted the award by signing its Conforme on the said Notice of Award;

NOW, THEREFORE, for and in consideration of the foregoing premises and the mutual stipulations herein contained, PPA and the CONTRACTOR have agreed, as follows:

1. In this Contract, words and expressions shall have the same meanings as are respectively assigned to them in the attached Contract Documents.
2. The following documents shall form part of this Contract:
 - A. Bid Documents consisting of the following:
 - A.1 Invitation to Bid;
 - A.2 Instructions to Bidders;
 - A.3 Bid Data Sheet;
 - A.4 General and Special Conditions of Contract;
 - A.5 Specifications
 - A.6 Drawings/Plans;
 - A.7 Addenda and/or Supplemental/Bid Bulletins, if any;
 - B. Technical and Financial Proposals;
 - C. Performance Security;
 - D. Notice of Award of Contract with the Contractor's Conforme thereto; and
 - E. Other contract documents that may be required by existing laws and PPA, such as:
 - E.1 Construction Schedule and S-Curve;
 - E.2 Manpower Schedule;
 - E.3 Construction Methods;
 - E.4 Equipment Utilization Schedule;
 - E.5 Construction Safety and Health Program approved by the DOLE;
 - E.6 Pert/CPM
 - E.7 Duly Approved Program of Works and Cost Estimates;
 - E.8 Certificate of Availability of Funds;
 - E.9 Abstract of Bids; and
 - E.10 Resolution of Award
3. In consideration of the payments to be made by PPA, the CONTRACTOR commits to complete the Works and remedy any defects therein in conformity with the provisions of this Contract and Contract Documents.
4. In consideration of the execution and completion of the Works and remedying any defects therein, PPA commits to pay the Contract Price or such other sum as may become payable under the provisions of this Contract and Contract Documents.

5. This Contract shall become effective after the same shall have been signed by the Parties hereof.

IN WITNESS WHEREOF, the Parties have hereunto signed this Contract on the date and place first hereinabove written.

PHILIPPINE PORTS AUTHORITY

TIN No. _____

By:

JAY DANIEL R. SANTIAGO

General Manager

WITNESSES:

ACKNOWLEDGMENT