in excess of the amount needed to complete a given section or that has been deposited outside the forms shall not be used in the work.

The Contractor shall provide suitable equipment for protecting the fresh concrete in case of rain, such as screens which will cause the rain water to run off beyond the edges of the paving, rain proof tarpaulins or other methods approved by the Engineer. The equipment shall be sufficient to shelter from rain all areas equal to that paved in two hours of work.

Finishing Concrete

The concrete shall be compacted and finished by a mechanical, self-propelled finishing machine of approved type, having two independently operated screeds. If a machine possessing only one screed is approved, the screed will not be less than 450 mm wide and shall be equipped with compensating springs to minimize the effect of the momentum of the screed on the side forms. The number of driving wheels, the weight of the machine and the power of the motor shall be so coordinated as to prevent slippage. The top of the forms and the surface of the finishing machine wheels shall be kept free from concrete or dirt.

The machine shall at all times be in first-class mechanical condition and shall be capable of compacting and finishing the concrete are herein described. Any machine which causes displacement of the side forms from the line or grade to which they have been properly set, or causes undue delay due to mechanical difficulties, shall be removed from the work and replaced by a machine meeting the Specifications.

The finishing machine shall be operated over each section of pavement two or more times and at such intervals as will produce the desired results. Generally, two passes of the finishing machine are considered the maximum desirable.

The concrete shall be vibrated, compacted, and finished by a vibratory finishing machine. The vibratory machine shall meet the requirements for ordinary finishing, and shall be one of the following type:

1. The machine shall have two independently operated screeds; the front screed shall be equipped with vibratory units with a frequency of not less than 3,500 pulsations per minute. There shall be not less than one vibratory unit for each 2.5 meters length or portion thereof, of vibratory screed surface. The front screed shall not be less than 300mm wide and shall be equipped with a "bull nose" front edge built on a radius of not less than 50mm. This type of vibratory finishing machine shall be operated in such manner that each section of pavement will receive at least one vibratory pass, but not more than two passes, unless otherwise directed, or ;

2. The machine shall be equipped with an independently operated vibratory "pan" (or pans) and two (2) independently operated screeds, the "pan" shall be mounted in a manner that will permit it to come in contact with the forms and will permit vibration of the full width of lane simultaneously.

   There shall be not less than one vibratory unit for each 2 m. length or portion thereof, of vibrating pan surface. The vibratory units in any individual pan shall be synchronized and have a frequency of not less than 3,500 pulsations per minute. The front screed shall be capable of operating in a position that will strike off the concrete at a sufficient height above the top of the forms to allow for proper compaction with the vibrating pan. This type of vibratory finishing machine shall be operated in such manner than each section of pavement will receive at least one vibratory pass but not more than two passes, unless otherwise directed.

After the final pass of the finishing machine and when the concrete has started to dry, the surface of the pavement shall be finished with an approved longitudinal float. The float may be operated either manually or by mechanical means. The float may be either of wood or metal shall be straight and smooth and light in weight so as not to displace or sink into the concrete surface.

To be effective, the float shall be at least 300mm wide and 3m long. When manually operated, the float shall be moved from edge to edge with a wiping motion and advance one (1) meter or more.

The succeeding trip shall overlap the previous trip. A light smoothing lute at least 3 meters long may be used provided approved by the Engineer.

The surface of the pavement shall be tested by the Contractor, before the final belting, with an approved standard straightedge 3 meter in length. Irregularities so detected shall be corrected immediately. Special attention shall be given to the concrete adjacent to transverse joints to insure that the edges thereof are not above the grade specified or the adjacent concrete below grade. All depressions or projections shall be corrected before any initial set has developed in the concrete.

After the concrete has been brought to the required grade, contour and smoothness, it shall be finished by passing over the concrete a drag of one or two burlap clothes, which give the surface the required roughness. The vehicles used to carry these cloths may be independent of the concrete-laying machine or may be incorporated with it and may be operated either by hand or mechanically.

Hand finishing will be permitted only on variable width sections of the pavement and other places where the use of the finishing machine would be impractical. Hand finishing shall be accomplished by means of the hand-operated strike-off template of either steel or steel-shod wood construction. The striking template shall be operated forward with a combined longitudinal and transverse motion and shall be so manipulated that neither end will be raised off the side forms. A similar tamper shall be used for tamping the concrete.

As soon as the concrete has attained its initial set, the edges of the pavement, the longitudinal joints, the construction dummy and expansion joints not sawn shall be carefully finished with an edging tool having radius of at least 5mm. The tools, the special accessories for cutting impressed joints and methods of workmanship shall be such as will produce a joint whose edges are of the same quality of concrete as the other portion of the pavement. Methods and workmanship which make use of excess mortar or grout in this area shall be eliminated. Unnecessary tool marks shall be eliminated during work, and the edges left smooth and true to line.

Striking Forms

Forms shall remain in place at least 12 hours after the concrete has been placed. When working conditions are such that the early strength gain of the concrete is delayed, the forms shall remain in place for a longer period, as directed by the Engineer. Bars or heavy load shall not be used against the concrete when still in the forms. Any damage to concrete resulting from form removal shall be repaired promptly by the Contractor as directed by the Engineer without any additional payment to the Contractor.

Curing Concrete

Unless otherwise ordered by the Engineer, curing of concrete shall be done by any method specified in the Section "Reinforced Concrete".

Cleaning and Sealing Joints

After completion of the required curing and before opening of the pavement to traffic, all joints shall be thoroughly cleaned of all concrete aggregate fragments or other materials.

After removal of side forms, the ends at transverse expansion joints at the edges of the pavement shall be carefully cleaned of any concrete within the expansion spaces for the entire depth of slab, care being taken not to injure the ends of the joints. Expansion and contraction joints shall then be poured with a hot joint sealer to the depth as indicated on the Drawings. Joint sealer shall be poured using approved hand pouring pots, with liquid at a temperature not less than that recommended by the approved manufacturer.

Opening to Traffic

The pavement shall be closed to traffic, including the vehicles of the Contractor, for a period of 10 days after the concrete is placed or longer if in the opinion of the Engineer, the weather conditions make it necessary to extend this time. The Contractor shall furnish, place and maintain satisfactory barricades and lights as directed, to exclude all traffic from the pavement.

Any damage to the pavement due to traffic shall be repaired or replaced at the expense of the Contractor. Paving mixers, mechanical concrete spreaders and finishers and other heavy paving equipment shall not be operated on completed concrete lanes in order to construct alternate lanes until after the regular curing period is completed. Even then, planks shall be laid on the finished pavement or other precautions taken to prevent damage to the concrete pavement.

Pavement Smoothness, Thickness and Tolerance

Portland cement concrete pavement shall be constructed to the designed level and transverse slope shown on the Drawing. The allowable tolerance shall be as listed hereunder:

1.	Permitted variation from design thickness of layer	+ - 5mm
2.	Permitted variation from design level of surface	+ - 5mm

The thickness of the pavement will be determined by measurement of cores from the completed pavement in accordance with AASHTO T 148.

The completed pavement shall be accepted on a lot basis. A lot shall be considered as 2,500 sq.m of pavement. The last unit in each slab constitutes a lot in itself when its length is at least ½ of the normal lot length. If the length of the last unit is shorter than ½ of the normal lot length, it shall be included in the previous lot.

Other areas such as intersections, entrances, crossovers, ramp, etc., will be grouped together to form a lot. Small irregular areas may be included with other unit areas to form a lot.

ITEM 11 : DRAINAGE WORKS

SCOPE OF WORK

The works shall consist of excavation, backfilling and construction of lateral drains, construction of manholes, reconnection to existing lateral and other related works in accordance with the dimensions, size, elevation and grade as shown on the drawing and shall conform with the Specification.

At least thirty (30) days before the start of any construction related to drainage works, the Contractor shall submit to the Engineer for his approval, shop drawings of the drainage work he intends to construct. The shop drawings shall include the materials and the general method of installation he intends to employ.

MATERIAL REQUIREMENTS

BACK FILL

Fill shall be in accordance with Item "Reclamation and Fill".

GRAVEL BEDDING

Gravel Bedding/gravel base shall be in accordance with the specifications of Crushed Course Aggregates in "Reinforced Concrete".

SAND BEDDING

Sand bedding shall be in accordance with Item "Reinforced Concrete (Fine Aggregates)".

CONCRETE

Mixing/Casting and steel reinforcements shall be in accordance with Item "Reinforced Concrete" while the dimensions shall be as shown on the Drawings.

CEMENT MORTAR

Cement mortar shall consist of one part Portland cement to two parts of fine aggregate with water added as necessary to obtain the required consistency.

REINFORCED CONCRETE PIPE

The fabrication of reinforced concrete pipes shall conform to the Specifications of ASTM C 76 while the testing requirements shall conform to ASTM C 497. The Engineer reserves the right to inspect and test the pipe delivered for intended purpose. Defects that are discovered after acceptance of delivery of the pipe but before installation shall be a cause for rejection.

Standard reinforcement details and concrete strength shall be in accordance with DPWH "Standard Two Meter Concrete Pipe Culvert".

STEEL GRATING

All materials shall be compliant with ASTM A36 or equivalent and Hot Dip Galvanizing shall be in accordance with ASTM A123 with minimum average coating of 610gms/sq.m.

The gratings shall be fusion welded type and non-manually fabricated with loading capacity equivalent to HS20-44. Loads and deflection shall be in accordance with AS3990 and the fabrication shall be covered by the requirements of AWS D1.1.

EXECUTION

EARTHWORKS

All earthworks for concrete pipe culvert shall conform to the lines, grades and elevations shown on the drawings or as directed by the Engineer.

The lateral drain shall be excavated to the depth, grade and width established by the Engineer. The bedding surface shall provide a firm foundation of uniform density throughout the entire length. Soft, spongy, or otherwise unstable material encountered that will not provide a firm foundation for the concrete drainage shall be removed to the full width of the trenches and replaced by suitable material to a depth of not less than 30 cm. 100mm thick gravel bedding shall be used as foundation or otherwise as specified.

PIPE LAYING

The pipe shall be tested for water-tightness of joints before backfilling the trench. Unsatisfactory work shall be corrected without additional cost to the PPA. The collar shall have set sufficiently prior to backfilling.

Methods of installation and typical bedding for pipe conduits if not included in the plans, shall conformed to DPWH "Standard Two Meter Reinforced Concrete Culvert".

LATERAL DRAIN

Concrete cover and the steel gratings shall be set to the required elevations as shown on the drawings to fit the adjoining surfaces and shall be installed after the adjoining concrete is struck off and finished, and the fit on the frames shall be such that there is no rocking.

All completed structures shall be thoroughly cleaned of any accumulations of silts, debris or foreign matter of any kind, until finally accepted and put into service.

CATCH BASIN INLETS, MANHOLES AND OUTLETS

Lid frames shall be set to the required elevations as shown on the drawings to fit the adjoining surfaces. Lids shall be installed after the adjoining concrete is struck off and finished, and the fit on the frames shall be such that there is no rocking.

Where reconstruction of existing catch basin inlets, manholes, outlets, or similar structures are indicated, the work shall be in accordance to the details and elevations as shown on the drawings, including re-installation of existing metal frames, grates and lids, or replacing of concrete covers instead of grates that may have been lost or found lacking. All completed structures shall be thoroughly cleaned of any accumulations of silts, debris or foreign matter of any kind, until finally accepted and put into service.

FIELD DENSITY TEST

Field Density tests to determine the percent of compaction of the fill material shall be conducted until a field density of at least 95 percent of the maximum dry density in accordance with AASHTO T180, Method D has been achieved. In place density determination shall be made in accordance with AASHTO T191.

CLEARING AND DISPOSAL

Dumping or disposal of un-used excavated materials shall be coordinated to PMO. If the excavated materials are determined for disposal, the contractor will provide all necessary works and expenses for its completion in concurrence by the Engineer.

ITEM 12 : MOORING AND FENDERING SYSTEM

SCOPE OF WORK

1. The work includes furnishing of all labor, materials and equipment to complete the installation of mooring bollards and fenders in piers/wharves.

2. The work shall include the supply, transport, handling, storage and installation of fenders systems in the newly constructed piers.

3. The Contractor shall furnish and install the necessary fittings as shown on the drawings and/or specified.

Supplementary parts necessary to complete and install each item of works shall be included whether or not shown or specified. The Contractor shall furnish to relevant trades all anchors, fastenings, inserts, fittings, fixtures or the like to be installed on or required for securing the works.

The Contractor shall submit shop drawings of all fitting works prior to placing orders and commencement of any fabrication.

MATERIAL REQUIREMENTS

MOORING SYSTEM

Designated load capacity of mooring bollards shall be as shown in the drawings, and shall be referred to as the maximum load capacity. The mooring bollards shall be at rupture stage upon reaching the maximum load capacity.

Mooring bollards shall be of the dimensions, weights, capacities and designs as shown in the drawings and shall be fabricated by approved manufacturer with cast steel conforming to the requirements indicated in the plan/drawings, or approved equivalent.

The size of the bolts, nuts and washers shall be in accordance with the specifications provided in the plans/drawings. The anchor plate shall be connected to the holding down bolt as shown in the plans/drawings. All bolts, nuts, washers etc., that are exposed shall be hot-dip galvanized.

Samples of the bolts, nuts, washers and anchor plates shall be submitted to the Engineer for approval before being used in the Works.

The upper part of bollards and base plates which are not embedded in concrete shall be painted. The surface of bollards shall be cleaned thoroughly by wire brush or other means prior to painting to remove rust or any other contamination which may interfere with bond of paint to metal.

The exposed surface shall be coated with rust proof paint and finishing paint, which shall be coal-tar epoxy of 120m micron thickness in accordance with JIS K5623 or the approved standard.

Base Steel:

Chemical composition and mechanical properties of base metal to be used for fabrication of mooring bollard and its accessories shall comply with ASTM A36 and other required standard stated therein.

Concrete Foundation :

Concrete foundation for mooring bollards shall conform to the requirements of the Section concerning "Reinforced Concrete".

Visual Inspection :

All mooring bollards delivered to Site shall be inspected by the Engineer for any signs of flaws or defect inimical to usage.

Mill Test Certificates:

Two (2) copies of mill test reports shall be submitted certifying that materials meet the specified standards.

Test Inspection:

Inspection of all materials and methods of fabrication shall be carried out by the Contractor. However, the Engineer reserves the right to inspect all facilities at any time during the manufacture to ensure that the materials and workmanship are in accordance with Specifications and the best of workmanship.

FENDER SYSTEM

The rubber fenders should comply with the performance requirements specified in the table provided on the plan/drawings of Rubber Dock Fenders (RDF).

PHYSICAL PROPERTIES OF MATERIALS

The rubber for the fenders shall be of high quality natural rubber, synthetic rubber or mixed rubber blended with carbon black used in the rubber industry and shall have sufficient resilience and anti-ageing, weathering, abrasion, wear and oil resistant properties. The rubber dock fenders shall be free from bubbles, cracks and other harmful defects.

The physical properties of the rubber compound used for the fenders shall comply with the following requirements:

Physical Properties and Test Method

Test Item			Properties	Test Method	
Physical Test	Before Aging	Tensile Strength	160kg/sq.m minimum	Test piece: Dumbell No. 3	ASTM D412
		Elongation	350% minimum		ASTM D1456
		Hardness	76Hs maximum	Spring Type hardness test (Type A)	ASTM D2240
	After Aging	Tensile Strength	Not less than 80% of original value	Aging by air heating: 70±1°C x 96 hours.	ASTM D412
		Elongation			ASTM D1456
		Hardness	Not more than original value +8°		ASTM D2240
	Compression Test		30% maximum	Heat treatment: 70±1°C x 22 hours.	ASTM D395

Note: Equivalent Standards are acceptable.

FITTINGS AND ANCHORAGE

Anchor bolts and connecting hardware shall be fabricated using type of steel specified and to the required shapes and sizes shown on the approved plan/drawings.

TESTING, SAMPLING, INSPECTION, ACCEPTANCE, MARKING AND PACKAGING

Testing

All rubber dock fenders shall be tested for performance. It shall pass the required energy absorption and reaction force at a certain deflection as indicated in the plan.

The Contractor shall be required to submit test certificates showing compliance to the above requirements. The test certificates shall be certified by an independent testing institute / organization recognized by the Authority.

The standard performance testing methodology shall be Method B, to wit:

1. Fender temperature shall be stabilized at 23 degrees plus or minus 5 degrees centigrade for at least 24 hours before compression testing.

2. Break-in of fender by deflecting 3 times to rated deflection.

3. Removed load from the RDF and allow recovering for a minimum of 1 hour.

4. Deflect RDF at speed of 2-8 cm/min once to rated deflection.

The testing apparatus shall be calibrated and certified within plus or minus 1% in accordance with ISO or equivalent JIS or ASTM requirements. Calibration shall be traceable to a national/international standard and shall be performed annually by an accredited third party organization. The RDF performance testing center shall be subjected to accreditation by PPA and notation and /or certification by DPWH-BRS prior to acceptance.

Inspection

All fenders of each type shall be inspected for compliance to specified dimensions and all fenders shall be inspected by the Engineer for any sign of flaw or defect inimical to its use.

All anchor bolts and fittings shall be inspected. The material used for the fabrication of bolts and fittings shall be covered by the manufacturer's certified mill certificate and shall be verified by the Authority.

All RDF items/units shall be clearly numbered and marked indicated the following:

Acceptance Tolerance

The acceptance tolerance shall be based on the following:

1. Fender Dimension

Length	:	-2% to +4%
Width	:	-2% to +4%
Height	:	-2% to +4%
Thickness	:	-2% to +8%

2. Anchor Bolt Holes in Fender

Diameter of the Hole	:	+2.0mm
Pitch of the Hole	:	+4.0mm

3. Acceptance tolerance for all fenders supplied shall be as follows:

E = Energy absorption,	E ≥ Specified E but not less than 10% of the specified E
R = Reaction force,	R ≤ Specified R but not more than 10% of the specified R

Marking

All fender units shall be clearly numbered and marked. Each fender shall have the following markings.

1. Fender type and manufacturer's name or trade mark
2. Production serial number
3. Date of manufacture or its abbreviation
4. Main dimensions
5. Project identification as follows:

Name of Port/Project:_____

Year supplied _____

Packaging

The fenders shall be packaged on wooden crate or wrapped individually with Polypropylene sheets except when shipped containerized. The bolts and fittings should be placed in crates and suitably treated for protection when transported by sea and stored in port areas.

EXECUTION

MOORING / FENDERING SYSTEM

All units shall be installed at the locations shown on the drawings and as directed by the Engineer.

ITEM 13 : ELECTRICAL WORKS

SCOPE OF WORK

The work to be done shall consist of furnishing, delivering and installing electrical materials / fixtures completed in accordance with all the details of the electrical works as shown on the drawings including materials, labor, tools and equipment and all incidental works as found necessary.

Refer to electrical plans/drawings for location and extent of work involved.

GENERAL REQUIREMENTS

a) All works shall be done in accordance with the requirements of the publications and agencies having jurisdiction, as well as the requirements of the approved standards.

1.	National Fire Protection Association	-	(NFPA)
2.	National Electrical Manufacturer Association	-	(NEMA)
3.	Underwriter Laboratories, Inc.	-	(UL)
4.	Philippine Electrical Code Philippine National Standard	- -	(PEC) (PNS)
5.	Federation Specification: Circuit Breaker, Molded Case, Branch Circuit and Service		
6.	American National Standard Institute	-	(ANSI)
7.	American Society for Testing and Materials	-	(ASTM)
8.	Illuminating Engineering Society	-	(IES)
9.	Light Emitting Diode	-	(LED)

b) The electrical power of the Port lighting system will be connected to the Main Disconnect Panel (MDP) located on the concrete pedestal post. While the supply voltage should be 230 volts, single phase (1Ø), and 60 hertz.

c) The Contractor shall employ a licensed Registered Electrical Engineer or Master electrician to perform or to supervise and to conduct the continuous inspection of all electrical work.

d) The Contractor shall first obtain approval from the Authority before procurement, fabrication or delivery of electrical materials to the site. Partial submittals will not be acceptable and will be returned without review. Submittals shall include the Manufacturer's Name, Trade Name, Place of Manufacture, Catalog Model or Number, Nameplate Data, Size, Layout Dimensions, Capacity, Project Specification and Paragraph Reference, Technical Society Publication References and other information necessary to establish contract compliance of each item to be furnished.

e) All excavations fill and backfill and concrete works involved herein, shall be carried to the required elevations and shall conform to the provisions of specification under Earthwork and Concrete Construction of this tender document.

f) The materials and equipment to be furnished shall be standard products of reputable manufacturer engaged in the reproduction of such materials and equipment.

g) All permits and electrical fees required for this work shall be obtained at the expense of the Contractor. The Contractor shall furnish the Engineer-in-Charge, the final Certificates of Inspections and approval from the proper government authorities after the completion of work. The Contractor shall prepare all as- built plans and all other paper works as required by the enforcing authorities.

h) The Contractor shall furnish and install electrical materials as shown in the drawings. A licensed Electrical Engineer or Master Electrician is required to implement the installation of the electrical system.

i) Electrical installation shall conform to the requirements of Philippine Electrical Code (PEC) and the other approved standards.

j) The contractor shall install all electrical works with the supervision of the qualified Registered Electrical Engineer (REE) or Master Electrician. All electrical installation applications regardless of capacity and voltage whether new, addition or revision shall be accompanied by electrical plans signed and sealed by a duly licensed Professional Electrical Engineer (PEE).

MATERIAL REQUIREMENTS

All materials shall be brand new and shall be of the approved type meeting all the requirements of the Philippine Electrical Code and bearing the Philippine Standard Agency (PSA) mark.

PRODUCTS

WIRES AND CABLES

The conductor material to be furnished and installed shall be copper wire Heat-Resistant Thermoplastic (THHN/THWN-2). All conductors shall be rated 600 volts insulation and shall be standard for all sizes.

CONDUIT AND FITTINGS

Underground PVC conduit shall be polyvinyl chloride with concrete covered. It shall be manufactured to schedule 40 outside diameter. All fittings and bends shall be solvent bonded using manufacturers recommended product.

LED FLOODLIGHT FIXTURE 200 WATT

Specifications:

Rated	: 200 watt LED Floodlight Fixture or equivalent
Input Voltage	: AC 85-265 / 50-60 HZ
Luminous Flux	: 30000 LM
Color Temperature	: 5500-6500k / Daylight
Light Source	: 4 layer of High B rightness LED Module
Material	: Die Cast Aluminum Alloy Housing
Beam Angle	: 120 degrees
Lifetime	: > 50,000 hours
IP Rating	: IP 66 outdoor (water resistant, excellent for outdoor use)

SWITCHES:

Weatherproof die cast aluminum toggle switch (NEMA-3R) attached to Single Angle Bar Floodlight Steel Tapered Lamp Post.

CONCRETE DUCT BANK and HANDHOLE

The contractor shall construct concrete duct bank and Handhole as shown in the approved plans.

SINGLE ANGLE BAR FLOODLIGHT STEEL TAPERED LAMP POST

Lamp Post shall be 10.0 m ht. Single Angle Bar Floodlight steel tapered lamp post, furnished installed and tested as shown on the approved plans. The post/s shall be dimensioned for a wind velocity of 185 km/hr. It shall be locally fabricated or manufactured. The post shall be Hot – Dipped Galvanized, prime-coated with red lead and shall be painted at site with the final coating preferably aluminum paint to be approved by the Engineer.

PANEL BOARD

Panel board shall conform as shown on the approved plans with respect to supply characteristics, rating of main lugs or main circuit breaker, number and ratings and capacities of branch circuit breakers.

Panel board shall consist of a factory completed dead front assembly mounted in an enclosing NEMA-3R cabinet consisting of code gauge galvanized sheet steel box with trim and door.

Main and branch circuit breakers for panel board shall have the rating, capacity and number of poles as shown on the approved plans. Breakers shall be thermal magnetic type solid state-type with interrupting capacity of 10,000 amperes symmetrical minimum. Breaker terminal shall be UL listed as suitable for type of conductor provided. Breaker shall be the bolt-in type (that is, bolted to the current carrying bus). Plug-in circuit breakers are not acceptable

EXECUTION

INSTALLATION

Single Angle Bar Floodlight Steel Tapered Lamp Post shall be installed as shown on the approved plans.

Pole Setting: Depth as shown on the approved plans.

Construction of lamp post foundation shall be in accordance with the shape and dimensions as shown on the approved plans.

Excavations / backfilling required before /after installation of lamp post foundation with the trench shall conform to the provisions of Earthwork and Concrete construction.

Concrete Pedestal shall be reinforced concrete with appropriate weatherproof fittings as constructed as shown in the approved plan. Reinforced concrete materials shall conform to the requirements of concrete. Concrete shall be of 21 Mpa (3000 psi) compressive strength.

Metering: the local utility company of Port of Aparri, Aparri, Cagayan is responsible for the supply and installation of measuring equipment, and its accessories, but it is part of the contractor responsibility and expense to contact them about this.

WORKMANSHIP

The work throughout shall be executed in the best and most thorough manner under the direction of and at the satisfaction of the Registered Electrical Engineer or Master Electrician, who will interpret the intent meaning of the drawings and specification and shall have the power to reject any work and materials which in his judgment, are not in full accordance therewith.

TESTING OPERATIONS

When the electrical installation is completed, the Contractor shall test the installed electrical materials and equipment in the presence of Registered Electrical Engineer or Master Electrician. The system shall be free from any defects, shorts or grounds. The Contractor at no extra cost shall furnish all necessary instruments and personnel required for the testing.

GUARANTEE

Upon completion and before final acceptance of the work, the Contractor shall furnish the Engineer a written guarantee stating that all works executed are free from defects on materials and workmanship. The guarantee shall be for a period of one year from the date of the final acceptance. Any work that becomes defective during the said period shall be corrected / replaced by the Contractor at his own expense in a manner satisfactory to the Authority.

ITEM 14 : PROJECT BILLBOARD

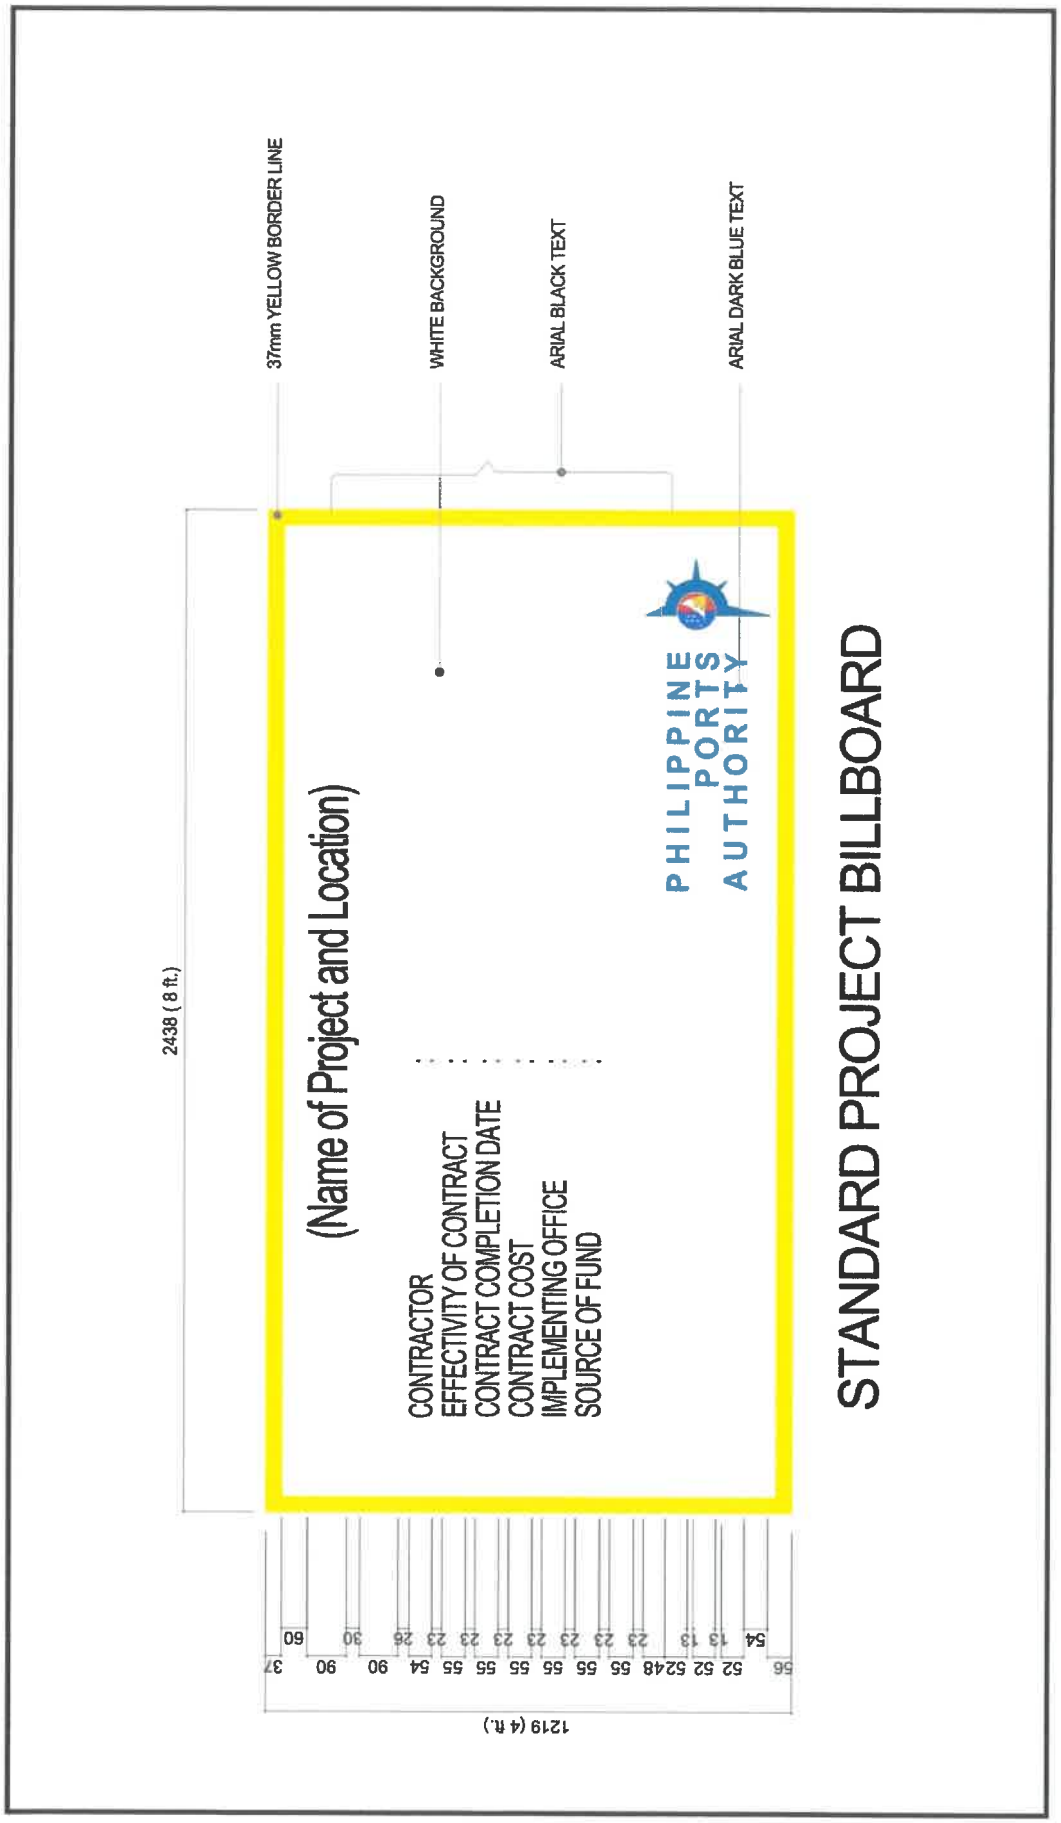
SPECIFICATION

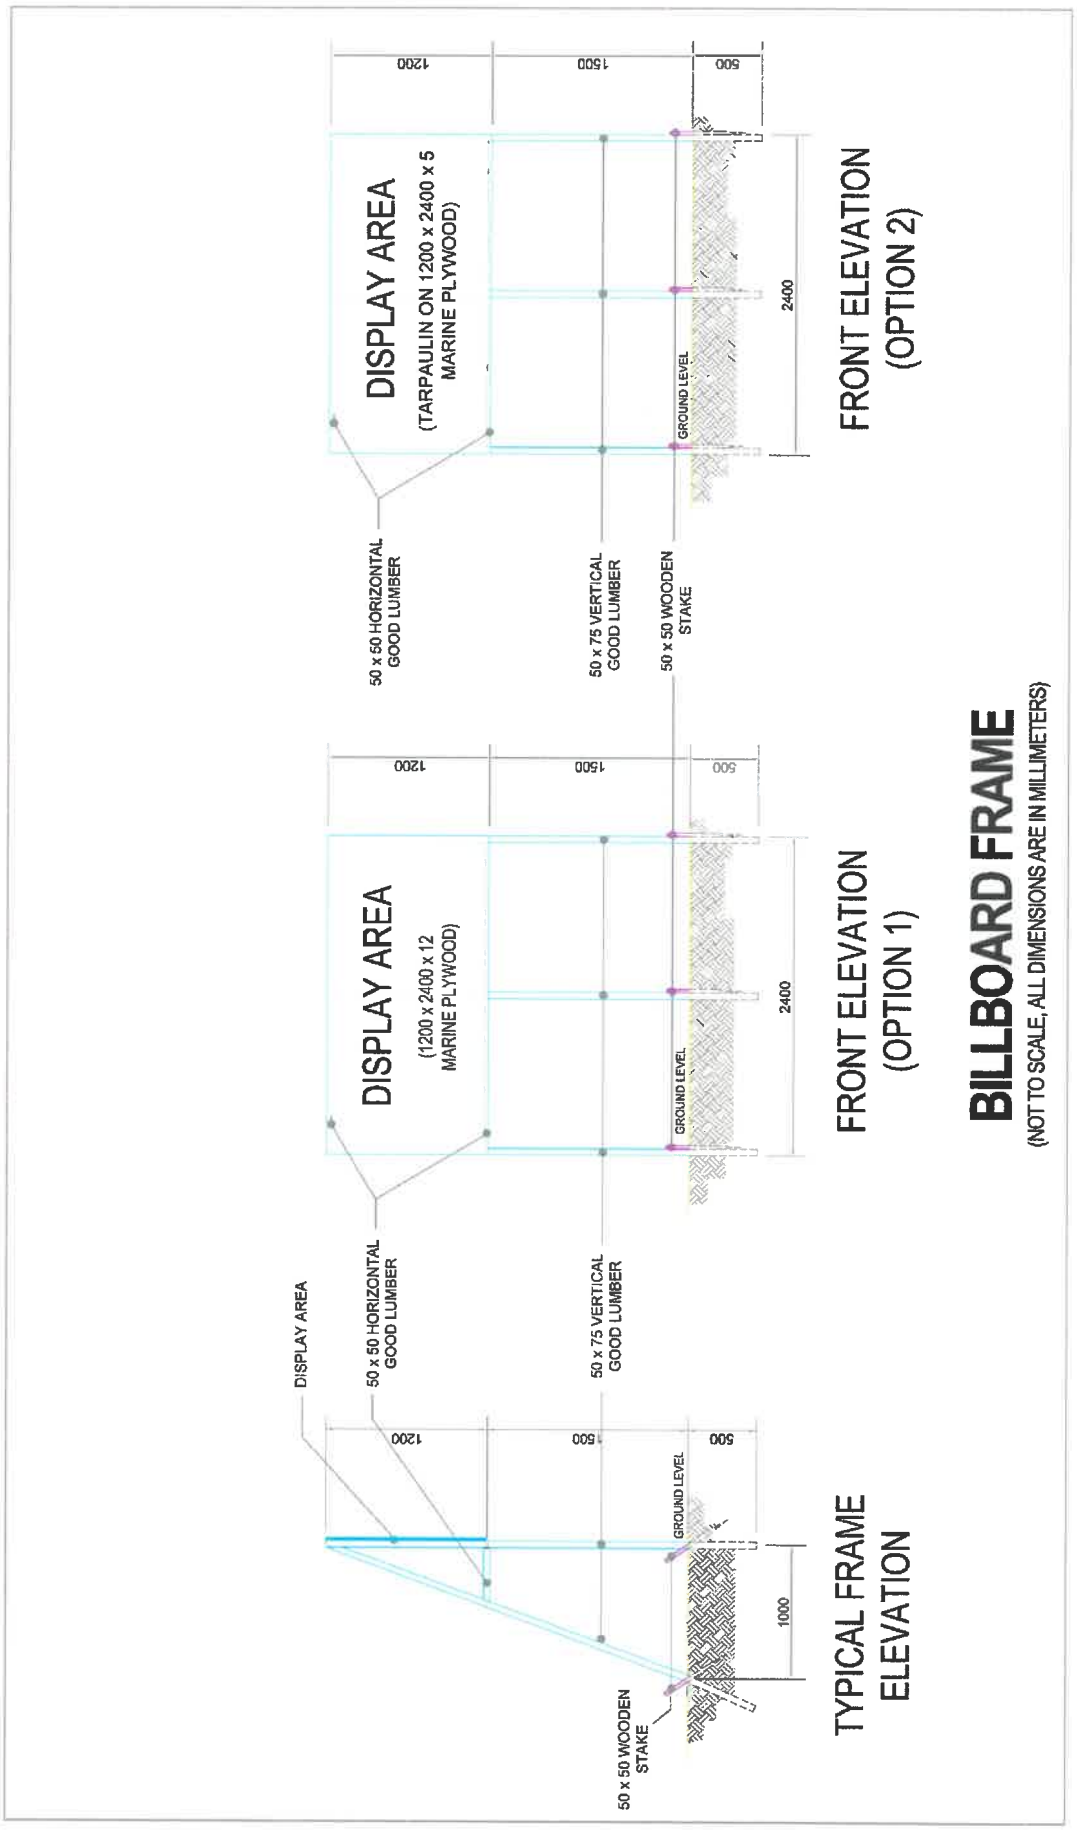
The Project Billboard shall be installed at location(s) designated by the Engineer.

The size and specifications of materials for the standard billboard shall be 4ft. x 8ft. (1,200mm x 2,400mm) using ½ inch (12mm) marine plywood or tarpaulin poster on 3/16 inch (5mm) marine plywood.

Project billboards shall not contain Name(s) and/or picture(s) of any personages.

See attached drawings for further details of the standard billboard.


STANDARD PROJECT BILLBOARD
37mm YELLOW BORDER LINE
WHITE BACKGROUND
ARIAL BLACK TEXT
ARIAL DARK BLUE TEXT
PHILIPPINE PORTS AUTHORITY
(Name of Project and Location)
CONTRACTOR
EFFECTIVITY OF CONTRACT
CONTRACT COMPLETION DATE
CONTRACT COST
IMPLEMENTING OFFICE
SOURCE OF FUND
2438 (8 ft.)
1219 (4 ft.)


BILLBOARD FRAME
(NOT TO SCALE, ALL DIMENSIONS ARE IN MILLIMETERS)
FRONT ELEVATION
(OPTION 2)
DISPLAY AREA
(TARPAULIN ON 1200 x 2400 x 5
MARINE PLYWOOD)
50 x 50 HORIZONTAL
GOOD LUMBER
50 x 75 VERTICAL
GOOD LUMBER
50 x 50 WOODEN
STAKE
GROUND LEVEL
2400
1200
1500
500
FRONT ELEVATION
(OPTION 1)
DISPLAY AREA
(1200 x 2400 x 12
MARINE PLYWOOD)
50 x 50 HORIZONTAL
GOOD LUMBER
50 x 75 VERTICAL
GOOD LUMBER
GROUND LEVEL
2400
1200
1500
500
TYPICAL FRAME
ELEVATION
DISPLAY AREA
50 x 50 HORIZONTAL
GOOD LUMBER
50 x 75 VERTICAL
GOOD LUMBER
50 x 50 WOODEN
STAKE
GROUND LEVEL
1000
1200
500
500

ITEM 15 : SAFETY SIGNAGES AND BARRICADES

DESCRIPTION

This work includes the furnishing and installing of safety signages and barricades in accordance with the specifications and to the details shown below in the drawings, or as directed by the Engineer.

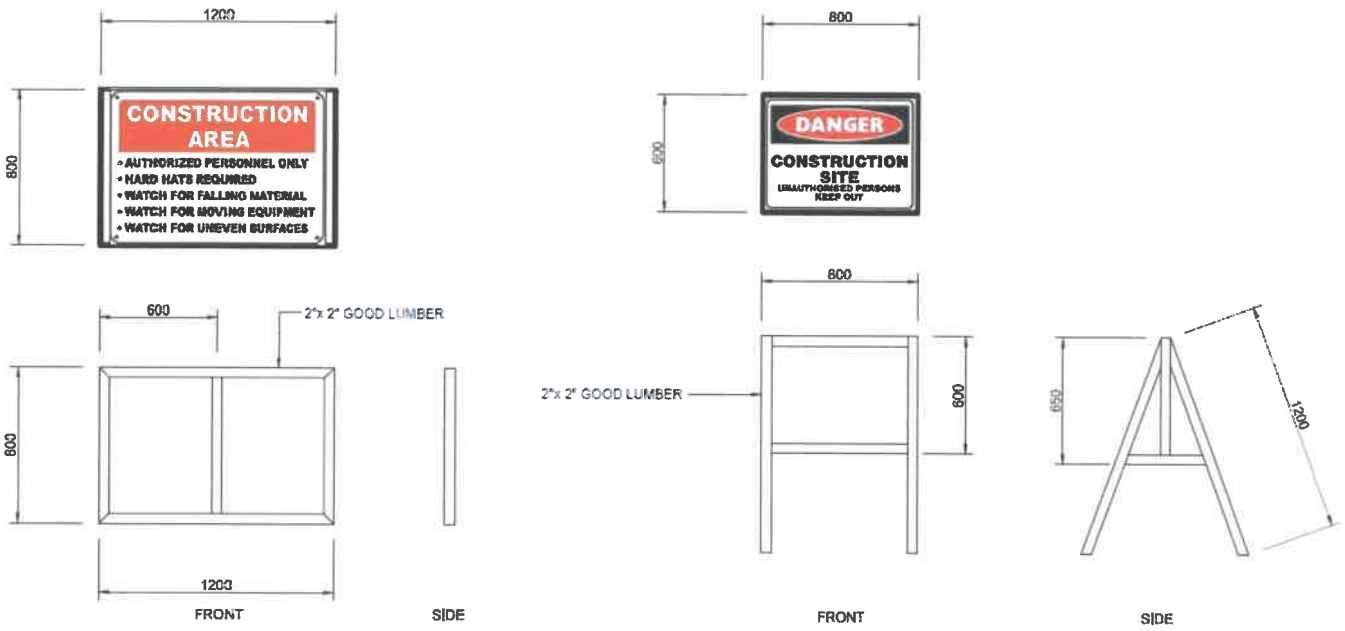
SPECIFICATION

The Signage's and Barricades shall be installed at location(s) designated by the Engineer.

The sizes of the standard signages shall be 2-2/3ft x 4ft (800mm X 1,200mm) for fixed type and 2ft x 2–2/3ft (600mm x 800mm) for mobile type. For barricade standard 2ft x 2–2/3ft (600mm x 800mm) shall be provided.

The materials to be used for signages and barricades are ½ inch (12mm) marine plywood or tarpaulin poster on 2" x 2" (50mm x 50mm) good lumber frame (see drawing below).

The printing or painting shall be the discretion of the Engineer.



STANDARD PLAN FOR SIGNAGES AND BARRICADES

SECTION VII

DRAWINGS
(APPROVED PLANS)

DRAWINGS AND APPROVED PLANS
(SEE ISSUED APPROVED PLANS)

LIST OF DRAWINGS:

01	OF	21	-	VICINITY MAP, DEVELOPMENT PLAN, GENERAL NOTES, LIST OF DRAWINGS
02	OF	21	-	PLAN SHOWING EXISTING FACILITIES
03	OF	21	-	GENERAL PLAN
04	OF	21	-	PORT OPERATIONAL PLAN & RESTORATION OF PAVEMENT LAYOUT PLAN
05	OF	21	-	STORM DRAINAGE LAY-OUT PLAN & PILING PLAN
06	OF	21	-	STATION 0+000, STATION 0+010, STATION 0+020 & STATION 0+030
07	OF	21	-	STATION 0+040, STATION 0+050, STATION 0+060 & STATION 0+070
08	OF	21	-	STATION 0+080, STATION 0+090, STATION 0+100 & STATION 0+110
09	OF	21	-	STATION 0+120, STATION 0+130, STATION 0+140 & STATION 0+150
10	OF	21	-	STATION 0+160, SECTION "A" & SECTION "B" & TYP. SECTION FOR RESTORATION OF PAVEMENT
11	OF	21	-	OFFSHORE ELEVATION OF WHARF
12	OF	21	-	KEY SHEET PILING PLAN, DETAIL OF WALE SPLICE, PILE CONNECTOR & DETAIL OF TIE ROD
13	OF	21	-	DETAIL ATTACHMENT OF RUBBER DOCK FENDER AND MOORING TEE HEAD, DETAIL OF RETAINING WALL-1, DETAIL OF ANCHOR WALL & DETAIL OF ANCHOR BLOCK
14	OF	21	-	DETAIL OF COPING WALL-1, DETAIL OF RETAINING WALL-1 & DETAIL OF TIE ROD
15	OF	21	-	TYPICAL ELEVATION OF DRAINAGE SYSTEM, DETAIL OF CATCH DRAIN MANHOLE, DETAIL OF 300mm PCC PAVEMENT & DETAIL OF RETAINING WALL-2

16	OF	21	-	DETAIL OF RUBBER DOCK FENDER (V-500H x 1500L)
17	OF	21	-	DETAIL OF SUPER CONE FENDER (1200H)
18	OF	21	-	DETAIL OF 100 TONS MOORING BOLLARD (TEE HEAD)
19	OF	21	-	PORT LIGHTING LAYOUT PLAN, GENERAL NOTES & LEGEND
20	OF	21	-	DETAIL OF LAMP POST FOUNDATION, SINGLE ANGLE BAR FLOODLIGHT STEEL TAPERED LAMP POST, FLOODLIGHT POST CONNECTION DETAILS, BASE PLATE & SPECIFICATION
21	OF	21	-	DETAIL OF DUCT BANK, LOAD SCHEDULE, ELECTRICAL HAND HOLE DETAIL, DETAIL OF CONCRETE PEDESTAL POST & RISER DIAGRAM

SECTION VIII

BILL OF QUANTITIES
and
ATTACHMENTS

BID SUMMARY

APARRI PORT WIDENING AND UPGRADING PROJECT

Port of Aparri, Aparri, Cagayan

NO.	DESCRIPTION OF WORK	AMOUNT (Pesos)
BILL NO. 1	GENERAL EXPENSES	
BILL NO. 2	REMOVAL AND EXCAVATION WORKS	
BILL NO. 3	WIDENING AND UPGRADING OF WHARF	
	BID PRICE	

Name of Firm

Name of Bidder/Authorized Representative
(Signatory's Legal Capacity)

Date

BILL OF QUANTITIES
APARRI PORT WIDENING AND UPGRADING PROJECT
Port of Aparri, Aparri, Cagayan

NO. (1)	DESCRIPTION OF WORK (2)	UNIT (3)	QTY. (4)	UNIT PRICE (Pesos) (5)	AMOUNT (Pesos) (4) x (5)
BILL NO.	**1 GENERAL EXPENSES**				
1.01	Mobilization, demobilization and cleaning	lot	1		
1.02	Rental of temporary site office and residence for the Engineer and staff	mo.	22		
1.03	Maintain temporary site office and residence for the Engineer and staff	mo.	22		
1.04	Provide Construction Safety and Health Program in the execution of the project	mo.	22		
	TOTAL FOR BILL NO. 1				

Name of Bidder/Authorized Representative
(Signatory's Legal Capacity)

BILL OF QUANTITIES
APARRI PORT WIDENING AND UPGRADING PROJECT
Port of Aparri, Aparri, Cagayan

NO. (1)	DESCRIPTION OF WORK (2)	UNIT (3)	QTY. (4)	UNIT PRICE (Pesos) (5)	AMOUNT (Pesos) (4) x (5)
BILL NO.	**2 REMOVAL AND EXCAVATION WORKS**				
2.01	Remove and dispose existing pavement	sq.m.	1,357		
2.02	Excavate seabed prior for laying of sheet pile and laying or rocks	cu.m.	11,943		
2.03	Excavate and dispose existing fill materials prior for installation of tie-rod	cu.m.	3,740		
	TOTAL FOR BILL NO. 2				

Name of Bidder/Authorized Representative
(Signatory's Legal Capacity)

BILL OF QUANTITIES
APARRI PORT WIDENING AND UPGRADING PROJECT
Port of Aparri, Aparri, Cagayan

NO. (1)	DESCRIPTION OF WORK (2)	UNIT (3)	QTY. (4)	UNIT PRICE (Pesos) (5)	AMOUNT (Pesos) (4) x (5)
BILL NO.	**3 WIDENING AND UPGRADING OF WHARF**				
3.01	Supply and deliver to site Z-Type steel sheet piles including connectors	m.t.	1,681		
3.02	Supply and install dowel bars for steel pipe piles	kg.	6,521		
3.03	Handle, pitch and drive steel sheet piles and connectors	l.m.	11,750		
3.04	Supply and install steel waling and splice plate for the steel sheet piles	kg.	26,048		
3.05	Cutting of newly driven steel sheet piles and turn over excess materials to the authority	no.	470		
3.06	Supply and place 3,500 psi concrete for the anchor wall, anchor block, retaining wall, mooring block, rc crub, and electrical works	cu.m.	1,587		
3.07	Supply and install steel reinforcement for the anchor wall, anchor block, retaining wall, mooring block, rc crub, and electrical works	kg.	134,502		
3.08	Supply and place gravel bedding	cu.m.	6		
3.09	Supply and place 50-100 kg. Core rocks	cu.m.	7,006		
3.10	Supply and install tie-rod of various sizes including accessories				
	a) 44mm Ø x 30m	set	20		
	b) 44mm Ø x 15m	set	194		
	c) 32mm Ø x 12m	set	30		

Name of Bidder/Authorized Representative
(Signatory's Legal Capacity)

BILL OF QUANTITIES
APARRI PORT WIDENING AND UPGRADING PROJECT
Port of Aparri, Aparri, Cagayan

NO. (1)	DESCRIPTION OF WORK (2)	UNIT (3)	QTY. (4)	UNIT PRICE (Pesos) (5)	AMOUNT (Pesos) (4) x (5)
3.11	Supply and install Geotextile Fabric	sq.m.	6,384		
3.12	Supply and place Sand and Gravel fill	cu.m.	15,058		
3.13	Supply, spread and compact aggregate sub-base course	cu.m.	10,968		
3.14	Supply, spread and compact aggregate base course	cu.m.	1,564		
3.15	Construct portland cement concrete pavement (300mm thk) including dowel bars and construction joint	sq.m.	7,822		
3.16	Supply deliver and install port lighting system including lamp post and other accessories	lot	1		
3.17	Construct catch drain manhole including accessories	no.	19		
3.18	Supply and lay 600mm dia. reinforced concrete pipe including accessories	l.m.	303		
3.19	Supply and deliver to site rubber dock fender (V-type, 500H x 1500L) including accessories	set	29		
3.20	Install rubber dock fender and accessories	set	29		
3.21	Supply and deliver to site mooring bollard (35 Tons, T-head) including accessories	set	15		

Name of Bidder/Authorized Representative
(Signatory's Legal Capacity)

BILL OF QUANTITIES
APARRI PORT WIDENING AND UPGRADING PROJECT
Port of Aparri, Aparri, Cagayan

NO. (1)	DESCRIPTION OF WORK (2)	UNIT (3)	QTY. (4)	UNIT PRICE (Pesos) (5)	AMOUNT (Pesos) (4) x (5)
3.22	Install mooring bollards (T-head type) and accessories	set	15		
TOTAL FOR BILL NO. 3					

Name of Bidder/Authorized Representative
(Signatory's Legal Capacity)

BASIS OF PAYMENT FOR WORK ITEMS INCLUDED IN THE PROPOSAL

The work items included in the proposal and the basis of payments are as follows:

BILL NO. 1

GENERAL EXPENSES

Item 1.01 Mobilization, demobilization, and cleaning

The quantity to be paid for shall be the minimum equipment requirement enumerated in the bid documents mobilized, demobilized and cleaning of the site and accepted by the Engineer. The contract lump sum price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to mobilize and demobilize all the minimum equipment requirement enumerated in the bid documents including cleaning of the site. Fifty percent (50%) of the total amount shall be payable after the mobilization activity while the remaining (50%) payable after demobilization and cleaning.

Item 1.02 Rental of temporary site office and residence for the Engineer and staff

The quantity to be paid for shall be the actual rental of site office and residence for the engineer and staff and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary for the provision of temporary site office and residence for the engineer and staff.

Item 1.03 Maintain temporary site office and residence for the Engineer and staff

The quantity to be paid for shall be the actual services rendered in maintaining the site office and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the maintenance of the temporary site office and residence as well as other expenses such as provision for electric power, telephone bill, potable water supply, janitorial and security services.

Item 1.04 Provide construction safety and Health Program in the execution of the project

The quantity to be paid for shall be the actual implementation of construction safety and health program and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the implementation of the Construction Safety and Health Program, as required and approved by the Department of Labor and Employment (DOLE).

BILL NO. 2

REMOVAL AND EXCAVATION WORKS

Item 2.01 Remove and dispose existing payment

The quantity to be paid for shall be the actual area in square meter of existing pavement to be removed and disposed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 2.02 Excavate seabed prior for laying of sheet pile and laying of rocks

The quantity to be paid for shall be the actual volume in cubic meter of existing seabed to be excavated prior to laying of sheet pile and rocks in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 2.03 Excavate and dispose existing fill materials prior to installation of tie-rod

The quantity to be paid for shall be the actual volume in cubic meter of existing fill materials to be excavated and properly disposed prior to installation of tie-rod in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

BILL NO. 3

WIDENING AND UPGRADING OF WHARF

Item 3.01 Supply and deliver to site Z-Type steel sheet piles including connectors

The quantity to be paid for shall be the actual weight in metric tons of Z-Type steel sheet piles including connectors to be supplied and delivered to site in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 3.02 Supply and install dowel bars for steel pipe piles

The quantity to be paid for shall be the actual weight in kilogram of dowel bars for steel pipe piles to be supplied and installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 3.03 Handle, pitch and drive steel sheet piles and connectors

The quantity to be paid for shall be the actual length in linear meter of steel sheet piles and connectors to be handled, pitched and driven in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 3.04 Supply and install steel waling and splice plate for the steel sheet piles

The quantity to be paid for shall be the actual weight in kilogram of steel waling and splice plate for the steel sheet piles to be supplied and installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 3.05 Cutting of newly driven steel sheet piles and turn over excess materials to the authority

The quantity to be paid for shall be the actual number of newly driven steel sheet piles to be cut off up to required elevation and turn over excess materials to the authority in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 3.06 Supply and place 3,500 psi. concrete for anchor wall, anchor block, retaining wall, mooring block, rc curb, and electrical works

The quantity to be paid for shall be the actual volume in cubic meters of 3,500 psi. concrete for anchor wall, anchor block, retaining wall, mooring block, rc curb, and electrical works to be supplied and placed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 3.07 Supply and install steel reinforcement for the anchor wall, anchor block, retaining wall, mooring block, rc curb, and electrical works

The quantity to be paid for shall be the actual weight in kilogram of steel reinforcement for anchor wall, anchor block, retaining wall, mooring block, rc curb, and electrical works to be supplied and installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 3.08 Supply and place gravel bedding

The quantity to be paid for shall be the actual volume in cubic meters of gravel bedding to be supplied and placed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 3.09 Supply and place 50-100 kg. core rocks

The quantity to be paid for shall be the actual volume in cubic meters of 50-100 kg core rocks to be supplied and placed in accordance with the plans and specifications and accepted by the Engineer. Hydrographic/Topographic Surveys before and after placing core rocks shall be made to determine the actual elevations along the cross sections and the actual quantities for payment. Volume due to settlement as established using settlement plates shall also be considered for payment. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 3.10 Supply and install tie-rod of various sizes including accessories

a. 44 mm ø x 30m
b. 44mm ø x 15m
c. 32mm ø x 12m

The quantity to be paid for shall be the actual set of tie-rod in various sizes including accessories to be supplied and installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 3.11 Supply and install geotextile fabric

The quantity to be paid for shall be the actual area in square meters of geotextile filter fabric to be supplied and installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 3.12 Supply and place sand and gravel fill

The quantity to be paid for shall be the actual volume in cubic meters of sand and gravel fill to be supplied and placed in accordance with the plans and specifications and accepted by the Engineer. Hydrographic/Topographic Surveys before and after placing and compacting of sand and gravel fill shall be made to determine the actual elevations along the cross sections and the actual quantities for payment. Volume due to settlement as established using settlement plates shall also be considered for

payment. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 3.13 Supply, spread and compact aggregate sub-base course

The quantity to be paid for shall be the actual volume in cubic meters of aggregate sub-base course to be supplied, spread and compacted in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 3.14 Supply, spread and compact aggregate base course

The quantity to be paid for shall be the actual volume in cubic meters of aggregate base course to be supplied, spread and compacted in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 3.15 Construct portland cement concrete pavement (300mm thick) including dowel bars and construction joints

The quantity to be paid for shall be the actual area in square meter of portland cement concrete pavement (300mm thick) including dowel bars and construction joints to be constructed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 3.16 Supply deliver and install port lighting system including lamp post and other accessories

The quantity to be paid for shall be the actual lot of port lighting system including lamp post and other accessories to be supplied and installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 3.17 Construct catch drain manhole including accessories

The quantity to be paid for shall be the actual number of catch drain manhole including accessories to be constructed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 3.18 Supply and lay 600mm dia. reinforced concrete pipe including accessories

The quantity to be paid for shall be the actual length in linear meter of 600mm dia. reinforced concrete pipe including accessories to be supplied and laid-in-place in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 3.19 Supply and deliver to site rubber dock fender (V-type, 500H x 1500L) including accessories

The quantity to be paid for shall be the actual set of site rubber dock fender (V-type, 500H x 1500L) including accessories to be supplied and delivered to site in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 3.20 Install rubber dock fender and accessories

The quantity to be paid for shall be the actual set of rubber dock fender and accessories to be installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 3.21 Supply and deliver to site mooring bollard (35 Tons, T-head) including accessories

The quantity to be paid for shall be the actual set of mooring bollard (35 Tons, T-head) including accessories to be supplied and delivered to site in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 3.22 Install mooring bollards (T-head type) including accessories

The quantity to be paid for shall be the actual set of mooring bollards (T-head Type) including accessories to be installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

FACILITIES TO BE PROVIDED FOR THE ENGINEER & HIS STAFF

RENTAL OF SITE OFFICE AND RESIDENCE FOR THE ENGINEER & STAFF

The Contractor shall provide a temporary site office and residence (rental) with an area of at least 48 square meters for use of the Engineer and his staff for the whole duration of the project.

MINIMUM MAJOR EQUIPMENT REQUIREMENTS

1	unit/s	Backhoe (0.40 cu.m., 94.30hp, minimum), owned
1	unit/s	Clamshell, owned
2	unit/s	Concrete cutter, owned
2	unit/s	Concrete Mixer (1 bagger, minimum), owned
2	unit/s	Concrete bucket, owned
2	unit/s	Concrete Screeder, owned
2	unit/s	Concrete Vibrator (3.5 hp, minimum), owned
1	unit/s	Crane Barge (319 GW, minimum) with 60T crane, owned,
1	unit/s	Crawler Crane (30T, minimum), owned
1	unit/s	Pile Hammer (Diesel, 6,500 kg.m. min, to 7,500 kg.m. max or hydraulic equivalent), owned
1	unit/s	Drop Hammer (2T, minimum), owned
1	unit/s	Dump Truck (10T net capacity, minimum), owned
2	unit/s	Bar Bender (electric, 25mm dia min.), owned
2	unit/s	Bar Cutter (electric, 25mm dia min.), owned
2	unit/s	Oxy/Acetylene cutting outfit, owned
1	unit/s	Payloader (80 hp, minimum), owned
1	unit/s	Plate Compactor (5 hp, minimum), owned
1	unit/s	Road Grader (125 hp, minimum), owned/leased
1	unit/s	Road Roller (10T, vibratory, minimum), owned/leased
2	unit/s	Transit Mixer (6 cu.m. cap., minimum), owned/leased
1	unit/s	Tugboat (500hp, minimum), owned/leased
1	unit/s	Water Truck with pump (1,000 gal., minimum), owned
2	unit/s	Welding Machine (400 amp., minimum), owned
1	unit/s	Cargo Truck (2 Tons, minimum), owned

CONSTRUCTION SAFETY AND HEALTH REQUIREMENT

The Contractor shall implement the construction safety and health program in accordance with the applicable provisions of the Occupational Safety and Health Standards (OSHS) of the Department of Labor and Employment (DOLE).

The Contractor, subject to the approval of the Engineer shall provide and maintain throughout the duration of the contract a medical room with at least 15 square meters together with all necessary supplies to be sited in the Contractor's main area.

The Contractor shall provide the following minimum requirements:

L A B O R

1	no.	Safety Engineer / Officer
1	no.	Nurse / Health Officer

EQUIPMENT / MATERIALS

Personnel Protective Equipment

51	pcs.	Hard Hats
51	pcs.	Gloves (rubberized)
51	pcs.	Safety Glasses/Goggles (clear)
102	pcs.	Long sleeve T-shirt
8	pcs.	Aprons
4	pcs.	Safety Belts
51	pairs	Safety Shoes
4	pcs.	Life lines

Safety Devices

1	lot	Barricades
1	lot	Warning signs (Signages)
2	unit/s	Fire extinguisher (10kg)

Medical and First Aid System	-	Twenty-two (22) mos.
Temporary shelter for workers	-	1 lot

NOTE:

The Contractor shall provide the above-cited minimum construction safety and health requirements or as required by the Engineer.

PPA MEMORANDUM CIRCULAR
No 02
Series of 2016
Attachment

REVISED SCHEDULE OF MINIMUM TEST REQUIREMENTS OF CONSTRUCTION MATERIALS FOR PPA INFRASTRUCTURE PROJECTS

Materials/Items of Work	*Required Tests*	*Minimum Incremental Frequency of Tests*
I. Construction of Pier/Wharf, Platform and Ramp		
Structural Concrete (SC)		
A Portland Cement	Quality Test	For every 2,000 bags (40kg) or fraction thereof
B Fine Aggregate	Quality Test for Grading, Elutriation (wash), Bulk Specific Gravity, Absorption, Mortar Strength, Soundness, Organic Impurities, Unit Weight, % Clay Lumps and Shale	For every 1,500 cubic meter or fraction thereof
C Coarse Aggregate	Quality Test for Grading, Bulk Specific Gravity, Absorption and Abrasion	For every 1,500 cubic meter or fraction thereof
D Water	Certificate from the Engineer or Quality Test for Density and Chloride Content	One per source
E Steel Bars	Mill Certificate and Quality Test for Chemical Composition and Mechanical Properties	For every 10,000 kg or fraction thereof
F Concrete	Compressive Strength on cylinder samples	1 set consisting of 3 concrete cylinder samples shall be taken from each day's pouring and to represent not more than 75 cu m of concrete or fraction thereof
	Slump Test	For every mix
G Admixture and Concrete Curing Materials	Quality Test	One per shipment
Piling (P)		
A Concrete Piles	Fabrication Report	One per fabrication
1 Concrete	Same test as for SC (F)	Same frequency as SC (F)
2 Steel Bars	Same test as for SC (E)	Same frequency as SC (E)
3 High Tension Strand	Test for Chemical Composition and Mechanical Properties	For every 20000kg or fraction thereof