ITEM 06 : PORTLAND CEMENT CONCRETE PAVEMENT

SCOPE OF WORK

The works include the furnishing of all labor, materials and equipment required for the construction of gravel base course and concrete pavement. The works shall be in accordance with the lines and grades shown on the Drawings and in conformity with the Specifications.

MATERIAL REQUIREMENTS

Cement

Portland cement shall conform to the requirements of the Section "Reinforced Concrete".

Fine Aggregate

The fine aggregate shall be well-graded from coarse to fine and shall conform to the requirements of the Section "Reinforced Concrete".

Coarse Aggregate

Coarse aggregate shall conform to the requirements of the Section "Reinforced Concrete".

Water

Clean, fresh, potable water shall be used for the mixing of all concrete and mortar and shall be from a source approved by the Engineer. Sea water or brackish water shall not be used.

Admixture

Admixture shall only be used with the written permission of the Engineer. If air-entraining agents, water reducing agents, set retarders or strength accelerators are permitted to be used, they shall not be used in greater dosages than those recommended by the manufacturer, or as permitted by the Engineer. The cost shall be considered as already in the Contractor's unit cost bid for concrete.

TIE BARS AND SLIP BARS

Tie bars shall be deformed bars conforming to the requirements specified in AASHTO M 31 or M 42, except that rail steel shall not be used for tie bars that are to be bent and re-straightened during construction, sizes as indicated on the Drawings. The deformed bars shall be Grade 40 and shall be shipped in standard bundles, tagged and marked in accordance with the Code of Standard practice of the Concrete Reinforcement Steel Institute.

Slip bars shall be smooth round steel bars conforming to the requirements specified in AASHTO M 31 or plain M 42.

Joint Filler

Poured filler for joint shall conform to the requirements of AASHTO M173.

EXECUTION

Concrete Class

The concrete for pavement shall satisfy the following requirements:

Minimum 28-day comprehensive strength	:	24 MPa
Minimum Flexural Strength	:	3.8 MPa
Maximum Aggregate size	:	25 mm
Maximum water cement ratio	:	0.52

Proportioning, Consistency and Mixing of Concrete

The proportioning, consistency and mixing of concrete shall conform to the requirements of the Section "Reinforced Concrete".

Preparation

The base shall be watered and thoroughly moistened prior to placing of the concrete.

Formwork Construction

Formwork shall comply with the requirements of the Section "Reinforced Concrete". Forms shall be of steel, of an approved section and shall be straight and of a depth equal to thickness of the pavement at the edge. The base of the forms shall be of sufficient width to provide necessary stability in all directions. The flange braces must extend outward on the base not less than 2/3 the height of the form.

All forms shall be rigidly supported on a bed of thoroughly compacted material during the entire operation of placing and finishing the concrete. They shall be set with their faces vertical so as to produce a surface complying with the required tolerance.

Adjacent lanes may be used in lieu of forms for supporting finishing equipment provided that proper protection is afforded to the concrete of the adjacent lanes to prevent damage, and provided further that the surface of the concrete carrying the finishing equipment does not vary by more than 3mm in each meter length. Adjacent lanes in lieu of forms may not be used until the concrete is at least seven (7) days old. Flanged wheels of the finishing equipment shall not be operated on the concrete surface. The inside edge of supporting wheels of the finishing machine shall not operate closer than 100mm from the edge of the concrete lane.

Alternative to placing forms, slip-forming may be used. Slip-form paving equipment shall be equipped with the traveling side forms of sufficient dimensions, shape and strength to support the concrete laterally for a sufficient length of time during placement to produce pavement of the required cross section. No abrupt changes in longitudinal alignment of the pavement will be permitted. The horizontal deviation shall not exceed 20mm from the proper alignment established by the Engineer.

Joints

All joints, longitudinal, transverse, etc., shall be constructed as shown on the Drawings and shall be clean and free of all foreign material after completion of shoulder work prior to acceptance of the work and in accordance with the following provisions:

Longitudinal and Transverse Contact Joints:

Longitudinal contact joints are joints formed between lanes that are poured separately. Transverse contact joints are joints formed between segments of a lane that are poured separately. Transverse contact joints shall be formed perpendicular to pavement centerline at the end of each day of concrete placing, or where concreting has been stopped for 30 minutes or longer but not nearer than 1.5 meters from sawed contraction joints. All contact joints shall have faces perpendicular to the surface of the pavement. Tie bars of the size, length and spacing shown on the Drawings shall be placed across longitudinal and transverse contact joints.

Placing Concrete

The concrete shall be deposited and spread in order that segregation will not occur and place a uniform layer of concrete whose thickness is approximately 20 mm greater than that required for the finished pavement is placed. Rakes shall not be used for handling concrete.

In order to prevent the introduction into the concrete of earth and other foreign materials, the men whose duties require them to work in the concrete, shall in general, confine their movements to the area already covered with fresh concrete. Whenever it becomes necessary for these men to step out of the concrete, their footwear shall be washed or otherwise thoroughly cleaned before returning to the concrete. Repeated carelessness with regard to this detail will be deemed sufficient cause for removing and replacing such worker.

During the operation of striking off the concrete, a uniform ridge of concrete at least 70 mm in height shall be maintained ahead of the strike-off screed for its entire length. Except when making a construction joint, the finishing machine shall at no time be operated beyond that point where this surplus can be maintained in front of the strike-off screed.

After the first operation of the finishing machine, additional concrete shall be added to all low places and honeycombed spots and the concrete rescreeded. In any rescreeding, a uniform head of concrete shall be maintained ahead of the strike-off for its entire length. Honeycombed spots shall not be eliminated by tamping or grouting.

Workers on the job shall have mobile footbridges at their disposal so that they need not walk on the wet concrete.

In conjunction with the placing and spreading, the concrete shall be thoroughly spaded and vibrated along the forms, bulkhead, and joints.

The internal vibrators shall be of pneumatic, gas-driven, or electric type, and shall operate at a frequency of not less than 3,200 pulsations per minute.

Whenever the placing of the concrete is stopped or suspended for any reason, for a period of 30 minutes or longer, a suitable bulkhead shall be placed so as to produce a vertical transverse joint. If an emergency stop occurs within 2.5 meters of the contraction or an expansion joint the concrete shall be removed back to the joint. When the placing of the concrete is resumed, the bulkhead shall be removed and a new concrete placed and vibrated evenly and solidly against the face of previously deposited concrete. Any concrete in excess of the amount needed to complete a given section or that has been deposited outside the forms shall not be used in the work.

The Contractor shall provide suitable equipment for protecting the fresh concrete in case of rain, such as screens which will cause the rain water to run off beyond the edges of the paving, rain proof tarpaulins or other methods approved by the Engineer. The equipment shall be sufficient to shelter from rain all areas equal to that paved in two hours of work.

Finishing Concrete

The concrete shall be compacted and finished by a mechanical, self-propelled finishing machine of approved type, having two independently operated screeds. If a machine possessing only one screed is approved, the screed will not be less than 450 mm wide and shall be equipped with compensating springs to minimize the effect of the momentum of the screed on the side forms. The number of driving wheels, the weight of the machine and the power of the motor shall be so coordinated as to prevent slippage. The top of the forms and the surface of the finishing machine wheels shall be kept free from concrete or dirt.

The machine shall at all times be in first-class mechanical condition and shall be capable of compacting and finishing the concrete are herein described. Any machine which causes displacement of the side forms from the line or grade to which they have been properly set, or causes undue delay due to mechanical difficulties, shall be removed from the work and replaced by a machine meeting the Specifications.

The finishing machine shall be operated over each section of pavement two or more times and at such intervals as will produce the desired results. Generally, two passes of the finishing machine are considered the maximum desirable.

The concrete shall be vibrated, compacted, and finished by a vibratory finishing machine. The vibratory machine shall meet the requirements for ordinary finishing, and shall be one of the following type:

1. The machine shall have two independently operated screeds; the front screed shall be equipped with vibratory units with a frequency of not less than 3,500 pulsations per minute. There shall be not less than one vibratory unit for each 2.5 meters length or portion thereof, of vibratory screed surface. The front screed shall not be less than 300mm wide and shall be equipped with a "bull nose" front edge built on a radius of not less than 50mm. This type of vibratory finishing machine shall be operated in such manner that each section of pavement will receive at least one vibratory pass, but not more than two passes, unless otherwise directed, or ;

2. The machine shall be equipped with an independently operated vibratory "pan" (or pans) and two (2) independently operated screeds, the "pan" shall be mounted in a manner that will permit it to come in contact with the forms and will permit vibration of the full width of lane simultaneously.

   There shall be not less than one vibratory unit for each 2 m. length or portion thereof, of vibrating pan surface. The vibratory units in any individual pan shall be synchronized and have a frequency of not less than 3,500 pulsations per minute. The front screed shall be capable of operating in a position that will strike off the concrete at a sufficient height above the top of the forms to allow for proper compaction with the vibrating pan. This type of vibratory finishing machine shall be operated in such manner than each section of pavement will receive at least one vibratory pass but not more than two passes, unless otherwise directed.

   After the final pass of the finishing machine and when the concrete has started to dry, the surface of the pavement shall be finished with an approved longitudinal float. The float may be operated either manually or by mechanical means. The float may be either of wood or metal shall be straight and smooth and light in weight so as not to displace or sink into the concrete surface.

   To be effective, the float shall be at least 300mm wide and 3m long. When manually operated, the float shall be moved from edge to edge with a wiping motion and advance one (1) meter or more.

The succeeding trip shall overlap the previous trip. A light smoothing lute at least 3 meters long may be used provided approved by the Engineer.

The surface of the pavement shall be tested by the Contractor, before the final belting, with an approved standard straightedge 3 meter in length. Irregularities so detected shall be corrected immediately. Special attention shall be given to the concrete adjacent to transverse joints to insure that the edges thereof are not above the grade specified or the adjacent concrete below grade. All depressions or projections shall be corrected before any initial set has developed in the concrete.

After the concrete has been brought to the required grade, contour and smoothness, it shall be finished by passing over the concrete a drag of one or two burlap clothes, which give the surface the required roughness. The vehicles used to carry these cloths may be independent of the concrete-laying machine or may be incorporated with it and may be operated either by hand or mechanically.

Hand finishing will be permitted only on variable width sections of the pavement and other places where the use of the finishing machine would be impractical. Hand finishing shall be accomplished by means of the hand-operated strike-off template of either steel or steel-shod wood construction. The striking template shall be operated forward with a combined longitudinal and transverse motion and shall be so manipulated that neither end will be raised off the side forms. A similar tamper shall be used for tamping the concrete.

As soon as the concrete has attained its initial set, the edges of the pavement, the longitudinal joints, the construction dummy and expansion joints not sawn shall be carefully finished with an edging tool having radius of at least 5mm. The tools, the special accessories for cutting impressed joints and methods of workmanship shall be such as will produce a joint whose edges are of the same quality of concrete as the other portion of the pavement. Methods and workmanship which make use of excess mortar or grout in this area shall be eliminated. Unnecessary tool marks shall be eliminated during work, and the edges left smooth and true to line.

Striking Forms

Forms shall remain in place at least 12 hours after the concrete has been placed. When working conditions are such that the early strength gain of the concrete is delayed, the forms shall remain in place for a longer period, as directed by the Engineer. Bars or heavy load shall not be used against the concrete when still in the forms. Any damage to concrete resulting from form removal shall be repaired promptly by the Contractor as directed by the Engineer without any additional payment to the Contractor.

Curing Concrete

Unless otherwise ordered by the Engineer, curing of concrete shall be done by any method specified in the Section "Reinforced Concrete".

Cleaning and Sealing Joints

After completion of the required curing and before opening of the pavement to traffic, all joints shall be thoroughly cleaned of all concrete aggregate fragments or other materials.

After removal of side forms, the ends at transverse expansion joints at the edges of the pavement shall be carefully cleaned of any concrete within the expansion spaces for the entire depth of slab, care being taken not to injure the ends of the joints. Expansion and contraction joints shall then be poured with a hot joint sealer to the depth as indicated on the

Drawings. Joint sealer shall be poured using approved hand pouring pots, with liquid at a temperature not less than that recommended by the approved manufacturer.

Opening to Traffic

The pavement shall be closed to traffic, including the vehicles of the Contractor, for a period of 10 days after the concrete is placed or longer if in the opinion of the Engineer, the weather conditions make it necessary to extend this time. The Contractor shall furnish, place and maintain satisfactory barricades and lights as directed, to exclude all traffic from the pavement.

Any damage to the pavement due to traffic shall be repaired or replaced at the expense of the Contractor. Paving mixers, mechanical concrete spreaders and finishers and other heavy paving equipment shall not be operated on completed concrete lanes in order to construct alternate lanes until after the regular curing period is completed. Even then, planks shall be laid on the finished pavement or other precautions taken to prevent damage to the concrete pavement.

Pavement Smoothness, Thickness and Tolerance

Portland cement concrete pavement shall be constructed to the designed level and transverse slope shown on the Drawing. The allowable tolerance shall be as listed hereunder:

1.	Permitted variation from design thickness of layer	+ - 5mm
2.	Permitted variation from design level of surface	+ - 5mm

The thickness of the pavement will be determined by measurement of cores from the completed pavement in accordance with AASHTO T 148.

The completed pavement shall be accepted on a lot basis. A lot shall be considered as 2,500 sq.m of pavement. The last unit in each slab constitutes a lot in itself when its length is at least ½ of the normal lot length. If the length of the last unit is shorter than ½ of the normal lot length, it shall be included in the previous lot.

Other areas such as intersections, entrances, crossovers, ramp, etc., will be grouped together to form a lot. Small irregular areas may be included with other unit areas to form a lot.

ITEM 07 : REINFORCED CONCRETE

SCOPE OF WORK

All works falling under this Section shall include reinforced concrete for all kinds and parts of any reinforced concrete structure.

GENERAL PROVISIONS

1. Full cooperation shall be given to the other trades to install embedded items. Suitable templates or instructions will be provided for setting, items shall have been inspected, and tests for concrete or other materials or for mechanical operations shall have been completed and approved.

2. The following publications of the issues listed below, but referred to thereafter by basic designation only, form as an integral part of this Specification to the extent indicated by the reference thereto:

   a. American Concrete Institute (ACI) Standards:

ACI 117	Standard Specifications for Tolerances for Concrete Construction and Materials
ACI 121R	Quality Management System for Concrete Construction
ACI 201.2R	Guide to Durable Concrete
ACI 211.1	Standard Practice for Selecting Proportions for Normal, Heavyweight, and Mass Concrete
ACI 214R	Recommended Practice for Evaluation of Strength Test Results of Concrete
ACI 301	Specifications for Structural Concrete
ACI 304.2R	Placing Concrete by Pumping Methods
ACI 304R	Guide for Measuring, Mixing, Transporting, and Placing Concrete
ACI 305R	Hot Weather Concreting
ACI 306.1	Standard Specification for Cold Weather Concreting
ACI 308R	Guide to Curing Concrete
ACI 309R	Guide for Consolidation of Concrete
ACI 311.4R	Guide for Concrete Inspection
ACI 318M	Metric Building Code Requirements for Structural Concrete and Commentary
ACI 347	Guide to Formwork for Concrete

ACI SP-15 Field Reference Manual: Standard Specifications for Structural Concrete with Selected ACI and ASTM References

ACI SP-2 ACI Manual of Concrete Inspection

b. American Society for Testing and Materials (ASTM) Publications:

ASTM C 150 Standard Specification for Portland Cement

ASTM C 114 Standard Method for Chemical Analysis of Hydraulic Cement

ASTM C 185 Standard Method for Air Content of Hydraulic Cement

ASTM C 115 Standard Test Method for Fineness of Portland Cement by the Turbidimeter

ASTM C 204 Standard Test Method for Fineness of Hydraulic Cement by Air-Permeability Apparatus

ASTM C 151 Standard Test Method for Autoclave Expansion of Portland Cement

ASTM C 109 Standard Test Method for Compressive Strength of Hydraulic Cement Mortars

ASTM C 266 Standard Test Method for Time of Setting of Hydraulic-Cement Paste Gilmore Needles

ASTM C 191 Standard Test Method of Time Setting of Hydraulic Cement by Vicat Needle

ASTM C 33 Standard Specification for Concrete Aggregates

ASTM C 136 Standard Test Method for Sieve Analysis of Fine and Coarse Aggregates

ASTM C 117 Standard Test Method for Materials Finer than 75 micron (No. 200) Sieve in Mineral Aggregates by Washing

ASTM C 29 Standard Test Method for Bulk Density (Unit Weight") and Voids in Aggregate

ASTM C 128 Standard Test Method for Density, Relative Density (Specific Gravity), and Absorption of Fine Aggregates

ASTM C 87 Standard Test Method for Effect of Organic Impurities in Fine Aggregate on Strength of Mortar

ASTM C 88 Standard Test Method for Soundness of Aggregates by Use of Sodium Sulfate or Magnesium Sulfate

ASTM C 142 Standard Test Method for Clay Lumps and Friable Particles in Aggregates

ASTM C 97 Standard Test Method for Absorption and Bulk Specific Gravity of Dimension Stone

ASTM C 127	Test Method for Specific Gravity and Absorption of Coarse Aggregate
ASTM C 535	Standard Test Method for Resistance to Degradation of Large-Size Aggregate by Abrasion and Impact in the Los Angeles Machine
ASTM C 88	Standard Test Method for Soundness of Aggregates by Use of Sodium Sulfate or Magnesium Sulfate
ASTM C 131	Test Method for Resistance to Degradation of Small-size Coarse Aggregate by Abrasion and Impact in the Los Angeles Machine
ASTM C 94	Standard Specification for Ready-Mixed Concrete
ASTM D 512	Chloride Ion in Water
ASTM D 516	Sulfate Ion in Water
ASTM A 615	Standard Specification for Deformed and Plain Carbon-Steel Bars for Concrete Reinforcement
ASTM A 370	Standard Test Methods and Definitions for Mechanical Testing of Steel Products
ASTM A 510	Standard Specification for General Requirements for Wire Rods and Coarse Round Wire, Carbon Steel
ASTM A 6	Standard Specification for General Requirements for Rolled Structural Steel Bars, Plates, Shapes, and Sheet Piling
ASTM C 31	Standard Practice for Making and Curing Concrete Test Specimens in the Field
ASTM C 39	Standard Test Method for Compressive Strength of Cylindrical Concrete Specimens
ASTM C 172	Standard Practice for Sampling Freshly Mixed Concrete
ASTM C 192	Standard Practice for Making and Curing Concrete Test Specimens in the Laboratory
ASTM C 293	Standard Test Method for Flexural Strength of Concrete (Using Simple Beam with Center-Point Loading)
ASTM C 78	Standard Test Method for Flexural Strength of Concrete (Using Simple Beam with Third-Point Loading)
ASTM C 42	Standard Test Method for Obtaining and Testing Drilled Cores and Sawed Beams of Concrete
ASTM C 174	Standard Test Method for Measuring Thickness of Concrete Elements Using Drilled Concrete Cores
ASTM C 143	Standard Test Method for Slump of Hydraulic-Cement Concrete
ASTM C 494	Standard Specification for Chemical Admixtures for Concrete

ASTM C 1017 Standard Specification for Chemical Admixtures for use in Producing Flowing Concrete

ASTM C 171 Standard Specification for Sheet Materials for Curing Concrete

ASTM C 309 Standard Specification for Liquid Membrane-Forming Compounds for Curing Concrete

ASTM 5329 Standard Test Methods for Sealants and Fillers, Hot Applied, For Joints and Cracks in Asphaltic and Portland Cement Concrete Pavements

ASTM D 5167 Standard Practice for Melting of Hot Applied Joint and Crack Sealant and Filler for Evaluation

ASTM A 706 Standard Specification for Low-Alloy Steel Deformed and Plain Bars for Concrete Reinforcement

ASTM A 966 Standard Test Method for Magnetic Particle Examination of Steel Forgings using Alternating Current

ASTM C 1064 Standard Test Method for Temperature of Freshly Mixed Hydraulic-Cement Concrete

ASTM C 1077 Standard Practice for Laboratories Testing Concrete and Concrete Aggregates for use in Construction and Criteria for Laboratory Evaluation

ASTM C 1107 Standard Specification for Packaged Dry, Hydraulic-Cement Grout (Non-shrink)

ASTM C 1116 Standard Specification for Fiber-Reinforced Concrete

ASTM C 1157 Standard Specification for Hydraulic Cement

ASTM C 138 Standard Test Method for Density ("Unit Weight"), Yield, and Air Content (Gravimetric) of Concrete

ASTM C 173 Standard Test Method for Air Content of Freshly Mixed Concrete by the Volumetric Method

ASTM C 260 Standard Specification for Air-Entraining Admixtures for Concrete

ASTM C 295 Petrographic Examination of Aggregates for Concrete

ASTM C 33 Standard Specification for Concrete Aggregates

ASTM C 42 Standard Test Method for Obtaining and Test Drilled cores and Sawed Beams of Concrete

ASTM C 469 Static Modulus of Elasticity and Poisson's Ratio of Concrete in Compression

ASTM C 595 Standard Specification for Blended Hydraulic Cements

ASTM C1116 Standard Specification for Fiber-Reinforced Concrete and Shotcrete

ASTM C 1751 Preformed Expansion Joint Fillers for Concrete Paving and Structural Construction.(Non-extruding and Resilient Bituminous Types).

ASTM D 1179 Fluoride Ion in Water

ASTM D 1190 Standard Specification for Concrete Joint Sealer, Hot-Applied Elastic Type

ASTM D 1751 Standard Specification for Preformed Expansion Joint Filler for Concrete Paving and Structural Construction (Non-extruding and Resilient Bituminous Types)

ASTM E 329 Standard Specification for Agencies Engaged in the Testing and/ or Inspection of Materials used in Construction

c. American Welding Society (AWS)

D 12 Welding Reinforcing Steel, Metal Inserts and Connections in Reinforced Concrete Construction.

d. Philippine National Standard (PNS)

PNS 49 Steel Bars for Concrete Reinforcement

e. DPWH Standard Specifications

e. All other standards hereinafter indicated.

f. The edition or the revised version of such codes and standards current at the date twenty eight (28) days prior to date of bid submission shall apply. During Contract execution, any changes in such codes and standards shall be applied after approval by the Owner.

SUBMITTALS

1. Test Reports and Certificates shall be furnished and approval received before delivery of certified or tested materials to the Project Sites.

a. Submit Test Reports for the following:

a.1 Concrete mixture proportions

Submit copies of test reports by independent test labs conforming to ASTM C 1077 showing that the mixture has been successfully tested to produce concrete with the properties specified and that mixture will be suitable for the job conditions. Test reports shall be submitted along with the concrete mixture proportions. Obtain approval before concrete placement. Fully describe the processes and methodology whereby mixture proportions were developed and tested and how proportions will be adjusted during progress of the work to achieve, as closely as possible, the designated levels of relevant properties.

a.2 Aggregates

Submit test results for aggregate quality in accordance with ASTM C 33. Where there is potential for alkali-silica reaction, provide results of tests

conducted in accordance with ASTM C 227 or ASTM C 1260. Submit results of all tests during progress of the work in tabular and graphical form as noted above, describing the cumulative combined aggregate grading and the percent of the combined aggregate retained on each sieve.

a.3 Admixtures

Submit test results in accordance with ASTM C 494 and ASTM C 1017 for concrete admixtures, ASTM C 260 for air-entraining agent, and manufacturer's literature and test reports for corrosion inhibitor and anti-washout admixture. Submitted data shall be based upon tests performed within 6 months of submittal.

a.4 Cement

Submit test results in accordance with ASTM C 150 Portland cement. Submit current mil data.

a.5 Water

Submit test results in accordance with ASTM D 512 and ASTM D 516.

b. Submit Certificates for the following:

b.1 Curing concrete elements

Submit proposed materials and methods for curing concrete elements.

b.2 Form removal schedule

Submit proposed materials and methods for curing concrete elements.

b.3 Concrete placement and compaction

Submit technical literature for equipment and methods proposed for use in placing concrete. Include pumping or conveying equipment including type, size and material for pipe, valve characteristics, and the maximum length and height concrete will be pumped. No adjustments shall be made to the mixture design to facilitate pumping.

Submit technical literature for equipment and methods proposed for vibrating and compacting concrete. Submittal shall include technical literature describing the equipment including vibrator diameter, length, frequency, amplitude, centrifugal force, and manufacturer's description of the radius of influence under load. Where flat work is to be cast, provide similar information relative to the proposed compacting screed or other method to ensure dense placement.

b.4 Mixture designs

Provide a detailed report of materials and methods used, test results, and the field test strength (fcr) for marine concrete required to meet durability requirements.

2. The Contractor shall submit shop drawings and erection drawings for formwork and scaffolding at least 14 days prior to commencing the work.

Each shop drawing and erection drawing shall bear the signature of a Contractor's qualified Engineer. Details of all proposed formwork to be prefabricated and formwork to produce special finishes shall be submitted to the Engineer for approval before any materials are ordered. If the Engineer so requires, samples of proposed formworks shall be constructed and concrete placed at the Contractor's expense so that the proposed methods and finished effect can be demonstrated.

The Contractor shall submit shop drawings showing reinforcing bar placing and bar lists for the Engineer's approval. Such shop drawings shall show also supplemental bars for forming, strengthening frames of bars of sufficient rigidity to withstand forces during placing concrete. If necessary, shaped steel may be added to improve rigidity of the frame of bar.

Such shop drawings shall clearly indicate bar sizes, spacing, location and quantities of reinforcement, mesh, chairs, spacers and other details to be as per ACI Manual of Standard Practice for Detailing Reinforced Concrete Structures.

Details shall be prepared for placement of reinforcement where special conditions occur, including most congested areas and connection between pre-cast concrete and concrete in-situ.

All shop drawings shall be reviewed by the Engineer within seven (7) days after receiving them. At least two (2) days prior to pouring concrete, the Contractor shall submit to the Engineer a pouring permit for his inspection and approval.

MATERIAL REQUIREMENTS

CEMENT

Unless otherwise specified in the Drawings, only one (1) brand of cement shall be used for any individual structure. In determining the approved mix, only Portland cement shall be used as the cementitious material.

1. Portland Cement: ASTM C 150

   Type I (for general use in construction)

ADMIXTURE (IF NECESSARY)

Unless otherwise required by field conditions, admixture may be used subject to the expressed approval of the Engineer. The cost of which shall already be included in the unit cost bid of the Contractor for the concrete.

1. Air Entraining Admixture shall conform to ASTM C 260.
2. Admixture other than air entraining agent shall conform to ASTM C 494.
3. Admixture containing chloride ions, or other ions producing deleterious effect shall not be used.

AGGREGATES

1. Crushed Coarse Aggregate

Conforming to ASTM C 33 and having nominal sizes passing 38.0 mm to 19.0 mm, 19.0 mm to 9.5 mm to No. 4 sieve. The material shall be well graded between the limits indicated and individually stockpiled. It shall be the Contractor's responsibility to blend the materials to

meet the gradation requirements for various types of concrete as specified herein.

Nominal sizes for combined gradation shall be as follows:

ASTM Sieves	Nominal Size of Coarse Aggregates			
	% by Weight Passing			
	40mm	**25mm**	**19mm**	**10mm**
50.0mm (2")	100	-	-	-
38.0mm (1 1/2")	95 - 100	100	-	-
31.8mm (1 1/4")	-	90 - 100	100	-
25.0mm (1")	-	-	90 - 100	-
19.0mm (3/4")	35 - 70	25 - 90	-	100
16.0mm (5/8")	-	-	20 - 55	85 - 100
9.5mm (3/8")	10 - 30	0 - 10	0 - 10	0 - 20
No. 4	0 - 5			

2. Fine Aggregate

ASTM C 33 except for gradation which has been revised to meet local conditions unless otherwise required by the Engineer, grading of find aggregate shall be as follows:

ASTM Sieves	% by Weight Passing
9.5mm (3/8")	100
No.4	90 - 100
No. 8	80 - 100
No. 16	50 - 90
No. 30	25 - 60
No. 50	5 - 30
No. 100	0 - 10

a. Grading of fine aggregates shall be reasonably uniform and fineness modulus thereof shall not vary more than 0.2 from that of the representative sample in which mix proportions of concrete are based.

b. Due care shall be taken to prevent segregation.

WATER

The mixing water shall be clear and apparently clean. If it contains quantities or substances that discolor it or make it smell or taste unusual or objectionable, or cause suspicion, it shall not be used unless service records of concrete made with it (or other information) indicated that it is not injurious to the quality, shall be subject to the acceptance criteria as shown in Table 6.3 and Table 6.4 or as designated by the purchaser.

When wash water is permitted, the producer will provide satisfactory proof or data of non-detrimental effects if potentially reactive aggregates are to be used. Use of wash water will be discontinued if undesirable reactions with admixtures or aggregates occur.

Table 6.3 Acceptance Criteria for Questionable Water Supplies

Test	Limits
Compressive strength, min. % Control at 7 days	90
Time of Setting deviation from control	from 1:00 earlier to 1:30 later
Time of Setting (Gillmore Test) Initial Final Set	 No marked change No marked change
Appearance	Clear
Color	Colorless
Odor	Odorless
Total Solids	500 parts/million max.
PH value	4.5 to 8.5

Table 6.4 Chemical Limitation for Wash Water

	Limits
Chemical Requirements, Minimum Concentration Chloride as $C1^{(-1)}$ expressed as a mass percent of cement when added to the $C1^{(-1)}$ in the other components of the concrete mixtures shall not exceed the following levels:	
1. Prestressed Concrete	0.06 percent
2. Conventionally reinforced concrete in a moist environment and exposed to chloride	0.10 percent
3. Conventionally reinforced concrete in a moist environment but not exposed to chloride	0.15 percent
4. Above ground building construction where the concrete will stay dry	No limit for corrosion
Sulfate as SO_4, ppm[A]	3,000
Alkalies as (Na_2O + 0.658 K_2O), ppm	600
Total Solids, ppm	50,000

Wash water reused as mixing water in concrete may exceed the listed concentrations of sulfate if it can be shown that the concentration calculated in the total mixing water, including mixing water on the aggregate and other sources, does not exceed that stated limits.

Water will be tested in accordance with, and shall meet the suggested requirements of AASHTO T 26.

Water known to be of potable quality may be used without test.

CURING MATERIALS

1. Impervious Sheet Materials

   ASTM C 171 type, optional, except that polyethylene film, if used, shall be white opaque.

2. Burlap of commercial quality, non-staining type, consisting of 2 layers minimum.

3. Membrane Forming Curing Compound

   ASTM C 309; submit evidence that product conforms to specifications.

JOINTING MATERIALS

1. Sealant

   Sealant shall be multi-component, polyurethane base compound, gray in color, self-leveling for horizontal joints, 2 part polythremdyne, terpolymer compound, gray in color; non-sag for vertical joints.

   Sealant shall be compatible with materials in contact and to perform satisfactorily under salt water and traffic conditions, and be capable of making joint watertight and allow movement 25% of the width of joint in any direction.

   Sealant shall be guaranteed against leakage, cracking, crumbling, melting, shrinkage, running, loss of adhesion for a period of five years from the date of acceptance of work.

2. Joint backing shall be expanded extruded polyethylene, low density, oval in shape to fit the joints as indicated on the drawings and to be compatible with sealant.

3. Where required, primer shall be compatible with joint materials and installed in accordance with manufacturer's instructions.

4. Joint filler shall conform to ASTM D1751 (AASHTO M213) non-extruding, resilient bituminous type. Filler shall be furnished for each joint in single piece for depth and width required for joint, unless otherwise authorized by the Engineer. When more than one piece is authorized for a joint, abutting ends shall be fastened and hold securely to shape by stapling or other positive fastening.

EPOXY BONDING COMPOUND

ASTM C 881. Provide Type I for bonding hardened concrete to hardened concrete; Type II for bonding freshly mixed concrete to hardened concrete; and Type III as a binder in epoxy mortar or concrete, or for use in bonding skid-resistant materials to hardened concrete. Provide Class B if placement temperature is between 4 and 16°C; or Class C if placement temperature is above 16°C.

REINFORCEMENT

Steel reinforcement, other than Steel for Pre-stressing, used in Reinforced Concrete, shall conform to ASTM and PNS as follows:

ASTM Designation A615 - Deformed Billet Steel Bars for Concrete Reinforcement. Minimum yield strength of 276 MPa (40,000 psi).

PNS 49 - Steel Bars for Concrete Reinforcement

TIE WIRE

Tie wire shall be plain, cold drawn annealed steel wire 1.6 mm diameter.

SAMPLES AND TESTING

1. Cement

Sampled either at the mill or at the site of work and tested by an independent commercial or government testing laboratory duly accredited by the Bureau of Research and Standards (BRS) of the DPWH, Department of Science and Technology (DOST) or the Department of Trade and Industry (DTI) at no additional cost to PPA. Certified copies of laboratory test reports shall be furnished for each lot of cement and shall include all test data, results, and certificates that the sampling and testing procedures are in conformance with the Specifications. No cement shall be used until notice has been given by the Engineer that the test results are satisfactory. Cement that has been stored, other than in bins at the mills, for more than 3 months after delivery to the Site shall be re-tested before use. Cement delivered at the Site and later found after test to be unsuitable shall not be incorporated into the permanent works.

2. Aggregates: Tested as prescribed in ASTM C 33

At least 28 days prior to commencing the work, the Contractor shall inform the Engineer of the proposed source of aggregates and provide access for sampling.

Gradation tests will be made on each sample without delay. All other aggregates tests required by these Specifications shall be made on the initial source samples, and shall be repeated whenever there is a change of source. The tests shall include an analysis of each grade of material and an analysis of the combined material representing the aggregate part of the mix.

3. Reinforcement

Certified copies of mill certificates shall accompany deliveries of steel bar reinforcement. If requested by the Engineer additional testing of the materials shall be made at the Contractor's expense.

4. Concrete Tests

For test purposes, provide 1 set of three (3) concrete cylinder samples taken from each day's pouring and to represent not more than 75 cu.m. of concrete class or fraction thereof of concrete placed. Samples shall be secured in conformance with ASTM C 172. Tests specimens shall be made, cured, and packed for shipment in accordance with ASTM C 31. Cylinders will be tested by and at the expense of the Contractor in accordance with ASTM C 39. Test specimens will be evaluated separately by the Engineer, for meeting strength level requirements for each with concrete quality of ACI 318. When samples fail to conform to the requirements for strengths, the Engineer shall have the

right to order a change in the proportions of the concrete mix for the remaining portions of the work at no additional cost to the Authority.

5. Test of Hardened Concrete in or Removed from the Structure

When the results of the strength tests of the concrete specimens indicates the concrete as placed does not meet the Specification requirements or where there are other evidences that the quality of concrete is below the specification requirement in the opinion of the Engineer, tests on cores of in-place concrete shall be made in conformance with ASTM C 42.

Core specimens shall be obtained by the Contractor and shall be tested. Any deficiency shall be corrected or if the Contractor elects, he may submit a proposal for approval before the load test is made. If the proposal is approved, the load test shall be made by the Contractor and the test results evaluated by the Engineer in conformance with Chapter 20 of ACI 318. The cost of the load tests shall be borne by the Contractor. If any concrete shows evidence of failure during the load test, or fails the load test as evaluated, the deficiency be corrected in a manner approved by the Engineer at no additional cost to the Authority.

6. Chemical Admixtures/Additives

The admixtures/additives if approved shall conformed to ASTM C 494 and ASTM C 1017. The testing shall be conducted with cement and aggregate proposed for the Project. The admixtures/additives shall be tested and those that have been in storage at the Project Site for longer than six (6) months shall not be used until proven by retest to be satisfactory.

Samples of any admixtures/additives proposed by the Contractor shall be submitted for testing at least 56 days in advance of use, which shall require approval of the Engineer. Testing of admixtures/additives proposed by the Contractor including test mixing and cylinder test shall be at the Contractor's expense.

7. Jointing Materials and Curing Compound Samples

At least 28 days prior to commencing the work, the Contractor shall submit to the Engineer for his approval samples of the following materials proposed for use together with manufacturer's certificate.

a. 10 kg of joint sealant
b. 1m length of joint filler
c. 5 li. of curing compound
d. 1m length of joint backing

The Engineer shall deliver to the Contractor his assessment on the materials within seven (7) days after receiving them.

EXECUTION

DELIVERY, STORAGE AND HANDLING OF MATERIALS

1. Cement

Do not deliver concrete until vapor barrier, forms, reinforcement, embedded items, and chamfer strips are in place and ready for concrete placement. ACI 301 and ASTM A 934 for job site storage of materials. Protect materials from contaminants such as grease, oil, and dirt. Ensure materials can be accurately identified after bundles are broken and tags removed.

Immediately upon receipt at the Site, the cement shall be stored separately in a dry weathertight, properly ventilated structures with adequate provisions for prevention of absorption of moisture. Storage accommodations for concrete materials shall be subject to approval and shall afford easy access for inspection and identification of each shipment in accordance with test reports.

Cement shall be delivered to the Site in bulk or in sound and properly sealed bags and while being loaded or unloaded and during transit to the concrete mixers whether conveyed in vehicles or in mechanical means, cement shall be protected from whether by effective coverings. Efficient screens shall be supplied and erected during heavy winds.

If the cement is delivered in bulk, the Contractor shall provide, at his own cost, approved silos of adequate size and numbers to store sufficient cement to ensure continuity of work and the cement shall be placed in these silos immediately after it has been delivered to the Site. Approved precautions shall be taken into consideration during unloading to ensure that the resulting dust does not constitute a nuisance.

If the cement is delivered in bags, the Contractor shall provide, at his own cost, perfectly waterproofed and well ventilated sheds having a floor of wood or concrete raised at least 0.5m above the ground. The sheds shall be large enough to store sufficient cement to ensure continuity of the work and each consignment shall be stacked separately therein to permit easy access for inspection, testing and approval. Upon delivery, the cement shall at once be placed in these sheds and shall be used in the order in which it has been delivered.

Cement bags should not be stacked more than 13 bags high. All cement shall be used within two months of the date of manufacture. If delivery conditions render this impossible, the Engineer may permit cement to be used up to three (3) month after manufacturing, subject to such conditions including addition of extra cement as he shall stipulate.

2. Aggregate

All fine and coarse aggregate for concrete shall be stored on close fitting, steel or concrete stages design with drainage slopes or in bins of substantial construction in such a manner as to prevent segregation of sizes and to avoid the inclusion of dirt and other foreign materials in the concrete. All such bins shall be emptied and cleaned at intervals of every six (6) months or as required by the Engineer. Each size of aggregate shall be stored separately unless otherwise approved by the Engineer.

Stockpiles of coarse aggregate shall be built in horizontal layers not exceeding 1.2 m in depth to minimize segregation.

FORMWORK

1. Forms

Designed, constructed, and maintained so as to insure that after removal of forms the finished concrete members will have true surfaces free of offset, waviness or bulges and will conform accurately to the indicated shapes, dimensions, lines, elevations and positions. Form surfaces that will be in contact with concrete shall be thoroughly cleaned before each use.

2. Design

Studs and wales shall be spaced to prevent deflection of form material. Forms and joints shall be sufficiently tight to prevent leakage of grout and cement paste during placing of concrete. Juncture of formwork panels shall occur at vertical control joints, and construction

joints. Forms placed on successive units for continuous surfaces shall be fitted in accurate alignment to assure smooth completed surfaces free from irregularities and signs of discontinuity. Temporary opening shall be arranged to wall and where otherwise required to facilitate cleaning and inspection. Forms shall be readily removable without impact, shock, or damage to the concrete.

3. Form Ties

Factory fabricated, adjustable to permit tightening of the forms, removable or snap-off metal of design that will not allow form deflection and will not spall concrete upon removal. Bolts and rods that are to be completely withdrawn shall be coated with a non-staining bond breaker. Ties shall be of the type which provide watertight concrete.

4. Chamfering

External corners that will be exposed shall be chamfered, beveled, or rounded by mouldings placed in the forms or as indicated in the drawings.

5. Coatings

Forms for exposed surfaces shall be coated with form oil or form-release agent before reinforcement is placed. The coating shall be a commercial formulation of satisfactory and proven performance that will not bond with, stain, or adversely affect concrete surfaces, and shall not impair subsequent treatment of concrete surfaces depending upon bond or adhesion nor impede the wetting of surfaces to be cured with water or curing compounds. The coating shall be used as recommended in the manufacturer's printed or written instructions. Forms for unexposed surfaces may be wet with water in lieu of coating immediately before placing of concrete. Surplus coating on form surfaces and coating on reinforcement steel and construction joints shall be removed before placing concrete.

6. Removal of Forms shall be done in a manner as to prevent injury to the concrete and to insure complete safety of the structure after the following conditions have been met. Where the structure as a whole is supported on shores, forms for beam and girder sides, and similar vertical structural members may be removed before expiration of curing period. Care shall be taken to avoid spalling the concrete surface or damaging concrete edges. Wood forms shall be completely removed.

Minimum stripping and striking time shall be as follows unless otherwise approved by the Engineer.

Vertical sides of beams, walls, and columns, lift not 12 hours exceeding 1.2 m

Vertical sides of beams and walls, lift exceeding 1.2 m 36 hours Softlifts of main slabs and beams (props left under) 5 days

Removal of props from beams and mains slabs and other work 10 days

7. Control Test

If the Contractor proposes to remove forms earlier than the period stated above, he shall be required to submit the results of control tests showing evidence that concrete has attained sufficient strength to permit removal of supporting forms. Cylinders required for control tests shall be provided in addition to those otherwise required by this Specification. Test specimens shall be removed from molds at the end of 24 hours and stored in the structure as near the points as practicable, the same protection from the elements during curing as is given to those portions of the structure which they represent, and shall not be removed from the structure for transmittal to the laboratory prior to expiration of three fourths of the proposed period before removal of forms. Cylinders will be tested by and at the expense of

the Contractor. Supporting forms or shoring shall not be removed until control test specimens have attained strength of at least 160 kg/sq cm. The newly unsupported portions of the structure shall not be subjected to heavy construction or material loading.

REINFORCEMENT

1. Reinforcement

Fabricated to shapes and dimensions shown and shall be placed where indicated. Reinforcement shall be free of loose or flaky rust and mill scale, or coating, and any other substance that would reduce or destroy the bond. Reinforcing steel reduced in section shall not be used. After any substantial delay in the work, previously placed reinforcing steel for future bonding shall be inspected and cleaned. Reinforcing steel shall not be bent or straightened in a manner injurious to the steel or concrete. Bars with kinks or bends not shown in the drawings shall not be placed. The use of heat to bend or straighten reinforcing steel shall not be permitted. Bars shall be moved as necessary to avoid interference with other reinforcing steel, conduits, or embedded items. If bars are moved more than one bar diameter, the resulting arrangement of bars including additional bars necessary to meet structural requirements shall be approved before concrete is placed. In slabs, beams and girders, reinforcing steel shall not be spliced at points of maximum stress unless otherwise indicated. Unless otherwise shown in the drawings, laps or splices shall be 40 times the reinforcing bar diameter.

2. The nominal dimensions and unit weights of bars shall be in accordance with the following table:

Nominal Diameter (mm)	Nominal Perimeter (mm)	Nominal Sectional Area (sq. mm)	Unit Weight (kg/m)
10	31.4	78.54	0.616
12	37.7	113.10	0.888
16	50.3	201.10	1.579
20	62.8	314.20	2.466
25	78.5	490.90	3.854
28	88.0	615.70	4.833
32	100.5	804.20	6.313
36	113.1	1,017.60	7.991
40	125.7	1,256.60	9.864
50	157.1	1,963.50	15.413

3. Welding of reinforcing bars shall only be permitted where shown; all welding shown shall be performed in accordance with AWS D 12.1.

4. Exposed reinforcement bars, dowels and plates intended for bonding with future extensions shall be protected from corrosion.

5. Supports shall be provided in conformance with ACI 315 and ACI 318, unless otherwise indicated or specified.

6. Concrete Protection for Reinforcement

   a. The minimum concrete cover of reinforcement shall be as shown below unless otherwise indicated in the drawings.

   b. Tolerance for Concrete Cover of Reinforcing Steel other than Tendons.

      Minimum Cover

      7.5cm or more (marine structures and concrete cast against and permanently exposed to earth)

DESIGN STRENGTH OF CONCRETE

Concrete for structural parts or members such as beams, slabs, curtain wall, pile caps and fender/mooring blocks shall develop a minimum 28-day compressive cylinder strength of 24 MPa (3,500 psi) as indicated in the drawings. While for pre-stressed concrete piles a compressive strength of 35 MPa (5,000psi).

TRIAL BATCH FOR CONCRETE

Thirty (30) calendar days before the start of concreting works, the Contractor shall submit design mixes and the corresponding test result made on sample thereof. Sampling and testing shall be in accordance with the ASTM Standard procedures for sampling and testing for the particular design strength(s) required.

The particulars of the mix such as the slump and the proportionate weights of cement, saturated surface dry aggregates and water used shall be stated.

The design mix for concrete to be used shall be submitted together with at least three (3) standard cylinder samples for approval at least one (1) month prior to the start of each concreting schedule. Such samples shall be prepared in the presence of the Engineer.

Standard laboratory strength tests for the 7, 14 and 28 days periods shall be taken to all concrete samples in addition to routine field tests, at cost to the Contractor. Only design mixes represented by test proving the required strength for 7, 14 and 28 days tests shall be allowed.

The cost of sampling, handling and transporting samples from jobsite to the laboratory and the cost of subsequent tests made until the desired mix is attained shall be for the account of the Contractor.

Slump Test shall be made in conformance with ASTM C143, and unless otherwise specified by the Engineer, slump shall be within the following limits:

Structural Element	Slump for Vibrated Concrete	
	Minimum	Maximum
Pavement Concrete	25mm	50mm
Pre-cast Concrete	50mm	70mm
Lean Concrete	100mm	200mm
Sacked Concrete	25mm	50mm
All other Concrete	50mm	90mm

Sampling : Provide suitable facilities and labor for obtaining representative samples of concrete for the Contractor's quality control and the Engineer's quality assurance testing. All necessary platforms, tools and equipment for obtaining samples shall be furnished by the Contractor.

MIXING CONCRETE

1. GENERAL

a. Concrete shall be thoroughly mixed in a mixer of an approved size and type that will insure a uniform distribution of the materials throughout the mass.

b. All concrete shall be mixed in mechanically operated mixers. Mixing plant and equipment for transporting and placing concrete shall be arranged with an ample auxiliary installation to provide a minimum supply of concrete in case of breakdown of machinery or in case the normal supply of concrete is disrupted. The auxiliary supply of concrete shall be sufficient to complete the casting of a section up to a construction joint that will meet the approval of the Engineer.

c. Equipment having components made of aluminum or magnesium alloys, which would be in contact with plastic concrete during mixing, transporting or pumping of Portland cement concrete, shall not be used.

d. Concrete mixers shall be equipped with adequate water storage and a device for accurately measuring and automatically controlling the amount of water used.

e. Materials shall be measured by weighing. The apparatus provided for weighing the aggregates and cement shall be suitably designed and constructed for this purpose. The accuracy of all weighing devices except that for water shall be such that successive quantities can be measured to within one percent of the desired amounts. The water measuring device shall be accurate to plus or minus 0.5 percent. All measuring devices shall be subject to the approval of the Engineer. Scales and measuring devices shall be tested at the expense of the Contractor as frequently as the Engineer may deem necessary to insure their accuracy.

f. Weighing equipment shall be insulated against vibration or movement of other operating equipment in the plant. When the entire plant is running, the scale reading at cut-off shall not vary from the weight designated by the Engineer by more than one percent for cement, 1-½ percent for any size of aggregate, or one percent for the total aggregate in any batch.

g. Manual mixing of concrete shall not be permitted unless approved by the Engineer.

2. MIXING CONCRETE AT SITE

a. Concrete mixers may be of the revolving drum or the revolving blade type and the mixing drum or blades shall be operated uniformly at the mixing speed recommended by the manufacturer.

The pick-up and throw-over blades of mixers shall be restored or replaced when any part or section is worn 20 mm or more below the original height of the manufacturer's design. Mixers and agitators which have an accumulation of hard concrete or mortar shall not be used.

b. When bulk cement is used and the volume of the batch is 0.5 m^3 or more, the scale and weigh hopper for Portland cement shall be separate and distinct from the aggregate hopper or hoppers.

The discharge mechanism of the bulk cement weigh hopper shall be interlocked against opening before the full amount of cement is in the hopper. The discharging mechanism shall be interlocked against opening when the amount of cement in the hopper is underweight by more than one percent or overweight by more than 3 percent of the amount specified.

c. When the aggregates contain more water than the quantity necessary to produce a saturated surface dry condition, representative samples shall be taken and the moisture content determined for each kind of aggregate.

d. The batch shall be so charged into the mixer that some water enter in advance of cement and aggregates. All water shall be in the drum by the end of the first quarter of the specified mixing time.

e. Cement shall be batched and charged into the mixer by such means that it will not result in loss of cement due to the effect of wind, or in accumulation of cement on surfaces of conveyors or hoppers, or in other conditions which reduce or vary the required quantity of cement in the concrete mixture.

f. Where required, synthetic fibrous reinforcement shall be added directly to the concrete mixer after placing the sufficient amount of mixing water, cement and aggregates.

g. The entire contents of a batch mixer shall be removed from the drum before materials for a succeeding batch are place therein. The materials composing a batch except water shall be deposited simultaneously into the mixer.

h. All concrete shall be mixed for a period of not less that 3 minutes after all materials, including water, are in the mixer. During the period of mixing, the mixer shall operate at the speed for which it has been designed.

i. Mixers shall be operated with an automatic timing device that can be locked by the Engineer. The time device and discharge mechanism shall be so interlocked that during normal operation no part of the batch will be discharged until the specified mixing time has elapsed.

j. The first batch of concrete materials placed in the mixer shall contain a sufficient excess of cement, sand, and water to coat the inside of the drum without reducing the required mortar content of the mix. When mixing is to cease for a period of one hour or more, the mixer shall be thoroughly cleaned.

k. In case of rubble concrete, proper mixture and placing of concrete and stones/rocks shall be in accordance to the approved plan. Methodology of work shall be approved by the Engineer.

3. MIXING CONCRETE IN TRUCKS

a. Truck mixers, unless otherwise authorized by the Engineer, shall be of the revolving drum type, watertight, and so constructed that the concrete can be mixed to insure a uniform distribution of materials throughout the mass. All solid materials for the concrete shall be accurately measured and charged into the drum at the proportioning plant. Except as subsequently provided, the truck mixer shall be equipped with a device by which the quantity of water added can be readily verified. The mixing water may be added directly to the batch, in which case a tank is not required. Truck mixers may be required to be provided with a means by which the mixing time can be readily verified by the Engineer.

b. The maximum size of batch in truck mixers shall not exceed the minimum rated capacity of the mixer as stated by the manufacture and stamped in metal on the mixer. Truck mixing shall, unless otherwise directed, be continued for not less than 100 revolutions after all ingredients, including water, are in the drum. The mixing speed shall not be less than 4 rpm, nor more than 6 rpm.

c. Mixing shall begin within 30 minutes after the cement has been added either to the water or aggregate, but when cement is charged into a mixer drum containing water or surface-wet aggregate and when the temperature is above 32 °C, this limit shall be reduced to 15 minutes. The limitation in time between the introduction of the cement to the aggregate and the beginning of the mixing may be waived when, in the judgment of the Engineer, the aggregate is sufficiently free from moisture, so that there will be no harmful effects on the cement.

d. When a truck mixer is used for transportation, the mixing time in stationary mixer may be reduced to 30 seconds and the mixing completed in a truck mixer. The mixing time in truck mixer shall be as specified for truck mixing.

JOINTS

1. No reinforcement, corner protection angles or other fixed metal items shall be run continuously through joints containing expansion-joint filler, through crack-control joints in slabs on grade and vertical surfaces.

2. Preformed Expansion Joint Filler

a. Joints with Joint Sealant

At expansion joints in concrete slabs to be exposed, and at other joints indicated to receive joint sealant, preformed expansion-joint filler strips shall be installed at the proper level below the elevation with a slightly tapered, dressed-and-oiled wood strip temporarily secured to the top thereof to form a groove. When surface dry, the groove shall be cleaned of foreign matter, loose particles, and concrete protrusions, then filled flush approximately with joint sealant so as to be slightly concave after drying.

b. Finish of concrete at joints

Edges of exposed concrete slabs along expansion joints shall be neatly finished with a slightly rounded edging tool.

c. Construction Joints

Unless otherwise specified herein, all construction joints shall be subject to approval of the Engineer. Concrete shall be placed continuously so that the unit will be monolithic in construction. Fresh concrete may be placed against adjoining units, provided the set concrete is sufficiently hard not to be injured thereby. Joints not indicated shall be made and located in a manner not to impair strength and appearance of the structure. Placement of concrete shall be at such rate that the surface of concrete not carried to joint levels will not have attained initial set before additional concrete is placed thereon. Lifts shall terminate at such levels as are indicated or as to conform to structural requirements as directed. If horizontal construction joints are required, a strip of 25mm square-edged lumber, beveled to facilitate removal shall be tacked to the inside of the forms at the construction joint. Concrete shall be placed to a point 25mm above the underside of the strip. The strip shall be removed one hour after the concrete has been placed. Any irregularities in the joint line shall be leveled off with a wood float, and all laitance removed. Prior to placing additional concrete, horizontal construction joints shall be prepared.

Construction Joint which is not indicated in the Drawings shall be located as to least affect the strength of the structure. Such locations will be pointed out by the Engineer.

PREPARATION FOR PLACING

Hardened concrete, debris and foreign materials shall be removed from the interior of forms and from inner surfaces of mixing and conveying equipment. Reinforcement shall be secured in position, and shall be inspected, and approved before placing concrete. Runways shall be provided for wheeled concrete-handling equipment. Such equipment shall not be wheeled over reinforcement nor shall runways be supported on reinforcement.

Notice of any concreting operations shall be served to the Engineer at least three (3) days ahead of each schedule.

PLACING CONCRETE

1. Handling Concrete

Concrete shall be handled from mixers and transported to place for final deposit in a continuous manner, as rapidly as practicable, and without segregation or loss of ingredients until the approved unit of work is completed. Placing will not be permitted when the sun, heat, wind or limitations of facilities furnished by the Contractor prevent proper finishing and curing of the concrete. Concrete shall be placed in the forms, as close as possible in final position, in uniform approximately horizontal layers not over 40cm deep. Forms splashed with concrete and reinforcement splashed with concrete or form coating shall be cleaned in advance of placing subsequent lifts. Concrete shall not be allowed to drop freely more than 1.5m in unexposed work nor more than 1.0 m in exposed work; where greater drops are required, tremie or other approved means shall be employed.

2. Time Interval between Mixing and Placing

Concrete mixed in stationary mixers and transported by non-agitating equipment shall be placed in the forms within 30 minutes from the time ingredients are charged into the mixing drum. Concrete transported in truck mixers or truck agitators shall be delivered to the site of work, discharged in the forms within 45 minutes from the time ingredients are discharged into the mixing drum. Concrete shall be placed in the forms within 15 minutes after discharged from the mixer at the jobsite.

3. Hot Weather Requirements

The temperature of concrete during the period of mixing while in transport and/or during placing shall not be permitted to rise above 36 °C. Any batch of concrete which had reached a temperature greater than 36 °C at any time in the aforesaid period shall not be placed but shall be rejected, and shall not thereafter be used in any part of the permanent works.

a. Control Procedures

Provide water cooler facilities and procedures to control or reduce the temperature of cement, aggregates and mixing handling equipment to such temperature that, at all times during mixing, transporting, handling and placing, the temperature of the concrete shall not be greater than 36 °C.

b. Cold Joints and Shrinkage

Where cold joints tend to form or where surfaces set and dry too rapidly or plastic shrinkage cracks tend to appear, concrete shall be kept moist by fog sprays, or other approved means, applied shortly after placement, and before finishing.

c. Supplementary Precautions

When the aforementioned precautions are not sufficient to satisfy the requirements herein above, they shall be supplemented by restricting work during evening or night. Procedure shall conform to American Concrete Institute Standard ACI 305.

4. Conveying Concrete by Chute, Conveyor or Pump

Concrete may be conveyed by chute, conveyor, or pump if approved in writing. In requesting approval, the Contractor shall submit his entire plan of operation from the time of discharge of concrete from the mixer to final placement in the forms, and the steps to be taken to prevent the formation of cold joints in case the transporting of concrete by chute, conveyor or pump is disrupted. Conveyors and pumps shall be capable of expeditiously placing concrete at the rate most advantageous to good workmanship. Approval will not be given for chutes or conveyors requiring changes in the concrete materials or design mix for efficient operation.

a. Chutes and Conveyors

Chutes shall be of steel or steel lined wood, rounded in cross section rigid in construction, and protected from overflow. Conveyors shall be designed and operated and chute sections shall be set, to assure a uniform flow of concrete from mixer to final place of deposit without segregation of ingredients, loss of mortar, or change in slump. The discharged portion of each chute or conveyor shall be provided with a device to prevent segregation. The chute and conveyor shall be thoroughly cleaned before and after each run. Waste material and flushing water shall be discharged outside the forms.

b. Pumps shall be operated and maintained so that a continuous stream of concrete is delivered into the forms without air pockets, segregation or changes in slump. When pumping is completed, concrete remaining in the pipeline shall be ejected and wasted without contamination of concrete already placed. After each operation, equipment shall be thoroughly cleaned and the flushing water shall be splashed outside the forms.

5. Wall and Abutments

No load shall be placed upon finished walls, foundations or abutments until authorized by the Engineer. Minimum time before loading shall be 7 days.

6. Concrete Placing on Wharf

When placing concrete on wharf decks, the Contractor shall:

Ensure that rate of placing is sufficient to complete proposed placing, finishing and curing operations within the scheduled time; that experienced finishing machine operators and concrete finishers are provided to finish the deck; that curing equipment and finishing tools and equipment are at the site of work and in satisfactory condition for use.
Immediately prior to placing, the Contractor shall place scaffolding and wedges and make necessary adjustments. Care shall be taken to ensure that settlement and deflection due to added weight of concrete will be minimal. The Contractor shall provide suitable means to readily permit measurement of settlement deflection as it occurs.

Should any event occur which, in opinion of the Engineer, would prevent the concrete conforming to specified requirements, the Contractor shall discontinue placing of concrete until corrective measures are provided satisfactory to the Engineer. If satisfactory measures are not provided prior to initial set of concrete in affected areas, the Contractor shall discontinue placing concrete and install a bulkhead at a location determined by the Engineer. Concrete in place beyond bulkheads shall be removed. The Contractor shall limit the size of casting to that which can be finished before beginning of initial set.

COMPACTION

1. Immediately after placing, each layer of concrete shall be completed by internal concrete vibrators supplemented by hand-spading, rodding, and tamping. Tapping or other external vibration of forms will not be permitted unless specifically approved by the Engineer. Vibrators shall not be used to transport concrete inside the forms. Internal vibrators submerged in concrete shall maintain a speed of not less than 7,000 impulses per minute. The vibrating equipment shall at all times be adequate in number of units and power to properly consolidate all concrete.

2. Spare units shall be on hand as necessary to insure such adequacy. The duration of vibrating equipment shall be limited to the time necessary to produce satisfactory consolidation without causing objectionable segregation. The vibrator shall not be inserted into the lower courses that have begun to set. Vibrator shall be applied vertically at uniformly spaced points not further apart than the visible effectiveness of the machine.

EPOXY BONDING COMPOUND

Before depositing new concrete on or against concrete that has set, the surfaces of the set concrete shall be thoroughly cleaned so as to expose the coarse aggregate and be free of laitance, coatings, foreign matter and loose particles. Forms shall be re-tightened. The cleaned surfaces shall be moistened, but shall be without free water when concrete is placed. ASTM C 881. Provide Type I for bonding hardened concrete to hardened concrete; Type II for bonding freshly mixed concrete to hardened concrete; and Type III as a binder in epoxy mortar or concrete, or for use in bonding skid-resistant materials to hardened concrete. Provide Class B if placement temperature is between 4 to 16 °C; or Class C if placement temperature is above 16°C.

FINISHES OF CONCRETE

Within 12 hours after the forms are removed, surface defects shall be remedied as specified herein. The Temperature of the concrete, ambient air and mortar during remedial work including curing shall be above 10 °C. Fine and loose material shall be removed. Honeycomb, aggregate pockets, voids over 13mm in diameter, and holes left by the rods or bolts shall be cut out to solid concrete, reamed, thoroughly wetted, brush-coated with neat cement grout, and filled with mortar. Mortar shall be a stiff mix of one part Portland cement to not more than 2 parts fine aggregate passing the No. 16 mesh sieve, with a minimum amount of water. The color of the mortar shall match the adjoining concrete color. Mortar shall be thoroughly compacted in place. Holes passing entirely through walls shall be completely filled from the inside face by forcing mortar through the outside face. Holes which do not pass entirely through wall shall be packed full. Patchwork shall be finished flush and in the same plane as adjacent surfaces. Exposed patchwork shall be finished to match adjoining surfaces in texture and color. Patchwork shall be damp-cured for 72 hours. Dusting of finish surfaces with dry material or adding water to concrete surfaces will not be permitted.

CONCRETE FINISHING DETAILS

1. Concrete Paving

   After concrete is placed and consolidated, slabs shall be screeded or struck off. No further finish is required.

2. Smooth Finish

   Required only where specified; screed concrete and float to required level with no coarse aggregate visible. After surface moisture has disappeared and laitance has been removed, the surface shall be finished by float and steel trowel. Smooth finish shall consist of thoroughly wetting and then brush coating the surfaces with cement to not more than 2 parts fine aggregate passing the no. 30 mesh sieve and mixed with water to the consistency of thick paint.

3. Broom Finish

   Required for paving; the concrete shall be screeded and floated to required finish level with no coarse aggregate visible. After the surface moisture has disappeared and laitance has been removed, surface shall be float-finished to an even, smooth finish. The floated surfaces shall be broomed with a fiber bristle brush in a direction transverse to the direction of the main traffic.

ITEM 08 : SECURITY FENCE

DESCRIPTION

This item shall consist of furnishing, construction and installation of security fence components in any combinations in accordance with this specification, lines, grades and cross-sections shown on the Plans, or as directed by the Engineer.

MATERIALS REQUIREMENT

Materials shall conform to the respective specifications and other requirements specified below

CONCRETE HOLLOW BLOCKS (CHB)

CHB shall be of standard manufacture, machine vibrated with fine and even texture and well-defined edges and conforming to the requirements of ASTM C 129. Unless otherwise specified on the Drawings, It shall have a minimum compressive strength of 4.14 MPa (600 psi). CHB shall be non-load bearing uniform and essentially smooth as normally achieves by standard molding methods and shall be free from any cracks, flaws or other defects.

BEDDING MORTAR

Mortar shall be composed of 1 part of Portland cement, 3 parts of sand and ½ part of lime. It shall have a compressive strength of [14 MPa (2,000 psi)] at 28 days and shall comply with property specifications for type N mortar set forth in ASTM Specification C 270 and as modified herein, proportioned and tested in an approved laboratory at the expense of the Contractor. When tested for water retention, the mortar shall have a flow after suction, of 75 percent or more when mixed to an initial flow of 125 to 140 percent. When tested for compressive strength, mortar shall be mixed to a flow of 100 to 115 percent. Aggregate for mortar shall conform to ASTM C 144.

PLASTER

Plaster shall comply with the same specification as those for bedding mortar and will include the use of synthetic fibrous reinforcement of type and dosage recommended by the manufacturer.

REINFORCING STEEL BARS AND RODS

Minimum yield strength of reinforcement shall conform to the specifications in Section of Reinforced Concrete.

CONCRETE

Minimum compressive strength of concrete shall conform to the specifications in Section of Reinforced Concrete.

BARBED WIRE AND STEEL/GI PIPE POST

The materials to be used shall conform to the specifications indicated on the drawings and shall be approved by the Engineer prior to installation.

CYCLONE WIRE MESH

Cyclone Wire Mesh shall conform to the requirements of ASTM A 121, Class I.

CONSTRUCTION REQUIREMENT

The Contractor shall perform such clearing and grubbing as may be necessary to construct the fence to required grade and alignment. Fence shall generally follow the contour of the ground. Grading shall be performed where necessary to provide a neat appearance.

The post shall be erected vertically in position inside the formwork of the foundation block prior to the placing of concrete shall be adequately supported by bracing to prevent movement of the post during the placing and setting of the concrete. The post shall be erected to the height and location shown on the Plans, or as ordered by the Engineer.

Masonry shall be laid plumb, true to line, with level courses accurately spaced. Bond pattern shall be kept plumb throughout. Corners and reveals shall be plumb and true. Vertical joints shall be shoved tight. Each unit shall be adjusted to final position while mortar is still soft and plastic. Any unit that is disturbed after mortar has stiffened shall be removed and relaid with fresh mortar. Courses shall be so spaced that backing masonry will level off, flush with the face work at all joints where ties occur. Chases and rake-out joints shall be kept free from mortar or other debris.

Anchorage to concrete. Anchorage to abutting columns shall be provided only where indicated. Details shall be as indicated including anchorage to underside of beams and slabs

Cutting and fitting, including that required to accommodate the work of others shall be done by masonry mechanics. Wherever possible, full units of the proper size shall be used in lieu of cut units. Cut edges shall be clean, true and sharp. Openings shall be carefully cut, formed or otherwise neatly made for recessed items and for electrical, plumbing, or other mechanical installations so that wall plates, cover plates, or escutcheons required by the installation will completely conceal the openings and will have bottoms in alignment with lower edge of masonry joints. Webs of hollow masonry units shall be cut to the minimum required for the installation. Reinforced masonry lintels shall be provided as indicated above openings over 300mm wide, for pipes, ducts and cable trays, unless steel sleeves are used.

Spaces around built-in items shall be filled with mortar. Openings around flush-mounted electrical outlet boxes in wet locations shall be pointed flush with mortar including flush joints above the boxes. Anchors, ties, accessories, flashing, pipe sleeves and other items required to be built-in shall be built-in as the masonry work progresses. Anchors, ties, and joint reinforcement shall be fully embedded in mortar.

Unfinished work shall be stepped back for jointing with new work. Toothing may be resorted to only when specifically approved. Before laying new work, loose mortar shall be removed and the exposed joint shall be thoroughly cleaned.

Mortar shall be accurately measured in laboratory-established proportions and mixed with as much water as may be necessary to produce the wettest workable consistency possible. Mortar shall be placed in final position within one hour after mixing. Mortar not used or that has started to set within this time interval shall be discarded.

Joints in exposed-to-view except control joints, joints to be pointed or caulked or sealed, and openings around flush-mounted electrical outlet boxes in wet locations shall be tooled slightly concave with the mortar thoroughly compacted and pressed against the edges of the units. Tooling shall be done when the mortar has been thumbprint hard. The tooled joint shall be finished to uniformly straight and true lines and surfaces, smooth and free of tool marks.

Details of reinforcement shall be as indicated in the drawings. Reinforcing shall not be bent or straightened in a manner injurious to the steel. Bars with kinks or bends not shown on the drawings shall not be used. Placement of reinforcement shall be inspected and approved prior to placing grout. One piece vertical bars extending from floor to floor or roof above shall be provided. Vertical bars shall be spliced only where indicated.

a. Positioning Bars

Vertical bars shall be positioned accurately at the centerline of the wall. A minimum clearance between the bars and masonry units of 12mm and between parallel bars of one diameter of the reinforcement shall be maintained. Vertical reinforcing shall be held in place using metal supports, centering clips, spacers, ties or caging devices located near the ends of each bar and at intermediate intervals of not more than 192 diameters of the reinforcement.

b. Splices

Splices shall be located only as indicated. Splices shall be staggered in adjacent bars at least 600mm. Bars shall be lapped a minimum of 40 diameters of the reinforcement.

Welding shall be done in accordance with Standard Code and under supervision of Engineer.

PAINTING AND CLEANING

If required in the contract, paint shall be in accordance to the specification indicated in the plans and coordinated with the end user.

Mortar daubs or splashing, before setting or hardening, shall be completely removed from masonry unit surfaces that will be exposed or painted. Before completion of the work, all defects in joints or masonry to be exposed or painted shall be raked out as necessary, filled with mortar, and tooled to match existing joints. Masonry surfaces shall not be cleaned, other than removing excess surface mortar until mortar in joints has hardened. Masonry hardened surfaces shall be left clean, free of mortar daubs, dirt, stain and discoloration, including scum from cleaning operations and with tight mortar joints throughout. Metal tools and metal brushes shall not be used for cleaning.

ITEM 09 : DRAINAGE WORKS

SCOPE OF WORK

The works shall consist of excavation, backfilling and construction of lateral drains, construction of manholes, reconnection to existing lateral and other related works in accordance with the dimensions, size, elevation and grade as shown on the drawing and shall conform with the Specification.

At least thirty (30) days before the start of any construction related to drainage works, the Contractor shall submit to the Engineer for his approval, shop drawings of the drainage work he intends to construct. The shop drawings shall include the materials and the general method of installation he intends to employ.

MATERIAL REQUIREMENTS

BACK FILL

Fill shall be in accordance with Item "Reclamation and Fill".

GRAVEL BEDDING

Gravel Bedding/gravel base shall be in accordance with the specifications of Crushed Course Aggregates in "Reinforced Concrete".

SAND BEDDING

Sand bedding shall be in accordance with Item "Reinforced Concrete (Fine Aggregates)".

CONCRETE

Mixing/Casting and steel reinforcements shall be in accordance with Item "Reinforced Concrete" while the dimensions shall be as shown on the Drawings.

CEMENT MORTAR

Cement mortar shall consist of one part Portland cement to two parts of fine aggregate with water added as necessary to obtain the required consistency.

REINFORCED CONCRETE PIPE

The fabrication of reinforced concrete pipes shall conform to the Specifications of ASTM C 76 while the testing requirements shall conform to ASTM C 497. The Engineer reserves the right to inspect and test the pipe delivered for intended purpose. Defects that are discovered after acceptance of delivery of the pipe but before installation shall be a cause for rejection.

Standard reinforcement details and concrete strength shall be in accordance with DPWH "Standard Two Meter Concrete Pipe Culvert".

STEEL GRATING

All materials shall be compliant with ASTM A36 or equivalent and Hot Dip Galvanizing shall be in accordance with ASTM A123 with minimum average coating of 610gms/sq.m.

The gratings shall be fusion welded type and non-manually fabricated with loading capacity equivalent to HS20-44. Loads and deflection shall be in accordance with AS3990 and the fabrication shall be covered by the requirements of AWS D1.1.

EXECUTION

EARTHWORKS

All earthworks for concrete pipe culvert shall conform to the lines, grades and elevations shown on the drawings or as directed by the Engineer.

The lateral drain shall be excavated to the depth, grade and width established by the Engineer. The bedding surface shall provide a firm foundation of uniform density throughout the entire length. Soft, spongy, or otherwise unstable material encountered that will not provide a firm foundation for the concrete drainage shall be removed to the full width of the trenches and replaced by suitable material to a depth of not less than 30 cm. 100mm thick gravel bedding shall be used as foundation or otherwise as specified.

PIPE LAYING

The pipe shall be tested for water-tightness of joints before backfilling the trench. Unsatisfactory work shall be corrected without additional cost to the PPA. The collar shall have set sufficiently prior to backfilling.

Methods of installation and typical bedding for pipe conduits if not included in the plans, shall conformed to DPWH "Standard Two Meter Reinforced Concrete Culvert".

LATERAL DRAIN

Concrete cover and the steel gratings shall be set to the required elevations as shown on the drawings to fit the adjoining surfaces and shall be installed after the adjoining concrete is struck off and finished, and the fit on the frames shall be such that there is no rocking.

All completed structures shall be thoroughly cleaned of any accumulations of silts, debris or foreign matter of any kind, until finally accepted and put into service.

CATCH BASIN INLETS, MANHOLES AND OUTLETS

Lid frames shall be set to the required elevations as shown on the drawings to fit the adjoining surfaces. Lids shall be installed after the adjoining concrete is struck off and finished, and the fit on the frames shall be such that there is no rocking.

Where reconstruction of existing catch basin inlets, manholes, outlets, or similar structures are indicated, the work shall be in accordance to the details and elevations as shown on the drawings, including re-installation of existing metal frames, grates and lids, or replacing of concrete covers instead of grates that may have been lost or found lacking. All completed structures shall be thoroughly cleaned of any accumulations of silts, debris or foreign matter of any kind, until finally accepted and put into service.

FIELD DENSITY TEST

Field Density tests to determine the percent of compaction of the fill material shall be conducted until a field density of at least 95 percent of the maximum dry density in accordance with AASHTO T180, Method D has been achieved. In place density determination shall be made in accordance with AASHTO T191.

CLEARING AND DISPOSAL

Dumping or disposal of un-used excavated materials shall be coordinated to PMO. If the excavated materials are determined for disposal, the contractor will provide all necessary works and expenses for its completion in concurrence by the Engineer.

ITEM 10 : PROJECT BILLBOARD

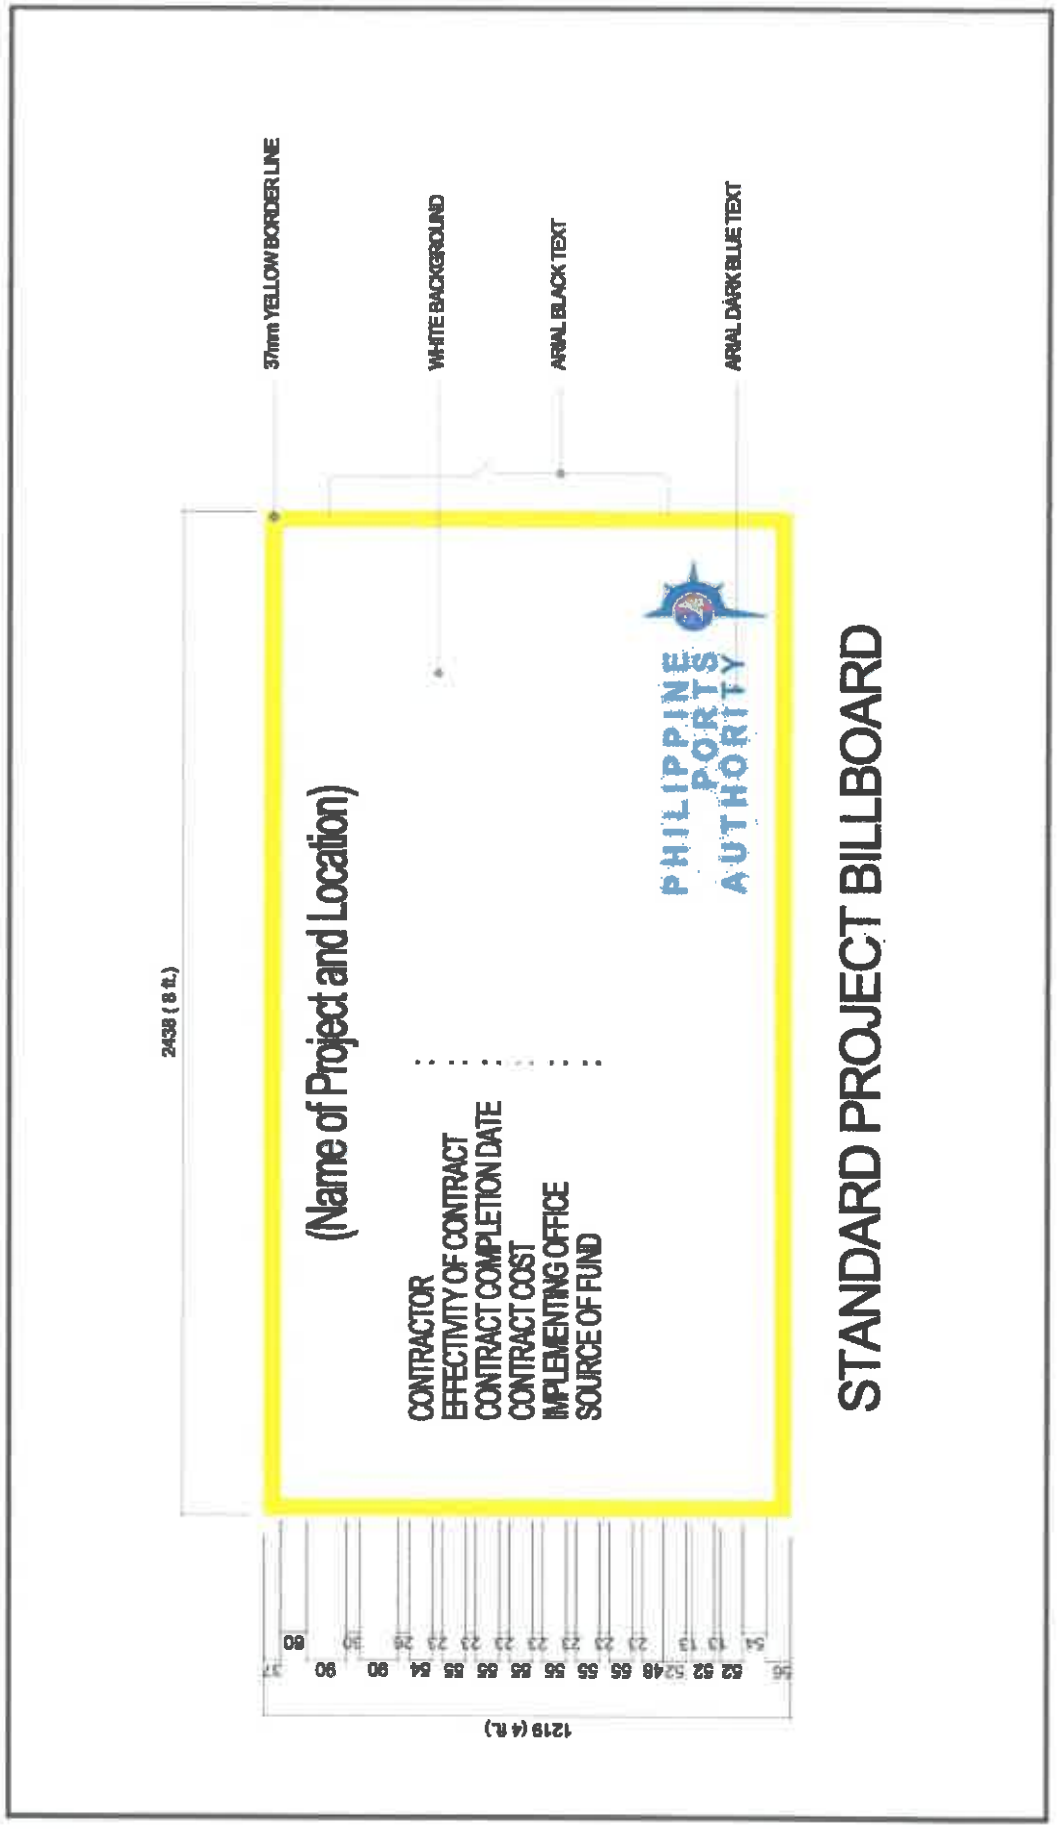
SPECIFICATION

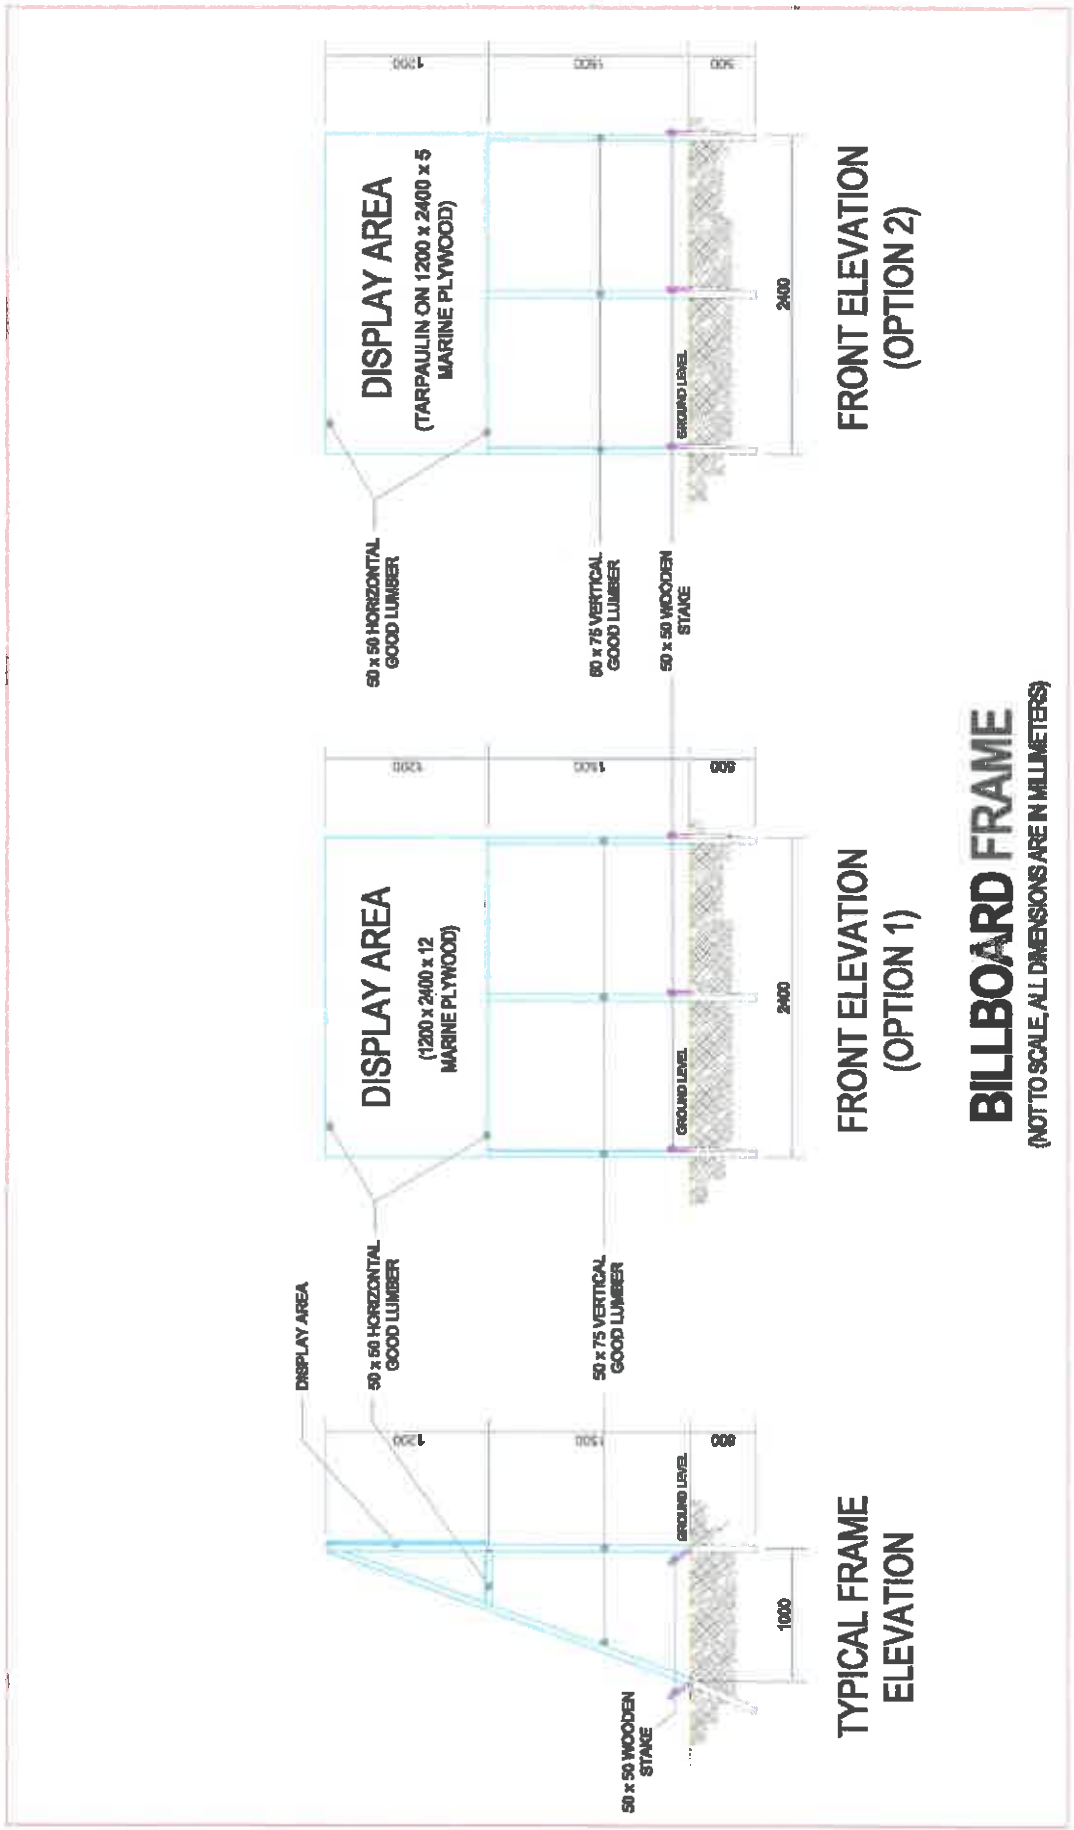
The Project Billboard shall be installed at location(s) designated by the Engineer.

The size and specifications of materials for the standard billboard shall be 4ft. x 8ft. (1,200mm x 2,400mm) using ½ inch (12mm) marine plywood or tarpaulin poster on 3/16 inch (5mm) marine plywood.

Project billboards shall not contain Name(s) and/or picture(s) of any personages.

See attached drawings for further details of the standard billboard.


STANDARD PROJECT BILLBOARD
37mm YELLOW BORDER LINE
WHITE BACKGROUND
ARIAL BLACK TEXT
ARIAL DARK BLUE TEXT
PHILIPPINE PORTS AUTHORITY
(Name of Project and Location)
CONTRACTOR
EFFECTIVITY OF CONTRACT
CONTRACT COMPLETION DATE
CONTRACT COST
IMPLEMENTING OFFICE
SOURCE OF FUND
2438 (8 ft.)
1219 (4 ft.)


BILLBOARD FRAME
(NOT TO SCALE, ALL DIMENSIONS ARE IN MILLIMETERS)
FRONT ELEVATION
(OPTION 1)
DISPLAY AREA
(1200 x 2400 x 12
MARINE PLYWOOD)
50 x 50 HORIZONTAL
GOOD LUMBER
50 x 75 VERTICAL
GOOD LUMBER
GROUND LEVEL
2400
FRONT ELEVATION
(OPTION 2)
DISPLAY AREA
(TARPAULIN ON 1200 x 2400 x 5
MARINE PLYWOOD)
50 x 50 WOODEN
STAKE
TYPICAL FRAME
ELEVATION
DISPLAY AREA
1000

ITEM 11 : SAFETY SIGNAGES AND BARRICADES

DESCRIPTION

This work includes the furnishing and installing of safety signages and barricades in accordance with the specifications and to the details shown below in the drawings, or as directed by the Engineer.

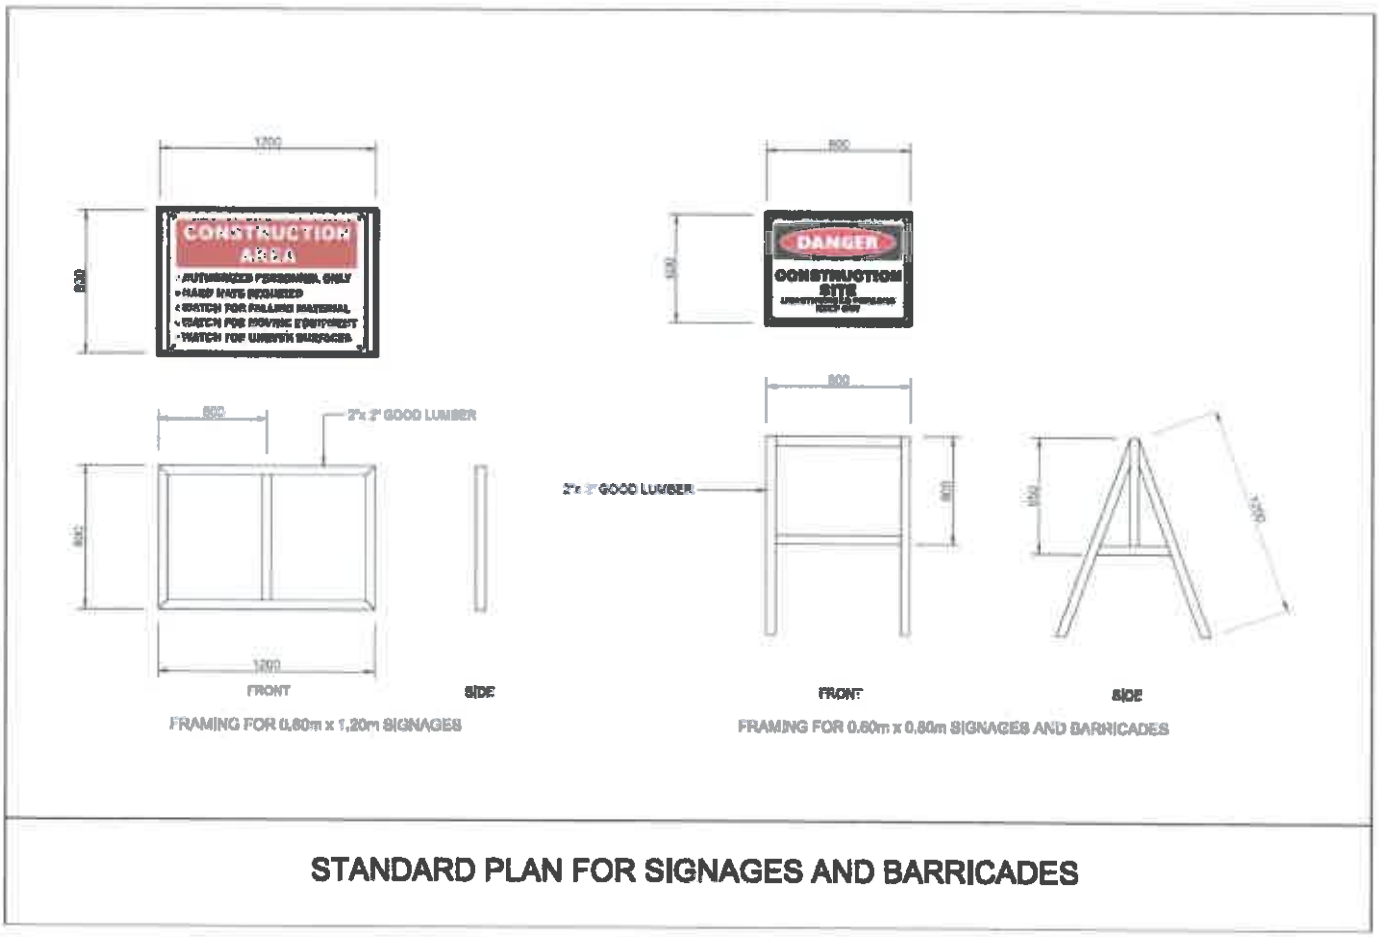
SPECIFICATION

The Signage's and Barricades shall be installed at location(s) designated by the Engineer.

The sizes of the standard signages shall be 2-2/3ft x 4ft (800mm X 1,200mm) for fixed type and 2ft x 2–2/3ft (600mm x 800mm) for mobile type. For barricade standard 2ft x 2–2/3ft (600mm x 800mm) shall be provided.

The materials to be used for signages and barricades are ½ inch (12mm) marine plywood or tarpaulin poster on 2" x 2" (50mm x 50mm) good lumber frame (see drawing below).

The printing or painting shall be the discretion of the Engineer.



STANDARD PLAN FOR SIGNAGES AND BARRICADES

SECTION VII

DRAWINGS
(APPROVED PLANS)

DRAWINGS AND APPROVED PLANS
(SEE ISSUED APPROVED PLANS)

LIST OF DRAWINGS:

01	OF	11	-	Vicinity Map, Development Plan, General Notes, List of Drawings
02	OF	11	-	General Plan
03	OF	11	-	Part Plan (Area-1), Part Plan (Area-2)
04	OF	11	-	Drainage Layout Plan (Area-1), Drainage Layout Plan (AREA-2)
05	OF	11	-	Section - X, Section - Y, Section - 01, Section – 02
06	OF	11	-	Section - 03, Section – 04
07	OF	11	-	Section - 05, Section – 06
08	OF	11	-	Section - 07, Section - 08, Section - 09, Section - 10, Section - 11, Section - 12, Section Detail of Portland Cement Concrete Pavement, Detail of Drainage Outfall, Detail of Retaining Wall
09	OF	11	-	Detail of Catch Drain Manhole, Detail of Lateral Drainage
10	OF	11	-	Detail of Fence-1
11	OF	11	-	Detail of Fence-2

SECTION VIII

BILL OF QUANTITIES and ATTACHMENTS

BID SUMMARY

PAVING OF PORT OPERATIONAL AREA

Port of Matnog, Matnog, Sorsogon

NO.	DESCRIPTION OF WORK	AMOUNT (Pesos)
BILL NO. 1	GENERAL EXPENSES	
BILL NO. 2	PAVING OF PORT OPERATIONAL AREA	
	BID PRICE	

Name of Firm	Name of Bidder/Authorized Representative (Signatory's Legal Capacity)	Date

BILL OF QUANTITIES
PAVING OF PORT OPERATIONAL AREA
Port of Matnog, Matnog, Sorsogon

NO. (1)	DESCRIPTION OF WORK (2)	UNIT (3)	QTY. (4)	UNIT PRICE (Pesos) (5)	AMOUNT (Pesos) (4) x (5)
BILL NO.	**1 GENERAL EXPENSES**				
1.01	Mobilization, demobilization and cleaning	lot	1		
1.02	Rental of temporary site office and residence for the Engineer and staff	mo.	15		
1.03	Maintain temporary site office and residence for the Engineer and staff	mo.	15		
1.04	Provide Construction Safety and Health Program in the execution of the project	mo.	15		
	TOTAL FOR BILL NO. 1				

Name of Bidder/Authorized Representative
(Signatory's Legal Capacity)

BILL OF QUANTITIES
PAVING OF PORT OPERATIONAL AREA
Port of Matnog, Matnog, Sorsogon

NO. (1)	DESCRIPTION OF WORK (2)	UNIT (3)	QTY. (4)	UNIT PRICE (Pesos) (5)	AMOUNT (Pesos) (4) x (5)
BILL NO.	**2 PAVING OF PORT OPERATIONAL AREA**				
2.01	Remove and dispose existing pavement	sq.m.	242		
2.02	Remove and dispose existing Fence	l.m.	49		
2.03	Chip-off portion of existing fence	l.m.	157		
2.04	Subgrade preparations	sq.m.	8,230		
2.05	Excavate and dispose existing fill materials	cu.m.	2,830		
2.06	Supply and place 3,500 psi concrete for the retaining wall, outfall, and rc curb	cu.m.	22		
2.07	Supply and install steel reinforcement for the retaining wall, outfall, and rc curb	kg.	2,621		
2.08	Supply and place gravel bedding	cu.m.	24		
2.09	Supply, spread and compact aggregate base course	cu.m.	1,120		
2.10	Supply and place cement treated base course	cu.m.	819		
2.11	Construct portland cement concrete pavement (300mm thk) including temperature bars	sq.m.	8,193		

Name of Bidder/Authorized Representative
(Signatory's Legal Capacity)

BILL OF QUANTITIES
PAVING OF PORT OPERATIONAL AREA
Port of Matnog, Matnog, Sorsogon

NO. (1)	DESCRIPTION OF WORK (2)	UNIT (3)	QTY. (4)	UNIT PRICE (Pesos) (5)	AMOUNT (Pesos) (4) x (5)
2.12	Construct cyclone fence including painting and accessories	l.m.	50		
2.13	Upgrading of existing fence including painting and accessories	l.m.	157		
2.14	Construct lateral drainage including trench grate, built-up frames, and other accessories	l.m.	199		
2.15	Construct catch drain manhole including trench grate for manhole cover, built-up frames, dowels and other accessories	no.	22		
	TOTAL FOR BILL NO. 2				

Name of Bidder/Authorized Representative
(Signatory's Legal Capacity)