ADMIXTURE (IF NECESSARY)

Unless otherwise required by field conditions, admixture may be used subject to the expressed approval of the Engineer. The cost of which shall already be included in the unit cost bid of the Contractor for the concrete.

1. Air Entraining Admixture shall conform to ASTM C 260.
2. Admixture other than air entraining agent shall conform to ASTM C 494.
3. Admixture containing chloride ions, or other ions producing deleterious effect shall not be used.

AGGREGATES

1. Crushed Coarse Aggregate

Conforming to ASTM C 33 and having nominal sizes passing 38.0 mm to 19.0 mm, 19.0 mm to 9.5 mm to No. 4 sieve. The material shall be well graded between the limits indicated and individually stockpiled. It shall be the Contractor's responsibility to blend the materials to meet the gradation requirements for various types of concrete as specified herein.

Nominal sizes for combined gradation shall be as follows:

ASTM Sieves	Nominal Size of Coarse Aggregates			
	% by Weight Passing			
	40mm	25mm	19mm	10mm
50.0mm (2")	100	-	-	-
38.0mm (1 1/2")	95 - 100	100	-	-
31.8mm (1 1/4")	-	90 - 100	100	-
25.0mm (1")	-	-	90 - 100	-
19.0mm (3/4")	35 - 70	25 - 90	-	100
16.0mm (5/8")	-	-	20 - 55	85 - 100
9.5mm (3/8")	10 - 30	0 - 10	0 - 10	0 - 20
No. 4	0 - 5			

2. Fine Aggregate

ASTM C 33 except for gradation which has been revised to meet local conditions unless otherwise required by the Engineer, grading of find aggregate shall be as follows:

ASTM Sieves	% by Weight Passing
9.5mm (3/8")	100
No.4	90 - 100
No. 8	80 - 100
No. 16	50 - 90
No. 30	25 - 60
No. 50	5 - 30
No. 100	0 - 10

a. Grading of fine aggregates shall be reasonably uniform and fineness modulus thereof shall not vary more than 0.2 from that of the representative sample in which mix properties of concrete are based.

b. Due care shall be taken to prevent segregation.

WATER

The mixing water shall be clear and apparently clean. If it contains quantities or substances that discolor it or make it smell or taste unusual or objectionable, or cause suspicion, it shall not be used unless service records of concrete made with it (or other information) indicated that it is not injurious to the quality, shall be subject to the acceptance criteria as shown in Table 6.3 and Table 6.4 or as designated by the purchaser.

When wash water is permitted, the producer will provide satisfactory proof or data of non-detrimental effects if potentially reactive aggregates are to be used. Use of wash water will be discontinued if undesirable reactions with admixtures or aggregates occur.

Table 6.3 Acceptance Criteria for Questionable Water Supplies

Test	Limits
Compressive strength, min. % Control at 7 days	90
Time of Setting deviation from control	from 1:00 earlier to 1:30 later
Time of Setting (Gillmore Test) Initial Final Set	 No marked change No marked change
Appearance	Clear
Color	Colorless

Odor	Odorless
Total Solids	500 parts/million max.
PH value	4.5 to 8.5

Table 6.4 Chemical Limitation for Wash Water

	Limits
Chemical Requirements, Minimum Concentration Chloride as $C1^{(-1)}$ expressed as a mass percent of cement when added to the $C1^{(-1)}$ in the other components of the concrete mixtures shall not exceed the following levels:	
1. Prestressed Concrete	0.06 percent
2. Conventionally reinforced concrete in a moist environment and exposed to chloride	0.10 percent
3. Conventionally reinforced concrete in a moist environment but not exposed to chloride	0.15 percent
4. Above ground building construction where the concrete will stay dry	No limit for corrosion
Sulfate as SO_4, ppm[A]	3,000
Alkalies as (Na_2O + 0.658 K_2O), ppm	600
Total Solids, ppm	50,000

Wash water reused as mixing water in concrete may exceed the listed concentrations of sulfate if it can be shown that the concentration calculated in the total mixing water, including mixing water on the aggregate and other sources, does not exceed that stated limits.

Water will be tested in accordance with, and shall meet the suggested requirements of AASHTO T 26.

Water known to be of potable quality may be used without test.

CURING MATERIALS

1. Impervious Sheet Materials

   ASTM C 171 type, optional, except that polyethylene film, if used, shall be white opaque.

2. Burlap of commercial quality, non-staining type, consisting of 2 layers minimum.

3. Membrane Forming Curing Compound

   ASTM C 309; submit evidence that product conforms to specifications.

JOINTING MATERIALS

1. Sealant

Sealant shall be multi-component, polyurethane base compound, gray in color, self-leveling for horizontal joints, 2 part polythremdyne, terpolymer compound, gray in color; non-sag for vertical joints.

Sealant shall be compatible with materials in contact and to perform satisfactorily under salt water and traffic conditions and be capable of making joint watertight and allow movement 25% of the width of joint in any direction.

Sealant shall be guaranteed against leakage, cracking, crumbling, melting, shrinkage, running, loss of adhesion for a period of five years from the date of acceptance of work.

2. Joint backing shall be expanded extruded polyethylene, low density, oval in shape to fit the joints as indicated on the drawings and to be compatible with sealant.

3. Where required, primer shall be compatible with joint materials and installed in accordance with manufacturer's instructions.

4. Joint filler shall conform to ASTM D1751 (AASHTO M213) non-extruding, resilient bituminous type. Filler shall be furnished for each joint in single piece for depth and width required for joint, unless otherwise authorized by the Engineer. When more than one piece is authorized for a joint, abutting ends shall be fastened and hold securely to shape by stapling or other positive fastening.

EPOXY BONDING COMPOUND

ASTM C 881. Provide Type I for bonding hardened concrete to hardened concrete; Type II for bonding freshly mixed concrete to hardened concrete; and Type III as a binder in epoxy mortar or concrete, or for use in bonding skid-resistant materials to hardened concrete. Provide Class B if placement temperature is between 4 and 16°C; or Class C if placement temperature is above 16°C.

REINFORCEMENT

Steel reinforcement, other than Steel for Pre-stressing, used in Reinforced Concrete, shall conform to ASTM and PNS as follows:

ASTM Designation A615 - Deformed Billet Steel Bars for Concrete Reinforcement. Minimum yield strength of 276 MPa (40,000 psi).

PNS 49 - Steel Bars for Concrete Reinforcement

TIE WIRE

Tie wire shall be plain, cold drawn annealed steel wire 1.6 mm diameter.

SAMPLES AND TESTING

1. Cement

Sampled either at the mill or at the site of work and tested by an independent commercial or

government testing laboratory duly accredited by the Bureau of Research and Standards (BRS) of the DPWH, Department of Science and Technology (DOST) or the Department of Trade and Industry (DTI) at no additional cost to PPA. Certified copies of laboratory test reports shall be furnished for each lot of cement and shall include all test data, results, and certificates that the sampling and testing procedures are in conformance with the Specifications. No cement shall be used until notice has been given by the Engineer that the test results are satisfactory. Cement that has been stored, other than in bins at the mills, for more than 3 months after delivery to the Site shall be re-tested before use. Cement delivered at the Site and later found after test to be unsuitable shall not be incorporated into the permanent works.

2. Aggregates: Tested as prescribed in ASTM C 33

At least 28 days prior to commencing the work, the Contractor shall inform the Engineer of the proposed source of aggregates and provide access for sampling.

Gradation tests will be made on each sample without delay. All other aggregates tests required by these Specifications shall be made on the initial source samples and shall be repeated whenever there is a change of source. The tests shall include an analysis of each grade of material and an analysis of the combined material representing the aggregate part of the mix.

3. Reinforcement

Certified copies of mill certificates shall accompany deliveries of steel bar reinforcement. If requested by the Engineer additional testing of the materials shall be made at the Contractor's expense.

4. Concrete Tests

For test purposes, provide 1 set of three (3) concrete cylinder samples taken from each day's pouring and to represent not more than 75 cu.m. of concrete class or fraction thereof of concrete placed. Samples shall be secured in conformance with ASTM C 172. Tests specimens shall be made, cured, and packed for shipment in accordance with ASTM C 31. Cylinders will be tested by and at the expense of the Contractor in accordance with ASTM C 39. Test specimens will be evaluated separately by the Engineer, for meeting strength level requirements for each with concrete quality of ACI 318. When samples fail to conform to the requirements for strengths, the Engineer shall have the right to order a change in the proportions of the concrete mix for the remaining portions of the work at no additional cost to the Authority.

5. Test of Hardened Concrete in or Removed from the Structure

When the results of the strength tests of the concrete specimens indicates the concrete as placed does not meet the Specification requirements or where there are other evidences that the quality of concrete is below the specification requirement in the opinion of the Engineer, tests on cores of in-place concrete shall be made in conformance with ASTM C 42.

Core specimens shall be obtained by the Contractor and shall be tested. Any deficiency shall be corrected or if the Contractor elects, he may submit a proposal for approval before the load test is made. If the proposal is approved, the load test shall be made by the Contractor and the test results evaluated by the Engineer in conformance with Chapter 20 of ACI 318. The cost of the load tests shall be borne by the Contractor. If any concrete shows evidence of failure during the load test, or fails the load test as evaluated, the deficiency be

corrected in a manner approved by the Engineer at no additional cost to the Authority.

6. Chemical Admixtures/Additives

The admixtures/additives if approved shall conformed to ASTM C 494 and ASTM C 1017. The testing shall be conducted with cement and aggregate proposed for the Project. The admixtures/additives shall be tested and those that have been in storage at the Project Site for longer than six (6) months shall not be used until proven by retest to be satisfactory.

Samples of any admixtures/additives proposed by the Contractor shall be submitted for testing at least 56 days in advance of use, which shall require approval of the Engineer. Testing of admixtures/additives proposed by the Contractor including test mixing and cylinder test shall be at the Contractor's expense.

7. Jointing Materials and Curing Compound Samples

At least 28 days prior to commencing the work, the Contractor shall submit to the Engineer for his approval samples of the following materials proposed for use together with manufacturer's certificate.

a. 10 kg of joint sealant
b. 1m length of joint filler
c. 5 li. of curing compound
d. 1m length of joint backing

The Engineer shall deliver to the Contractor his assessment on the materials within seven (7) days after receiving them.

EXECUTION

DELIVERY, STORAGE AND HANDLING OF MATERIALS

1. Cement

Do not deliver concrete until vapor barrier, forms, reinforcement, embedded items, and chamfer strips are in place and ready for concrete placement. ACI 301 and ASTM A 934 for job site storage of materials. Protect materials from contaminants such as grease, oil, and dirt. Ensure materials can be accurately identified after bundles are broken and tags removed.

Immediately upon receipt at the Site, the cement shall be stored separately in a dry weathertight, properly ventilated structures with adequate provisions for prevention of absorption of moisture. Storage accommodations for concrete materials shall be subject to approval and shall afford easy access for inspection and identification of each shipment in accordance with test reports.

Cement shall be delivered to the Site in bulk or in sound and properly sealed bags and while being loaded or unloaded and during transit to the concrete mixers whether conveyed in vehicles or in mechanical means, cement shall be protected from whether by effective coverings. Efficient screens shall be supplied and erected during heavy winds.

If the cement is delivered in bulk, the Contractor shall provide, at his own cost, approved silos of adequate size and numbers to store sufficient cement to ensure continuity of work

and the cement shall be placed in these silos immediately after it has been delivered to the Site. Approved precautions shall be taken into consideration during unloading to ensure that the resulting dust does not constitute a nuisance.

If the cement is delivered in bags, the Contractor shall provide, at his own cost, perfectly waterproofed and well-ventilated sheds having a floor of wood or concrete raised at least 0.5m above the ground. The sheds shall be large enough to store sufficient cement to ensure continuity of the work and each consignment shall be stacked separately therein to permit easy access for inspection, testing and approval. Upon delivery, the cement shall at once be placed in these sheds and shall be used in the order in which it has been delivered.

Cement bags should not be stacked more than 13 bags high. All cement shall be used within two months of the date of manufacture. If delivery conditions render this impossible, the Engineer may permit cement to be used up to three (3) months after manufacturing, subject to such conditions including addition of extra cement as he shall stipulate.

2. Aggregate

All fine and coarse aggregate for concrete shall be stored on close fitting, steel or concrete stages design with drainage slopes or in bins of substantial construction in such a manner as to prevent segregation of sizes and to avoid the inclusion of dirt and other foreign materials in the concrete. All such bins shall be emptied and cleaned at intervals of every six (6) months or as required by the Engineer. Each size of aggregate shall be stored separately unless otherwise approved by the Engineer.

Stockpiles of coarse aggregate shall be built in horizontal layers not exceeding 1.2 m in depth to minimize segregation.

FORMWORK

1. Forms

Designed, constructed, and maintained so as to insure that after removal of forms the finished concrete members will have true surfaces free of offset, waviness or bulges and will conform accurately to the indicated shapes, dimensions, lines, elevations and positions. Form surfaces that will be in contact with concrete shall be thoroughly cleaned before each use.

2. Design

Studs and wales shall be spaced to prevent deflection of form material. Forms and joints shall be sufficiently tight to prevent leakage of grout and cement paste during placing of concrete. Juncture of formwork panels shall occur at vertical control joints, and construction joints. Forms placed on successive units for continuous surfaces shall be fitted in accurate alignment to assure smooth completed surfaces free from irregularities and signs of discontinuity. Temporary opening shall be arranged to wall and where otherwise required to facilitate cleaning and inspection. Forms shall be readily removable without impact, shock, or damage to the concrete.

3. Form Ties

Factory fabricated, adjustable to permit tightening of the forms, removable or snap-off metal of design that will not allow form deflection and will not spall concrete upon removal. Bolts and rods that are to be completely withdrawn shall be coated with a non-staining

bond breaker. Ties shall be of the type which provide watertight concrete.

4. Chamfering

External comers that will be exposed shall be chamfered, beveled, or rounded by mouldings placed in the forms or as indicated in the drawings.

5. Coatings

Forms for exposed surfaces shall be coated with form oil or form-release agent before reinforcement is placed. The coating shall be a commercial formulation of satisfactory and proven performance that will not bond with, stain, or adversely affect concrete surfaces, and shall not impair subsequent treatment of concrete surfaces depending upon bond or adhesion nor impede the wetting of surfaces to be cured with water or curing compounds. The coating shall be used as recommended in the manufacturer's printed or written instructions. Forms for unexposed surfaces may be wet with water in lieu of coating immediately before placing of concrete. Surplus coating on form surfaces and coating on reinforcement steel and construction joints shall be removed before placing concrete.

6. Removal of Forms shall be done in a manner as to prevent injury to the concrete and to ensure complete safety of the structure after the following conditions have been met. Where the structure as a whole is supported on shores, forms for beam and girder sides, and similar vertical structural members may be removed before expiration of curing period. Care shall be taken to avoid spalling the concrete surface or damaging concrete edges. Wood forms shall be completely removed.

Minimum stripping and striking time shall be as follows unless otherwise approved by the Engineer.

Vertical sides of beams, walls, and columns, lift not 12 hours exceeding 1.2 m

Vertical sides of beams and walls, lift exceeding 1.2 m 36 hours Soffits of main slabs and beams (props left under) 5 days

Removal of props from beams and mains slabs and other work 10 days

7. Control Test

If the Contractor proposes to remove forms earlier than the period stated above, he shall be required to submit the results of control tests showing evidence that concrete has attained sufficient strength to permit removal of supporting forms. Cylinders required for control tests shall be provided in addition to those otherwise required by this Specification. Test specimens shall be removed from molds at the end of 24 hours and stored in the structure as near the points as practicable, the same protection from the elements during curing as is given to those portions of the structure which they represent and shall not be removed from the structure for transmittal to the laboratory prior to expiration of three fourths of the proposed period before removal of forms. Cylinders will be tested by and at the expense of the Contractor. Supporting forms or shoring shall not be removed until control test specimens have attained strength of at least 160 kg/sq cm. The newly unsupported portions of the structure shall not be subjected to heavy construction or material loading.

REINFORCEMENT

1. Reinforcement

Fabricated to shapes and dimensions shown and shall be placed where indicated. Reinforcement shall be free of loose or flaky rust and mill scale, or coating, and any other substance that would reduce or destroy the bond. Reinforcing steel reduced in section shall not be used. After any substantial delay in the work, previously placed reinforcing steel for future bonding shall be inspected and cleaned. Reinforcing steel shall not be bent or straightened in a manner injurious to the steel or concrete. Bars with kinks or bends not shown in the drawings shall not be placed. The use of heat to bend or straighten reinforcing steel shall not be permitted. Bars shall be moved as necessary to avoid interference with other reinforcing steel, conduits, or embedded items. If bars are moved more than one bar diameter, the resulting arrangement of bars including additional bars necessary to meet structural requirements shall be approved before concrete is placed. In slabs, beams and girders, reinforcing steel shall not be spliced at points of maximum stress unless otherwise indicated. Unless otherwise shown in the drawings, laps or splices shall be 40 times the reinforcing bar diameter.

2. The nominal dimensions and unit weights of bars shall be in accordance with the following table:

Nominal Diameter (mm)	Nominal Perimeter (mm)	Nominal Sectional Area (sq. mm)	Unit Weight (kg/m)
10	31.4	78.54	0.616
12	37.7	113.10	0.888
16	50.3	201.10	1.579
20	62.8	314.20	2.466
25	78.5	490.90	3.854
28	88.0	615.70	4.833
32	100.5	804.20	6.313
36	113.1	1,017.60	7.991
40	125.7	1,256.60	9.864
50	157.1	1,963.50	15.413

3. Welding of reinforcing bars shall only be permitted where shown; all welding shown shall be performed in accordance with AWS D 12.1.

4. Exposed reinforcement bars, dowels and plates intended for bonding with future extensions shall be protected from corrosion.

5. Supports shall be provided in conformance with ACI 315 and ACI 318, unless otherwise indicated or specified.

6. Concrete Protection for Reinforcement

a. The minimum concrete cover of reinforcement shall be as shown below unless otherwise indicated in the drawings.

b. Tolerance for Concrete Cover of Reinforcing Steel other than Tendons.

Minimum Cover

7.5cm or more (marine structures and concrete cast against and permanently exposed to earth)

DESIGN STRENGTH OF CONCRETE

Concrete for structural parts or members such as beams, slabs, curtain wall, pile caps and fender/mooring blocks shall develop a minimum 28-day compressive cylinder strength of 24 MPa (3,500 psi) as indicated in the drawings. While for pre-stressed concrete piles a compressive strength of 35 MPa (5,000psi).

TRIAL BATCH FOR CONCRETE

Thirty (30) calendar days before the start of concreting works, the Contractor shall submit design mixes and the corresponding test result made on sample thereof. Sampling and testing shall be in accordance with the ASTM Standard procedures for sampling and testing for the particular design strength(s) required.

The particulars of the mix such as the slump and the proportionate weights of cement, saturated surface dry aggregates and water used shall be stated.

The design mix for concrete to be used shall be submitted together with at least three (3) standard cylinder samples for approval at least one (1) month prior to the start of each concreting schedule. Such samples shall be prepared in the presence of the Engineer.

Standard laboratory strength tests for the 7, 14 and 28 days periods shall be taken to all concrete samples in addition to routine field tests, at cost to the Contractor. Only design mixes represented by test proving the required strength for 7, 14 and 28 days tests shall be allowed.

The cost of sampling, handling and transporting samples from jobsite to the laboratory and the cost of subsequent tests made until the desired mix is attained shall be for the account of the Contractor.

Slump Test shall be made in conformance with ASTM C143, and unless otherwise specified by the Engineer, slump shall be within the following limits:

Structural Element	Slump for Vibrated Concrete	
	Minimum	Maximum
Pavement Concrete	25mm	50mm
Pre-cast Concrete	50mm	70mm
Lean Concrete	100mm	200mm

Sacked Concrete	25mm	50mm
All other Concrete	50mm	90mm

Sampling : Provide suitable facilities and labor for obtaining representative samples of concrete for the Contractor's quality control and the Engineer's quality assurance testing. All necessary platforms, tools and equipment for obtaining samples shall be furnished by the Contractor.

MIXING CONCRETE

1. GENERAL

a. Concrete shall be thoroughly mixed in a mixer of an approved size and type that will insure a uniform distribution of the materials throughout the mass.

b. All concrete shall be mixed in mechanically operated mixers. Mixing plant and equipment for transporting and placing concrete shall be arranged with an ample auxiliary installation to provide a minimum supply of concrete in case of breakdown of machinery or in case the normal supply of concrete is disrupted. The auxiliary supply of concrete shall be sufficient to complete the casting of a section up to a construction joint that will meet the approval of the Engineer.

c. Equipment having components made of aluminum or magnesium alloys, which would be in contact with plastic concrete during mixing, transporting or pumping of Portland cement concrete, shall not be used.

d. Concrete mixers shall be equipped with adequate water storage and a device for accurately measuring and automatically controlling the amount of water used.

e. Materials shall be measured by weighing. The apparatus provided for weighing the aggregates and cement shall be suitably designed and constructed for this purpose. The accuracy of all weighing devices except that for water shall be such that successive quantities can be measured to within one percent of the desired amounts. The water measuring device shall be accurate to plus or minus 0.5 percent. All measuring devices shall be subject to the approval of the Engineer. Scales and measuring devices shall be tested at the expense of the Contractor as frequently as the Engineer may deem necessary to insure their accuracy.

f. Weighing equipment shall be insulated against vibration or movement of other operating equipment in the plant. When the entire plant is running, the scale reading at cut-off shall not vary from the weight designated by the Engineer by more than one percent for cement, 1-½ percent for any size of aggregate, or one percent for the total aggregate in any batch.

g. Manual mixing of concrete shall not be permitted unless approved by the Engineer.

2. MIXING CONCRETE AT SITE

a. Concrete mixers may be of the revolving drum or the revolving blade type and the mixing drum or blades shall be operated uniformly at the mixing speed recommended by the manufacturer.

The pick-up and throw-over blades of mixers shall be restored or replaced when any part or section is worn 20 mm or more below the original height of the manufacturer's design. Mixers and agitators which have an accumulation of hard concrete or mortar shall not be used.

b. When bulk cement is used and the volume of the batch is 0.5 m^3 or more, the scale and weigh hopper for Portland cement shall be separate and distinct from the aggregate hopper or hoppers.

The discharge mechanism of the bulk cement weigh hopper shall be interlocked against opening before the full amount of cement is in the hopper. The discharging mechanism shall be interlocked against opening when the amount of cement in the hopper is underweight by more than one percent or overweight by more than 3 percent of the amount specified.

c. When the aggregates contain more water than the quantity necessary to produce a saturated surface dry condition, representative samples shall be taken and the moisture content determined for each kind of aggregate.

d. The batch shall be so charged into the mixer that some water enter in advance of cement and aggregates. All water shall be in the drum by the end of the first quarter of the specified mixing time.

e. Cement shall be batched and charged into the mixer by such means that it will not result in loss of cement due to the effect of wind, or in accumulation of cement on surfaces of conveyors or hoppers, or in other conditions which reduce or vary the required quantity of cement in the concrete mixture.

f. Where required, synthetic fibrous reinforcement shall be added directly to the concrete mixer after placing the sufficient amount of mixing water, cement and aggregates.

g. The entire contents of a batch mixer shall be removed from the drum before materials for a succeeding batch are place therein. The materials composing a batch except water shall be deposited simultaneously into the mixer.

h. All concrete shall be mixed for a period of not less that 3 minutes after all materials, including water, are in the mixer. During the period of mixing, the mixer shall operate at the speed for which it has been designed.

i. Mixers shall be operated with an automatic timing device that can be locked by the Engineer. The time device and discharge mechanism shall be so interlocked that during normal operation no part of the batch will be discharged until the specified mixing time has elapsed.

j. The first batch of concrete materials placed in the mixer shall contain a sufficient excess of cement, sand, and water to coat the inside of the drum without reducing the required mortar content of the mix. When mixing is to cease for a period of one hour or more, the mixer shall be thoroughly cleaned.

k. In case of rubble concrete, proper mixture and placing of concrete and stones/rocks shall be in accordance to the approved plan. Methodology of work shall be approved by the Engineer.

3. MIXING CONCRETE IN TRUCKS

a. Truck mixers, unless otherwise authorized by the Engineer, shall be of the revolving drum type, watertight, and so constructed that the concrete can be mixed to insure a uniform distribution of materials throughout the mass. All solid materials for the concrete shall be accurately measured and charged into the drum at the proportioning plant. Except as subsequently provided, the truck mixer shall be equipped with a device by which the quantity of water added can be readily verified. The mixing water may be added directly to the batch, in which case a tank is not required. Truck mixers may be required to be provided with a means by which the mixing time can be readily verified by the Engineer.

b. The maximum size of batch in truck mixers shall not exceed the minimum rated capacity of the mixer as stated by the manufacture and stamped in metal on the mixer. Truck mixing shall, unless otherwise directed, be continued for not less than 100 revolutions after all ingredients, including water, are in the drum. The mixing speed shall not be less than 4 rpm, nor more than 6 rpm.

c. Mixing shall begin within 30 minutes after the cement has been added either to the water or aggregate, but when cement is charged into a mixer drum containing water or surface-wet aggregate and when the temperature is above 32 °C, this limit shall be reduced to 15 minutes. The limitation in time between the introduction of the cement to the aggregate and the beginning of the mixing may be waived when, in the judgment of the Engineer, the aggregate is sufficiently free from moisture, so that there will be no harmful effects on the cement.

d. When a truck mixer is used for transportation, the mixing time in stationary mixer may be reduced to 30 seconds and the mixing completed in a truck mixer. The mixing time in truck mixer shall be as specified for truck mixing.

JOINTS

1. No reinforcement, corner protection angles or other fixed metal items shall be run continuously through joints containing expansion-joint filler, through crack-control joints in slabs on grade and vertical surfaces.

2. Preformed Expansion Joint Filler

a. Joints with Joint Sealant

At expansion joints in concrete slabs to be exposed, and at other joints indicated to receive joint sealant, preformed expansion-joint filler strips shall be installed at the proper level below the elevation with a slightly tapered, dressed-and-oiled wood strip temporarily secured to the top thereof to form a groove. When surface dry, the groove shall be cleaned of foreign matter, loose particles, and concrete protrusions, then filled flush approximately with joint sealant so as to be slightly concave after drying.

b. Finish of concrete at joints

Edges of exposed concrete slabs along expansion joints shall be neatly finished with a slightly rounded edging tool.

c. Construction Joints

Unless otherwise specified herein, all construction joints shall be subject to approval of the Engineer. Concrete shall be placed continuously so that the unit will be monolithic in construction. Fresh concrete may be placed against adjoining units, provided the set concrete is sufficiently hard not to be injured thereby. Joints not indicated shall be made and located in a manner not to impair strength and appearance of the structure. Placement of concrete shall be at such rate that the surface of concrete not carried to joint levels will not have attained initial set before additional concrete is placed thereon. Lifts shall terminate at such levels as are indicated or as to conform to structural requirements as directed. If horizontal construction joints are required, a strip of 25mm square-edged lumber, beveled to facilitate removal shall be tacked to the inside of the forms at the construction joint. Concrete shall be placed to a point 25mm above the underside of the strip. The strip shall be removed one hour after the concrete has been placed. Any irregularities in the joint line shall be leveled off with a wood float, and all laitance removed. Prior to placing additional concrete, horizontal construction joints shall be prepared.

Construction Joint which is not indicated in the Drawings shall be located as to least affect the strength of the structure. Such locations will be pointed out by the Engineer.

PREPARATION FOR PLACING

Hardened concrete, debris and foreign materials shall be removed from the interior of forms and from inner surfaces of mixing and conveying equipment. Reinforcement shall be secured in position, and shall be inspected, and approved before placing concrete. Runways shall be provided for wheeled concrete-handling equipment. Such equipment shall not be wheeled over reinforcement nor shall runways be supported on reinforcement.

Notice of any concreting operations shall be served to the Engineer at least three (3) days ahead of each schedule.

PLACING CONCRETE

1. Handling Concrete

Concrete shall be handled from mixers and transported to place for final deposit in a continuous manner, as rapidly as practicable, and without segregation or loss of ingredients until the approved unit of work is completed. Placing will not be permitted when the sun, heat, wind or limitations of facilities furnished by the Contractor prevent proper finishing and curing of the concrete. Concrete shall be placed in the forms, as close as possible in final position, in uniform approximately horizontal layers not over 40cm deep. Forms splashed with concrete and reinforcement splashed with concrete or form coating shall be cleaned in advance of placing subsequent lifts. Concrete shall not be allowed to drop freely more than 1.5m in unexposed work nor more than 1.0 m in exposed work; where greater drops are required, tremie or other approved means shall be employed.

2. Time Interval between Mixing and Placing

Concrete mixed in stationary mixers and transported by non-agitating equipment shall be placed in the forms within 30 minutes from the time ingredients are charged into the mixing drum. Concrete transported in truck mixers or truck agitators shall be delivered to the site of work, discharged in the forms within 45 minutes from the time ingredients are

discharged into the mixing drum. Concrete shall be placed in the forms within 15 minutes after discharged from the mixer at the jobsite.

3. Hot Weather Requirements

The temperature of concrete during the period of mixing while in transport and/or during placing shall not be permitted to rise above 36 °C. Any batch of concrete which had reached a temperature greater than 36 °C at any time in the aforesaid period shall not be placed but shall be rejected, and shall not thereafter be used in any part of the permanent works.

a. Control Procedures

Provide water cooler facilities and procedures to control or reduce the temperature of cement, aggregates and mixing handling equipment to such temperature that, at all times during mixing, transporting, handling and placing, the temperature of the concrete shall not be greater than 36 °C.

b. Cold Joints and Shrinkage

Where cold joints tend to form or where surfaces set and dry too rapidly or plastic shrinkage cracks tend to appear, concrete shall be kept moist by fog sprays, or other approved means, applied shortly after placement, and before finishing.

c. Supplementary Precautions

When the aforementioned precautions are not sufficient to satisfy the requirements herein above, they shall be supplemented by restricting work during evening or night. Procedure shall conform to American Concrete Institute Standard ACI 305.

4. Conveying Concrete by Chute, Conveyor or Pump

Concrete may be conveyed by chute, conveyor, or pump if approved in writing. In requesting approval, the Contractor shall submit his entire plan of operation from the time of discharge of concrete from the mixer to final placement in the forms, and the steps to be taken to prevent the formation of cold joints in case the transporting of concrete by chute, conveyor or pump is disrupted. Conveyors and pumps shall be capable of expeditiously placing concrete at the rate most advantageous to good workmanship. Approval will not be given for chutes or conveyors requiring changes in the concrete materials or design mix for efficient operation.

a. Chutes and Conveyors

Chutes shall be of steel or steel lined wood, rounded in cross section rigid in construction, and protected from overflow. Conveyors shall be designed and operated and chute sections shall be set, to assure a uniform flow of concrete from mixer to final place of deposit without segregation of ingredients, loss of mortar, or change in slump. The discharged portion of each chute or conveyor shall be provided with a device to prevent segregation. The chute and conveyor shall be thoroughly cleaned before and after each run. Waste material and flushing water shall be discharged outside the forms.

b. Pumps shall be operated and maintained so that a continuous stream of concrete is delivered into the forms without air pockets, segregation or changes in slump.

When pumping is completed, concrete remaining in the pipeline shall be ejected and wasted without contamination of concrete already placed. After each operation, equipment shall be thoroughly cleaned and the flushing water shall be splashed outside the forms.

5. Wall and Abutments

No load shall be placed upon finished walls, foundations or abutments until authorized by the Engineer. Minimum time before loading shall be 7 days.

6. Concrete Placing on Wharf

When placing concrete on wharf decks, the Contractor shall:

Ensure that rate of placing is sufficient to complete proposed placing, finishing and curing operations within the scheduled time; that experienced finishing machine operators and concrete finishers are provided to finish the deck; that curing equipment and finishing tools and equipment are at the site of work and in satisfactory condition for use.
Immediately prior to placing, the Contractor shall place scaffolding and wedges and make necessary adjustments. Care shall be taken to ensure that settlement and deflection due to added weight of concrete will be minimal. The Contractor shall provide suitable means to readily permit measurement of settlement deflection as it occurs.

Should any event occur which, in opinion of the Engineer, would prevent the concrete conforming to specified requirements, the Contractor shall discontinue placing of concrete until corrective measures are provided satisfactory to the Engineer. If satisfactory measures are not provided prior to initial set of concrete in affected areas, the Contractor shall discontinue placing concrete and install a bulkhead at a location determined by the Engineer. Concrete in place beyond bulkheads shall be removed. The Contractor shall limit the size of casting to that which can be finished before beginning of initial set.

COMPACTION

1. Immediately after placing, each layer of concrete shall be completed by internal concrete vibrators supplemented by hand-spading, rodding, and tamping. Tapping or other external vibration of forms will not be permitted unless specifically approved by the Engineer. Vibrators shall not be used to transport concrete inside the forms. Internal vibrators submerged in concrete shall maintain a speed of not less than 7,000 impulses per minute. The vibrating equipment shall at all times be adequate in number of units and power to properly consolidate all concrete.

2. Spare units shall be on hand as necessary to insure such adequacy. The duration of vibrating equipment shall be limited to the time necessary to produce satisfactory consolidation without causing objectionable segregation. The vibrator shall not be inserted into the lower courses that have begun to set. Vibrator shall be applied vertically at uniformly spaced points not further apart than the visible effectiveness of the machine.

EPOXY BONDING COMPOUND

Before depositing new concrete on or against concrete that has set, the surfaces of the set concrete shall be thoroughly cleaned so as to expose the coarse aggregate and be free of laitance,

coatings, foreign matter and loose particles. Forms shall be re-tightened. The cleaned surfaces shall be moistened, but shall be without free water when concrete is placed. ASTM C 881. Provide Type I for bonding hardened concrete to hardened concrete; Type II for bonding freshly mixed concrete to hardened concrete; and Type III as a binder in epoxy mortar or concrete, or for use in bonding skid-resistant materials to hardened concrete. Provide Class B if placement temperature is between 4 to 16 °C; or Class C if placement temperature is above 16°C.

FINISHES OF CONCRETE

Within 12 hours after the forms are removed, surface defects shall be remedied as specified herein. The Temperature of the concrete, ambient air and mortar during remedial work including curing shall be above 10 °C. Fine and loose material shall be removed. Honeycomb, aggregate pockets, voids over 13mm in diameter, and holes left by the rods or bolts shall be cut out to solid concrete, reamed, thoroughly wetted, brush-coated with neat cement grout, and filled with mortar. Mortar shall be a stiff mix of one part Portland cement to not more than 2 parts fine aggregate passing the No. 16 mesh sieve, with a minimum amount of water. The color of the mortar shall match the adjoining concrete color. Mortar shall be thoroughly compacted in place. Holes passing entirely through walls shall be completely filled from the inside face by forcing mortar through the outside face. Holes which do not pass entirely through wall shall be packed full. Patchwork shall be finished flush and in the same plane as adjacent surfaces. Exposed patchwork shall be finished to match adjoining surfaces in texture and color. Patchwork shall be damp cured for 72 hours. Dusting of finish surfaces with dry material or adding water to concrete surfaces will not be permitted.

CONCRETE FINISHING DETAILS

1. Concrete Paving

   After concrete is placed and consolidated, slabs shall be screeded or struck off. No further finish is required.

2. Smooth Finish

   Required only where specified; screed concrete and float to required level with no coarse aggregate visible. After surface moisture has disappeared and laitance has been removed, the surface shall be finished by float and steel trowel. Smooth finish shall consist of thoroughly wetting and then brush coating the surfaces with cement to not more than 2 parts fine aggregate passing the no. 30 mesh sieve and mixed with water to the consistency of thick paint.

3. Broom Finish

   Required for paving; the concrete shall be screeded and floated to required finish level with no coarse aggregate visible. After the surface moisture has disappeared and laitance has been removed, surface shall be float-finished to an even, smooth finish. The floated surfaces shall be broomed with a fiber bristle brush in a direction transverse to the direction of the main traffic.

ITEM 05 : LIGHT BEACON

SCOPE OF WORK

The work includes the furnishing of all labor, materials and equipment required for the construction of beacon foundation, installation of body (tower) and placement of self-contained marine lantern and accessories in accordance with the Specifications as indicated in the drawings and directed by the Engineer.

MATERIAL REQUIREMENTS

Foundation

Materials for the reinforced concrete foundation shall be in accordance to the specifications of "Item 03 Reinforced Concrete".

Light Beacon Body

The beacon body (tower) shall be galvanized iron pipe (8" - schedule 40) with base plate and welded stiffener plate, painted in accordance to the plan requirements and installed in a concrete pedestal using anchor bolts.

Marine Lantern

The lantern should be suitable for achieving longer ranges in challenging isolated locations, IALA recommended and over 5 NM range.

- Standard for fixed application.
- Multiple cost-effective battery pack options suitable for a wide variety of installation locations
- Integrated flasher/battery/solar panel.
- Top-mounted LED display with simple tap to activate functionality
- 256 user selectable flash character
- Premium grade, UV stabilized acrylic lens material
- Environmentally friendly
- Super durable marine grade aluminum alloy chassis.
- Adjustable intensity and range
- IP 68 rated

Power Source

- Battery – 12V 14 AH (nominal); or up to 100AH
- Solar Modules – 1-12V 15Wp mono crystalline

EXECUTION

The tower shall be plumb vertically and on-center of the foundation.

Immediate settlement shall be considered before placing the beacon system, excavation and compaction shall be conducted if necessary.

All steel materials shall be coated with epoxy undercoat and final coat as specified in the plans. Paint brand to be used shall be the market leader and renowned for marine use.

TESTING

Upon completion of construction and installation, trial and range checking shall be conducted prior to acceptance of PPA.

ITEM 06 : PROJECT BILLBOARD

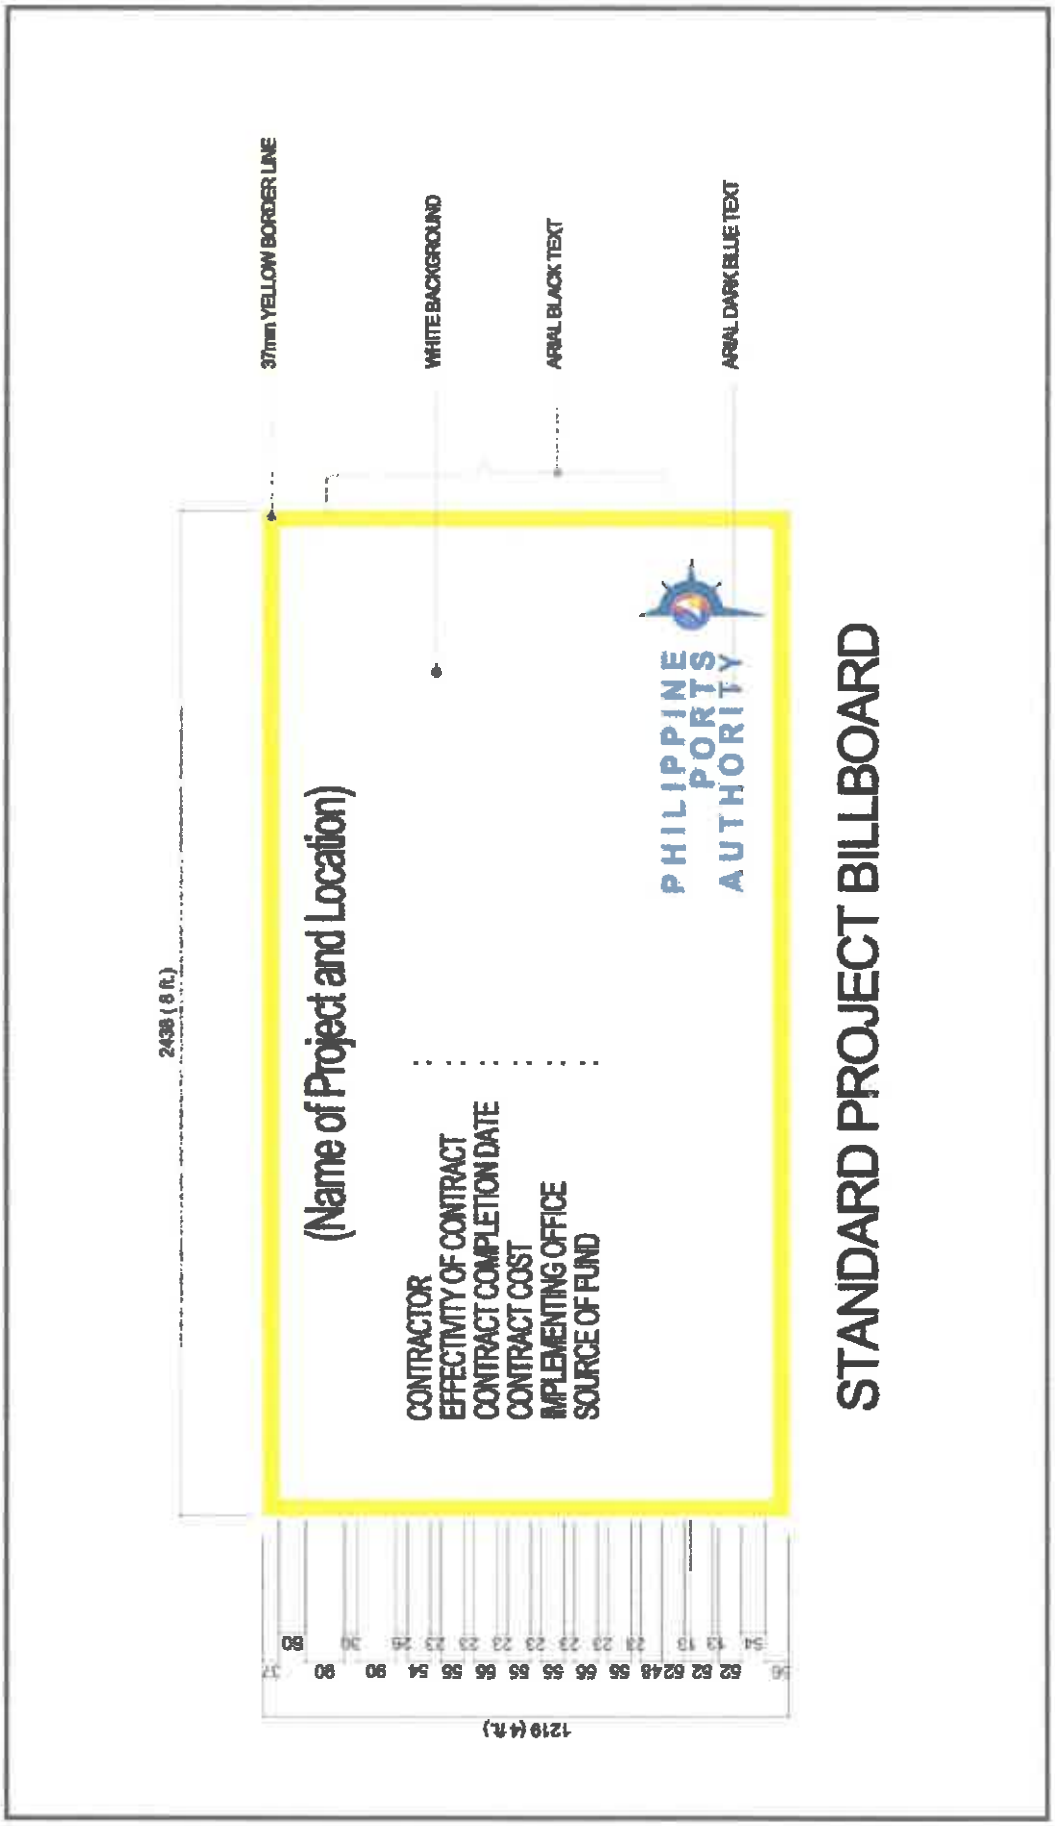
SPECIFICATION

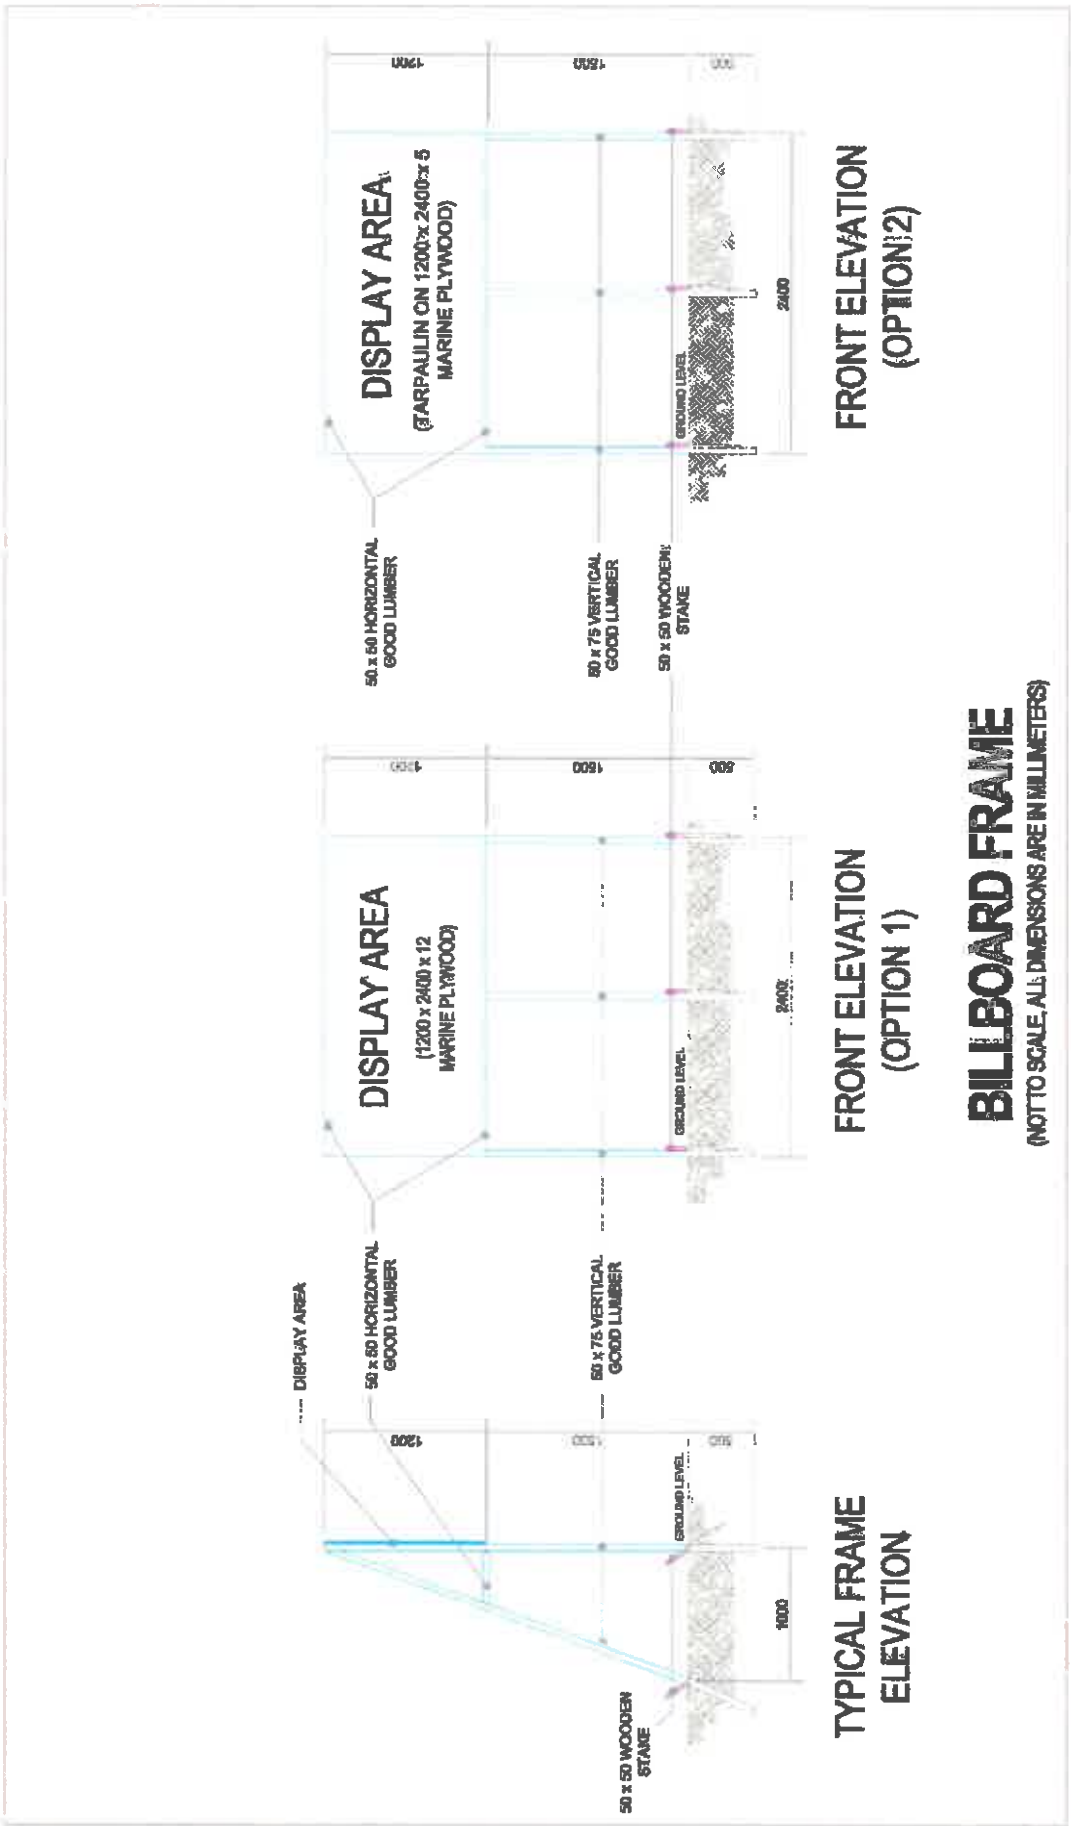
The Project Billboard shall be installed at location(s) designated by the Engineer.

The size and specifications of materials for the standard billboard shall be 4ft. x 8ft. (1,200mm x 2,400mm) using ½ inch (12mm) marine plywood or tarpaulin poster on 3/16 inch (5mm) marine plywood.

Project billboards shall not contain Name(s) and/or picture(s) of any personages.

See attached drawings for further details of the standard billboard.


STANDARD PROJECT BILLBOARD
PHILIPPINE PORTS AUTHORITY
(Name of Project and Location)
CONTRACTOR
EFFECTIVITY OF CONTRACT
CONTRACT COMPLETION DATE
CONTRACT COST
IMPLEMENTING OFFICE
SOURCE OF FUND
37mm YELLOW BORDER LINE
WHITE BACKGROUND
ARIAL BLACK TEXT
ARIAL DARK BLUE TEXT
2438 (8 ft.)
1219 (4 ft.)


BILLBOARD FRAME
(NOT TO SCALE, ALL DIMENSIONS ARE IN MILLIMETERS)
FRONT ELEVATION
(OPTION 1)
DISPLAY AREA
(1200 x 2400 x 12
MARINE PLYWOOD)
50 x 50 HORIZONTAL
GOOD LUMBER
50 x 75 VERTICAL
GOOD LUMBER
50 x 50 WOODEN
STAKE
GROUND LEVEL
FRONT ELEVATION
(OPTION 2)
DISPLAY AREA
(TARPAULIN ON 1200x 2400x 5
MARINE PLYWOOD)
TYPICAL FRAME
ELEVATION
DISPLAY AREA

ITEM 07 : SAFETY SIGNAGES AND BARRICADES

DESCRIPTION

This work includes the furnishing and installing of safety signages and barricades in accordance with the specifications and to the details shown below in the drawings, or as directed by the Engineer.

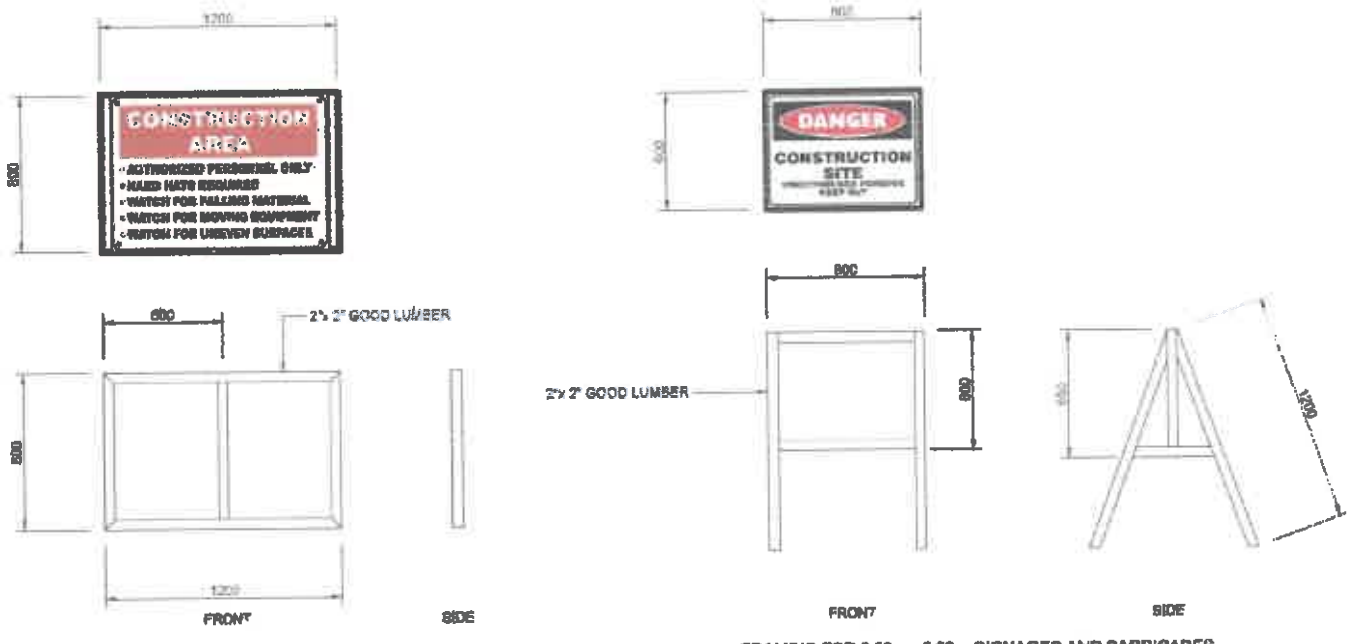
SPECIFICATION

The Signage's and Barricades shall be installed at location(s) designated by the Engineer.

The sizes of the standard signages shall be 2-2/3ft x 4ft (800mm X 1,200mm) for fixed type and 2ft x 2–2/3ft (600mm x 800mm) for mobile type. For barricade standard 2ft x 2–2/3ft (600mm x 800mm) shall be provided.

The materials to be used for signages and barricades are ½ inch (12mm) marine plywood or tarpaulin poster on 2" x 2" (50mm x 50mm) good lumber frame (see drawing below).

The printing or painting shall be the discretion of the Engineer.



FRAMING FOR 0.60m x 1.20m SIGNAGES

FRAMING FOR 0.60m x 0.80m SIGNAGES AND BARRICADES

STANDARD PLAN FOR SIGNAGES AND BARRICADES

SECTION VII

DRAWINGS (APPROVED PLANS)

DRAWINGS AND APPROVED PLANS
(SEE ISSUED APPROVED PLANS)

LIST OF DRAWINGS:

01 of 14	-	Vicinity Map, Development Plan, General Notes, List of Drawings
02 of 14	-	General Plan
03 of 14	-	Section @ Sta. 0 + 000, Section @ Sta. 0 + 010
04 of 14	-	Section @ Sta. 0 + 020, Section @ Sta. 0 + 030
05 of 14	-	Section @ Sta. 0 + 040, Section @ Sta. 0 + 050
06 of 14	-	Section @ Sta. 0 + 060, Section @ Sta. 0 + 070
07 of 14	-	Section @ Sta. 0 + 080, Section @ Sta. 0 + 090
08 of 14	-	Section @ Sta. 0 + 100, Section @ Sta. 0 + 110
09 of 14	-	Section - A, Section - B
10 of 14	-	Section - C
11 of 14	-	Section - D, Section – E
12 of 14	-	Section - F
13 of 14	-	Detail of Tetrapod
14 of 14	-	Beacon Light Foundation, Detail of Beacon Light

SECTION VIII

BILL OF QUANTITIES and ATTACHMENTS

BID SUMMARY
CONSTRUCTION OF BREAKWATER
Port of Nasugbu, Nasugbu, Batangas

NO.	DESCRIPTION OF WORK	AMOUNT (Pesos)
BILL NO. 1	GENERAL EXPENSES	
BILL NO. 2	CONSTRUCTION OF BREAKWATER	
	BID PRICE	

Name of Firm	Name of Bidder/Authorized Representative (Signatory's Legal Capacity)	Date

BILL OF QUANTITIES
CONSTRUCTION OF BREAKWATER
Port of Nasugbu, Nasugbu, Batangas

NO. (1)	DESCRIPTION OF WORK (2)	UNIT (3)	QTY. (4)	UNIT PRICE (Pesos) (5)	AMOUNT (Pesos) (4) x (5)
BILL NO. 1	GENERAL EXPENSES				
1.01	Mobilization, demobilization and cleaning	lot	1		
1.02	Rental of temporary site office and residence for the Engineer and staff	mo.	24		
1.03	Maintain temporary site office and residence for the Engineer and staff	mo.	24		
1.04	Provide Construction Safety and Health Program in the execution of the project	mo.	24		
	TOTAL FOR BILL NO. 1				

Name of Bidder/Authorized Representative
(Signatory's Legal Capacity)

BILL OF QUANTITIES
CONSTRUCTION OF BREAKWATER
Port of Nasugbu, Nasugbu, Batangas

NO. (1)	DESCRIPTION OF WORK (2)	UNIT (3)	QTY. (4)	UNIT PRICE (Pesos) (5)	AMOUNT (Pesos) (4) x (5)
BILL NO.	**2 CONSTRUCTION OF BREAKWATER**				
2.01	Excavation of existing seabed	cu.m.	13,693		
2.02	Supply and place 300-500 kg. core rocks	cu.m.	13,691		
2.03	Supply and place 3,000 kg. underlayer rocks	cu.m.	6,740		
2.04	Supply and fabricate 4,000 psi concrete tetrapod (7.36Tons/pc.)	pc	3,556		
2.05	Install 4,000 psi concrete tetrapod (7.36Tons/pc.)	pc	3,556		
2.06	Supply and place 3,500 psi concrete for beacon light foundation	cu.m.	4		
2.07	Supply and install steel reinforcement for beacon light foundation	kg.	457		
2.08	Supply, deliver and install beacon lights including accessories	set	1		
	TOTAL FOR BILL NO. 2				

Name of Bidder/Authorized Representative
(Signatory's Legal Capacity)

BASIS OF PAYMENT FOR WORK ITEMS INCLUDED IN THE PROPOSAL

The work items included in the proposal and the basis of payments are as follows:

BILL NO. 1

GENERAL EXPENSES

Item 1.01 Mobilization, demobilization, and cleaning

The quantity to be paid for shall be the minimum equipment requirement enumerated in the bid documents mobilized, demobilized and cleaning of the site and accepted by the Engineer. The contract lump sum price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to mobilize and demobilize all the minimum equipment requirement enumerated in the bid documents including cleaning of the site. Fifty percent (50%) of the total amount shall be payable after the mobilization activity while the remaining (50%) payable after demobilization and cleaning.

Item 1.02 Rental of temporary site office and residence for the Engineer and staff

The quantity to be paid for shall be the actual rental of site office and residence for the engineer and staff and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary for the provision of temporary site office and residence for the engineer and staff.

Item 1.03 Maintain temporary site office and residence for the Engineer and staff

The quantity to be paid for shall be the actual services rendered in maintaining the site office and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the maintenance of the temporary site office and residence as well as other expenses such as provision for electric power, telephone bill, potable water supply, janitorial and security services.

Item 1.04 Provide construction safety and Health Program in the execution of the project

The quantity to be paid for shall be the actual implementation of construction safety and health program and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the implementation of the Construction Safety and Health Program, as required and approved by the Department of Labor and Employment (DOLE).

BILL NO. 2

CONSTRUCTION OF BREAKWATER

Item 2.01 Excavation of existing seabed

The quantity to be paid for shall be the actual volume in cubic meters of existing seabed to be excavated in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 2.02 Supply and place 300-500 kg. core rocks

The quantity to be paid for shall be the actual volume in cubic meters of 300-500 kg. core rocks to be supplied and placed in accordance with the plans and specifications and accepted by the Engineer. Hydrographic/Topographic Surveys before and after placing of core rocks shall be made to determine the actual elevations along the cross sections and the actual quantities for payment. Volume due to settlement as established using settlement plates shall also be considered for payment. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 2.03 Supply and place 3,000 kg. underlayer rocks

The quantity to be paid for shall be the actual volume in cubic meter of 3,000 kg. underlayer rocks to be supplied and placed in accordance with the plans and specifications and accepted by the Engineer. Hydrographic/Topographic Surveys before and after placing underlayer rocks shall be made to determine the actual elevations along the cross sections and the actual quantities for payment. Volume due to settlement as established using settlement plates shall also be considered for payment. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 2.04 Supply and fabricate 4,000 psi concrete tetrapod (7.36Tons/pc.)

The quantity to be paid for shall be the actual pieces of 4,000 psi concrete tetrapod (7.36Tons/pc.) to be supplied and fabricated in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 2.05 Install 4,000 psi concrete tetrapod (7.36Tons/pc.)

The quantity to be paid for shall be the actual pieces of 4,000 psi concrete tetrapod (7.36Tons/pc.) to be installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the work.

Item 2.06 Supply and place 3,500 psi concrete for beacon light foundation

The quantity to be paid for shall be the actual volume in cubic meter of 3,500 psi concrete for beacon light foundation to be supplied and placed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 2.07 Supply and install steel reinforcement for beacon light foundation

The quantity to be paid for shall be the actual weight in kilogram of steel reinforcement for beacon light foundation to be supplied and installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 2.08 Supply, deliver and install beacon lights including accessories

The quantity to be paid for shall be the actual set of beacon lights including accessories to be supplied, delivered and installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

FACILITIES TO BE PROVIDED FOR THE ENGINEER & HIS STAFF

RENTAL OF SITE OFFICE AND RESIDENCE FOR THE ENGINEER & STAFF

The Contractor shall provide a temporary site office and residence (rental) with an area of at least 48 square meters for use of the Engineer and his staff for the whole duration of the project.

MINIMUM MAJOR EQUIPMENT REQUIREMENTS

2	unit/s	Clamshell or cable for tying, owned
1	unit/s	Concrete Mixer (1 bagger, minimum), owned
4	unit/s	Concrete Vibrator (3.5hp, minimum), owned
3	unit/s	Crawler crane (30T, minimum), owned
2	unit/s	Deck Barge (1000T DWT, minimum), owned/leased
2	unit/s	Deck Barge (600T DWT, minimum), owned/leased
4	unit/s	Diving Equipment (complete), owned/leased
3	unit/s	Dump Truck (10T net capacity, minimum), owned
2	unit/s	Bar Bender (electric, 25mm dia. min.), owned
2	unit/s	Bar Cutter (electric, 25mm dia min.), owned
3	unit/s	Payloader (80 hp, minimum), owned/ leased
4	unit/s	Transit Mixer (6 cu.m. cap.; minimum), owned/leased
2	unit/s	Tugboat (500 hp, minimum), owned/ leased
1	unit/s	Water Truck with pump (1,000 gal., minimum), owned
2	unit/s	Cargo Truck (2T, minimum), owned
1	unit/s	Truck mounted concrete pump (40 cu.m. capacity, minimum), owned/leased

CONSTRUCTION SAFETY AND HEALTH REQUIREMENT

The Contractor shall implement the construction safety and health program in accordance with the applicable provisions of the Occupational Safety and Health Standards (OSHS) of the Department of Labor and Employment (DOLE).

The Contractor, subject to the approval of the Engineer shall provide and maintain throughout the duration of the contract a medical room with at least 15 square meters together with all necessary supplies to be sited in the Contractor's main area.

The Contractor shall provide the following minimum requirements:

L A B O R

1	no.	Safety Engineer / Officer
1	no.	Nurse / Health Officer

EQUIPMENT / MATERIALS

Personnel Protective Equipment

39	pcs.	Hard Hats
39	pcs.	Gloves (rubberized)
39	pcs.	Safety Glasses/Goggles (clear)
78	pcs.	Long sleeve T-shirt
4	pcs.	Aprons
39	pairs	Safety Shoes

Safety Devices

1	lot	Barricades
1	lot	Warning signs (Signages)
2	unit/s	Fire extinguisher (10kg)

Medical and First Aid System	-	Twenty-four (24) mos.
Temporary shelter for workers	-	1 lot

NOTE:

The Contractor shall provide the above-cited minimum construction safety and health requirements or as required by the Engineer.

PPA MEMORANDUM CIRCULAR
No 02
Series of 2016
Attachment

REVISED SCHEDULE OF MINIMUM TEST REQUIREMENTS OF CONSTRUCTION MATERIALS FOR PPA INFRASTRUCTURE PROJECTS

Materials/Items of Work	*Required Tests*	*Minimum Incremental Frequency of Tests*
I. Construction of Pier/Wharf, Platform and Ramp		
Structural Concrete (SC)		
A Portland Cement	Quality Test	For every 2,000 bags (40kg) or fraction thereof
B Fine Aggregate	Quality Test for Grading, Elutriation (wash), Bulk Specific Gravity, Absorption, Mortar Strength, Soundness, Organic Impurities, Unit Weight, % Clay Lumps and Shale	For every 1,500 cubic meter or fraction thereof
C Coarse Aggregate	Quality Test for Grading, Bulk Specific Gravity, Absorption and Abrasion	For every 1,500 cubic meter or fraction thereof
D Water	Certificate from the Engineer or Quality Test for Density and Chloride Content	One per source
E Steel Bars	Mill Certificate and Quality Test for Chemical Composition and Mechanical Properties	For every 10,000 kg or fraction thereof
F Concrete	Compressive Strength on cylinder samples	1 set consisting of 3 concrete cylinder samples shall be taken from each day's pouring and to represent not more than 75 cu m of concrete or fraction thereof
	Slump Test	For every mix
G Admixture and Concrete Curing Materials	Quality Test	One per shipment
Piling (P)		
A Concrete Piles	Fabrication Report	One per fabrication
1 Concrete	Same test as for SC (F)	Same frequency as SC (F)
2 Steel Bars	Same test as for SC (E)	Same frequency as SC (E)
3 High Tension Strand	Test for Chemical Composition and Mechanical Properties	For every 20000kg or fraction thereof