
PHILIPPINE PORTS AUTHORITY

BATARAZA PORT EXPANSION PROJECT

PORT OF BATARAZA, BRGY. BULILUYAN, BATARAZA, PALAWAN
(HO-INFRA-PPDD-24-0086)

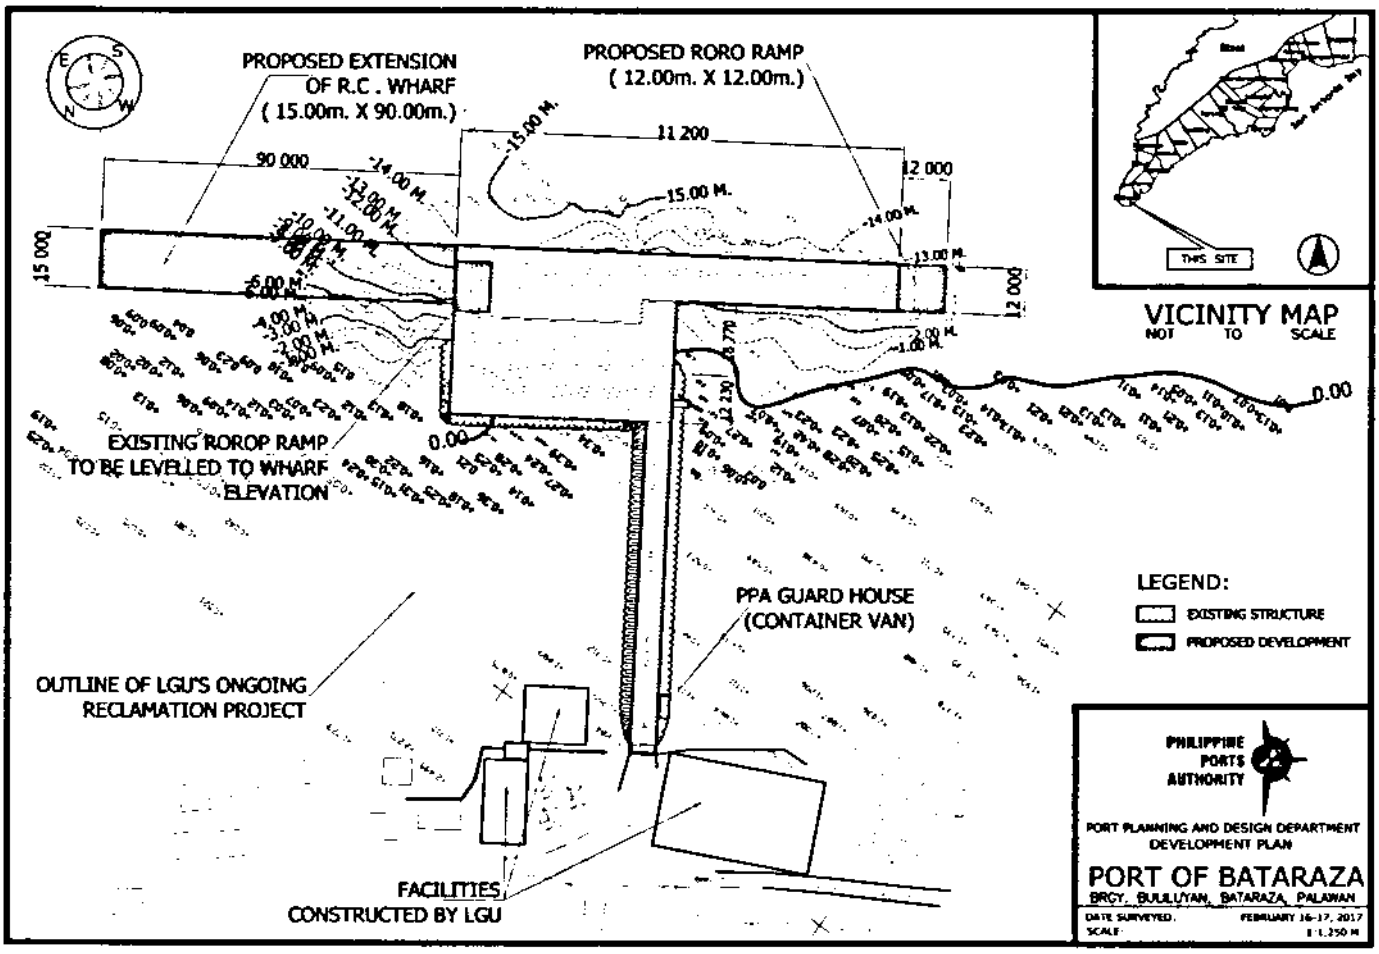

BID DOCUMENTS

December 2024

PAGE

Glossary of Terms, Abbreviations, and Acronyms ..... iv-v

SECTION I INVITATION TO BID 1-2

SECTION II INSTRUCTIONS TO BIDDERS ..... ITB 1-6

1. Scope of Bid 1
2. Funding Information 1
3. Bidding Requirements 1
4. Corrupt, Fraudulent, Collusive, Coercive, and Obstructive Practices 1
5. Eligible Bidders 2
6. Origin of Associated Goods 2
7. Subcontracts 2
8. Pre-Bid Conference 2
9. Clarification and Amendment of Bidding Documents 3
10. Documents Comprising the Bid: Eligibility and Technical Components 3
11. Documents Comprising the Bid: Financial Component 3
12. Alternative Bids 4
13. Bid Prices 4
14. Bid and Payment Currencies 4
15. Bid Security 4
16. Sealing and Marking of Bids 4
17. Deadline for Submission of Bids 5
18. Opening and Preliminary Examination of Bids 5
19. Detailed Evaluation and Comparison of Bids 5
20. Post Qualification 5
21. Signing of Contract 6

SECTION III BID DATA SHEET ..... BDS 1-2

SECTION IV GENERAL CONDITIONS OF CONTRACT ..... GCC 1-4

1. Scope of Contract 1
2. Sectional Completion of Works 1
3. Possession of Site 1
4. The Contractor's Obligations 1
5. Performance Security 2
6. Site Investigation Reports 2
7. Warranty 2
8. Liability of the Contractor 2
9. Termination for Other Causes 2
10. Dayworks 3
11. Program of Work 3
12. Instructions, Inspections and Audits 3
13. Advance Payment 3
14. Progress Payment 3
15. Operating and Maintenance Manuals 4

SECTION V SPECIAL CONDITIONS OF CONTRACT ..... SCC 1

SECTION VI TECHNICAL SPECIFICATIONS ..... TS 1-82

Item 1: Demolition and Removal Works

1. Description 1
2. General Provisions 1
3. Execution 2

Item 2: Piling Works (Pre-Stressed Concrete Piles)
1. Scope of Work 3
2. Material Requirements 3
3. Execution 4

Item 3: Reinforced Concrete
1. Scope of Work 8
2. General Provisions 8
3. Material Requirements 14
4. Execution 20

Item 4: Construction Joints
1. Scope of Work 32
2. Material Requirements 32
3. Execution 32

Item 5: Zinc (Hot-Dip Galvanized) Coatings on Iron and Steel
1. Scope of Work 33
2. Material Requirements 33
3. Execution 33

Item 6: Mooring and Fendering System
1. Scope of Work 39
2. Material Requirements 39
3. Execution 43

Item 7: Project Billboard
1. Specification 44
2. Standard Project Billboard 45
3. Billboard Frame 46

Item 8: Safety Signages and Barricades
1. Description 47
2. Specification 47

SECTION VII DRAWINGS (APPROVED PLANS) ..... PD 1-1

SECTION VIII BILL OF QUANTITIES AND ATTACHMENTS ..... BQ 1-21

1a Bid Summary 1-1
1b Bill of Quantities 1
2. Annex 1 (Basis of Payments) 4
3. Annex 2 (Facilities to be Provided) 9
4. Annex 3 (Minimum Equipment Requirements) 10
5. Annex 4 (Construction Safety and Health Requirements) 11
6. Annex 5 (Minimum Testing Requirements) 12

SECTION IX Checklist of Technical and Financial Documents ..... CL 1-2

SECTION X BIDDING FORMS ..... BF 1-21

1. Bid Form 1
2. Statement of all On-going Government and Private Contracts, including contracts awarded but not yet started 3
3. Statement of the Bidder's Single Largest Completed Contracts (SLCC) Similar to the Contract to be Bid 4
4. Experience Record on Similarly Completed Projects 5
5. Financial Data 6
6. List of Contractor's Personnel 7
7. List of Contractor's Equipment Units 8
8. Omnibus Sworn Statement for Sole Proprietorship 9
9. Omnibus Sworn Statement for Partnership or Cooperative 11
10. Omnibus Sworn Statement for Corporation or Joint Venture 13
11. Bid-Securing Declaration 15

12. Construction Methodology 16
13. Manpower Schedule 17
14. Equipment Utilization Schedule 18
15. Cash Flow by Quarter and Payment Schedule 19
16. Contract Agreement 20

GLOSSARY OF TERMS, ABBREVIATIONS, AND ACRONYMS

Glossary of Terms, Abbreviations, and Acronyms

ABC – Approved Budget for the Contract.

ARCC – Allowable Range of Contract Cost.

BAC – Bids and Awards Committee.

Bid – A signed offer or proposal to undertake a contract submitted by a bidder in response to and in consonance with the requirements of the bidding documents. Also referred to as *Proposal* and *Tender.* (2016 revised IRR, Section 5[c])

Bidder – Refers to a contractor, manufacturer, supplier, distributor and/or consultant who submits a bid in response to the requirements of the Bidding Documents. (2016 revised IRR, Section 5[d])

Bidding Documents – The documents issued by the Procuring Entity as the bases for bids, furnishing all information necessary for a prospective bidder to prepare a bid for the Goods, Infrastructure Projects, and/or Consulting Services required by the Procuring Entity. (2016 revised IRR, Section 5[e])

BIR – Bureau of Internal Revenue.

BSP – Bangko Sentral ng Pilipinas.

CDA – Cooperative Development Authority.

Consulting Services – Refer to services for Infrastructure Projects and other types of projects or activities of the GOP requiring adequate external technical and professional expertise that are beyond the capability and/or capacity of the GOP to undertake such as, but not limited to: (i) advisory and review services; (ii) pre-investment or feasibility studies; (iii) design; (iv) construction supervision; (v) management and related services; and (vi) other technical services or special studies. (2016 revised IRR, Section 5[i])

Contract – Refers to the agreement entered into between the Procuring Entity and the Supplier or Manufacturer or Distributor or Service Provider for procurement of Goods and Services; Contractor for Procurement of Infrastructure Projects; or Consultant or Consulting Firm for Procurement of Consulting Services; as the case may be, as recorded in the Contract Form signed by the parties, including all attachments and appendices thereto and all documents incorporated by reference therein.

Contractor – is a natural or juridical entity whose proposal was accepted by the Procuring Entity and to whom the Contract to execute the Work was awarded. Contractor as used in these Bidding Documents may likewise refer to a supplier, distributor, manufacturer, or consultant.

CPI – Consumer Price Index.

DOLE – Department of Labor and Employment.

DTI – Department of Trade and Industry.

Foreign-funded Procurement or Foreign-Assisted Project – Refers to procurement whose funding source is from a foreign government, foreign or international financing institution as

specified in the Treaty or International or Executive Agreement. (2016 revised IRR, Section 5[b]).

GFI – Government Financial Institution.

GOCC – Government-owned and/or –controlled corporation.

Goods – Refer to all items, supplies, materials and general support services, except Consulting Services and Infrastructure Projects, which may be needed in the transaction of public businesses or in the pursuit of any government undertaking, project or activity, whether in the nature of equipment, furniture, stationery, materials for construction, or personal property of any kind, including non-personal or contractual services such as the repair and maintenance of equipment and furniture, as well as trucking, hauling, janitorial, security, and related or analogous services, as well as procurement of materials and supplies provided by the Procuring Entity for such services. The term "related" or "analogous services" shall include, but is not limited to, lease or purchase of office space, media advertisements, health maintenance services, and other services essential to the operation of the Procuring Entity. (2016 revised IRR, Section 5[r])

GOP – Government of the Philippines.

Infrastructure Projects – Include the construction, improvement, rehabilitation, demolition, repair, restoration or maintenance of roads and bridges, railways, airports, seaports, communication facilities, civil works components of information technology projects, irrigation, flood control and drainage, water supply, sanitation, sewerage and solid waste management systems, shore protection, energy/power and electrification facilities, national buildings, school buildings, hospital buildings, and other related construction projects of the government. Also referred to as *civil works or works*. (2016 revised IRR, Section 5[u])

LGUs – Local Government Units.

NFCC – Net Financial Contracting Capacity.

NGA – National Government Agency.

PCAB – Philippine Contractors Accreditation Board.

PhilGEPS - Philippine Government Electronic Procurement System.

Procurement Project – refers to a specific or identified procurement covering goods, infrastructure project or consulting services. A Procurement Project shall be described, detailed, and scheduled in the Project Procurement Management Plan prepared by the agency which shall be consolidated in the procuring entity's Annual Procurement Plan. (GPPB Circular No. 06-2019 dated 17 July 2019)

PSA – Philippine Statistics Authority.

SEC – Securities and Exchange Commission.

SLCC – Single Largest Completed Contract.

UN – United Nations.

SECTION I

INVITATION TO BID

BAGONG PILIPINAS

PHILIPPINE PORTS AUTHORITY

INVITATION TO BID

FOR THE

BATARAZA PORT EXPANSION PROJECT, PORT OF BATARAZA, BRGY. BULILUYAN, BATARAZA, PALAWAN

The Philippine Ports Authority, through the Corporate Budget of the Authority for CY 2024, intends to apply the sum of **P126,311,651.23** being the Approved Budget for the Contract (ABC) to payments under the contract for the **BATARAZA PORT EXPANSION PROJECT, PORT OF BATARAZA, BRGY. BULILUYAN, BATARAZA, PALAWAN (HO-INFRA-PPDD-24-0086)**. Bids received in excess of the ABC shall be automatically rejected at bid opening.

The Philippine Ports Authority now invites bids for the above Procurement Project. Completion of the Works is required in **Four Hundred Fifty (450) calendar days** from the receipt by the successful bidder of the Notice to Proceed. Bidders should have completed a contract similar to the Project. The description of an eligible bidder is contained in the Bidding Documents, particularly, in Section II (Instructions to Bidders).

Bidding will be conducted through open competitive bidding procedures using a non-discretionary "pass/fail" criterion as specified in the 2016 Revised Implementing Rules and Regulations (IRR) of Republic Act (RA) 9184.

Interested bidders may obtain further information from the Philippine Ports Authority Bids and Awards Committee (BAC) and inspect the Bidding Documents at the address given below from 8:00 a.m. to 5:00 p.m., Monday to Friday.

A complete set of Bidding Documents may be acquired by interested Bidders on **13 December 2024** from the given address and website(s) below and upon payment of the applicable fee for the Bidding Documents, pursuant to the latest Guidelines issued by the GPPB, in the amount of **FIFTY THOUSAND PESOS (P50,000.00)**. The Procuring Entity shall allow the bidder to present its proof of payment for the fees in person.

The Philippine Ports Authority's Bids and Awards Committee will hold a Pre-Bid Conference on **06 January 2025 at 10:00 a.m.** at the PPA Function Room, 7th Floor, PPA Bldg., Bonifacio Drive, South Harbor, Port Area, Manila, which shall be open to all prospective bidders.

Bids must be duly received by the BAC Secretariat through manual submission at the office address indicated below on or before **20 January 2025 at 1:00 p.m.** Late bids shall not be accepted.

All bids must be accompanied by a bid security in any of the acceptable forms and in amount stated in ITB Clause 16.

Bid opening shall be on **20 January 2025 at 2:00 p.m.** at the 7th Floor, PPA Building, A. Bonifacio Drive, South Harbor, Port Area, Manila. Bids will be opened in the presence of the bidders' representatives who choose to attend the activity.

The Philippine Ports Authority reserves the right to reject any and all bids, declare a failure of bidding, or not award the contract at any time prior to contract award in accordance with Sections 35.6 and 41 of the 2016 revised Implementing Rules and Regulations of RA No. 9184, without thereby incurring any liability to the affected bidder or bidders.

- **Required PCAB Registration: MEDIUM A - Port, Harbor & Offshore Engineering**

For further information, please refer to:

BAC Secretariat, Philippine Ports Authority
5th Floor, PPA Bldg., A. Bonifacio Drive,
South Harbor, Port Area, Manila
Telephone Nos. 8 527-47-35
8 527-83-56 to 83 loc. 539
PPA Website: www.ppa.com.ph
PhilGEPS Website: www.philgeps.gov.ph

MARK JON S. PALOMAR
Chairperson, PPA Head Office Bids and Awards
Committee for Engineering Projects (HO-BAC-EP)

SECTION II

INSTRUCTIONS TO BIDDERS

1. Scope of Bid

The Procuring Entity, ***Philippine Ports Authority*** invites Bids for the ***Bataraza Port Expansion Project, Port of Bataraza, Brgy. Buliluyan, Bataraza, Palawan*** with Project Identification Number ***HO-INFRA-PPDD-24-0086.***

The ***Bataraza Port Expansion Project, Port of Bataraza, Brgy. Buliluyan, Bataraza, Palawan*** is for the construction of Works, as described in Section VI (Specifications).

2. Funding Information

2.1. The ***Philippine Ports Authority*** through the source of funding as indicated below for ***CY2024*** in the amount of **₱126,311,651.23**.

2.2. The source of funding is:

PPA Corporate Fund.

3. Bidding Requirements

The Bidding for the Project shall be governed by all the provisions of RA No. 9184 and its 2016 revised IRR, including its Generic Procurement Manual and associated policies, rules and regulations as the primary source thereof, while the herein clauses shall serve as the secondary source thereof.

Any amendments made to the IRR and other GPPB issuances shall be applicable only to the ongoing posting, advertisement, or invitation to bid by the BAC through the issuance of a supplemental or bid bulletin.

The Bidder, by the act of submitting its Bid, shall be deemed to have inspected the site, determined the general characteristics of the contracted Works and the conditions for this Project, such as the location and the nature of the work; (b) climatic conditions; (c) transportation facilities; (c) nature and condition of the terrain, geological conditions at the site communication facilities, requirements, location and availability of construction aggregates and other materials, labor, water, electric power and access roads; and (d) other factors that may affect the cost, duration and execution or implementation of the contract, project, or work and examine all instructions, forms, terms, and project requirements in the Bidding Documents.

4. Corrupt, Fraudulent, Collusive, Coercive, and Obstructive Practices

The Procuring Entity, as well as the Bidders and Contractors, shall observe the highest standard of ethics during the procurement and execution of the contract. They or through an agent shall not engage in corrupt, fraudulent, collusive, coercive, and obstructive practices defined under Annex "I" of the 2016 revised IRR of RA No. 9184 or other integrity violations in competing for the Project.

5. Eligible Bidders

5.1 Only Bids of Bidders found to be legally, technically, and financially capable will be evaluated.

5.2 The Bidder must have an experience of having completed a Single Largest Completed Contract (SLCC) that is similar to this Project, equivalent to at least fifty percent (50%) of the ABC adjusted, if necessary, by the Bidder to current prices using the PSA's CPI, except under conditions provided for in Section 23.4.2.4 of the 2016 revised IRR of RA No. 9184.

A contract is considered to be "similar" to the contract to be bid if it has the major categories of work stated in the **BDS**.

5.3. For Foreign-funded Procurement, the Procuring Entity and the foreign government/foreign or international financing institution may agree on another track record requirement, as specified in the Bidding Document prepared for this purpose.

5.4. The Bidders shall comply with the eligibility criteria under Section 23.4.2 of the 2016 IRR of RA No. 9184.

6. Origin of Associated Goods

There is no restriction on the origin of Goods other than those prohibited by a decision of the UN Security Council taken under Chapter VII of the Charter of the UN.

7. Subcontracts

7.1. The Bidder may subcontract portions of the Project to the extent allowed by the Procuring Entity as stated herein, but in no case more than fifty percent (50%) of the Project.

The Procuring Entity has prescribed that:

Subcontracting is not allowed.

7.2. Subcontracting of any portion of the Project does not relieve the Contractor of any liability or obligation under the Contract. The Supplier will be responsible for the acts, defaults, and negligence of any subcontractor, its agents, servants, or workmen as fully as if these were the Contractor's own acts, defaults, or negligence, or those of its agents, servants, or workmen.

8. Pre-Bid Conference

The Procuring Entity will hold a pre-bid conference for this Project on the specified date and time and either at its physical address and/or through videoconferencing/webcasting as indicated in paragraph 6 of the **IB.**

9. Clarification and Amendment of Bidding Documents

Prospective bidders may request for clarification on and/or interpretation of any part of the Bidding Documents. Such requests must be in writing and received by the Procuring Entity, either at its given address or through electronic mail indicated in the **IB**, at least ten (10) calendar days before the deadline set for the submission and receipt of Bids.

10. Documents Comprising the Bid: Eligibility and Technical Components

10.1 The first envelope shall contain the eligibility and technical documents of the Bid as specified in **Section IX. Checklist of Technical and Financial Documents.**

10.2 If the eligibility requirements or statements, the bids, and all other documents for submission to the BAC are in foreign language other than English, it must be accompanied by a translation in English, which shall be authenticated by the appropriate Philippine foreign service establishment, post, or the equivalent office having jurisdiction over the foreign bidder's affairs in the Philippines. For Contracting Parties to the Apostille Convention, only the translated documents shall be authenticated through an apostille pursuant to GPPB Resolution No. 13-2019 dated 23 May 2019. The English translation shall govern, for purposes of interpretation of the bid.

10.3 A valid PCAB License is required, and in case of joint ventures, a valid special PCAB License, and registration for the type and cost of the contract for this Project. Any additional type of Contractor license or permit shall be indicated in the **BDS**.

10.4 A List of Contractor's key personnel (e.g., Project Manager, Project Engineers, Materials Engineers, and Foremen) assigned to the contract to be bid, with their complete qualification and experience data shall be provided. These key personnel must meet the required minimum years of experience set in the **BDS**.

10.5 A List of Contractor's major equipment units, which are owned, leased, and/or under purchase agreements, supported by proof of ownership, certification of availability of equipment from the equipment lessor/vendor for the duration of the project, as the case may be, must meet the minimum requirements for the contract set in the **BDS**.

11. Documents Comprising the Bid: Financial Component

11.1. The second bid envelope shall contain the financial documents for the Bid as specified in Section **IX. Checklist of Technical and Financial Documents**.

11.2. Any bid exceeding the ABC indicated in paragraph 1 of the **IB** shall not be accepted.

11.3. For Foreign-funded procurement, a ceiling may be applied to bid prices provided the conditions are met under Section 31.2 of the 2016 revised IRR of RA No. 9184.

12. Alternative Bids

Bidders shall submit offers that comply with the requirements of the Bidding Documents, including the basic technical design as indicated in the drawings and specifications. Unless there is a value engineering clause in the BDS, alternative Bids shall not be accepted.

13. Bid Prices

All bid prices for the given scope of work in the Project as awarded shall be considered as fixed prices, and therefore not subject to price escalation during contract implementation, except under extraordinary circumstances as determined by the NEDA and approved by the GPPB pursuant to the revised Guidelines for Contract Price Escalation guidelines.

14. Bid and Payment Currencies

14.1. Bid prices may be quoted in the local currency or tradeable currency accepted by the BSP at the discretion of the Bidder. However, for purposes of bid evaluation, Bids denominated in foreign currencies shall be converted to Philippine currency based on the exchange rate as published in the BSP reference rate bulletin on the day of the bid opening.

14.2. *Payment of the contract price shall be made in:*

Philippine Pesos.

15. Bid Security

15.1. The Bidder shall submit a Bid Securing Declaration or any form of Bid Security in the amount indicated in the BDS, which shall be not less than the percentage of the ABC in accordance with the schedule in the BDS.

15.2. The Bid and bid security shall be valid until **One Hundred Twenty (120) days from the date set for Bid Opening.** Any bid not accompanied by an acceptable bid security shall be rejected by the Procuring Entity as non-responsive.

16. Sealing and Marking of Bids

Each Bidder shall submit one copy of the first and second components of its Bid.

The Procuring Entity may request additional hard copies and/or electronic copies of the Bid. However, failure of the Bidders to comply with the said request shall not be a ground for disqualification.

If the Procuring Entity allows the submission of bids through online submission to the given website or any other electronic means, the Bidder shall submit an electronic copy of its Bid, which must be digitally signed. An electronic copy that cannot be opened or is corrupted shall be considered non-responsive and, thus, automatically disqualified.

17. Deadline for Submission of Bids

The Bidders shall submit on the specified date and time and either at its physical address or through online submission as indicated in paragraph 7 of the **IB**.

18. Opening and Preliminary Examination of Bids

18.1. The BAC shall open the Bids in public at the time, on the date, and at the place specified in paragraph 9 of the **IB**. The Bidders' representatives who are present shall sign a register evidencing their attendance. In case videoconferencing, webcasting or other similar technologies will be used, attendance of participants shall likewise be recorded by the BAC Secretariat.

In case the Bids cannot be opened as scheduled due to justifiable reasons, the rescheduling requirements under Section 29 of the 2016 revised IRR of RA No. 9184 shall prevail.

18.2. The preliminary examination of Bids shall be governed by Section 30 of the 2016 revised IRR of RA No. 9184.

19. Detailed Evaluation and Comparison of Bids

19.1. The Procuring Entity's BAC shall immediately conduct a detailed evaluation of all Bids rated "passed" using non-discretionary pass/fail criteria. The BAC shall consider the conditions in the evaluation of Bids under Section 32.2 of 2016 revised IRR of RA No. 9184.

19.2. If the Project allows partial bids, all Bids and combinations of Bids as indicated in the **BDS** shall be received by the same deadline and opened and evaluated simultaneously so as to determine the Bid or combination of Bids offering the lowest calculated cost to the Procuring Entity. Bid Security as required by **ITB** Clause 16 shall be submitted for each contract (lot) separately.

19.3 In all cases, the NFCC computation pursuant to Section 23.4.2.6 of the 2016 revised IRR of RA No. 9184 must be sufficient for the total of the ABCs for all the lots participated in by the prospective Bidder.

20. Post Qualification

Within a non-extendible period of five (5) calendar days from receipt by the Bidder of the notice from the BAC that it submitted the Lowest Calculated Bid, the Bidder shall submit its latest income and business tax returns filed and paid through the BIR Electronic Filing and Payment System (eFPS), and other appropriate licenses and permits required by law and stated in the **BDS**.

21. Signing of the Contract

The documents required in Section 37.2 of the 2016 revised IRR of RA No. 9184 shall form part of the Contract. Additional Contract documents are indicated in the **BDS**.

SECTION III

BID DATA SHEET

Bid Data Sheet

<table>
<tr><td>ITB Clause</td><td colspan="4"></td></tr>
<tr><td>5.2</td><td colspan="4">For this purpose, contracts similar to the Project refer to contracts which have the same Major Categories of Works which shall be:</td></tr>
<tr><td></td><td colspan="2">Description/Clarification</td><td>Unit of Measure</td><td>Quantity (at least)</td></tr>
<tr><td></td><td colspan="2">1. Offshore pile driving works
2. Reinforced Concrete Works</td><td>l.m.
cu.m.</td><td>2,991
408</td></tr>
<tr><td>7.1</td><td colspan="2">Portion of Works allowed to be subcontracted:

Subcontracting is not allowed</td><td colspan="2">Maximum Percentage allowed to be subcontracted:

Subcontracting is not allowed</td></tr>
<tr><td>10.3</td><td colspan="4">For Joint Venture:
Special PCAB License</td></tr>
<tr><td>10.4</td><td colspan="4">The key personnel must meet the required minimum years of experience set below:</td></tr>
<tr><td></td><td>Key Personnel</td><td>General Experience</td><td colspan="2">Relevant Experience (Minimum)</td></tr>
<tr><td></td><td>a. Project Manager
b. Project Engineer
c. Materials Engineer II
d. Construction Safety and Health Officer
e. Foreman</td><td></td><td colspan="2">Five (5) years
Three (3) years
One (1) year
One (1) year
Five (5) years</td></tr>
<tr><td>10.5</td><td colspan="4">The minimum major equipment requirements are the following:</td></tr>
<tr><td></td><td colspan="4">Please refer to Section 8, Annex 3 Minimum Major Equipment Requirements</td></tr>
</table>

12	*Value Engineering Clause:* **Not Allowed**
15.1	The bid security shall be in the form of a Bid Securing Declaration or any of the following forms and amounts: a. The amount of not less than ₱ **2,526,233.02,** if bid security is in cash, cashier's/manager's check, bank draft/guarantee or irrevocable letter of credit; b. The amount of not less than ₱ **6,315,582.56**, if bid security is in Surety Bond.
16	Each bidder shall submit one (1) original and six (6) copies of the Technical and Financial Proposals, properly labelled, book-bound, with hard cover and corresponding index tabs. Failure to comply with the requirements is a ground for the automatic disqualification of the bidder.
19.2	Partial bids: **Not Allowed**
20	*Other appropriate licenses and permits required:* **None**
21	*Other contract documents are as follows:* *Construction Schedule and S-Curve, Manpower Schedule, Construction Methods, Equipment Utilization Schedule, Construction Safety and Health Program approved by the Department of Labor and Employment and PERT/CPM or other acceptable tools of project scheduling.*

SECTION IV

GENERAL CONDITIONS OF CONTRACT

1. Scope of Contract

This Contract shall include all such items, although not specifically mentioned, that can be reasonably inferred as being required for its completion as if such items were expressly mentioned herein. All the provisions of RA No. 9184 and its 2016 revised IRR, including the Generic Procurement Manual, and associated issuances, constitute the primary source for the terms and conditions of the Contract, and thus, applicable in contract implementation. Herein clauses shall serve as the secondary source for the terms and conditions of the Contract.

This is without prejudice to Sections 74.1 and 74.2 of the 2016 revised IRR of RA No. 9184 allowing the GPPB to amend the IRR, which shall be applied to all procurement activities, the advertisement, posting, or invitation of which were issued after the effectivity of the said amendment.

2. Sectional Completion of Works

If sectional completion is specified in the **Special Conditions of Contract (SCC)**, references in the Conditions of Contract to the Works, the Completion Date, and the Intended Completion Date shall apply to any Section of the Works (other than references to the Completion Date and Intended Completion Date for the whole of the Works).

3. Possession of Site

4.1. The Procuring Entity shall give possession of all or parts of the Site to the Contractor based on the schedule of delivery indicated in the **SCC**, which corresponds to the execution of the Works. If the Contractor suffers delay or incurs cost from failure on the part of the Procuring Entity to give possession in accordance with the terms of this clause, the Procuring Entity's Representative shall give the Contractor a Contract Time Extension and certify such sum as fair to cover the cost incurred, which sum shall be paid by Procuring Entity.

4.2. If possession of a portion is not given by the above date, the Procuring Entity will be deemed to have delayed the start of the relevant activities. The resulting adjustments in contract time to address such delay may be addressed through contract extension provided under Annex "E" of the 2016 revised IRR of RA No. 9184.

4. The Contractor's Obligations

The Contractor shall employ the key personnel named in the Schedule of Key Personnel indicating their designation, in accordance with **ITB** Clause 10.3 and specified in the **BDS**, to carry out the supervision of the Works.

The Procuring Entity will approve any proposed replacement of key personnel only if their relevant qualifications and abilities are equal to or better than those of the personnel listed in the Schedule.

5. Performance Security

5.1. Within ten (10) calendar days from receipt of the Notice of Award from the Procuring Entity but in no case later than the signing of the contract by both parties, the successful Bidder shall furnish the performance security in any of the forms prescribed in Section 39 of the 2016 revised IRR.

5.2. The Contractor, by entering into the Contract with the Procuring Entity, acknowledges the right of the Procuring Entity to institute action pursuant to RA No. 3688 against any subcontractor be they an individual, firm, partnership, corporation, or association supplying the Contractor with labor, materials and/or equipment for the performance of this Contract.

6. Site Investigation Reports

The Contractor, in preparing the Bid, shall rely on any Site Investigation Reports referred to in the **SCC** supplemented by any information obtained by the Contractor.

7. Warranty

7.1. In case the Contractor fails to undertake the repair works under Section 62.2.2 of the 2016 revised IRR, the Procuring Entity shall forfeit its performance security, subject its property(ies) to attachment or garnishment proceedings, and perpetually disqualify it from participating in any public bidding. All payables of the GOP in his favor shall be offset to recover the costs.

7.2. The warranty against Structural Defects/Failures, except that occasioned-on force majeure, shall cover the period from the date of issuance of the Certificate of Final Acceptance by the Procuring Entity. Specific duration of the warranty is found in the **SCC**.

8. Liability of the Contractor

Subject to additional provisions, if any, set forth in the **SCC**, the Contractor's liability under this Contract shall be as provided by the laws of the Republic of the Philippines.

If the Contractor is a joint venture, all partners to the joint venture shall be jointly and severally liable to the Procuring Entity.

9. Termination for Other Causes

Contract termination shall be initiated in case it is determined prima facie by the Procuring Entity that the Contractor has engaged, before, or during the implementation of the contract, in unlawful deeds and behaviors relative to contract acquisition and implementation, such as, but not limited to corrupt, fraudulent, collusive, coercive, and obstructive practices as stated in **ITB** Clause 4.

10. Dayworks

Subject to the guidelines on Variation Order in Annex "E" of the 2016 revised IRR of RA No. 9184, and if applicable as indicated in the SCC, the Dayworks rates in the Contractor's Bid shall be used for small additional amounts of work only when the Procuring Entity's Representative has given written instructions in advance for additional work to be paid for in that way.

11. Program of Work

11.1. The Contractor shall submit to the Procuring Entity's Representative for approval the said Program of Work showing the general methods, arrangements, order, and timing for all the activities in the Works. The submissions of the Program of Work are indicated in the **SCC.**

11.2. The Contractor shall submit to the Procuring Entity's Representative for approval an updated Program of Work at intervals no longer than the period stated in the **SCC.** If the Contractor does not submit an updated Program of Work within this period, the Procuring Entity's Representative may withhold the amount stated in the **SCC** from the next payment certificate and continue to withhold this amount until the next payment after the date on which the overdue Program of Work has been submitted.

12. Instructions, Inspections and Audits

The Contractor shall permit the GOP or the Procuring Entity to inspect the Contractor's accounts and records relating to the performance of the Contractor and to have them audited by auditors of the GOP or the Procuring Entity, as may be required.

13. Advance Payment

The Procuring Entity shall, upon a written request of the Contractor which shall be submitted as a Contract document, make an advance payment to the Contractor in an amount not exceeding fifteen percent (15%) of the total contract price, to be made in lump sum, or at the most two installments according to a schedule specified in the **SCC,** subject to the requirements in Annex "E" of the 2016 revised IRR of RA No. 9184.

14. Progress Payments

The Contractor may submit a request for payment for Work accomplished. Such requests for payment shall be verified and certified by the Procuring Entity's Representative/Project Engineer. Except as otherwise stipulated in the **SCC,** materials and equipment delivered on the site but not completely put in place shall not be included for payment.

15. Operating and Maintenance Manuals

15.1. If required, the Contractor will provide "as built" Drawings and/or operating and maintenance manuals as specified in the **SCC.**

15.2. If the Contractor does not provide the Drawings and/or manuals by the dates stated above, or they do not receive the Procuring Entity's Representative's approval, the Procuring Entity's Representative may withhold the amount stated in the **SCC** from payments due to the Contractor.

SECTION V

SPECIAL CONDITIONS OF CONTRACT

Special Conditions of Contract

GCC Clause	
2	*Sectional Completion:* **None**
4.1	The Procuring Entity shall give possession of all parts of the Site to the Contractor upon commencement of the project.
6	*Site Investigation Report:* **None**
7.2	*Permanent structures: Fifteen (15) years* Buildings of types 4 and 5 as classified under the National Building Code of the Philippines and other structures made of steel, iron, or concrete which comply with relevant structural codes (e.g., DPWH Standard Specifications), such as, but not limited to, steel/concrete bridges, flyovers, aircraft movement areas, ports, dams, tunnels, filtration and treatment plants, sewerage systems, power plants, transmission and communication towers, railway system, and other similar permanent structures
10	No dayworks are applicable to the contract.
11.1	The Contractor shall submit the Program of Work to the Procuring Entity's Representative within ____ days of delivery of the Notice of Award.
11.2	The amount to be withheld for late submission of an updated Program of Work is _____.
13	The provision on advance payments or mobilization fees in the terms and conditions of all contracts/ purchase orders/ job orders for goods, services and infrastructure projects that will be signed or executed shall henceforth be excluded.
14	No further instructions.
15.1	The date by which operating and maintenance manuals are required is _____. The date by which "as built" drawings are required is _____.
15.2	The amount to be withheld for failing to produce "as built" drawings and/or operating and maintenance manuals by the date required is _____.

SECTION VI

TECHNICAL SPECIFICATIONS

ITEM 01 : DEMOLITION AND REMOVAL WORKS

DESCRIPTION

The work includes the furnishing of all labor, materials and equipment required to carry out the demolition and removal of old structures, port accessories and obstructions including demolition of miscellaneous concrete curbs etc., as required for the execution of the Contract.

The Contractor shall submit the proposed methodology or procedure of demolition work with detailed drawings and calculations if necessary, to the Engineer for approval, before the execution of the Works.

The Contractor shall keep all pavements and landing areas to and from the site of the disposal area clean and free of mud, dirt and debris during and after the execution of disposal. Disposal of debris and materials shall be as directed by the Engineer.

GENERAL PROVISIONS

1. The Contractor shall be deemed to have satisfied himself of the site conditions, and to have included in his unit prices provision for all risks that may arise during or in connection with the work.

2. The demolition shall be carried out by approved methods and equipment such as concrete breakers, gas-cutters, hydraulic jacks, compressed air disintegrators, etc., however, no blasting shall be used unless approved in writing by the Engineer and after obtaining the written permission of the concerned authorities.

3. The Contractor shall provide suitable equipment, skilled labor and appropriate temporary works such as scaffoldings to ensure safety in his demolition works as well as in the adjacent area.

4. Contractor shall demolish all the structural members above the level on which the subsequent and permanent works under this Contract will begin. To this end, the temporary construction works such as excavation shall be conducted by the Contractor.

5. Materials coming from the demolition works, except general earth, shall remain the property of the Procuring Entity, the designated part of which shall be stored by the Contractor at places specified by the Engineer/ Accepting authority. Receiving copy of Turn-Over Report shall be provided.

6. In case of demolition of wharf deck and platform, the contractor shall ensure that no debris will be remained/deposited at seabed.

INTERFERENCE WITH PORT OPERATIONS

During the execution of the work, the Contractor shall not interfere with the shipping, navigation and other traffic in the port.

The Contractor shall make arrangements with the operations people on the schedule of demolition and related works to keep port operation activities undisturbed at all times.

Prior to commencement of the demolition works, the Contractor shall inform/announce to port users the schedule of disconnection of utilities.

STORAGE AND DUMPING

Prior to the commencement of the demolition work, the Engineer shall submit to the Contractor a list in which all the materials to be salvaged and overhauled, as property of PPA, and the description of the location of their storage. Materials embedded in concrete units shall not be salvaged.

The Contractor shall separate materials to be salvaged from debris. Salvaged materials shall be loaded, transported and unloaded by the Contractor at the specified locations.

The Contractor may dump debris or extracted rocks on land areas but out of the site, which areas shall be procured and prepared at his own expense. In this case, safety measures shall be undertaken in the transporting, unloading, covering and others as requested by the Engineer.

The approximate distance of the disposal site from the project site is about five (5) kms., as designated by the PMO thru the implementing office.

EXECUTION

1. Prior to the commencement of demolition works, the alignments of the new construction works to existing structure shall be checked.

2. The width and alignment of portion of existing structure to be demolished shall be marked by paint.

3. With these lines as guides, concrete shall be broken and reinforcing bars cut, such that panels or portions of the structure can be lifted out for disposal elsewhere outside of the operational work area.

4. Rocks removed from existing slope protection shall be stored for re-use in new construction.

5. Demolish pavements, curbs, fences, utilities, services, navigation aids and the likes as determined in the field for each project and as shown on the drawings or as directed by the Engineer.

6. Materials coming from the demolition works shall be properly disposed by the Contractor.

SAFETY

During the course of survey and clearing, any obstacles which are recognized and seemed to be explosive or hazardous to workers shall be removed from the site by the proper Authority.

At the end of each day's work, the Contractor shall keep the workplace in safe condition and clean so that no part is in danger of falling or creating hazard to personnel or equipment.

ITEM 02 : PILING WORKS (PRE-STRESSED CONCRETE PILES)

SCOPE OF WORK

This section covers the minimum requirements for the fabrication, hauling, spotting, driving and finishing of all foundation piles to be used in wharves/piers/platforms/pile anchor.

The Contractor may however, adopt, in addition to this minimum requirements additional provisions as may be necessary to insure the successful prosecution of the work related to foundation piling.

METHOD STATEMENT

Before the commencement of any piling works, the Contractor shall submit (allowing sufficient time for consideration) to the Engineer for approval a Safety Policy and a Method Statement which shall include the following information:

1. Program of Works detailing sequence and timing of individual portions of works.

2. Maximum proposed lead at any stage of driving between a pile and its neighbor and the limitations of same if hard driving is encountered.

3. Contingency plan in the event of encountering obstructions or reaching driving refusal to minimize disruption/delay especially when using pitch and drive methods.

MATERIAL REQUIREMENTS

TYPE OF FOUNDATION PILES

Pre-stressed concrete foundation piles to be used shall be in accordance with the design as shown on the Drawings and called for in the proposal.

PRE-STRESSED CONCRETE PILES

Pre-stressed concrete piles shall be constructed in accordance with the standard practice employed for the particular system specified and as directed by the Engineer subject to the following clauses.

1. Pre-stressed concrete piles shall be of readymade products of approved fabricator regularly engaged in the production of pre-stressed concrete piles.

2. If an alternative system of pre-stressing to that shown in the Drawings is proposed by the Contractor, full details, procedures and explanations shall be submitted in writing to the Engineer for his approval. When approved for the work, the provisions of this Specification and such other provisions as he may require shall be fully satisfied.

3. Concrete strength, high tension wires/strands, reinforcing bars to be used for pre-stressed concrete work shall be as specified in the Drawings.

4. The Contractor shall submit the casting method including pre-stressing, application of stress and casting schedule and shall obtain the approval of the Engineer before commencement of fabrication of the piles.

5. The Contractor shall arrange for the Engineer to have free access to the place of manufacture of the piles.

6. Piles shall be cast on a horizontal platform in approved steel moulds and details of the formwork and methods of concreting shall be as specified. The concreting of each pile shall be completed on one continuous operation and no interruption shall be permitted.

   The pile butt must be formed truly square to the axis of the pile. Provision for standard splicing shall be provided unless otherwise ordered by the Engineer.

7. Anchorages shall be made from steel of a suitable quality to withstand permanently the forces imposed upon them, and shall in general be in accordance with the normal practice of the proprietors of the pre-stressing system in use.

8. Application of stress, grouting of pre-stressing cables, protection of pre-stressing cable anchorages and other necessary steps to complete the pre-stressing process shall conform to the standard practice of the pre-stressing system in use or as directed by the Engineer.

9. When the stress has been transferred to the pile, the pile shall exhibit no curvature in its length on any face greater than 3 millimeters deviation along a chord of 15 meters (1 in 500).

10. Pre-cast pre-stressed units shall be lifted only by lifting holes/hook as indicated in the Drawings, or when not provided can be lifted by slings placed securely at corresponding points. Units shall be kept in the upright position at all times and shock shall be avoided. Any unit considered by the Engineer to have become sub-standard in any way shall be rejected and replaced by an acceptable unit.

11. Each pre-stressed member is to be uniquely and permanently marked to show its type, date of casting, length of pile and any control markings as ordered by the Engineer

12. Forms shall conform to the geometry of the pile with the provision of chamfer as shown on the Drawings.

13. Not less than five (5) cylindrical specimens shall be made for each casting batch of which at least two (2) shall be reserved for 28-day test, one (1) for 7-day, one (1) for 14-day, and one (1) test prior to lifting of pre-stressed concrete piles from the casting bed. Lifting of piles shall only be done if the result of the compressive strength has reached at least 60% of the specified compressive strength.

14. Wires/strands specifications shall be in accordance with ASTM A 416.

EXECUTION

HANDLING OF PILES

All piles shall be carefully lifted at the location of the lifting points as indicated in the Drawings. Other practical and convenient methods may be used subject to the approval of the Engineer.

DRIVING OF PILES

A hydraulic or diesel pile hammer shall be used for driving the pre-stressed concrete piles.

The required weight of ram for the hydraulic or diesel pile hammer, ranges from 3.5 to 4.5 tons.

Piles driven shall be held firmly in position in axial alignment with the hammer by means of leads of adequate length. Approved cushions shall be provided to the pile butts.

PILE SPLICING

General Provision

1. The alignment of piles shall be plumb and the length of upper and lower segment shall be in accordance in the approved plans.

2. The splice shall be embedded at least 4m from the design depth elevation.

Surface Preparation

Concrete piles to be bonded must be thoroughly cleaned, free of dirt, paint, grease, oil, curing compound and other contaminants. The concrete surface must be dry. Clean the dowels with steel brush to removed rust and other impurities. Blow compressed air to the dowel holes.

Pile Splicing Epoxy

Piling splicing epoxy is a two components, low viscosity, rapid cure, chemical resistant epoxy with high physical strength.

Preparation and Application of Epoxy Mortar

Mixing and ratio of pile splicing epoxy and dry silica sand, application and curing of epoxy mortar shall refer to product manual.

Compressive Strength

The compressive strength of epoxy mortar (Pile Splicing Epoxy + Dry Silica Sand) shall be at least 1.2 times the design compressive strength of pile or 6,000psi.

Mechanical Properties of Epoxy

Cured state at 27° C (80° F) for 24 hours

Mechanical Properties	**Specification (Test Methods)**
Ultimate Tensile Strength	ASTM D 638
Ultimate Flexural Strength	ASTM D 790
Hardness	ASTM D 2240
Compressive Strength at 1 hour cure	ASTM D 695
Compressive Strength with Silica Sand	**ASTM D 695**

PILE CHIPPING

Each pile shall be chipped-off to required elevation as indicated in the drawing. The contractor shall ensure that no damaged/cracked on the main pile will occurred after each chipping. Reinforcement from driven piles (dowels and strand) shall not be cut and will be incorporated to the construction of deck. Splicing of dowels are allowed in case of pile cutting due to early refusal.

BEARING POWER OF PILES

Each pile shall be driven to attain not less than the required minimum bearing power shown in the pile schedule, as determined by the Hiley's Formula as follows:

For Diesel Pile Hammer : $$R = \frac{1}{6} \times \frac{2WH}{S + 2.54}$$

For Hydraulic Pile Hammer : $R = \frac{1}{3} \times \frac{2WH}{S + 2.54}$

where : R = allowable bearing capacity of pile (tf)

W = weight of ram (tf)

H = fall of ram (cm)

S = set (cm)

INTERRUPTED DRIVING

When driving is stopped before final penetration is reached and/or refusal is attained, the record of pile penetration shall be taken only after a minimum of 30 cm. (12 in.) total penetration has been obtained on resumption of driving.

ALIGNMENT TOLERANCE

Piles driven shall be within the allowable tolerance in alignment of 10 cm. (4 in.) in any direction.

DAMAGED AND MISDRIVEN PILES

1. Piles shall not be more than 10 cm. (4 in.) out of place at cut-off level. All vertical piles shall not be more than 2% out of plumb.

2. Any pile damaged by improper driving or driven out of its proper location, or driven out of elevation fixed on the plans, shall be corrected correspondingly at the Contractor's expense by any of the following methods:

    a. Withdrawal of the pile and replacement by a new pile.

    b. Driving a second pile adjacent to the defective one.

    c. Splicing an additional length.

The method to be adopted in each case shall be at the discretion of the Engineer.

OBSTRUCTION

Where boulders or other obstructions make it impossible to drive certain piles in the location shown and to the required bearing strata, the Engineer may order additional pile or piles driven at other suitable location.

RECORDS

The Contractor shall keep records of each pile driven and shall furnish the Engineer two (2) signed typewritten/computerized copies. The records shall show the number of blows per 0.50 m. of initial penetration taken from the free fall elevation of the pile down to penetration depth of 5.0 m., the penetration under the last 10 blows, and the calculated safe load according to the Hiley's Formula as stated in bearing power of piles.

TESTING OF MATERIALS

The requirements regarding testing of concrete and reinforcement used in reinforced concrete piles shall be in accordance with "Reinforced Concrete".

However, the Engineer may conduct the necessary testing at the approved fabricator's casting yard whenever he considers necessary. Tests shall be carried out at the Contractor's expense.

High Tensile Strand shall be tested according to the latest ASTM Standard and PPA Circular

STORAGE AND HANDLING OF PILES

When raising or transporting piles, the Contractor shall provide slings or other equipment to avoid any appreciable bending of the pile or cracking of the concrete. Pile materials damaged in handling or driving shall be removed from the site and replaced by the Contractor at his expense.

Concrete piles shall be so handled at all times as to avoid breaking or chipping of the edges.

ITEM 03 : REINFORCED CONCRETE

SCOPE OF WORK

All works falling under this Section shall include reinforced concrete for all kinds and parts of any reinforced concrete structure.

GENERAL PROVISIONS

1. Full cooperation shall be given to the other trades to install embedded items. Suitable templates or instructions will be provided for setting, items shall have been inspected, and tests for concrete or other materials or for mechanical operations shall have been completed and approved.

2. The following publications of the issues listed below, but referred to thereafter by basic designation only, form as an integral part of this Specification to the extent indicated by the reference thereto:

   a. American Concrete Institute (ACI) Standards:

ACI 117	Standard Specifications for Tolerances for Concrete Construction and Materials
ACI 121R	Quality Management System for Concrete Construction
ACI 201.2R	Guide to Durable Concrete
ACI 211.1	Standard Practice for Selecting Proportions for Normal, Heavyweight, and Mass Concrete
ACI 214R	Recommended Practice for Evaluation of Strength Test Results of Concrete
ACI 301	Specifications for Structural Concrete
ACI 304.2R	Placing Concrete by Pumping Methods
ACI 304R	Guide for Measuring, Mixing, Transporting, and Placing Concrete
ACI 305R	Hot Weather Concreting
ACI 306.1	Standard Specification for Cold Weather Concreting
ACI 308R	Guide to Curing Concrete
ACI 309R	Guide for Consolidation of Concrete
ACI 311.4R	Guide for Concrete Inspection
ACI 318M	Metric Building Code Requirements for Structural Concrete and Commentary

ACI 347 Guide to Formwork for Concrete

ACI SP-15 Field Reference Manual: Standard Specifications for Structural Concrete with Selected ACI and ASTM References

ACI SP-2 ACI Manual of Concrete Inspection

b. American Society for Testing and Materials (ASTM) Publications:

ASTM C 150 Standard Specification for Portland Cement

ASTM C 114 Standard Method for Chemical Analysis of Hydraulic Cement

ASTM C 185 Standard Method for Air Content of Hydraulic Cement

ASTM C 115 Standard Test Method for Fineness of Portland Cement by the Turbidimeter

ASTM C 204 Standard Test Method for Fineness of Hydraulic Cement by Air-Permeability Apparatus

ASTM C 151 Standard Test Method for Autoclave Expansion of Portland Cement

ASTM C 109 Standard Test Method for Compressive Strength of Hydraulic Cement Mortars

ASTM C 266 Standard Test Method for Time of Setting of Hydraulic-Cement Paste Gilmore Needles

ASTM C 191 Standard Test Method of Time Setting of Hydraulic Cement by Vicat Needle

ASTM C 33 Standard Specification for Concrete Aggregates

ASTM C 136 Standard Test Method for Sieve Analysis of Fine and Coarse Aggregates

ASTM C 117 Standard Test Method for Materials Finer than 75 micron (No. 200) Sieve in Mineral Aggregates by Washing

ASTM C 29 Standard Test Method for Bulk Density (Unit Weight") and Voids in Aggregate

ASTM C 128 Standard Test Method for Density, Relative Density (Specific Gravity), and Absorption of Fine Aggregates

ASTM C 87 Standard Test Method for Effect of Organic Impurities in Fine Aggregate on Strength of Mortar

ASTM C 88 Standard Test Method for Soundness of Aggregates by Use of Sodium Sulfate or Magnesium Sulfate

ASTM C 142	Standard Test Method for Clay Lumps and Friable Particles in Aggregates
ASTM C 97	Standard Test Method for Absorption and Bulk Specific Gravity of Dimension Stone
ASTM C 127	Test Method for Specific Gravity and Absorption of Coarse Aggregate
ASTM C 535	Standard Test Method for Resistance to Degradation of Large-Size Aggregate by Abrasion and Impact in the Los Angeles Machine
ASTM C 88	Standard Test Method for Soundness of Aggregates by Use of Sodium Sulfate or Magnesium Sulfate
ASTM C 131	Test Method for Resistance to Degradation of Small-size Coarse Aggregate by Abrasion and Impact in the Los Angeles Machine
ASTM C 94	Standard Specification for Ready-Mixed Concrete
ASTM D 512	Chloride Ion in Water
ASTM D 516	Sulfate Ion in Water
ASTM A 615	Standard Specification for Deformed and Plain Carbon-Steel Bars for Concrete Reinforcement
ASTM A 370	Standard Test Methods and Definitions for Mechanical Testing of Steel Products
ASTM A 510	Standard Specification for General Requirements for Wire Rods and Coarse Round Wire, Carbon Steel
ASTM A 6	Standard Specification for General Requirements for Rolled Structural Steel Bars, Plates, Shapes, and Sheet Piling
ASTM C 31	Standard Practice for Making and Curing Concrete Test Specimens in the Field
ASTM C 39	Standard Test Method for Compressive Strength of Cylindrical Concrete Specimens
ASTM C 172	Standard Practice for Sampling Freshly Mixed Concrete
ASTM C 192	Standard Practice for Making and Curing Concrete Test Specimens in the Laboratory
ASTM C 293	Standard Test Method for Flexural Strength of Concrete (Using Simple Beam with Center-Point Loading)
ASTM C 78	Standard Test Method for Flexural Strength of Concrete (Using Simple Beam with Third-Point Loading)
ASTM C 42	Standard Test Method for Obtaining and Testing Drilled Cores and Sawed Beams of Concrete

ASTM C 174 Standard Test Method for Measuring Thickness of Concrete Elements Using Drilled Concrete Cores

ASTM C 143 Standard Test Method for Slump of Hydraulic-Cement Concrete

ASTM C 494 Standard Specification for Chemical Admixtures for Concrete

ASTM C 1017 Standard Specification for Chemical Admixtures for use in Producing Flowing Concrete

ASTM C 171 Standard Specification for Sheet Materials for Curing Concrete

ASTM C 309 Standard Specification for Liquid Membrane-Forming Compounds for Curing Concrete

ASTM 5329 Standard Test Methods for Sealants and Fillers, Hot Applied, For Joints and Cracks in Asphaltic and Portland Cement Concrete Pavements

ASTM D 5167 Standard Practice for Melting of Hot Applied Joint and Crack Sealant and Filler for Evaluation

ASTM A 706 Standard Specification for Low-Alloy Steel Deformed and Plain Bars for Concrete Reinforcement

ASTM A 966 Standard Test Method for Magnetic Particle Examination of Steel Forgings using Alternating Current

ASTM C 1064 Standard Test Method for Temperature of Freshly Mixed Hydraulic-Cement Concrete

ASTM C 1077 Standard Practice for Laboratories Testing Concrete and Concrete Aggregates for use in Construction and Criteria for Laboratory Evaluation

ASTM C 1107 Standard Specification for Packaged Dry, Hydraulic-Cement Grout (Non-shrink)

ASTM C 1116 Standard Specification for Fiber-Reinforced Concrete

ASTM C 1157 Standard Specification for Hydraulic Cement

ASTM C 138 Standard Test Method for Density ("Unit Weight"), Yield, and Air Content (Gravimetric) of Concrete

ASTM C 173 Standard Test Method for Air Content of Freshly Mixed Concrete by the Volumetric Method

ASTM C 260 Standard Specification for Air-Entraining Admixtures for Concrete

ASTM C 295 Petrographic Examination of Aggregates for Concrete

ASTM C 33 Standard Specification for Concrete Aggregates

ASTM C 42 Standard Test Method for Obtaining and Test Drilled cores and Sawed Beams of Concrete

ASTM C 469 Static Modulus of Elasticity and Poisson's Ratio of Concrete in Compression

ASTM C 595 Standard Specification for Blended Hydraulic Cements

ASTM C1116 Standard Specification for Fiber-Reinforced Concrete and Shotcrete

ASTM C 1751 Preformed Expansion Joint Fillers for Concrete Paving and Structural Construction.(Non-extruding and Resilient Bituminous Types).

ASTM D 1179 Fluoride Ion in Water

ASTM D 1190 Standard Specification for Concrete Joint Sealer, Hot-Applied Elastic Type

ASTM D 1751 Standard Specification for Preformed Expansion Joint Filler for Concrete Paving and Structural Construction (Non-extruding and Resilient Bituminous Types)

ASTM E 329 Standard Specification for Agencies Engaged in the Testing and/ or Inspection of Materials used in Construction

c. American Welding Society (AWS)

D 12 Welding Reinforcing Steel, Metal Inserts and Connections in Reinforced Concrete Construction.

d. Philippine National Standard (PNS)

PNS 49 Steel Bars for Concrete Reinforcement

e. DPWH Standard Specifications

e. All other standards hereinafter indicated.

f. The edition or the revised version of such codes and standards current at the date twenty eight (28) days prior to date of bid submission shall apply. During Contract execution, any changes in such codes and standards shall be applied after approval by the Owner.

SUBMITTALS

1. Test Reports and Certificates shall be furnished and approval received before delivery of certified or tested materials to the Project Sites.

a. Submit Test Reports for the following:

a.1 Concrete mixture proportions

Submit copies of test reports by independent test labs conforming to ASTM C 1077 showing that the mixture has been successfully tested to produce concrete with the properties specified and that mixture will be

suitable for the job conditions. Test reports shall be submitted along with the concrete mixture proportions. Obtain approval before concrete placement. Fully describe the processes and methodology whereby mixture proportions were developed and tested and how proportions will be adjusted during progress of the work to achieve, as closely as possible, the designated levels of relevant properties.

a.2 Aggregates

Submit test results for aggregate quality in accordance with ASTM C 33. Where there is potential for alkali-silica reaction, provide results of tests conducted in accordance with ASTM C 227 or ASTM C 1260. Submit results of all tests during progress of the work in tabular and graphical form as noted above, describing the cumulative combined aggregate grading and the percent of the combined aggregate retained on each sieve.

a.3 Admixtures

Submit test results in accordance with ASTM C 494 and ASTM C 1017 for concrete admixtures, ASTM C 260 for air-entraining agent, and manufacturer's literature and test reports for corrosion inhibitor and anti-washout admixture. Submitted data shall be based upon tests performed within 6 months of submittal.

a.4 Cement

Submit test results in accordance with ASTM C 150 Portland cement. Submit current mil data.

a.5 Water

Submit test results in accordance with ASTM D 512 and ASTM D 516.

b. Submit Certificates for the following:

b.1 Curing concrete elements

Submit proposed materials and methods for curing concrete elements.

b.2 Form removal schedule

Submit proposed materials and methods for curing concrete elements.

b.3 Concrete placement and compaction

Submit technical literature for equipment and methods proposed for use in placing concrete. Include pumping or conveying equipment including type, size and material for pipe, valve characteristics, and the maximum length and height concrete will be pumped. No adjustments shall be made to the mixture design to facilitate pumping.

Submit technical literature for equipment and methods proposed for vibrating and compacting concrete. Submittal shall include technical literature describing the equipment including vibrator diameter, length, frequency, amplitude, centrifugal force, and manufacturer's description of the radius of influence under load. Where flat work is to be cast, provide similar information relative to the proposed compacting screed or other method to ensure dense placement.

b.4 Mixture designs

Provide a detailed report of materials and methods used, test results, and the field test strength (fcr) for marine concrete required to meet durability requirements.

2. The Contractor shall submit shop drawings and erection drawings for formwork and scaffolding at least 14 days prior to commencing the work.

Each shop drawing and erection drawing shall bear the signature of a Contractor's qualified Engineer. Details of all proposed formwork to be prefabricated and formwork to produce special finishes shall be submitted to the Engineer for approval before any materials are ordered. If the Engineer so requires, samples of proposed formworks shall be constructed and concrete placed at the Contractor's expense so that the proposed methods and finished effect can be demonstrated.

The Contractor shall submit shop drawings showing reinforcing bar placing and bar lists for the Engineer's approval. Such shop drawings shall show also supplemental bars for forming, strengthening frames of bars of sufficient rigidity to withstand forces during placing concrete. If necessary, shaped steel may be added to improve rigidity of the frame of bar.

Such shop drawings shall clearly indicate bar sizes, spacing, location and quantities of reinforcement, mesh, chairs, spacers and other details to be as per ACI Manual of Standard Practice for Detailing Reinforced Concrete Structures.

Details shall be prepared for placement of reinforcement where special conditions occur, including most congested areas and connection between pre-cast concrete and concrete in-situ.

All shop drawings shall be reviewed by the Engineer within seven (7) days after receiving them. At least two (2) days prior to pouring concrete, the Contractor shall submit to the Engineer a pouring permit for his inspection and approval.

MATERIAL REQUIREMENTS

CEMENT

Unless otherwise specified in the Drawings, only one (1) brand of cement shall be used for any individual structure. In determining the approved mix, only Portland cement shall be used as the cementitious material.

1. Portland Cement: ASTM C 150

Type I (for general use in construction)

ADMIXTURE (IF NECESSARY)

Unless otherwise required by field conditions, admixture may be used subject to the expressed approval of the Engineer. The cost of which shall already be included in the unit cost bid of the Contractor for the concrete.

1. Air Entraining Admixture shall conform to ASTM C 260.
2. Admixture other than air entraining agent shall conform to ASTM C 494.
3. Admixture containing chloride ions, or other ions producing deleterious effect shall not be used.

AGGREGATES

1. Crushed Coarse Aggregate

Conforming to ASTM C 33 and having nominal sizes passing 38.0 mm to 19.0 mm, 19.0 mm to 9.5 mm to No. 4 sieve. The material shall be well graded between the limits indicated and individually stockpiled. It shall be the Contractor's responsibility to blend the materials to meet the gradation requirements for various types of concrete as specified herein.

Nominal sizes for combined gradation shall be as follows:

ASTM Sieves	Nominal Size of Coarse Aggregates			
	% by Weight Passing			
	40mm	25mm	19mm	10mm
50.0mm (2")	100	-	-	-
38.0mm (1 1/2")	95 - 100	100	-	-
31.8mm (1 1/4")	-	90 - 100	100	-
25.0mm (1")	-	-	90 - 100	-
19.0mm (3/4")	35 - 70	25 - 90	-	100
16.0mm (5/8")	-	-	20 - 55	85 - 100
9.5mm (3/8")	10 - 30	0 - 10	0 - 10	0 - 20
No. 4	0 - 5			

2. Fine Aggregate

ASTM C 33 except for gradation which has been revised to meet local conditions unless otherwise required by the Engineer, grading of find aggregate shall be as follows:

ASTM Sieves	% by Weight Passing
9.5mm (3/8")	100
No.4	90 - 100
No. 8	80 - 100
No. 16	50 - 90
No. 30	25 - 60
No. 50	5 - 30
No. 100	0 - 10

a. Grading of fine aggregates shall be reasonably uniform and fineness modulus thereof shall not vary more than 0.2 from that of the representative sample in which mix proportions of concrete are based.

b. Due care shall be taken to prevent segregation.

WATER

The mixing water shall be clear and apparently clean. If it contains quantities or substances that discolor it or make it smell or taste unusual or objectionable, or cause suspicion, it shall not be used unless service records of concrete made with it (or other information) indicated that it is not injurious to the quality, shall be subject to the acceptance criteria as shown in Table 6.3 and Table 6.4 or as designated by the purchaser.

When wash water is permitted, the producer will provide satisfactory proof or data of non-detrimental effects if potentially reactive aggregates are to be used. Use of wash water will be discontinued if undesirable reactions with admixtures or aggregates occur.

Table 6.3 Acceptance Criteria for Questionable Water Supplies

Test	Limits
Compressive strength, min. % Control at 7 days	90
Time of Setting deviation from control	from 1:00 earlier to 1:30 later
Time of Setting (Gillmore Test) Initial Final Set	 No marked change No marked change
Appearance	Clear
Color	Colorless

Odor	Odorless
Total Solids	500 parts/million max.
PH value	4.5 to 8.5

Table 6.4 Chemical Limitation for Wash Water

	Limits
Chemical Requirements, Minimum Concentration Chloride as $C1^{(-1)}$ expressed as a mass percent of cement when added to the $C1^{(-1)}$ in the other components of the concrete mixtures shall not exceed the following levels:	
1. Prestressed Concrete	0.06 percent
2. Conventionally reinforced concrete in a moist environment and exposed to chloride	0.10 percent
3. Conventionally reinforced concrete in a moist environment but not exposed to chloride	0.15 percent
4. Above ground building construction where the concrete will stay dry	No limit for corrosion
Sulfate as SO_4, ppm[A]	3,000
Alkalies as (Na_2O + 0.658 K_2O), ppm	600
Total Solids, ppm	50,000

Wash water reused as mixing water in concrete may exceed the listed concentrations of sulfate if it can be shown that the concentration calculated in the total mixing water, including mixing water on the aggregate and other sources, does not exceed that stated limits.

Water will be tested in accordance with, and shall meet the suggested requirements of AASHTO T 26.

Water known to be of potable quality may be used without test.

CURING MATERIALS

1. Impervious Sheet Materials

   ASTM C 171 type, optional, except that polyethylene film, if used, shall be white opaque.

2. Burlap of commercial quality, non-staining type, consisting of 2 layers minimum.

3. Membrane Forming Curing Compound

   ASTM C 309; submit evidence that product conforms to specifications.

JOINTING MATERIALS

1. Sealant

Sealant shall be multi-component, polyurethane base compound, gray in color, self-leveling for horizontal joints, 2 part polythremdyne, terpolymer compound, gray in color; non-sag for vertical joints.

Sealant shall be compatible with materials in contact and to perform satisfactorily under salt water and traffic conditions, and be capable of making joint watertight and allow movement 25% of the width of joint in any direction.

Sealant shall be guaranteed against leakage, cracking, crumbling, melting, shrinkage, running, loss of adhesion for a period of five years from the date of acceptance of work.

2. Joint backing shall be expanded extruded polyethylene, low density, oval in shape to fit the joints as indicated on the drawings and to be compatible with sealant.

3. Where required, primer shall be compatible with joint materials and installed in accordance with manufacturer's instructions.

4. Joint filler shall conform to ASTM D1751 (AASHTO M213) non-extruding, resilient bituminous type. Filler shall be furnished for each joint in single piece for depth and width required for joint, unless otherwise authorized by the Engineer. When more than one piece is authorized for a joint, abutting ends shall be fastened and hold securely to shape by stapling or other positive fastening.

EPOXY BONDING COMPOUND

ASTM C 881. Provide Type I for bonding hardened concrete to hardened concrete; Type II for bonding freshly mixed concrete to hardened concrete; and Type III as a binder in epoxy mortar or concrete, or for use in bonding skid-resistant materials to hardened concrete. Provide Class B if placement temperature is between 4 and 16°C; or Class C if placement temperature is above 16°C.

REINFORCEMENT

Steel reinforcement, other than Steel for Pre-stressing, used in Reinforced Concrete, shall conform to ASTM and PNS as follows:

ASTM Designation A615 - Deformed Billet Steel Bars for Concrete Reinforcement. Minimum yield strength of 276 MPa (40,000 psi).

PNS 49 - Steel Bars for Concrete Reinforcement

TIE WIRE

Tie wire shall be plain, cold drawn annealed steel wire 1.6 mm diameter.

SAMPLES AND TESTING

1. Cement

Sampled either at the mill or at the site of work and tested by an independent commercial or

government testing laboratory duly accredited by the Bureau of Research and Standards (BRS) of the DPWH, Department of Science and Technology (DOST) or the Department of Trade and Industry (DTI) at no additional cost to PPA. Certified copies of laboratory test reports shall be furnished for each lot of cement and shall include all test data, results, and certificates that the sampling and testing procedures are in conformance with the Specifications. No cement shall be used until notice has been given by the Engineer that the test results are satisfactory. Cement that has been stored, other than in bins at the mills, for more than 3 months after delivery to the Site shall be re-tested before use. Cement delivered at the Site and later found after test to be unsuitable shall not be incorporated into the permanent works.

2. Aggregates: Tested as prescribed in ASTM C 33

At least 28 days prior to commencing the work, the Contractor shall inform the Engineer of the proposed source of aggregates and provide access for sampling.

Gradation tests will be made on each sample without delay. All other aggregates tests required by these Specifications shall be made on the initial source samples, and shall be repeated whenever there is a change of source. The tests shall include an analysis of each grade of material and an analysis of the combined material representing the aggregate part of the mix.

3. Reinforcement

Certified copies of mill certificates shall accompany deliveries of steel bar reinforcement. If requested by the Engineer additional testing of the materials shall be made at the Contractor's expense.

4. Concrete Tests

For test purposes, provide 1 set of three (3) concrete cylinder samples taken from each day's pouring and to represent not more than 75 cu.m. of concrete class or fraction thereof of concrete placed. Samples shall be secured in conformance with ASTM C 172. Tests specimens shall be made, cured, and packed for shipment in accordance with ASTM C 31. Cylinders will be tested by and at the expense of the Contractor in accordance with ASTM C 39. Test specimens will be evaluated separately by the Engineer, for meeting strength level requirements for each with concrete quality of ACI 318. When samples fail to conform to the requirements for strengths, the Engineer shall have the right to order a change in the proportions of the concrete mix for the remaining portions of the work at no additional cost to the Authority.

5. Test of Hardened Concrete in or Removed from the Structure

When the results of the strength tests of the concrete specimens indicates the concrete as placed does not meet the Specification requirements or where there are other evidences that the quality of concrete is below the specification requirement in the opinion of the Engineer, tests on cores of in-place concrete shall be made in conformance with ASTM C 42.

Core specimens shall be obtained by the Contractor and shall be tested. Any deficiency shall be corrected or if the Contractor elects, he may submit a proposal for approval before the load test is made. If the proposal is approved, the load test shall be made by the Contractor and the test results evaluated by the Engineer in conformance with Chapter 20 of ACI 318. The cost of the load tests shall be borne by the Contractor. If any concrete shows evidence of failure during the load test, or fails the load test as evaluated, the deficiency be

corrected in a manner approved by the Engineer at no additional cost to the Authority.

6. Chemical Admixtures/Additives

The admixtures/additives if approved shall conformed to ASTM C 494 and ASTM C 1017. The testing shall be conducted with cement and aggregate proposed for the Project. The admixtures/additives shall be tested and those that have been in storage at the Project Site for longer than six (6) months shall not be used until proven by retest to be satisfactory.

Samples of any admixtures/additives proposed by the Contractor shall be submitted for testing at least 56 days in advance of use, which shall require approval of the Engineer. Testing of admixtures/additives proposed by the Contractor including test mixing and cylinder test shall be at the Contractor's expense.

7. Jointing Materials and Curing Compound Samples

At least 28 days prior to commencing the work, the Contractor shall submit to the Engineer for his approval samples of the following materials proposed for use together with manufacturer's certificate.

a. 10 kg of joint sealant
b. 1m length of joint filler
c. 5 li. of curing compound
d. 1m length of joint backing

The Engineer shall deliver to the Contractor his assessment on the materials within seven (7) days after receiving them.

EXECUTION

DELIVERY, STORAGE AND HANDLING OF MATERIALS

1. Cement

Do not deliver concrete until vapor barrier, forms, reinforcement, embedded items, and chamfer strips are in place and ready for concrete placement. ACI 301 and ASTM A 934 for job site storage of materials. Protect materials from contaminants such as grease, oil, and dirt. Ensure materials can be accurately identified after bundles are broken and tags removed.

Immediately upon receipt at the Site, the cement shall be stored separately in a dry weathertight, properly ventilated structures with adequate provisions for prevention of absorption of moisture. Storage accommodations for concrete materials shall be subject to approval and shall afford easy access for inspection and identification of each shipment in accordance with test reports.

Cement shall be delivered to the Site in bulk or in sound and properly sealed bags and while being loaded or unloaded and during transit to the concrete mixers whether conveyed in vehicles or in mechanical means, cement shall be protected from whether by effective coverings. Efficient screens shall be supplied and erected during heavy winds.

If the cement is delivered in bulk, the Contractor shall provide, at his own cost, approved

silos of adequate size and numbers to store sufficient cement to ensure continuity of work and the cement shall be placed in these silos immediately after it has been delivered to the Site. Approved precautions shall be taken into consideration during unloading to ensure that the resulting dust does not constitute a nuisance.

If the cement is delivered in bags, the Contractor shall provide, at his own cost, perfectly waterproofed and well ventilated sheds having a floor of wood or concrete raised at least 0.5m above the ground. The sheds shall be large enough to store sufficient cement to ensure continuity of the work and each consignment shall be stacked separately therein to permit easy access for inspection, testing and approval. Upon delivery, the cement shall at once be placed in these sheds and shall be used in the order in which it has been delivered.

Cement bags should not be stacked more than 13 bags high. All cement shall be used within two months of the date of manufacture. If delivery conditions render this impossible, the Engineer may permit cement to be used up to three (3) month after manufacturing, subject to such conditions including addition of extra cement as he shall stipulate.

2. Aggregate

All fine and coarse aggregate for concrete shall be stored on close fitting, steel or concrete stages design with drainage slopes or in bins of substantial construction in such a manner as to prevent segregation of sizes and to avoid the inclusion of dirt and other foreign materials in the concrete. All such bins shall be emptied and cleaned at intervals of every six (6) months or as required by the Engineer. Each size of aggregate shall be stored separately unless otherwise approved by the Engineer.

Stockpiles of coarse aggregate shall be built in horizontal layers not exceeding 1.2 m in depth to minimize segregation.

FORMWORK

1. Forms

Designed, constructed, and maintained so as to insure that after removal of forms the finished concrete members will have true surfaces free of offset, waviness or bulges and will conform accurately to the indicated shapes, dimensions, lines, elevations and positions. Form surfaces that will be in contact with concrete shall be thoroughly cleaned before each use.

2. Design

Studs and wales shall be spaced to prevent deflection of form material. Forms and joints shall be sufficiently tight to prevent leakage of grout and cement paste during placing of concrete. Juncture of formwork panels shall occur at vertical control joints, and construction joints. Forms placed on successive units for continuous surfaces shall be fitted in accurate alignment to assure smooth completed surfaces free from irregularities and signs of discontinuity. Temporary opening shall be arranged to wall and where otherwise required to facilitate cleaning and inspection. Forms shall be readily removable without impact, shock, or damage to the concrete.

3. Form Ties

Factory fabricated, adjustable to permit tightening of the forms, removable or snap-off metal of design that will not allow form deflection and will not spall concrete upon removal.

Bolts and rods that are to be completely withdrawn shall be coated with a non-staining bond breaker. Ties shall be of the type which provide watertight concrete.

4. Chamfering

External corners that will be exposed shall be chamfered, beveled, or rounded by mouldings placed in the forms or as indicated in the drawings.

5. Coatings

Forms for exposed surfaces shall be coated with form oil or form-release agent before reinforcement is placed. The coating shall be a commercial formulation of satisfactory and proven performance that will not bond with, stain, or adversely affect concrete surfaces, and shall not impair subsequent treatment of concrete surfaces depending upon bond or adhesion nor impede the wetting of surfaces to be cured with water or curing compounds. The coating shall be used as recommended in the manufacturer's printed or written instructions. Forms for unexposed surfaces may be wet with water in lieu of coating immediately before placing of concrete. Surplus coating on form surfaces and coating on reinforcement steel and construction joints shall be removed before placing concrete.

6. Removal of Forms shall be done in a manner as to prevent injury to the concrete and to insure complete safety of the structure after the following conditions have been met. Where the structure as a whole is supported on shores, forms for beam and girder sides, and similar vertical structural members may be removed before expiration of curing period. Care shall be taken to avoid spalling the concrete surface or damaging concrete edges. Wood forms shall be completely removed.

Minimum stripping and striking time shall be as follows unless otherwise approved by the Engineer.

Vertical sides of beams, walls, and columns, lift not 12 hours exceeding 1.2 m

Vertical sides of beams and walls, lift exceeding 1.2 m 36 hours Softlifts of main slabs and beams (props left under) 5 days

Removal of props from beams and mains slabs and other work 10 days

7. Control Test

If the Contractor proposes to remove forms earlier than the period stated above, he shall be required to submit the results of control tests showing evidence that concrete has attained sufficient strength to permit removal of supporting forms. Cylinders required for control tests shall be provided in addition to those otherwise required by this Specification. Test specimens shall be removed from molds at the end of 24 hours and stored in the structure as near the points as practicable, the same protection from the elements during curing as is given to those portions of the structure which they represent, and shall not be removed from the structure for transmittal to the laboratory prior to expiration of three fourths of the proposed period before removal of forms. Cylinders will be tested by and at the expense of the Contractor. Supporting forms or shoring shall not be removed until control test specimens have attained strength of at least 160 kg/sq cm. The newly unsupported portions of the structure shall not be subjected to heavy construction or material loading.

REINFORCEMENT

1. Reinforcement

Fabricated to shapes and dimensions shown and shall be placed where indicated. Reinforcement shall be free of loose or flaky rust and mill scale, or coating, and any other substance that would reduce or destroy the bond. Reinforcing steel reduced in section shall not be used. After any substantial delay in the work, previously placed reinforcing steel for future bonding shall be inspected and cleaned. Reinforcing steel shall not be bent or straightened in a manner injurious to the steel or concrete. Bars with kinks or bends not shown in the drawings shall not be placed. The use of heat to bend or straighten reinforcing steel shall not be permitted. Bars shall be moved as necessary to avoid interference with other reinforcing steel, conduits, or embedded items. If bars are moved more than one bar diameter, the resulting arrangement of bars including additional bars necessary to meet structural requirements shall be approved before concrete is placed. In slabs, beams and girders, reinforcing steel shall not be spliced at points of maximum stress unless otherwise indicated. Unless otherwise shown in the drawings, laps or splices shall be 40 times the reinforcing bar diameter.

2. The nominal dimensions and unit weights of bars shall be in accordance with the following table:

Nominal Diameter (mm)	Nominal Perimeter (mm)	Nominal Sectional Area (sq. mm)	Unit Weight (kg/m)
10	31.4	78.54	0.616
12	37.7	113.10	0.888
16	50.3	201.10	1.579
20	62.8	314.20	2.466
25	78.5	490.90	3.854
28	88.0	615.70	4.833
32	100.5	804.20	6.313
36	113.1	1,017.60	7.991
40	125.7	1,256.60	9.864
50	157.1	1,963.50	15.413

3. Welding of reinforcing bars shall only be permitted where shown; all welding shown shall be performed in accordance with AWS D 12.1.

4. Exposed reinforcement bars, dowels and plates intended for bonding with future extensions shall be protected from corrosion.

5. Supports shall be provided in conformance with ACI 315 and ACI 318, unless otherwise indicated or specified.

6. Concrete Protection for Reinforcement

a. The minimum concrete cover of reinforcement shall be as shown below unless otherwise indicated in the drawings.

b. Tolerance for Concrete Cover of Reinforcing Steel other than Tendons.

Minimum Cover

7.5cm or more (marine structures and concrete cast against and permanently exposed to earth)

DESIGN STRENGTH OF CONCRETE

Concrete for structural parts or members such as beams, slabs, curtain wall, pile caps and fender/mooring blocks shall develop a minimum 28-day compressive cylinder strength of 24 MPa (3,500 psi) as indicated in the drawings. While for pre-stressed concrete piles a compressive strength of 35 MPa (5,000psi).

TRIAL BATCH FOR CONCRETE

Thirty (30) calendar days before the start of concreting works, the Contractor shall submit design mixes and the corresponding test result made on sample thereof. Sampling and testing shall be in accordance with the ASTM Standard procedures for sampling and testing for the particular design strength(s) required.

The particulars of the mix such as the slump and the proportionate weights of cement, saturated surface dry aggregates and water used shall be stated.

The design mix for concrete to be used shall be submitted together with at least three (3) standard cylinder samples for approval at least one (1) month prior to the start of each concreting schedule. Such samples shall be prepared in the presence of the Engineer.

Standard laboratory strength tests for the 7, 14 and 28 days periods shall be taken to all concrete samples in addition to routine field tests, at cost to the Contractor. Only design mixes represented by test proving the required strength for 7, 14 and 28 days tests shall be allowed.

The cost of sampling, handling and transporting samples from jobsite to the laboratory and the cost of subsequent tests made until the desired mix is attained shall be for the account of the Contractor.

Slump Test shall be made in conformance with ASTM C143, and unless otherwise specified by the Engineer, slump shall be within the following limits:

Structural Element	**Slump for Vibrated Concrete**	
	Minimum	**Maximum**
Pavement Concrete	25mm	50mm
Pre-cast Concrete	50mm	70mm

Lean Concrete	100mm	200mm
Sacked Concrete	25mm	50mm
All other Concrete	50mm	90mm

Sampling : Provide suitable facilities and labor for obtaining representative samples of concrete for the Contractor's quality control and the Engineer's quality assurance testing. All necessary platforms, tools and equipment for obtaining samples shall be furnished by the Contractor.

MIXING CONCRETE

1. GENERAL

a. Concrete shall be thoroughly mixed in a mixer of an approved size and type that will insure a uniform distribution of the materials throughout the mass.

b. All concrete shall be mixed in mechanically operated mixers. Mixing plant and equipment for transporting and placing concrete shall be arranged with an ample auxiliary installation to provide a minimum supply of concrete in case of breakdown of machinery or in case the normal supply of concrete is disrupted. The auxiliary supply of concrete shall be sufficient to complete the casting of a section up to a construction joint that will meet the approval of the Engineer.

c. Equipment having components made of aluminum or magnesium alloys, which would be in contact with plastic concrete during mixing, transporting or pumping of Portland cement concrete, shall not be used.

d. Concrete mixers shall be equipped with adequate water storage and a device for accurately measuring and automatically controlling the amount of water used.

e. Materials shall be measured by weighing. The apparatus provided for weighing the aggregates and cement shall be suitably designed and constructed for this purpose. The accuracy of all weighing devices except that for water shall be such that successive quantities can be measured to within one percent of the desired amounts. The water measuring device shall be accurate to plus or minus 0.5 percent. All measuring devices shall be subject to the approval of the Engineer. Scales and measuring devices shall be tested at the expense of the Contractor as frequently as the Engineer may deem necessary to insure their accuracy.

f. Weighing equipment shall be insulated against vibration or movement of other operating equipment in the plant. When the entire plant is running, the scale reading at cut-off shall not vary from the weight designated by the Engineer by more than one percent for cement, 1-½ percent for any size of aggregate, or one percent for the total aggregate in any batch.

g. Manual mixing of concrete shall not be permitted unless approved by the Engineer.

2. MIXING CONCRETE AT SITE

a. Concrete mixers may be of the revolving drum or the revolving blade type and the mixing drum or blades shall be operated uniformly at the mixing speed recommended by the manufacturer.

The pick-up and throw-over blades of mixers shall be restored or replaced when any part or section is worn 20 mm or more below the original height of the manufacturer's design. Mixers and agitators which have an accumulation of hard concrete or mortar shall not be used.

b. When bulk cement is used and the volume of the batch is 0.5 m^3 or more, the scale and weigh hopper for Portland cement shall be separate and distinct from the aggregate hopper or hoppers.

The discharge mechanism of the bulk cement weigh hopper shall be interlocked against opening before the full amount of cement is in the hopper. The discharging mechanism shall be interlocked against opening when the amount of cement in the hopper is underweight by more than one percent or overweight by more than 3 percent of the amount specified.

c. When the aggregates contain more water than the quantity necessary to produce a saturated surface dry condition, representative samples shall be taken and the moisture content determined for each kind of aggregate.

d. The batch shall be so charged into the mixer that some water enter in advance of cement and aggregates. All water shall be in the drum by the end of the first quarter of the specified mixing time.

e. Cement shall be batched and charged into the mixer by such means that it will not result in loss of cement due to the effect of wind, or in accumulation of cement on surfaces of conveyors or hoppers, or in other conditions which reduce or vary the required quantity of cement in the concrete mixture.

f. Where required, synthetic fibrous reinforcement shall be added directly to the concrete mixer after placing the sufficient amount of mixing water, cement and aggregates.

g. The entire contents of a batch mixer shall be removed from the drum before materials for a succeeding batch are place therein. The materials composing a batch except water shall be deposited simultaneously into the mixer.

h. All concrete shall be mixed for a period of not less that 3 minutes after all materials, including water, are in the mixer. During the period of mixing, the mixer shall operate at the speed for which it has been designed.

i. Mixers shall be operated with an automatic timing device that can be locked by the Engineer. The time device and discharge mechanism shall be so interlocked that during normal operation no part of the batch will be discharged until the specified mixing time has elapsed.

j. The first batch of concrete materials placed in the mixer shall contain a sufficient excess of cement, sand, and water to coat the inside of the drum without reducing the required mortar content of the mix. When mixing is to cease for a period of one hour or more, the mixer shall be thoroughly cleaned.

k. In case of rubble concrete, proper mixture and placing of concrete and stones/rocks shall be in accordance to the approved plan. Methodology of work shall be approved by the Engineer.

3. MIXING CONCRETE IN TRUCKS

a. Truck mixers, unless otherwise authorized by the Engineer, shall be of the revolving drum type, watertight, and so constructed that the concrete can be mixed to insure a uniform distribution of materials throughout the mass. All solid materials for the concrete shall be accurately measured and charged into the drum at the proportioning plant. Except as subsequently provided, the truck mixer shall be equipped with a device by which the quantity of water added can be readily verified. The mixing water may be added directly to the batch, in which case a tank is not required. Truck mixers may be required to be provided with a means by which the mixing time can be readily verified by the Engineer.

b. The maximum size of batch in truck mixers shall not exceed the minimum rated capacity of the mixer as stated by the manufacture and stamped in metal on the mixer. Truck mixing shall, unless otherwise directed, be continued for not less than 100 revolutions after all ingredients, including water, are in the drum. The mixing speed shall not be less than 4 rpm, nor more than 6 rpm.

c. Mixing shall begin within 30 minutes after the cement has been added either to the water or aggregate, but when cement is charged into a mixer drum containing water or surface-wet aggregate and when the temperature is above 32 °C, this limit shall be reduced to 15 minutes. The limitation in time between the introduction of the cement to the aggregate and the beginning of the mixing may be waived when, in the judgment of the Engineer, the aggregate is sufficiently free from moisture, so that there will be no harmful effects on the cement.

d. When a truck mixer is used for transportation, the mixing time in stationary mixer may be reduced to 30 seconds and the mixing completed in a truck mixer. The mixing time in truck mixer shall be as specified for truck mixing.

JOINTS

1. No reinforcement, corner protection angles or other fixed metal items shall be run continuously through joints containing expansion-joint filler, through crack-control joints in slabs on grade and vertical surfaces.

2. Preformed Expansion Joint Filler

a. Joints with Joint Sealant

At expansion joints in concrete slabs to be exposed, and at other joints indicated to receive joint sealant, preformed expansion-joint filler strips shall be installed at the proper level below the elevation with a slightly tapered, dressed-and-oiled wood strip temporarily secured to the top thereof to form a groove. When surface dry, the groove shall be cleaned of foreign matter, loose particles, and concrete protrusions, then filled flush approximately with joint sealant so as to be slightly concave after drying.

b. Finish of concrete at joints

Edges of exposed concrete slabs along expansion joints shall be neatly finished with a slightly rounded edging tool.

c. Construction Joints

Unless otherwise specified herein, all construction joints shall be subject to approval of the Engineer. Concrete shall be placed continuously so that the unit will be monolithic in construction. Fresh concrete may be placed against adjoining units, provided the set concrete is sufficiently hard not to be injured thereby. Joints not indicated shall be made and located in a manner not to impair strength and appearance of the structure. Placement of concrete shall be at such rate that the surface of concrete not carried to joint levels will not have attained initial set before additional concrete is placed thereon. Lifts shall terminate at such levels as are indicated or as to conform to structural requirements as directed. If horizontal construction joints are required, a strip of 25mm square-edged lumber, beveled to facilitate removal shall be tacked to the inside of the forms at the construction joint. Concrete shall be placed to a point 25mm above the underside of the strip. The strip shall be removed one hour after the concrete has been placed. Any irregularities in the joint line shall be leveled off with a wood float, and all laitance removed. Prior to placing additional concrete, horizontal construction joints shall be prepared.

Construction Joint which is not indicated in the Drawings shall be located as to least affect the strength of the structure. Such locations will be pointed out by the Engineer.

PREPARATION FOR PLACING

Hardened concrete, debris and foreign materials shall be removed from the interior of forms and from inner surfaces of mixing and conveying equipment. Reinforcement shall be secured in position, and shall be inspected, and approved before placing concrete. Runways shall be provided for wheeled concrete-handling equipment. Such equipment shall not be wheeled over reinforcement nor shall runways be supported on reinforcement.

Notice of any concreting operations shall be served to the Engineer at least three (3) days ahead of each schedule.

PLACING CONCRETE

1. Handling Concrete

Concrete shall be handled from mixers and transported to place for final deposit in a continuous manner, as rapidly as practicable, and without segregation or loss of ingredients until the approved unit of work is completed. Placing will not be permitted when the sun, heat, wind or limitations of facilities furnished by the Contractor prevent proper finishing and curing of the concrete. Concrete shall be placed in the forms, as close as possible in final position, in uniform approximately horizontal layers not over 40cm deep. Forms splashed with concrete and reinforcement splashed with concrete or form coating shall be cleaned in advance of placing subsequent lifts. Concrete shall not be allowed to drop freely more than 1.5m in unexposed work nor more than 1.0 m in exposed work; where greater drops are required, tremie or other approved means shall be employed.

2. Time Interval between Mixing and Placing

Concrete mixed in stationary mixers and transported by non-agitating equipment shall be placed in the forms within 30 minutes from the time ingredients are charged into the mixing drum. Concrete transported in truck mixers or truck agitators shall be delivered to the site of work, discharged in the forms within 45 minutes from the time ingredients are

discharged into the mixing drum. Concrete shall be placed in the forms within 15 minutes after discharged from the mixer at the jobsite.

3. Hot Weather Requirements

The temperature of concrete during the period of mixing while in transport and/or during placing shall not be permitted to rise above 36 °C. Any batch of concrete which had reached a temperature greater than 36 °C at any time in the aforesaid period shall not be placed but shall be rejected, and shall not thereafter be used in any part of the permanent works.

a. Control Procedures

Provide water cooler facilities and procedures to control or reduce the temperature of cement, aggregates and mixing handling equipment to such temperature that, at all times during mixing, transporting, handling and placing, the temperature of the concrete shall not be greater than 36 °C.

b. Cold Joints and Shrinkage

Where cold joints tend to form or where surfaces set and dry too rapidly or plastic shrinkage cracks tend to appear, concrete shall be kept moist by fog sprays, or other approved means, applied shortly after placement, and before finishing.

c. Supplementary Precautions

When the aforementioned precautions are not sufficient to satisfy the requirements herein above, they shall be supplemented by restricting work during evening or night. Procedure shall conform to American Concrete Institute Standard ACI 305.

4. Conveying Concrete by Chute, Conveyor or Pump

Concrete may be conveyed by chute, conveyor, or pump if approved in writing. In requesting approval, the Contractor shall submit his entire plan of operation from the time of discharge of concrete from the mixer to final placement in the forms, and the steps to be taken to prevent the formation of cold joints in case the transporting of concrete by chute, conveyor or pump is disrupted. Conveyors and pumps shall be capable of expeditiously placing concrete at the rate most advantageous to good workmanship. Approval will not be given for chutes or conveyors requiring changes in the concrete materials or design mix for efficient operation.

a. Chutes and Conveyors

Chutes shall be of steel or steel lined wood, rounded in cross section rigid in construction, and protected from overflow. Conveyors shall be designed and operated and chute sections shall be set, to assure a uniform flow of concrete from mixer to final place of deposit without segregation of ingredients, loss of mortar, or change in slump. The discharged portion of each chute or conveyor shall be provided with a device to prevent segregation. The chute and conveyor shall be thoroughly cleaned before and after each run. Waste material and flushing water shall be discharged outside the forms.

b. Pumps shall be operated and maintained so that a continuous stream of concrete is delivered into the forms without air pockets, segregation or changes in slump.

When pumping is completed, concrete remaining in the pipeline shall be ejected and wasted without contamination of concrete already placed. After each operation, equipment shall be thoroughly cleaned and the flushing water shall be splashed outside the forms.

5. Wall and Abutments

No load shall be placed upon finished walls, foundations or abutments until authorized by the Engineer. Minimum time before loading shall be 7 days.

6. Concrete Placing on Wharf

When placing concrete on wharf decks, the Contractor shall:

Ensure that rate of placing is sufficient to complete proposed placing, finishing and curing operations within the scheduled time; that experienced finishing machine operators and concrete finishers are provided to finish the deck; that curing equipment and finishing tools and equipment are at the site of work and in satisfactory condition for use.
Immediately prior to placing, the Contractor shall place scaffolding and wedges and make necessary adjustments. Care shall be taken to ensure that settlement and deflection due to added weight of concrete will be minimal. The Contractor shall provide suitable means to readily permit measurement of settlement deflection as it occurs.

Should any event occur which, in opinion of the Engineer, would prevent the concrete conforming to specified requirements, the Contractor shall discontinue placing of concrete until corrective measures are provided satisfactory to the Engineer. If satisfactory measures are not provided prior to initial set of concrete in affected areas, the Contractor shall discontinue placing concrete and install a bulkhead at a location determined by the Engineer. Concrete in place beyond bulkheads shall be removed. The Contractor shall limit the size of casting to that which can be finished before beginning of initial set.

COMPACTION

1. Immediately after placing, each layer of concrete shall be completed by internal concrete vibrators supplemented by hand-spading, rodding, and tamping. Tapping or other external vibration of forms will not be permitted unless specifically approved by the Engineer. Vibrators shall not be used to transport concrete inside the forms. Internal vibrators submerged in concrete shall maintain a speed of not less than 7,000 impulses per minute. The vibrating equipment shall at all times be adequate in number of units and power to properly consolidate all concrete.

2. Spare units shall be on hand as necessary to insure such adequacy. The duration of vibrating equipment shall be limited to the time necessary to produce satisfactory consolidation without causing objectionable segregation. The vibrator shall not be inserted into the lower courses that have begun to set. Vibrator shall be applied vertically at uniformly spaced points not further apart than the visible effectiveness of the machine.

EPOXY BONDING COMPOUND

Before depositing new concrete on or against concrete that has set, the surfaces of the set concrete shall be thoroughly cleaned so as to expose the coarse aggregate and be free of laitance,

coatings, foreign matter and loose particles. Forms shall be re-tightened. The cleaned surfaces shall be moistened, but shall be without free water when concrete is placed. ASTM C 881. Provide Type I for bonding hardened concrete to hardened concrete; Type II for bonding freshly mixed concrete to hardened concrete; and Type III as a binder in epoxy mortar or concrete, or for use in bonding skid-resistant materials to hardened concrete. Provide Class B if placement temperature is between 4 to 16 °C; or Class C if placement temperature is above 16°C.

FINISHES OF CONCRETE

Within 12 hours after the forms are removed, surface defects shall be remedied as specified herein. The Temperature of the concrete, ambient air and mortar during remedial work including curing shall be above 10 °C. Fine and loose material shall be removed. Honeycomb, aggregate pockets, voids over 13mm in diameter, and holes left by the rods or bolts shall be cut out to solid concrete, reamed, thoroughly wetted, brush-coated with neat cement grout, and filled with mortar. Mortar shall be a stiff mix of one part Portland cement to not more than 2 parts fine aggregate passing the No. 16 mesh sieve, with a minimum amount of water. The color of the mortar shall match the adjoining concrete color. Mortar shall be thoroughly compacted in place. Holes passing entirely through walls shall be completely filled from the inside face by forcing mortar through the outside face. Holes which do not pass entirely through wall shall be packed full. Patchwork shall be finished flush and in the same plane as adjacent surfaces. Exposed patchwork shall be finished to match adjoining surfaces in texture and color. Patchwork shall be damp-cured for 72 hours. Dusting of finish surfaces with dry material or adding water to concrete surfaces will not be permitted.

CONCRETE FINISHING DETAILS

1. Concrete Paving

   After concrete is placed and consolidated, slabs shall be screeded or struck off. No further finish is required.

2. Smooth Finish

   Required only where specified; screed concrete and float to required level with no coarse aggregate visible. After surface moisture has disappeared and laitance has been removed, the surface shall be finished by float and steel trowel. Smooth finish shall consist of thoroughly wetting and then brush coating the surfaces with cement to not more than 2 parts fine aggregate passing the no. 30 mesh sieve and mixed with water to the consistency of thick paint.

3. Broom Finish

   Required for paving; the concrete shall be screeded and floated to required finish level with no coarse aggregate visible. After the surface moisture has disappeared and laitance has been removed, surface shall be float-finished to an even, smooth finish. The floated surfaces shall be broomed with a fiber bristle brush in a direction transverse to the direction of the main traffic.

ITEM 04 : CONSTRUCTION JOINTS

SCOPE OF WORK

This item shall consist of the manufacturing and installation of construction joints / expansion joints in accordance with the details, and at the locations, lines, grades and dimensions shown in the drawings.

MATERIAL REQUIREMENTS

1. All construction joints / expansion joints shall be hot-dipped galvanized inside and out in accordance with international standards for galvanizing BS EN1460.

2. Painted finish shall be rejected.

3. All steel gratings and angle bars for construction joints / expansion joints shall be hot-dipped galvanized except for the nuts, washers and bolts which shall be stainless steel.

4. Welding shall be in accordance with the AWS Code and as herein specified or any other welding standard, approved by the Engineer.

The Contractor shall be required to submit test certificates for steel materials for the construction / expansion joints joints used in its manufacture; and for hot-dip galvanizing which shall meet or exceed the specifications under "Zinc Coating".

EXECUTION

DELIVERY, STORAGE AND INSTALLATION

1. Upon delivery at site, the hot-dipped galvanized construction joints / expansion joints shall not be subjected to the following activities:

    a. Re-fabrication
    b. Cutting
    c. Grinding
    d. Welding
    e. Sawing
    f. Any hot works or similar activities

2. Stainless steel nuts and bolts may be tack welded using stainless steel welding rods.

3. The construction joints / expansion joints shall not be exposed to sea water and other corrosive chemicals or
substances prior to installation.

ITEM 05 : ZINC (HOT-DIP GALVANIZED) COATINGS ON IRON AND STEEL

SCOPE OF WORK

This specification covers the requirements for zinc coating (galvanizing) by the hot-dip process on iron and steel products made from rolled pressed and forged shapes, casting, plates, bars and strips.

This specification covers both fabricated and un-fabricated products, for example, assembled steel products, structural steel fabrications, large tubes already bent or welded before galvanizing, and wire work fabricated from uncoated steel wire. It also covers steel forgings and iron castings incorporated into pieces fabricated before galvanizing or which are too large to be centrifuged (or otherwise handled to remove excess galvanizing bath metal).

MATERIAL REQUIREMENTS

STEEL OR IRON

The specification, grade or designation, and type and degree of surface contamination of the iron or steel in articles to be galvanized shall be supplied by the purchaser to the hot-dip galvanizer prior to galvanizing.

The presence in steels and weld metal, in certain percentages, of some elements such as silicon, carbon and phosphorus tends to accelerate the growth of the zinc-iron alloy layer so that the coating may have a matte finish with a little or no outer zinc layer.

EXECUTION

FABRICATION

The design and fabrication of the product to be galvanized shall be in accordance to the plans and specifications. ASTM Practices A 143, A 384 and A 385 provide guidance for steel fabrication for optimum hot-dip galvanizing and shall be complied with in both design and fabrication.

CASTINGS

The composition of heat treatment of iron and steel castings shall conform to specifications designated by the purchaser. Some types of castings have been known to show potential problems being embrittttled during normal thermal cycle of hot-dip galvanizing. The requirements for malleable iron castings to be galvanized are stipulated in ASTM specification A 47.

ZINC

The zinc used in the galvanizing bath shall conform to ASTM Specification B 6. If a zinc alloy is used as the primary feed to the galvanizing bath, then the base material used to make that alloy shall conform to ASTM Specification B 6.

BATH COMPOSITION

The molten metal in the working volume of the galvanizing bath shall contain not less than an average value of 98.0% zinc by weight.

COATING PROPERTIES

Table 1 – Minimum Average Coating Thickness Grade by Material Category

Material Category	All Specimens Tested Steel Thickness Range (Measured), mm (in.)				
	< 1/16 (<1.6)	1/16 to < 1/8 (1.6 to < 3.2)	1/8 to < 3/16 (3.2 to 4.8)	> 3/16 to < 1/4 (> 4.8 to < 6.4)	≥ 1/4 (≥ 6.4)
Structural Shapes & Plate	45	65	75	85	100
Strip and Bar	45	65	75	85	100
Pipe and Tubing	45	45	75	75	75
Wire	35	50	60	65	80

COATING THICKNESS

The average thickness of coating for all specimens tested shall conform to the requirements of Table 1 for the categories and thickness of the material being galvanized. Minimum average thickness of coating for any individual specimen is one coating grade less than that required in Table 1. Where products consisting of various material thicknesses or categories are galvanized, the coating thickness grades of each thickness range and material category of material shall be shown in Table 1. The specification of coating thickness heavier than those required by Table 1 shall be subject to mutual agreement between the galvanizer and Engineer.

For articles whose surface area is greater than 100,000 mm^2 (160 $in.^2$) (multi-specimen articles), each test article in the sample must meet the appropriate minimum average coating thickness grade requirements of Table 1. Each specimen coating thickness grade comprising that overall average for each test article shall average not less than one coating grade below that required in Table 1.

For articles whose surface area is equal to or less than 100,000 mm^2 (160 $in.^2$) (single-specimen articles), the average of all test articles in the sample must meet the appropriate minimum average coating thickness grade requirements of Table 1. For each test article, its specimen coating thickness shall not be less than one coating grade below that required in Table 1.

No individual measurement or cluster of measurements at the same general location on a test specimen shall be cause for rejection under this specification provided that when those measurements are averaged with the other dispersed measurements to determine the specimen coating thickness grade for that specimen, the requirements of the above specifications as appropriate are met.

The coating thickness grades in Table 1 represent the minimum value obtainable with a high level of confidence for the ranges typically found in each material category. While most coating thicknesses will be in excess of those values, some materials in each category may be less reactive (for example, because of chemistry or surface condition) than other materials of the steel category spectrum. Therefore, some articles may have a coating grade at or close to the minimum requirements shown in Table 1. In such cases, the precision and accuracy of the coating thickness measuring technique should be taken into consideration when rejecting such articles for coating thickness below that is required by this specification.

FINISH

The coating shall be continuous (except as provided below), and as reasonably smooth and uniform in thickness as the weight size and shape of the item. Except for local excess coating thickness which would interfere with the use of the product or make it dangerous to handle (edge tears or spikes), rejection for non-uniform coating shall be made only for plainly visible excess coating not related to design factors such as holes, joints, or special drainage problems. Since surface smoothness is a relative term, minor roughness that does not interfere with the intended use of the product, or roughness that is related to the as-received (un-galvanized) surface condition, steel chemistry to zinc shall not be grounds for rejection.

Surfaces that remain uncoated after galvanizing may be renovated in accordance with the methods in ASTM Practice A 780 provided that the following conditions are met:

1. Each area subject to renovation shall be 25mm (1 in.) or less in its narrowest dimension.

2. The total area subject to renovation on each article shall be no more than ½ of 1% of the accessible surface area to be coated on that article, or 22,500mm^2 (36 in.^{2}) per ton of piece weight, whichever is less. Inaccessible surface areas are those which cannot be reached for appropriate surface preparation and application of repair materials as described in ASTM Practice A 780.

3. The thickness of renovation shall be that is required by the thickness grade for the appropriate material category and thickness range in Table 1 in accordance with the coating thickness requirements, except that for renovation using zinc paints, the thickness of renovation shall be 50% higher than that required by table 1, but not greater than 0.0254mm (4.0 mils).

4. When areas requiring renovation exceed the criteria previously provide, or are inaccessible for repair, the coating shall be rejected.

THREADED COMPONENTS IN ASSEMBLIES

The zinc coating on external threads shall not be subjected to a cutting, rolling or finishing tool operation, unless specifically authorized by the purchaser. Internal threads may be tapped or retapped after galvanizing. Coatings shall conform to the requirements of ASTM Specification A 153/A 153 M.

APPEARANCE

Upon shipment from the galvanizing facility, galvanized articles shall be free from uncoated areas, blisters, flux deposits and gross dross inclusions. Lumps, projections, globules or heavy deposits of zinc which will interfere with the intended use of the material will not be permitted. Plain holes of 12.5mm (1/2 in.) diameter or more shall be clean and reasonably free from excess zinc. Marks in the zinc coating caused by tongs or other items used in handling the article during the galvanizing operation shall not be cause for rejection unless such marks have exposed the base metal, and the bare metal areas exceed the criteria provided in number 1 and 2 of Subsection "Finish".

Whenever dross is present in a form other than finely dispersed pimples in the coating and is present in such amount as to be susceptible to mechanical damage, it will be considered as "gross".

ADHERENCE

The zinc coating shall withstand handling consistent with the nature and thickness of the coating and the normal use of the article, without peeling or flanking. Although some material may be formed after

galvanizing, in general the zinc coating on the articles covered by this specification is too heavy to permit severe bonding without damaging the coating.

SAMPLING

A lot is a unit of production or shipment from which a sample may be taken for testing. Unless otherwise agreed upon between the galvanizer and the purchaser, or established within this specification, the lot shall be as follows:

1. For testing at a galvanizer's facility, a lot is one or more articles of the same type and size comprising a single order or a single delivery load, whichever is smaller, or any number of articles identified as a lot by the galvanizer, when these have been galvanized within a single production shift and in the same bath.

2. For test by the purchaser after delivery, the lot consists of the single order or the single delivery load, whichever is smaller, unless the lot identify, established in accordance with the above, is maintained and clearly indicated in the shipment by the galvanizer.

The method of selection and number of test specimens shall be agreed upon between the galvanizer and the purchaser. Otherwise, the test specimens shall be selected random from each lot. In this case, the minimum number of specimens from each lot shall be as follows:

Number of Pieces in Lot	Number of Specimens
3 or less	All
4 to 500	3
501 to 1,200	5
1,201 to 3,200	8
3,201 to 10,000	13
10,001 and over	20

A test specimen which fails to conform to any requirement of this specifications shall not be used to determine the conformance to other requirements.

TEST REQUIREMENTS

Magnetic Thickness Measurements:

The thickness of the coating shall be determined by magnetic thickness gauge measurements in accordance with ASTM Practice E 376. For each specimen, five or more measurements shall be made at points widely dispersed throughout the volume occupied by the specimen so as to represent as much as practical, the entire surface area of the test specimen. The average of the five or more measurements thus made for each specimen is the specimen coating thickness.

For articles whose surface area is greater than 100,000 mm^2 (160 in^2), in the average of the three specimen coating thickness grades comprising each test article is the average coating thickness for that test article. A specimen must be evaluated for each steel category and material thickness within the requirements for each specimen of the test article

For articles whose surface area is equal to or less than 100,000 mm^2 (160 in^2), the average of all specimen coating thickness grades is the average coating thickness for the sample.

The use of magnetic measurement method is appropriate for larger articles, and may be appropriate for smaller articles when such is practical using ASTM Practice E 376.

Stripping Method

The average weight of coating may be determined by stripping a test article, a specimen removed from a test article, or group of test articles in the case of very small items such as nails, etc., in accordance with Test method ASTM A 90/A 90m. The weight of coating per unit area thus determined is converted to equivalent coating thickness values in accordance with Table 2, Coating Thickness Grade (rounding up or down as appropriate). The thickness of coating thus obtained is the test article coating thickness, or in the case of a specimen removed from a test article, is the specimen average coating thickness.

Table 2 – Coating Thickness Grade [A]

Coating Grade	mils	oz/ft^2	µm	g/m^2
35	1.4	0.8	35	245
40	1.4	1.0	45	320
50	2.0	1.2	50	355
55	2.2	1.3	55	390
60	2.4	1.4	60	425
65	2.6	1.5	65	460
75	3.0	1.7	75	530
80	3.1	1.9	80	565
85	3.3	2.0	85	600
100	3.9	2.3	100	705

[A] Conversions in Table 2 are based on the metric thickness value equivalents from the next earlier version, using conversion factors consistent with Table X 2.1 in Specification A 653/A 653M, rounded to the nearest 5 µm (0.0002 in.). The conversion factors used are: mils = µm x 0.03937; oz/ft^2 = µm x 0.002316; g/m^2 = µm x 7.067.

Weighing Before or After Galvanizing

The average of coating may be determined by weighing articles before and after galvanizing, subtracting the first weigh from the second and dividing the result by the surface area. The first weigh shall be determined after pickling and drying, and the second after cooling to ambient temperature. The weight of coating per unit area thus determined is converted to equivalent coating thickness values according to Table 2 (rounding up or sown as

appropriate). The thickness of coating thus obtained is the test article coating thickness.

Microscopy

The thickness of coating may be determined by cross-sectional and optical measurement in accordance with ASTM Test Method B 487. The thickness thus determined is a point value. No less than five such measurements shall be made at locations on the test article which are as widely dispersed as practical, so as to be representative of the whole surface of the test article. The average of no less than five such measurement is the specimen coating thickness.

Adhesion

Determine adhesion of the zinc coating to the surface of the base metal by cutting or prying with the point of a stout knife, applied with considerable pressure in a manner tending to remove a portion of the coating. The adhesion shall be considered inadequate if the coating flakes off in the form of a layer of the coating so as to expose the base metal in advance of the knifepoint. Do not use testing carried out at edges or corners (points of lowest coating adhesion) to determine adhesion of the coating. Likewise, do not use removal of small particles of the coating by paring or whittling to determine failure.

Embrittlement

Test for embrittlement may be made in accordance with ASTM Practice A 143

The galvanized article should withstand a degree of bending substantially the same as the ungalvanized article. Flaking or spalling of the galvanized coating is not be constructed as anembrittlement failure.

Inspection, Rejection and Retest

The material shall be inspected at the galvanizer's plant prior to shipment. However, by agreement the purchaser may make the tests which govern the acceptance or rejection of the materials in his own laboratory or elsewhere.

When inspection of materials to determine conformity with the visual requirements of Subsection "Finish" warrants rejection of a lot, the galvanizer may sort the lot and submit it once again for acceptance after he has removed any nonconforming articles and replace them with conforming articles.

Materials have been rejected for reasons other than embrittlement may be stripped and regalvanized, and again submitted for inspection and test at which time they shall conform to the requirements of this inspection.

Transport and Storage

Galvanized components shall, wherever possible, be transported and stored under dry, well-ventilated conditions to prevent the formation of wet storage staining.

Either zinc phosphate or chromate passivation treatment after galvanizing may be used to minimize the wet storage staining which may occur on articles unable to be stored in dry, well-ventilated conditions.

Provided the coating thickness complies with the requirements of Subsection "Coating Thickness", no further remedial action is required to the stained areas.

ITEM 06 : MOORING AND FENDERING SYSTEM

SCOPE OF WORK

1. The work includes furnishing of all labor, materials and equipment to complete the installation of mooring bollards and fenders in piers/wharves.

2. The work shall include the supply, transport, handling, storage and installation of fenders systems in the newly constructed piers.

3. The Contractor shall furnish and install the necessary fittings as shown on the drawings and/or specified.

Supplementary parts necessary to complete and install each item of works shall be included whether or not shown or specified. The Contractor shall furnish to relevant trades all anchors, fastenings, inserts, fittings, fixtures or the like to be installed on or required for securing the works.

The Contractor shall submit shop drawings of all fitting works prior to placing orders and commencement of any fabrication.

MATERIAL REQUIREMENTS

MOORING SYSTEM

Designated load capacity of mooring bollards shall be as shown in the drawings, and shall be referred to as the maximum load capacity. The mooring bollards shall be at rupture stage upon reaching the maximum load capacity.

Mooring bollards shall be of the dimensions, weights, capacities and designs as shown in the drawings and shall be fabricated by approved manufacturer with cast steel conforming to the requirements indicated in the plan/drawings, or approved equivalent.

The size of the bolts, nuts and washers shall be in accordance with the specifications provided in the plans/drawings. The anchor plate shall be connected to the holding down bolt as shown in the plans/drawings. All bolts, nuts, washers etc., that are exposed shall be hot-dip galvanized.

Samples of the bolts, nuts, washers and anchor plates shall be submitted to the Engineer for approval before being used in the Works.

The upper part of bollards and base plates which are not embedded in concrete shall be painted. The surface of bollards shall be cleaned thoroughly by wire brush or other means prior to painting to remove rust or any other contamination which may interfere with bond of paint to metal.

The exposed surface shall be coated with rust proof paint and finishing paint, which shall be coal-tar epoxy of 120m micron thickness in accordance with JIS K5623 or the approved standard.

Base Steel:

Chemical composition and mechanical properties of base metal to be used for fabrication of mooring bollard and its accessories shall comply with ASTM A36 and other required standard stated therein.

Concrete Foundation :

Concrete foundation for mooring bollards shall conform to the requirements of the Section concerning "Reinforced Concrete".

Visual Inspection :

All mooring bollards delivered to Site shall be inspected by the Engineer for any signs of flaws or defect inimical to usage.

Mill Test Certificates:

Two (2) copies of mill test reports shall be submitted certifying that materials meet the specified standards.

Test Inspection:

Inspection of all materials and methods of fabrication shall be carried out by the Contractor. However, the Engineer reserves the right to inspect all facilities at any time during the manufacture to ensure that the materials and workmanship are in accordance with Specifications and the best of workmanship.

FENDER SYSTEM

The rubber fenders should comply with the performance requirements specified in the table provided on the plan/drawings of Rubber Dock Fenders (RDF).

PHYSICAL PROPERTIES OF MATERIALS

The rubber for the fenders shall be of high quality natural rubber, synthetic rubber or mixed rubber blended with carbon black used in the rubber industry and shall have sufficient resilience and anti-ageing, weathering, abrasion, wear and oil resistant properties. The rubber dock fenders shall be free from bubbles, cracks and other harmful defects.

The physical properties of the rubber compound used for the fenders shall comply with the following requirements:

Physical Properties and Test Method

Test Item			Properties	Test Method	
Physical Test	Before Aging	Tensile Strength	160kg/sq.m minimum	Test piece: Dumbell No. 3	ASTM D412
		Elongation	350% minimum		ASTM D1456
		Hardness	76Hs maximum	Spring Type hardness test (Type A)	ASTM D2240
	After Aging	Tensile Strength	Not less than 80% of original value	Aging by air heating: 70±1°C x 96 hours.	ASTM D412
		Elongation			ASTM D1456
		Hardness	Not more than original value +8°		ASTM D2240
	Compression Test		30% maximum	Heat treatment: 70±1°C x 22 hours.	ASTM D395

Note: Equivalent Standards are acceptable.

FITTINGS AND ANCHORAGE

Anchor bolts and connecting hardware shall be fabricated using type of steel specified and to the required shapes and sizes shown on the approved plan/drawings.

TESTING, SAMPLING, INSPECTION, ACCEPTANCE, MARKING AND PACKAGING

Testing

All rubber dock fenders shall be tested for performance. It shall pass the required energy absorption and reaction force at a certain deflection as indicated in the plan.

The Contractor shall be required to submit test certificates showing compliance to the above requirements. The test certificates shall be certified by an independent testing institute / organization recognized by the Authority.

The standard performance testing methodology shall be Method B, to wit:

1. Fender temperature shall be stabilized at 23 degrees plus or minus 5 degrees centigrade for at least 24 hours before compression testing.

2. Break-in of fender by deflecting 3 times to rated deflection.

3. Removed load from the RDF and allow recovering for a minimum of 1 hour.

4. Deflect RDF at speed of 2-8 cm/min once to rated deflection.

The testing apparatus shall be calibrated and certified within plus or minus 1% in accordance with ISO or equivalent JIS or ASTM requirements. Calibration shall be traceable to a national/international standard and shall be performed annually by an accredited third party organization. The RDF performance testing center shall be subjected to accreditation by PPA and notation and /or certification by DPWH-BRS prior to acceptance.

Inspection

All fenders of each type shall be inspected for compliance to specified dimensions and all fenders shall be inspected by the Engineer for any sign of flaw or defect inimical to its use.

All anchor bolts and fittings shall be inspected. The material used for the fabrication of bolts and fittings shall be covered by the manufacturer's certified mill certificate and shall be verified by the Authority.

All RDF items/units shall be clearly numbered and marked indicated the following:

Acceptance Tolerance

The acceptance tolerance shall be based on the following:

1. Fender Dimension

Length	:	-2% to +4%
Width	:	-2% to +4%
Height	:	-2% to +4%
Thickness	:	-2% to +8%

2. Anchor Bolt Holes in Fender

Diameter of the Hole	:	+2.0mm
Pitch of the Hole	:	+4.0mm

3. Acceptance tolerance for all fenders supplied shall be as follows:

E = Energy absorption,	E ≥ Specified E but not less than 10% of the specified E
R = Reaction force,	R ≤ Specified R but not more than 10% of the specified R

Marking

All fender units shall be clearly numbered and marked. Each fender shall have the following markings.

1. Fender type and manufacturer's name or trade mark
2. Production serial number
3. Date of manufacture or its abbreviation
4. Main dimensions
5. Project identification as follows:

Name of Port/Project:_____

Year supplied _____

Packaging

The fenders shall be packaged on wooden crate or wrapped individually with Polypropylene sheets except when shipped containerized. The bolts and fittings should be placed in crates and suitably treated for protection when transported by sea and stored in port areas.

EXECUTION

MOORING / FENDERING SYSTEM

All units shall be installed at the locations shown on the drawings and as directed by the Engineer.

ITEM 07 : PROJECT BILLBOARD


SPECIFICATION


The Project Billboard shall be installed at location(s) designated by the Engineer.

The size and specifications of materials for the standard billboard shall be 4ft. x 8ft. (1,200mm x 2,400mm) using ½ inch (12mm) marine plywood or tarpaulin poster on 3/16 inch (5mm) marine plywood.

Project billboards shall not contain Name(s) and/or picture(s) of any personages.

See attached drawings for further details of the standard billboard.

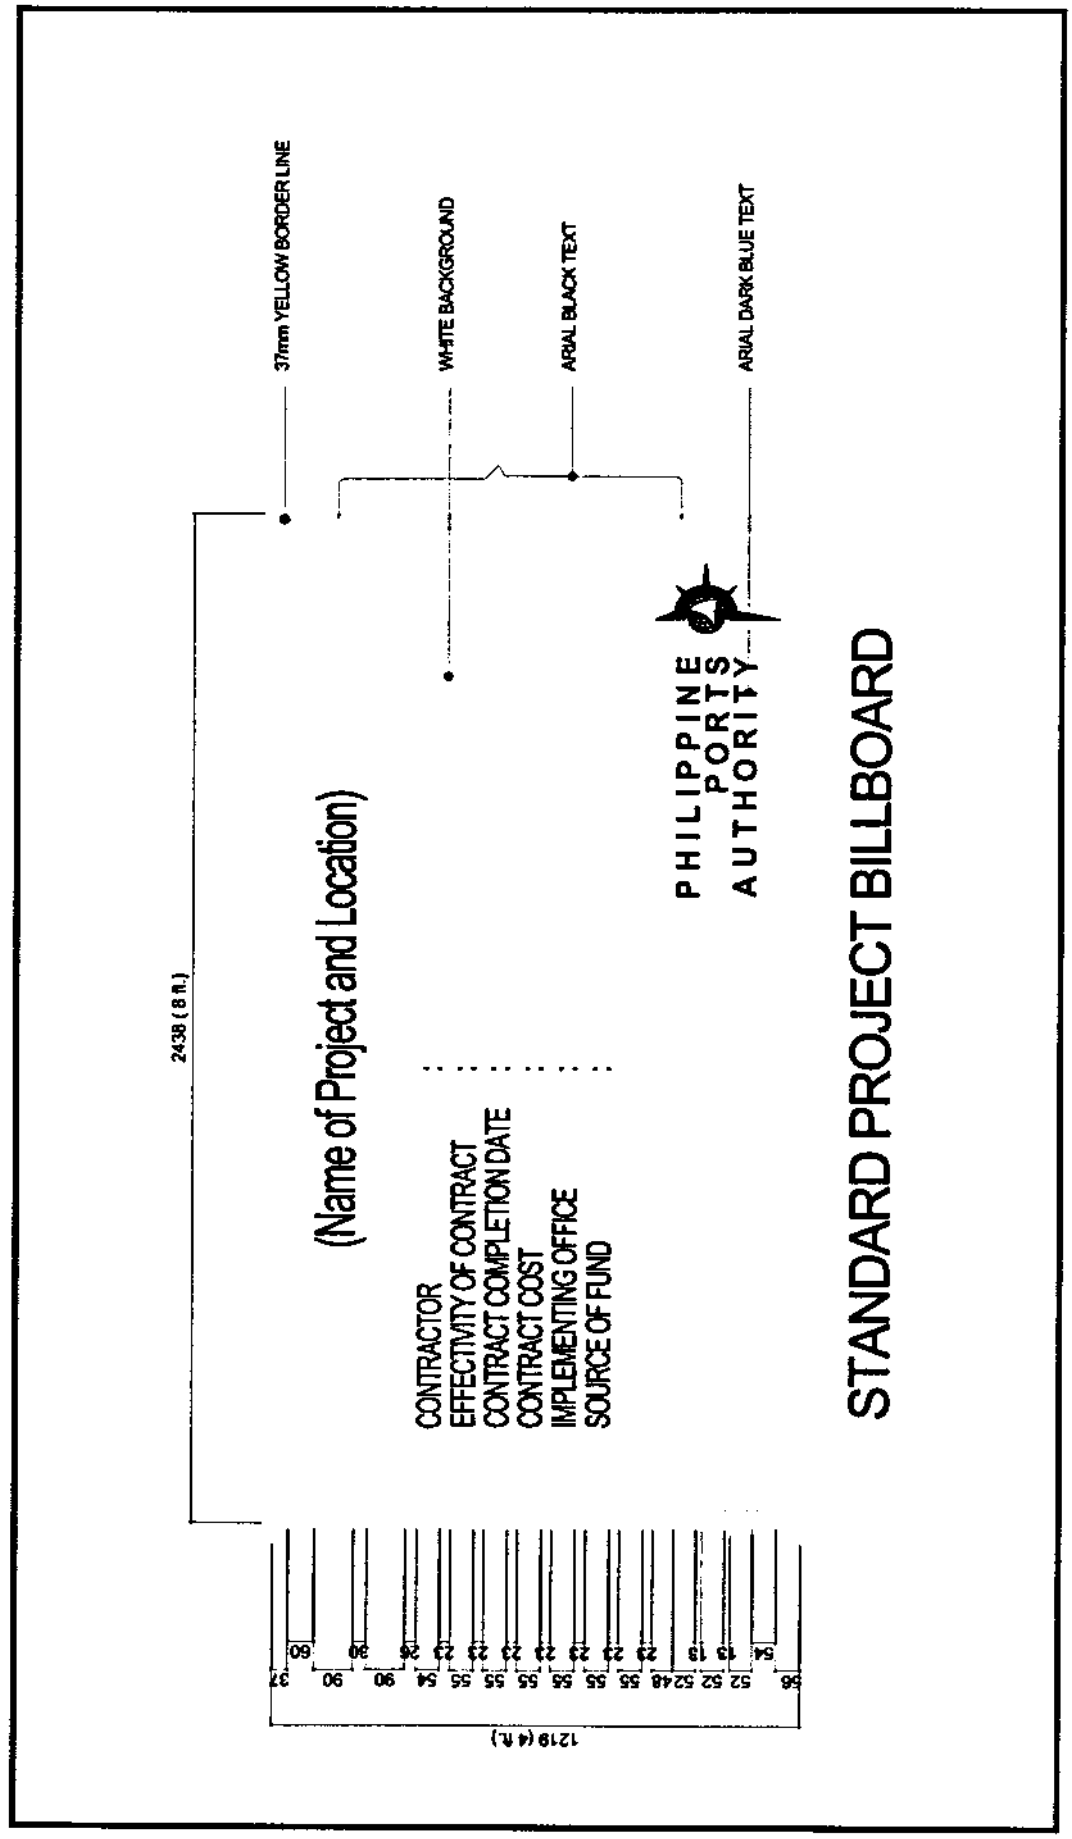
37mm YELLOW BORDER LINE
WHITE BACKGROUND
ARIAL BLACK TEXT
ARIAL DARK BLUE TEXT
2438 (8 ft.)
(Name of Project and Location)
CONTRACTOR
EFFECTIVITY OF CONTRACT
CONTRACT COMPLETION DATE
CONTRACT COST
IMPLEMENTING OFFICE
SOURCE OF FUND
PHILIPPINE PORTS AUTHORITY
STANDARD PROJECT BILLBOARD
1219 (4 ft.)
56 52 52 52 48 23 23 55 55 55 55 23 23 23 23 54 90 90 30 26 60 37

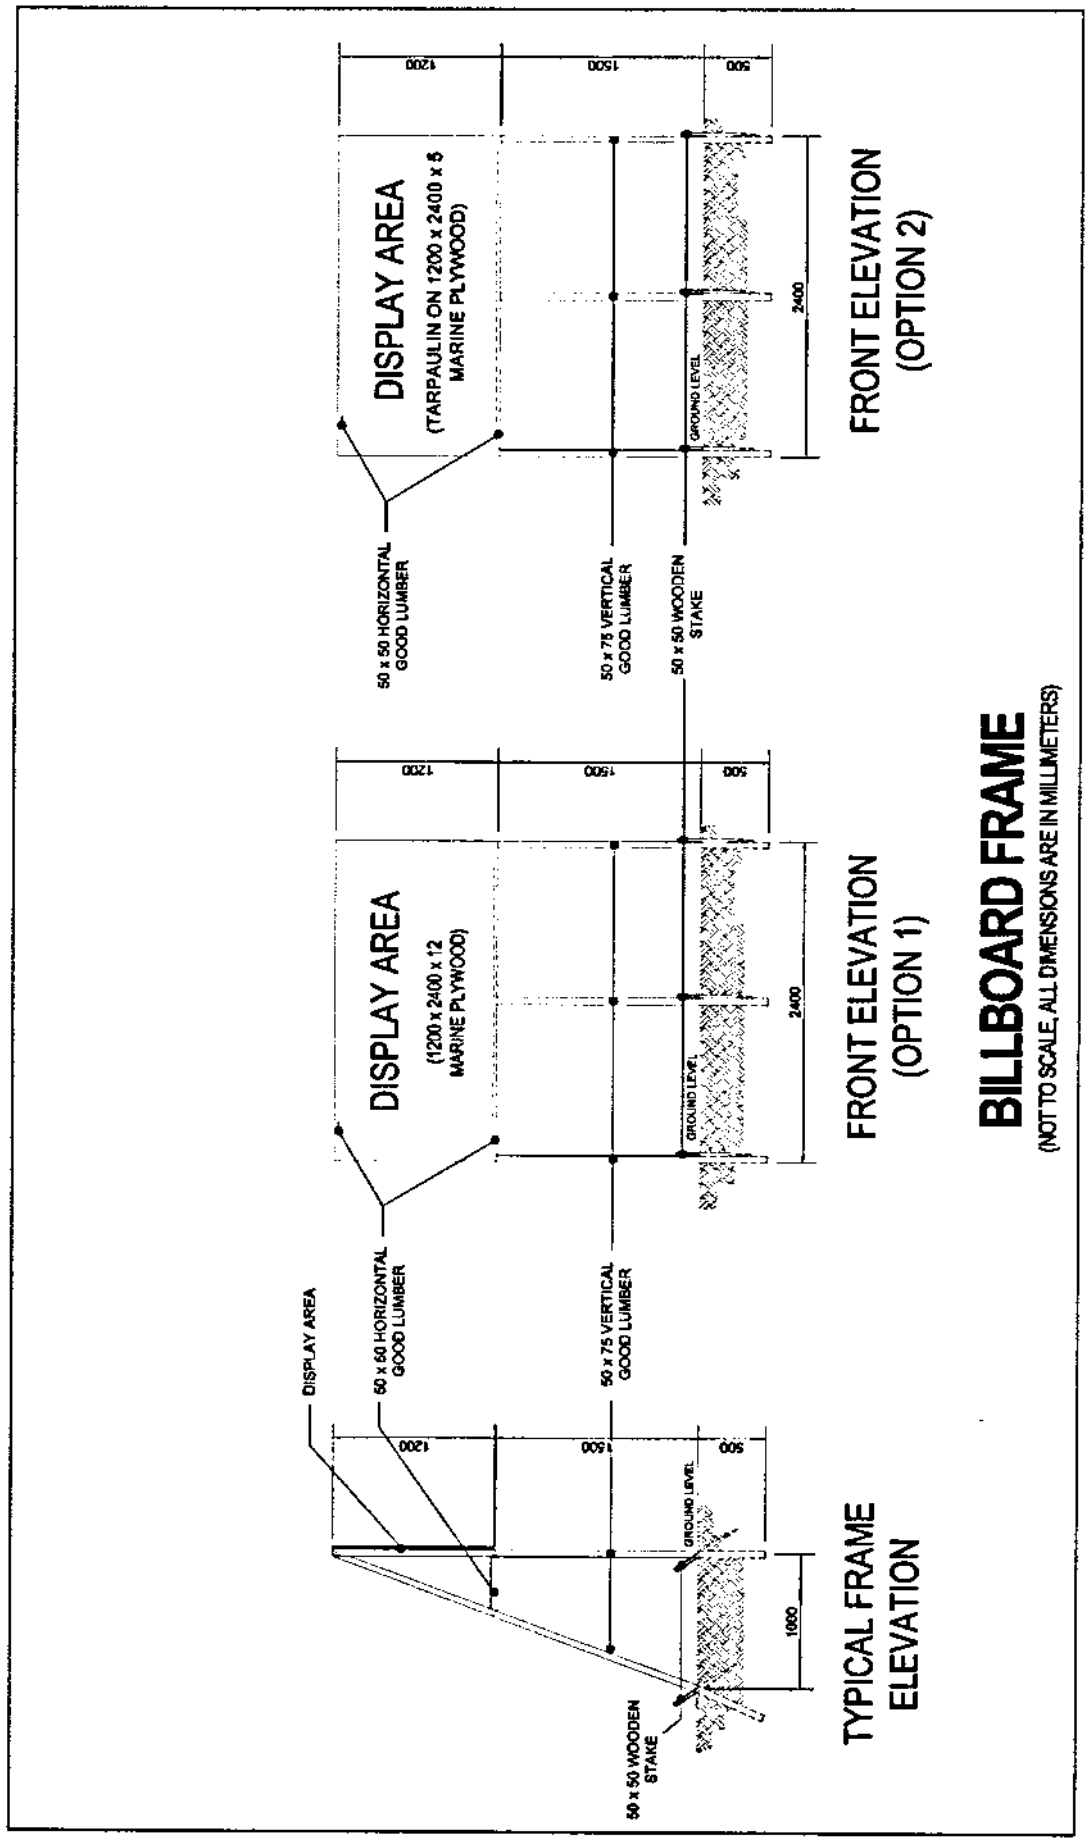
BILLBOARD FRAME
(NOT TO SCALE, ALL DIMENSIONS ARE IN MILLIMETERS)
FRONT ELEVATION
(OPTION 2)
DISPLAY AREA
(TARPAULIN ON 1200 x 2400 x 6
MARINE PLYWOOD)
50 x 50 HORIZONTAL
GOOD LUMBER
50 x 75 VERTICAL
GOOD LUMBER
50 x 50 WOODEN
STAKE
GROUND LEVEL
2400
1200
1500
500
FRONT ELEVATION
(OPTION 1)
DISPLAY AREA
(1200 x 2400 x 12
MARINE PLYWOOD)
TYPICAL FRAME
ELEVATION
DISPLAY AREA
1000

ITEM 08 : SAFETY SIGNAGES AND BARRICADES

DESCRIPTION

This work includes the furnishing and installing of safety signages and barricades in accordance with the specifications and to the details shown below in the drawings, or as directed by the Engineer.


SPECIFICATION

The Signage's and Barricades shall be installed at location(s) designated by the Engineer.

The sizes of the standard signages shall be 2-2/3ft x 4ft (800mm X 1,200mm) for fixed type and 2ft x 2–2/3ft (600mm x 800mm) for mobile type. For barricade standard 2ft x 2-2/3ft (600mm x 800mm) shall be provided.

The materials to be used for signages and barricades are ½ inch (12mm) marine plywood or tarpaulin poster on 2" x 2" (50mm x 50mm) good lumber frame (see drawing below).

The printing or painting shall be the discretion of the Engineer.

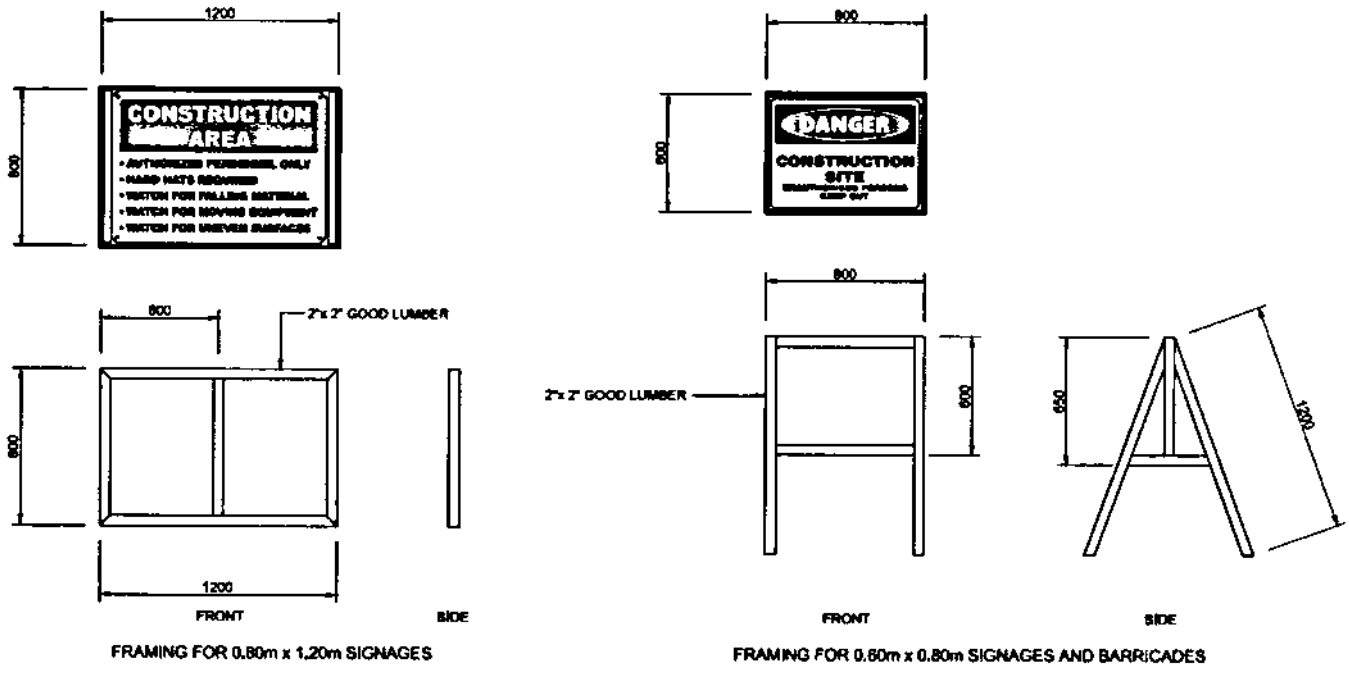

STANDARD PLAN FOR SIGNAGES AND BARRICADES

SECTION VII

DRAWINGS
(APPROVED PLANS)

SECTION VII

DRAWINGS AND APPROVED PLANS
(SEE ISSUED APPROVED PLANS)

LIST OF DRAWINGS:

PS 01 OF 17	DEVELOPMENT PLAN, GENERAL NOTES, DESIGN PARAMETERS, LIST OF DRAWINGS AND LOCATION MAP.
PS 02 OF 17	GENERAL PLAN.
PS 03 OF 17	PILING AND FRAMING LAYOUT.
PS 04 OF 17	WHARF OFF-SHORE ELEVATION AND SECTION A-A.
PS 05 OF 17	SECTION B-B, SECTION C-C, SECTION D-D AND SECTION E-E.
PS 06 OF 17	SECTION F-F AND SECTION G-G.
PS 07 OF 17	DETAILS OF 450mm x 450mm PRE-STRESSED CONCRETE PILE.
PS 08 OF 17	PILE CAP DETAILS, DETAIL OF CURTAIN WALL, DETAIL OF CONSTRUCTION JOINT AND DETAIL OF WHARF SLAB
PS 09 OF 17	BEAM DETAILS AT R.C. WHARF.
PS 10 OF 17	BEAM DETAILS AT R.C. WHARF, DETAIL OF JOINT BEAM AND PILE OF PILE JACKET.
PS 11 OF 17	REINFORCEMENT DETAIL OF MOORING /FENDERING BLOCK-1 AND TYPICAL ATTACHMENT OF 600H x 2000L RDF AND 35T/50T MOORING TEE-HEAD.
PS 12 OF 17	BEAM DETAILS AT RORO RAMP.
PS 13 OF 17	DETAIL OF RORO RAMP SLAB AND RORO RAMP PILE CAP DETAILS.
PS 14 OF 17	INSTALLATION DETAIL OF STEEL RAMP PROTECTION AT R.C. DECK.
PS 15 OF 17	REINFORCEMENT DETAIL OF MOORING/FENDERING BLOCK-2 AND TYPICAL ATTACHMENT OF 500H x 1500L RDF AND 35T MOORING TEE-HEAD.
PS 16 OF 17	DETAIL OF 50 TON MOORING TEE - HEAD AND DETAIL OF 35 TON MOORING TEE - HEAD.
PS 17 OF 17	DETAIL OF V-TYPE RUBBER DOCK FENDER (V600H x 2000L) AND DETAIL OF V-TYPE RUBBER DOCK FENDER (V500H x 1500L)

SECTION VIII

BILL OF QUANTITIES and ATTACHMENTS

BID SUMMARY
BATARAZA PORT RESTORATION PROJECT
Port of Bataraza, Brgy. Bulliuyan, Bataraza, Palawan

NO.	DESCRIPTION OF WORK	AMOUNT (Pesos)
BILL NO.	1 GENERAL EXPENSES	
BILL NO.	2 RC PIER AND RORO RAMP	
	BID PRICE	

Name of Firm	Name of Bidder/Authorized Representative (Signatory's Legal Capacity)	Date

BILL OF QUANTITIES
BATARAZA PORT EXPANSION PROJECT
Port of Bataraza, Brgy. Bulliuyan, Bataraza, Palawan

NO. (1)	DESCRIPTION OF WORK (2)	UNIT (3)	QTY. (4)	UNIT PRICE (Pesos) (5)	AMOUNT (Pesos) (4) x (5)
BILL NO.	**1 GENERAL EXPENSES**				
1.01	Mobilization, demobilization and cleaning	lot	1		
1.02	Rental of temporary site office and residence for the Engineer and staff	mo.	15		
1.03	Maintain temporary site office and residence for the Engineer and staff	mo.	15		
1.04	Provide Construction Safety and Health Program in the execution of the project	mo.	15		
	TOTAL FOR BILL NO. 1				-

Name of Bidder/ Authorized Representative
(Signatory's Legal Capacity)

BILL OF QUANTITIES
BATARAZA PORT EXPANSION PROJECT
Port of Bataraza, Brgy. Bulliuyan, Bataraza, Palawan

NO. (1)	DESCRIPTION OF WORK (2)	UNIT (3)	QTY. (4)	UNIT PRICE (Pesos) (5)	AMOUNT (Pesos) (4) x (5)
BILL NO.	**2 RC PIER AND RORO RAMP**				
2.01	Remove and dispose existing roro ramp (deck and beam included)	sq.m.	125		
2.02	Chip-off of existing pile cap for build-up	no.	19		
2.03	Remove existing rubber dock fender and turn-over to the Authority	no.	3		
2.04	Chip-off RC curb and smoothened with mortar	l.m.	17		
2.05	Supply, deliver and drive 450mm x 450mm PSC Test piles	no.	3		
2.06	Supply and deliver to site 450mm x 450mm PSC piles	l.m.	5,982		
2.07	Handle, pitch and drive 450mm x 450mm vertical PSC piles	l.m.	3,024		
2.08	Handle, pitch and drive 450mm x 450mm batter PSC piles	l.m.	2,958		
2.09	Chip/cut and dispose portion of driven PSC piles up to required elevation	no.	213		
2.10	Apply concrete epoxy to existing concrete prior to concrete pouring	sq.m.	19		
2.11	Supply and place 3,500 psi. concrete for pile cap, beam, curtain wall, deck, RC curb and lamp post foundation	cu.m.	815		
2.12	Supply and install steel reinforcement for pile cap, beam, curtain wall, deck, RC curb and lamp post foundation	kg.	122,755		

Name of Bidder/ Authorized Representative
(Signatory's Legal Capacity)

BILL OF QUANTITIES
BATARAZA PORT EXPANSION PROJECT
Port of Bataraza, Brgy. Bulliuyan, Bataraza, Palawan

NO. (1)	DESCRIPTION OF WORK (2)	UNIT (3)	QTY. (4)	UNIT PRICE (Pesos) (5)	AMOUNT (Pesos) (4) x (5)
2.13	Supply and install 20mm thk. steel ramp protection plate (ASTM A572, Grade 50) including dowel connectors	kg.	5,616		
2.14	Supply and Install hot-dipped galvanized 100mm x 100mm x 10mm angle bar for construction joints, including dowel bars	l.m.	54		
2.15	Supply and deliver to site rubber dock fender (V-type, 600H x 2000L) including accessories	set	12		
2.16	Supply and deliver to site rubber dock fender (V-type, 500H x 1500L) including accessories	set	5		
2.17	Install rubber dock fender including accessories	set	17		
2.18	Supply and deliver to site 50T mooring bollard, T-head, including accessories	set	5		
2.19	Supply and deliver to site 35T mooring bollard, T-head, including accessories	set	7		
2.20	Install mooring bollard including accessories	set	12		
	TOTAL FOR BILL NO. 3				-

Name of Bidder/ Authorized Representative
(Signatory's Legal Capacity)

BASIS OF PAYMENT FOR WORK ITEMS INCLUDED IN THE PROPOSAL

The work items included in the proposal and the basis of payments are as follows:

BILL NO. 1

GENERAL EXPENSES

Item 1.01 Mobilization, demobilization, and cleaning

The quantity to be paid for shall be the minimum equipment requirement enumerated in the bid documents mobilized, demobilized and cleaning of the site and accepted by the Engineer. The contract lump sum price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to mobilize and demobilize all the minimum equipment requirement enumerated in the bid documents including cleaning of the site. Fifty percent (50%) of the total amount shall be payable after the mobilization activity while the remaining (50%) payable after demobilization and cleaning.

Item 1.02 Rental of temporary site office and residence for the Engineer and staff

The quantity to be paid for shall be the actual rental of site office and residence for the engineer and staff and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary for the provision of temporary site office and residence for the engineer and staff.

Item 1.03 Maintain temporary site office and residence for the Engineer and staff

The quantity to be paid for shall be the actual services rendered in maintaining the site office and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the maintenance of the temporary site office and residence as well as other expenses such as provision for electric power, telephone bill, potable water supply, janitorial and security services.

Item 1.04 Provide construction safety and Health Program in the execution of the project

The quantity to be paid for shall be the actual implementation of construction safety and health program and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools and incidentals necessary to complete the implementation of the Construction Safety and Health Program, as required and approved by the Department of Labor and Employment (DOLE).

BILL NO. 2

RC PIER AND RORO RAMP

Item 2.01 **Remove and dispose existing roro ramp (deck and beam included)**

The quantity to be paid for shall be the actual area in square meter of existing roro ramp (deck and beam included) to be removed and disposed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 2.02 **Chip-off existing pile cap for build-up**

The quantity to be paid for shall be the actual number of existing pile cap to be chipped off for build-up in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 2.03 **Remove existing rubber dock fender and turn-over to the Authority**

The quantity to be paid for shall be the actual number of existing rubber dock fender to be removed and turned over to the Authority as directed by the Engineer in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 2.04 **Chip-off R.C. Curb and smoothen with mortar**

The quantity to be paid for shall be the actual length in linear meter of RC curb to be chipped off and smoothened with mortar in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 2.05 **Supply, deliver and drive 450mm x 450mm PSC Test piles**

The quantity to be paid for shall be the actual number of 450mm x 450mm PSC Test piles to be supplied, delivered, and driven in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 2.06 **Supply and deliver to site 450mm x 450mm PSC piles**

The quantity to be paid for shall be the actual length in linear meter of 450mm x 450mm PSC piles to be supplied and delivered to site in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 2.07 Handle, pitch, and drive 450mm x 450mm vertical PSC piles

The quantity to be paid for shall be the actual length in linear meter of 450mm x 450mm vertical PSC piles to be handled, pitched, and driven in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 2.08 Handle, pitch and drive 450mm x 450mm batter PSC piles

The quantity to be paid for shall be the actual length in linear meter of 450mm x 450mm batter PSC piles to be handled, pitched, and driven in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 2.09 Chip/cut and dispose portion of driven PSC piles up to required elevation

The quantity to be paid for shall be the actual number of driven PSC piles whose portion is to be chipped/cut off up to required elevation including proper disposal of debris in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 2.10 Apply concrete epoxy to existing concrete prior to concrete pouring

The quantity to be paid for shall be the actual area in square meter of existing concrete to be applied with concrete epoxy prior to concrete pouring in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 2.11 Supply and place 3,500 psi. concrete for pile cap, beam, curtain wall, deck, RC curb and lamp post foundation

The quantity to be paid for shall be the actual volume in cubic meter of 3,500 psi concrete supplied and set-in-place for pile cap, beam, curtain wall, deck, RC curb and lamp post foundation in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 2.12 Supply and install steel reinforcements for pile cap, beam, curtain wall, deck, RC curb and lamp post foundation

The quantity to be paid for shall be the actual weight in kilogram of reinforcing steel bars to be supplied and installed for pile cap, beam, curtain wall, deck, RC curb and lamp post foundation in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 2.13 Supply and install 20mm thick steel ramp protection plate (ASTM A572, Grade 50) including dowel connectors

The quantity to be paid for shall be the actual weight in kilogram of 20mm thick steel ramp protection plate (ASTM A572, Grade 50) including dowel connectors to be supplied and installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 2.14 Supply and install hot-dipped galvanized 100mm x 100mm x 10mm angle bar for construction joints, including dowel bars

The quantity to be paid for shall be the actual length in linear meter of hot-dipped galvanized 100mm x 100mm x 10mm angle bar for construction joints, including dowel bars to be supplied and installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 2.15 Supply and deliver to site rubber dock fender (V-type, 600H x 2000L) including accessories

The quantity to be paid for shall be the actual set of rubber dock fender (V-type, 600H x 2000L) including accessories to be supplied and delivered to site in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 2.16 Supply and deliver to site rubber dock fender (V-type, 500H x 1500L) including accessories

The quantity to be paid for shall be the actual set of rubber dock fender (V-type, 500H x 1500L) including accessories to be supplied and delivered to site in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 2.17 Install rubber dock fender including accessories

The quantity to be paid for shall be the actual set of rubber dock fender and cone fender including accessories to be installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 2.18 Supply and deliver to site 50T mooring bollard, T-head, including accessories

The quantity to be paid for shall be the actual set of 50T mooring bollard, T-head, including accessories to be supplied and delivered to site in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 2.19 Supply and deliver to site 35T mooring bollard, T-head, including accessories

The quantity to be paid for shall be the actual set of 35T mooring bollard, T-head including accessories to be supplied and delivered to site in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

Item 2.20 Install mooring bollard including accessories

The quantity to be paid for shall be the actual set of mooring bollard including accessories to be installed in accordance with the plans and specifications and accepted by the Engineer. The contract unit price shall be full compensation for furnishing all materials, labor, equipment, tools, and incidentals necessary to complete the work.

FACILITIES TO BE PROVIDED FOR THE ENGINEER & HIS STAFF

RENTAL OF SITE OFFICE AND RESIDENCE FOR THE ENGINEER & STAFF

The Contractor shall provide a temporary site office and residence (rental) with an area of at least 48 square meters for use of the Engineer and his staff for the whole duration of the project.

MINIMUM MAJOR EQUIPMENT REQUIREMENTS

1	unit/s	Concrete Mixer (1 bagger, minimum), owned
1	unit/s	Concrete bucket, owned
1	unit/s	Concrete Vibrator (3.5 hp, minimum), owned
1	unit/s	Crane Barge (319 GW, minimum) with 60T crane, owned
1	unit/s	Crawler Crane (30T, minimum), owned
1	unit/s	Pile Hammer (Diesel, Minimum 13,500 kg.m. to Maximum 16,500 kg.-m. or Hydraulic equivale
1	unit/s	Drop Hammer (2T, minimum), owned
1	unit/s	Dump Truck (10T net cap., minimum), owned
1	unit/s	Bar Bender (electric, 25mm dia min.), owned
1	unit/s	Bar Cutter (electric, 25mm dia min.), owned
2	unit/s	Oxy/Acetylene cutting outfit, owned
1	unit/s	Payloader (80 hp, minimum), owned
2	unit/s	Transit Mixer (6 cu.m. cap., minimum), owned/leased
1	unit/s	Tugboat (500hp, minimum), owned
1	unit/s	Water Truck with pump (1,000 gal., minimum), owned
2	unit/s	Welding Machine (400 amp., minimum), owned
1	unit/s	Cargo Truck (2T, minimum) , owned

CONSTRUCTION SAFETY AND HEALTH REQUIREMENT

The Contractor shall implement the construction safety and health program in accordance with the applicable provisions of the Occupational Safety and Health Standards (OSHS) of the Department of Labor and Employment (DOLE).

The Contractor, subject to the approval of the Engineer shall provide and maintain throughout the duration of the contract a medical room with at least 15 square meters together with all necessary supplies to be sited in the Contractor's main area.

The Contractor shall provide the following minimum requirements:

L A B O R

1	no.	Safety Engineer / Officer
1	no.	Nurse / Health Officer

EQUIPMENT / MATERIALS

Personnel Protective Equipment

37	pcs.	Hard Hats
37	pairs	Gloves (rubberized)
37	pcs.	Safety Glasses/Goggles (clear)
74	pcs.	Long sleeve T-shirt
6	pc.	Aprons
4	pc.	Safety Belts
37	pairs	Safety Shoes
4	sets	Life Lines

Safety Devices

1	lot	Barricades
1	lot	Warning signs
2	unit/s	Fire extinguisher (10kg)

Medical and First Aid System - Fifteen (15) mos.

NOTE:

The Contractor shall provide the above-cited minimum construction safety and health requirements or as required by the Engineer.

PPA MEMORANDUM CIRCULAR
No 02
Series of 2016
Attachment

REVISED SCHEDULE OF MINIMUM TEST REQUIREMENTS OF CONSTRUCTION MATERIALS FOR PPA INFRASTRUCTURE PROJECTS

Materials/Items of Work	*Required Tests*	*Minimum Incremental Frequency of Tests*
I. Construction of Pier/Wharf, Platform and Ramp		
Structural Concrete (SC)		
A Portland Cement	Quality Test	For every 2,000 bags (40kg) or fraction thereof
B Fine Aggregate	Quality Test for Grading, Elutriation (wash), Bulk Specific Gravity, Absorption, Mortar Strength, Soundness, Organic Impurities, Unit Weight, % Clay Lumps and Shale	For every 1,500 cubic meter or fraction thereof
C Coarse Aggregate	Quality Test for Grading, Bulk Specific Gravity, Absorption and Abrasion	For every 1,500 cubic meter or fraction thereof
D Water	Certificate from the Engineer or Quality Test for Density and Chloride Content	One per source
E Steel Bars	Mill Certificate and Quality Test for Chemical Composition and Mechanical Properties	For every 10,000 kg or fraction thereof
F Concrete	Compressive Strength on cylinder samples	1 set consisting of 3 concrete cylinder samples shall be taken from each day's pouring and to represent not more than 75 cu m of concrete or fraction thereof
	Slump Test	For every mix
G Admixture and Concrete Curing Materials	Quality Test	One per shipment
Piling (P)		
A Concrete Piles	Fabrication Report	One per fabrication
1 Concrete	Same test as for SC (F)	Same frequency as SC (F)
2 Steel Bars	Same test as for SC (E)	Same frequency as SC (E)
3 High Tension Strand	Test for Chemical Composition and Mechanical Properties	For every 20000kg or fraction thereof

Materials/Items of Work	Required Tests	Minimum Incremental Frequency of Tests
4 Coarse Aggregates	Same Test as for SC (C)	Same frequency as SC (C)
5 Fine Aggregates	Same Test as for SC (B)	Same frequency as SC (B)
B Steel Pipe Piles	Fabrication Report, Mill Certificate and Quality Test for Chemical and Mechanical properties	One per fabrication
1 Steel	Chemical Composition (refer below)	
	- Under 14" (355 60mm) Outside Diameter	2 from 200 pipe of fraction thereof
	- 14" to 36" (355 6 to 914mm) Outside Dia	2 from 100 pipe or fraction thereof
	- Over 36" (914mm) Outside Diameter	2 from 3000ft (914m) or fraction thereof
	Mechanical/Tensile	One (1) tension test shall be made on one length or fraction thereof of each size, or one piece of skelp representing each lot of 200 lengths or fraction thereof of each size
2 Polyurethane Coating	Mill Certificate and Quality Test	One per fabrication
3 Concrete	Same test as for SC (F)	Same frequency as SC (F)
4 Fine Aggregate	Same test as for SC (B)	Same frequency as SC (B)
5 Coarse Aggregate	Same test as for SC (C)	Same frequency as SC (C)
6 Steel Bars	Same Test as SC (E)	Same frequency as SC (E)
7 Water	Same Test as SC (D)	Same frequency as SC (D)
Rubber Dock Fenders (RDF)	Physical Test	All units
	Performance Test for Energy Absorption and Reaction Force	All units
Accessories		
Washer and Fixing Bolt, Anchor Bolt	Physical Test	All units
	Quality Test for Chemical Composition and Mechanical Properties	One per fabrication

Materials/Items of Work	***Required Tests***	***Minimum Incremental Frequency of Tests***
Mooring Bollard (MB) and Accessories (Hexagon Nuts, Plain Washer, Anchor Ring and Anchor Bolt)	Physical Test Quality Test for Chemical Composition and Mechanical Properties	All Units One per fabrication
II. Construction of Back-Up Area, Causeway and Pavement Sheet Piling (SP) A Concrete Sheet Piles		
1 Concrete	Same test as for SC (F)	Same frequency as SC (F)
2 Steel Bars	Same test as for SC (E)	Same frequency as SC (E)
3 High Tension Strands	Same test as for P (A 3)	Same frequency as P (A 3)
4 Fine Aggregates	Same test as for SC (B)	Same frequency as SC (B)
5 Coase Aggregates	Same Test as for SC (C)	Same frequency as SC (C)
B Steel Pipe Piles		
1 Steel	Same test as for P (B1)	Same frequency as P (B1)
2 Concrete	Same test as for SC (F)	Same frequency as SC (F)
3 Fine Aggregate	Same test as for SC (B)	Same frequency as SC (B)
4 Steel Bars	Same test as for SC (E)	Same frequency as SC (E)

Materials/Items of Work	***Required Tests***	***Minimum Incremental Frequency of Tests***
Rocks	Test for Apparent Specific Gravity and Abrasion	For every 1,500 cubic meter or fraction thereof
Geotextile Filter	Physical and Mechanical Test Mill Certificate	One per batch One per batch
Sand and Gravel Fill	Quality Test for Organic Impurities and Grading	For every 1,500 cubic meter or fraction thereof
Selected Fill	Quality Test for Grading, Plasticity and Laboratory Compaction Test Laboratory California Bearing Ratio (CBR) Field Density Test	For every 1,500 cubic meter or fraction thereof For every 2,500 cubic meter or fraction thereof For every layer of 150mm of compacted depth at least one group of three in-situ density test for every 500 sq m or fraction thereof
Aggregate Base Course	Quality Test for Grading and Plasticity Quality Test for Grading, Plasticity, Abrasion and Laboratory Compaction Test Laboratory California Bearing Ratio (CBR) Field Density Test	For every 300 cubic meter or fraction thereof For every 1,500 cubic meter or fraction thereof Same frequency as Selected Fill Same frequency as Selected Fill
Portland Cement Concrete Pavement (PCCP) A Portland Cement B Fine Aggregate C Coarse Aggregate D Water E Steel Bars (Dowels) F Joint Filler	 Same test as for SC (A) Same test as for SC (B) Same test as for SC (C) Same test as for SC (D) Same test as for SC (E) Quality Test	 Same frequency as SC (A) Same frequency as SC (B) Same frequency as SC (C) Same frequency as SC (D) Same frequency as SC (E) One (1) per shipment

Materials/Items of Work	***Required Tests***	***Minimum Incremental Frequency of Tests***
G Admixture and Concrete Curing Material	Same test as for SC (G)	Same frequency as SC (G)
H Concrete	Same test as for SC (F)	Same frequency as SC (F)
	Flexural Test	3 beam samples for every 330 sq m or fraction thereof
I Completed Pavement	Core Test	1 set (3 specimen) for every 2,500 sq m and fraction thereof
Interlocking Concrete Blocks		
A Cement	Same test as for SC (A)	Same frequency as SC (A)
B Fine Aggregate	Same test as for SC (B)	Same frequency as SC (B)
C Coarse Aggregate	Same test as for SC (C)	Same frequency as SC (C)
D Water	Same test as for SC (D)	Same frequency as SC (D)
E Admixture & Concrete Curing Materials	Same test as for SC (G)	Same frequency as SC (G)
F Completed Blocks	Physical Test and Compressive Strength	6 blocks per day of fabrication
Cement Treated Base Course (CTB)		
A Portland Cement	Same test as for SC (A)	Same frequency as SC (A)
B Fine & Coarse Aggregates	Quality Test for Grading, Abrasion and Soundness	For every 1,500 cubic meter or fraction thereof
C Water	Same test as for SC (D)	Same frequency as SC (D)
D Completed CTB	Field Density Test	For every layer of 150mm of compacted depth at least one group of three in-situ density test every 500 sq m or fraction thereof
Retaining Wall/Coping Wall/RC Curb/RC Ditch/Shear Key/Concrete Blocks\Lean Concrete		
A Portland Cement	Same test as for SC (A)	Same frequency as SC (A)
B Fine Aggregate	Same test as for SC (B)	Same frequency as SC (B)

Materials/Items of Work	***Required Tests***	***Minimum Incremental Frequency of Tests***
C Coarse Aggregates	Same test as for SC (C)	Same frequency as SC (C)
D Water	Same test as for SC (D)	Same frequency as SC (D)
E Steel Bars	Same test as for SC (E)	Same frequency as SC (E)
F Admixture and Concrete Curing	Same test as for SC (G)	Same frequency as SC (G)
G Concrete	Same test as for SC (F)	Same frequency as SC (F)
Tie Rod		
A Steel	Same test as for SC (E)	One per batch
B Assembly	Performance Test (Tension)	One per batch
Tie Bars and Dowels	Same test as for SC (E)	For every 10,000 kg or fraction thereof per Tie bars and Dowels
Pipe Culverts and Storm Drains		
A Pipes	Test for Strength, Absorption and Physical	For every 50 pieces
B Mortar or Joint	Same Test as for SC (A,B and D) Alternative Test Same test as for SC (F) and Inspection Report	For every 25 pieces
Concrete Hollow Blocks		
A Portland Cement	Same test as for SC (A)	Same frequency as SC (A)
B Fine Aggregates	Same test as for SC (B)	Same frequency as SC (B)
C Water	Same test as for SC (D)	Same frequency as SC (C)
D Concrete	Same test as for SC (F)	Same frequency as SC (F)
E Completed CHB	Quality Test	One for every 500 pieces or fraction thereof
Construction Joints (CJ)		
A Angle Bars	Test for Physical and Mechanical Properties	One per batch
B Steel Bars	Same test as for SC (E)	One per batch
C Zinc (Hot Dip Galvanizing) Coatings	Physical Test for Appearance, Stripping, Weighing, Adherence and Adhesion	All units
	Coating Thickness Magnetic Thickness Measurement	1 set (3 specimen) for every 100,000 sq mm or fraction thereof

Materials/Items of Work	*Required Tests*	*Minimum Incremental Frequency of Tests*
Sacked Concrete		
A Cement	Same test as for SC (A)	Same frequency as SC (A)
B Fine Aggregates	Same test as for SC (B)	Same frequency as SC (B)
C Coarse Aggregates	Same test as for SC (C)	Same frequency as SC (C)
D Water	Same test as for SC (D)	Same frequency as SC (D)
E Concrete	Same test as for SC (F)	Same frequency as SC (F)
F Sack (jute)	Physical Test	One for every 50 pieces
Rubble Concrete		
A Cement	Same test as for SC (A)	Same frequency as SC (A)
B Fine Aggregates	Same test as for SC (B)	Same frequency as SC (B)
C Coarse Aggregates	Same test as for SC (C)	Same frequency as SC (C)
D Water	Same test as for SC (D)	Same frequency as SC (D)
E Concrete	Same test as for SC (F)	Same frequency as SC (F)
F Rocks	Same test as for ROCKS	Same frequency as ROCKS
Earthworks		
A Sub-grade preparation	Grading Test Plasticity Test (LL,PL,PI) Laboratory Compaction Test	For every 1,500 cubic meter or fraction thereof
	Density Test	For every layer of 150mm of compacted depth at least one group of three in-situ density test every 500 sq m or fraction thereof
B Structure Excavation	If excavated materials shall be used as Backfill Grading Test Plasticity Test (LL,PL,PI) Laboratory Compaction Test	For every 1,500 cubic meter or fraction thereof
	Density Test	For every layer of 150mm of compacted depth at least one group of three in-situ density test every 500 sq m or fraction thereof

PPA MEMORANDUM CIRCULAR
No 02
Series of 2016
Attachment

Materials/Items of Work	*Required Tests*	*Minimum Incremental Frequency of Tests*
III Port Operations Building/Passenger Terminal Building/Transit Shed/Warehouse		
STRUCTURAL WORKS	Refer to Structural Concrete (SC) and Piling Works (P)	
ARCHITECTURAL WORKS		
Ceramic – Filled Liquid Membrane / Water Proofing, Hydrophobic Poreblocking Ingredients with Superplasticizer	Physical Property, Mechanical and Chemical Property, Leak Test / Flood Test	One per shipment
Paint	Quality Test	One 4-L can for every 100 cans or fraction thereof
Ceramic Tile	Inspection and Evaluation Report from the Engineer	One per shipment
Stainless Steel	Inspection and Evaluation Report from the Engineer	One per shipment
Roofing Materials	Inspection and Evaluation Report from the Engineer	One per shipment
Ceiling Materials	Inspection and Evaluation Report from the Engineer	One per shipment
ELECTRICAL AND MECHANICAL WORKS		
Wires / Cables	Inspection and Evaluation Report from the Engineer Testing and Commissioning	One per shipment
Electrical Devices	Inspection and Evaluation Report from the Engineer Testing and Commissioning	One per shipment
Fire Alarm System	Inspection and Evaluation Report from the Engineer Testing and Commissioning	One per item
Wiring Devices	Inspection and Evaluation Report from the Engineer Testing and Commissioning	One per shipment

Materials/Items of Work	Required Tests	Minimum Incremental Frequency of Tests
Protective Devices	Inspection and Evaluation Report from the Engineer Testing and Commissioning	One per shipment
Telephone System	Inspection and Evaluation Report from the Engineer Testing and Commissioning	One per item
CCTV System	Inspection and Evaluation Report from the Engineer Testing and Commissioning	One per item
CATV System	Inspection and Evaluation Report from the Engineer Testing and Commissioning	One per item
Background Music and Paging System	Inspection and Evaluation Report from the Engineer, Testing and Commissioning	One per item
Air Conditioning Units & Ventilation	Inspection and Evaluation Report from the Engineer Testing and Commissioning	One per item
Conduit Pipes	Inspection and Evaluation Report from the Engineer Testing and Commissioning	One per item
Lighting Fixtures	Inspection and Evaluation Report from the Engineer Testing and Commissioning	One per item
PLUMBING WORKS		
Pipes	Inspection and Evaluation Report from the Engineer Testing and Commissioning	One per item

Materials/Items of Work	Required Tests	Minimum Incremental Frequency of Tests
Fixtures	Inspection and Evaluation Report from the Engineer Testing and Commissioning	One per item
Pipe Culverts	Compression Strength Inspection and Evaluation Report from the Engineer	For every size not more than 25 pipes cast in the field
IV Miscellaneous Materials Fencing A Barbed Wire, Cyclone Wire Mesh, Chain Link B Concrete Post	Physical Test (Dimensions and Coatings) Refer to Superstructure (SC)	One per Batch Refer to Superstructure (SC)
Lamp Post A Structural Steel B Zinc (Hot Dip Galvanizing) Coatings	Physical Test (Dimensions) Same test as for SC (E) Same test as for CJ (C)	All units One per batch
Drainage Steel Grating	Same test as for SC (E) Inspection Report	One (1) batch
Metal Pipe (Cast Iron Galvanized, etc)	Physical Test (Dimensions and Coatings)	1 per delivery
Welding Works	Destructive and Non Destructive Test	One (1) per lot

NOTES 1. Testing of RDF shall be performed only by an independent Testing Laboratory duly accredited by BRS, DOST and PPA
2. Testing of other materials shall be performed only by an independent Testing Laboratory duly accredited by BRS and PPA.
3. All other issuances which are otherwise inconsistent herewith are hereby revoked or otherwise amended.

Approved

RAUL T. SANTOS
Officer-In-Charge,
Office of the General Manager

SECTION IX

CHECKLIST OF TECHNICAL AND FINANCIAL DOCUMENTS

Checklist of Technical and Financial Documents

I. TECHNICAL COMPONENT ENVELOPE

Class "A" Documents

Legal Documents

☐ (a) Valid PhilGEPS Registration Certificate (Platinum Membership) (all pages)

Technical Documents

☐ (b) Statement of the prospective bidder of all its ongoing government and private contracts, including contracts awarded but not yet started, if any, whether similar or not similar in nature and complexity to the contract to be bid; **and**

☐ (c) Statement of the bidder's Single Largest Completed Contract (SLCC) similar to the contract to be bid, except under conditions provided under the rules; **and**

☐ (d) Special PCAB License in case of Joint Ventures;
and registration for the type and cost of the contract to be bid; **and**

☐ (e) Original copy of Bid Security. If in the form of a Surety Bond, submit also a certification issued by the Insurance Commission;
or
Original copy of Notarized Bid Securing Declaration; **and**

(f) Project Requirements, which shall include the following:

☐ a. Organizational chart for the contract to be bid;

☐ b. List of contractor's key personnel (*e.g.*, Project Manager, Project Engineers, Materials Engineers, and Foremen), to be assigned to the contract to be bid, with their complete qualification and experience data;

☐ c. List of contractor's major equipment units, which are owned, leased, and/or under purchase agreements, supported by proof of ownership or certification of availability of equipment from the equipment lessor/vendor for the duration of the project, as the case may be; **and**

☐ (g) Original duly signed Omnibus Sworn Statement (OSS);
and if applicable, Original Notarized Secretary's Certificate in case of a corporation, partnership, or cooperative; or Original Special Power of Attorney of all members of the joint venture giving full power and authority to its officer to sign the OSS and do acts to represent the Bidder.

Financial Documents

☐ (h) The prospective bidder's computation of Net Financial Contracting Capacity (NFCC).

Class "B" Documents

☐ (i) If applicable, duly signed joint venture agreement (JVA) in accordance with RA No. 4566 and its IRR in case the joint venture is already in existence;
or
duly notarized statements from all the potential joint venture partners stating that they will enter into and abide by the provisions of the JVA in the instance that the bid is successful.

II. FINANCIAL COMPONENT ENVELOPE

☐ (j) Original of duly signed and accomplished Financial Bid Form; **and**

Other documentary requirements under RA No. 9184

☐ (k) Original of duly signed Bid Prices in the Bill of Quantities; **and**

☐ (l) Duly accomplished Detailed Estimates Form, including a summary sheet indicating the unit prices of construction materials, labor rates, and equipment rentals used in coming up with the Bid; **and**

☐ (m) Cash Flow by Quarter.

SECTION X

BIDDING FORM

Bid Form for the Procurement of Infrastructure Projects

[shall be submitted with the Bid]

BID FORM

Date : _____
Project Identification No. : _____

To: **Philippine Ports Authority**
PPA Building, Bonifacio Drive,
South Harbor, Port Area, Manila

Having examined the Philippine Bidding Documents (PBDs) including the Supplemental or Bid Bulletin Numbers _____, the receipt of which is hereby duly acknowledged, we, the undersigned, declare that:

a. We have no reservation to the PBDs, including the Supplemental or Bid Bulletins, for the Procurement Project: **Bataraza Port Expansion Project, Port of Bataraza, Brgy. Buliluyan, Bataraza, Palawan**;

b. We offer to execute the Works for this Contract in accordance with the PBDs;

c. The total price of our Bid in words and figures, excluding any discounts offered below is: _____;

d. The discounts offered and the methodology for their application are: _____;

e. The total bid price includes the cost of all taxes, such as, but not limited to: *[specify the applicable taxes, e.g. (i) value added tax (VAT), (ii) income tax, (iii) local taxes, and (iv) other fiscal levies and duties],* which are itemized herein and reflected in the detailed estimates,

f. Our Bid shall be valid within the period stated in the PBDs, and it shall remain binding upon us at any time before the expiration of that period;

g. If our Bid is accepted, we commit to obtain a Performance Security in the amount of _____ percent of the Contract Price for the due performance of the Contract, or a Performance Securing Declaration in lieu of the the allowable forms of Performance Security, subject to the terms and conditions of issued GPPB guidelines[1] for this purpose;

h. We are not participating, as Bidders, in more than one Bid in this bidding process, other than alternative offers in accordance with the Bidding Documents;

i. We understand that this Bid, together with your written acceptance thereof

[1] currently based on GPPB Resolution No. 09-2020

included in your notification of award, shall constitute a binding contract between us, until a formal Contract is prepared and executed; and

j. We understand that you are not bound to accept the Lowest Calculated Bid or any other Bid that you may receive.

k. We likewise certify/confirm that the undersigned, is the duly authorized representative of the bidder, and granted full power and authority to do, execute and perform any and all acts necessary to participate, submit the bid, and to sign and execute the ensuing contract for the **Bataraza Port Expansion Project, Port of Bataraza, Brgy. Buliluyan, Bataraza, Palawan** of the **Philippine Ports Authority**.

l. We acknowledge that failure to sign each and every page of this Bid Form, including the Bill of Quantities, shall be a ground for the rejection of our bid.

Name: _____

Legal Capacity: _____

Signature: _____

Duly authorized to sign the Bid for and behalf of: _____

Date: _____

STATEMENT OF THE BIDDER'S ALL ONGOING GOVERNMENT AND PRIVATE CONTRACTS, INCLUDING CONTRACTS AWARDED BUT NOT YET STARTED

I hereby declare that all ongoing contracts, including awarded contracts yet to be started coinciding with the contract to be bid are listed below:

Name of outstanding Contracts 1]	Owner's Name and Address	Scope of Work 2]	Contractor's Role and Percentage of Participation 3]	Total Contract Amount or Value 4]	Date of Contract and NOA 5]	Value of Outstanding Works 6]	Accomplishment (in percentage, %) 7]		Contract Duration 8]	
							Planned	Actual	Start of Project	Estimated Completion Date
A) Government Contracts i. On-going ii. Awarded but not yet started B) Private Contracts i. On-going ii. Awarded but not yet started										

NOTE:

1] As appearing in the contract executed by the parties.
2] With special reference to the Scope of Works of the Project as described/enumerated in the Contract.
3] Indicate the percentage of participation and whether as Sole Contractor, Sub-Contractor or Member in a Joint Venture / Consortium.
4] Indicate the FOREX used if Contract Value is expressed in a currency other than the Philippine Peso.
5] As appearing in the Contract and Notice of Award (NOA).
6] Amount or value of all outstanding or uncompleted portions of the projects under ongoing contracts, including awarded contracts yet to be started coinciding with the contract to be bid.
7] Percentage of Accomplishment as of the preceding month which should not be earlier than two (2) months from the date of bid submission.
8] As appearing in the Notice to Proceed and Contract.

This Statement shall be supported by:

a) Notice of Award
b) Notice to Proceed and Contract

Name of Firm	Name of Bidder/Authorized Representative (Signatory's Legal Capacity)	Date

Revised: September 2021

STATEMENT OF THE BIDDER'S SINGLE LARGEST COMPLETED CONTRACT (SLCC) SIMILAR TO THE CONTRACT TO BE BID

Name of the completed Contract 1]	Owner's Name and Address	Scope of Work 2]	Contractor's Role and Percentage of Participation 3]	Total Contract Value At 4]			Date of Award 5]	Contract Duration 6]	
				Award	Completion	Escalated Value to Present Prices		Start	Completed

NOTE :

1] As appearing in the contract executed by the parties.
2] With special reference to the Scope of Works of the Project as described/enumerated in the Contract.
3] Indicate the percentage of participation and whether as Sole Contractor, Sub-Contractor or Member in a Joint Venture / Consortium.
4] Indicate the FOREX used if Contract Value is expressed in a currency other than the Philippine Peso. Attached the computation for the escalated contract value.
5] As appearing in the Notice of Award.
6] As appearing in the Notice to proceed and Certificate of Completion.

A. The bidder must have an experience of having completed a SLCC that is similar to the contract to be bid equivalent to at least fifty percent (50%) of the ABC, adjusted if necessary, by the Bidder to current prices using the PSA consumer price indices. A contract is considered to be "similar" to the contract to be bid if it has the same Major Categories of Work as stated in the Bid Data Sheet (BDS).
B. This Statement shall be supported by:
   a. Notice of Award, Notice to Proceed and Contract.
   b. Project Owner's Certificate of Final Acceptance issued by the owner and/ or Constructors Performance Evaluation System (CPES) Final Rating, which must be at least Satisfactory. The said Certificate of Acceptance shall contain the following: 1) Name of project owner that issued the certificate, 2) Name of Contractor/ Constructor, 3) Name of Contract, and 4) Contract Duration.
   c. Recapitulation or Final Bill of Quantities.

Name of Firm	Name of Bidder/Authorized Representative (Signatory's Legal Capacity)	Date

Revised: September 2021

STATEMENT OF THE BIDDER'S EXPERIENCE ON MAJOR CATEGORIES OF WORK OF THE SLCC INCLUDING OTHER COMPLETED CONTRACTS SIMILAR TO THE CONTRACT TO BE BID

Major Categories of Work 1]	Unit of Measure 1]	Quantity 1]	SLCC similar to the contract to be bid 2]	Other completed contracts similar to the contract to be bid 2]			Unit of Measure 2]	Quantity 2]
			Name of the contract	Name of the contract	Name of the contract	Name of the contract		
1. Offshore pile driving works	l.m.	2,991						
2. Reinforced Concrete Works	cu.m.	408						

NOTE:
1] As stated in the Bid Data Sheet.
2] As appearing in the Recapitulation and/ or Final Bill of Quantities.
This statement shall be supported by:

a. Notice of Award, Notice to Proceed and Contract.
b. Project Owner's Certificate of Final Acceptance issued by the owner and/ or Constructors Performance Evaluation System (CPES) Final Rating, of at least satisfactory. The said Certificate of Acceptance shall contain the following: 1) Name of project owner that issued the certificate, 2) Name of Contractor/Constructor, 3) Name of Contract, and 4) Contract Duration.
c. Recapitulation and/ or Final Bill of Quantities.

Name of Firm	Name of Bidder/Authorized Representative Signatory's Legal Capacity	Date

Revised: September 2021

FINANCIAL DATA

A. The prospective bidder's audited Financial Statements, showing, among others, the prospective bidder's total and current assets and liabilities, stamped "RECEIVED" by the Bureau of Internal Revenue (BIR), or its duly accredited and authorized institutions, for the preceding calendar year which should not be earlier than two (2) years from the date of bid submission.

	Year
1. Total Assets	
2. Current Assets	
3. Total Liabilities	
4. Current Liabilities	
5. Net worth (1-3)	
6. Net Working Capital (2-4)	

B. The computation of the bidders Net Financial Contracting Capacity (NFCC) must be at least equal to the ABC to be bid, as follows:

NFCC = [(Current assets minus current liabilities) (15)] minus the value of all outstanding or uncompleted portions of the projects under ongoing contracts, including awarded contracts yet to be started coinciding with the contract to be bid.

NFCC = _____

Attached herewith are certified true copies of the audited financial statements stamped received by the BIR or BIR authorized collecting agent for the latest/immediately preceding calendar year.

_____
Name of Firm/Applicant

_____
Authorized Signing Official

Date:_____

NOTES:

If Partnership or Joint Venture, each Partner or Member Firm of Joint venture shall submit separate financial statements.

STATEMENT OF THE BIDDER'S KEY PERSONNEL PLEDGED FOR THE CONTRACT TO BE BID

I hereby declare that the following key personnel are qualified and available for the duration of the contract to be bid:

Position of Key Personnel 1]	Name	No. of Key Personnel	Similar Experience in the Position (Years) 2]	Total Experience in the Position (Years)	Attachment(s)	Annex(es)
Project Manager					PRC License (CE Preferred) Complete Qualification and Experience Data Certificate of Commitment	Annex "_"
Project Engineer					PRC License (CE Preferred) Complete Qualification and Experience Data Certificate of Commitment	Annex "_"
Materials Engineer II					PRC License (CE Preferred) Submit Valid and Renewed DPWH Certificate of Accreditation Submit Accreditation Identification Card as Materials Engineer Complete Qualification and Experience Data Certificate of Commitment	Annex "_"
Construction Safety and Health Officer					Certificate of Safety and Health Construction Related Course issued by DOLE Accredited Trainings Complete Qualification and Experience Data Certificate of Commitment	Annex "_"
Foreman					Complete Qualification and Experience Data Certificate of Commitment	Annex "_"
Other Position(s)					Complete Qualification and Experience Data Certificate of Commitment	Annex "_"

NOTE: 1] As stated in the Bid Data Sheet
2] The number of years of experience of the key personnel shall be as indicated in the qualification and experience data or curriculum vitae.

Minimum qualification requirements: The key personnel must have a work experience that is similar in nature and complexity to the contract to be bid.

Project Manager - Five (5) years
Project Engineer - Three (3) years
Foreman - Five (5) years
Construction Safety and Health Officer – One (1) year
Materials Engineer – One (1) year
Materials Engineer I – for projects costing up to 100M
Materials Engineer II – for projects costing more than 100M

Name of Firm

Name of Bidder/Authorized Representative
(Signatory's Legal Capacity)

Date

Revised: September 2021

STATEMENT OF THE BIDDER'S EQUIPMENT PLEDGED FOR THE CONTRACT TO BE BID

I hereby declare that the following equipment are in good operating condition and available for the duration of the contract to be bid:

DESCRIPTION (Type, Model, Make)	No. of Unit(s)	Capacity/ Output 1]	Owned, Leased, and/or under purchased agreement 2]	Proof of Ownership/ Leased/ Under Purchase Agreement (Mark as Annex "A.....Z") 3]	OTHER INFORMATION (As Applicable)				
					Manufacturer	Engine Serial No.	Chassis No./ Name of Vessel	Location	Status

NOTE:

1] The unit of capacity of the pledged equipment shall be as indicated in the Proof of Ownership, i.e. GW (for crane barge), DWT (for deck barge and hopper barge), Ton (for crane, road roller and drop hammer), kg.-m/blow (for diesel hammer), cu.m. (for dump truck), hp (for tugboat, road grader, bulldozer and concrete vibrator), cfm (for compressor), gal (for water truck with pump), amp (for welding machine), bagger (for concrete mixer). If the capacity of the pledged equipment is not indicated in the Proof of Ownership/Lease Contract/Purchased Agreement, submit other proof of capacity such as specifications, brochures or other verifiable printouts indicating the model name, model number and other details of the equipment.

2] Indicate if the pledged equipment are owned, leased or under purchase agreement.

3] If the pledged equipment is owned, it should be in the name of the bidder. Submit proof of ownership, i.e. deed of sale, sales invoice, official receipt; For owned Water Truck, Dump Truck, Cargo Truck and Transit Mixer submit LTO Certificate of Registration and valid Official Receipt; For owned barge/tugboat, submit Marina Certificate of Ownership and valid Cargo Ship Safety Certificate.

If the pledged equipment is leased/under purchase agreement, submit the following:

For equipment under lease agreement:

a. certification of availability of equipment from the equipment lessor for the duration of the project
b. duly Notarized copy of lease contract
c. For Water Truck, Dump Truck, Cargo Truck and Transit Mixer submit LTO Certificate of Registration and valid Official Receipt

For equipment under purchase agreement:

a. certification of availability of equipment from the equipment vendor
b. duly Notarized copy of purchase agreement
c. For Water Truck, Dump Truck and Transit Mixer submit LTO Certificate of Registration and valid Official Receipt or copy of conduction sticker, whichever is applicable.

If the pledged barge/tugboat is leased/under purchase agreement, submit certification of availability of barge/tugboat from the equipment lessor/vendor for the duration of the project, and duly Notarized copy of lease contract/purchased agreement together with a copy of the Marina Certificate of Ownership and valid Cargo Ship Safety Certificate.

The Minimum Major Equipment Requirements are listed in Section 8, Annex 3.

Name of Firm	Name of Bidder/Authorized Representative (Signatory's Legal Capacity)	Date

Revised: August 2024

Omnibus Sworn Statement for Sole Proprietorship

[shall be submitted with the Bid]

REPUBLIC OF THE PHILIPPINES)
CITY/MUNICIPALITY OF _____) S.S.

AFFIDAVIT

I, _____, of legal age, [Civil Status], [Nationality], and residing at _____, after having been duly sworn in accordance with law, do hereby depose and state that:

1. I am the sole proprietor or authorized representative of _____ with office address at _____;

2. As the owner and sole proprietor, or authorized representative of _____, I have full power and authority to do, execute and perform any and all acts necessary to participate, submit the bid, and to sign and execute the ensuing contract for **Bataraza Port Expansion Project, Port of Bataraza, Brgy. Buliluyan, Bataraza, Palawan** of the **Philippine Ports Authority**, as shown in the attached duly notarized Special Power of Attorney;

3. [Name of Bidder] is not "blacklisted" or barred from bidding by the Government of the Philippines or any of its agencies, offices, corporations, or Local Government Units, foreign government/foreign or international financing institution whose blacklisting rules have been recognized by the Government Procurement Policy Board, **by itself or by relation, membership, association, affiliation, or controlling interest with another blacklisted person or entity as defined and provided for in the Uniform Guidelines on Blacklisting;**

4. Each of the documents submitted in satisfaction of the bidding requirements is an authentic copy of the original, complete, and all statements and information provided therein are true and correct;

5. [Name of Bidder] is authorizing the Head of the Procuring Entity or its duly authorized representative(s) to verify all the documents submitted;

6. The owner or sole proprietor is not related to the Head of the Procuring Entity, members of the Bids and Awards Committee (BAC), the Technical Working Group, and the BAC Secretariat, the head of the Project Management Office or the end-user unit, and the project consultants by consanguinity or affinity up to the third civil degree;

7. *[Name of Bidder]* complies with existing labor laws and standards; and

8. *[Name of Bidder]* is aware of and has undertaken the responsibilities as a Bidder in compliance with the Philippine Bidding Documents, which includes:

   a. Carefully examining all of the Bidding Documents;
   b. Acknowledging all conditions, local or otherwise, affecting the implementation of the Contract;
   c. Making an estimate of the facilities available and needed for the contract to be bid, if any; and
   d. Inquiring or securing Supplemental/Bid Bulletin(s) issued for the *[Name of the Project]*.

9. *[Name of Bidder]* did not give or pay directly or indirectly, any commission, amount, fee, or any form of consideration, pecuniary or otherwise, to any person or official, personnel or representative of the government in relation to any procurement project or activity.

10. **In case advance payment was made or given, failure to perform or deliver any of the obligations and undertakings in the contract shall be sufficient grounds to constitute criminal liability for Swindling (Estafa) or the commission of fraud with unfaithfulness or abuse of confidence through misappropriating or converting any payment received by a person or entity under an obligation involving the duty to deliver certain goods or services, to the prejudice of the public and the government of the Philippines pursuant to Article 315 of Act No. 3815 s. 1930, as amended, or the Revised Penal Code.**

IN WITNESS WHEREOF, I have hereunto set my hand this __ day of ___, 20__ at _____, Philippines.

_____
Name of Bidder/ Authorized Representative
(Signatory's Legal Capacity)
AFFIANT

[Jurat]
[Format shall be based on the latest Rules on Notarial Practice]

Omnibus Sworn Statement for Partnership or Cooperative

[shall be submitted with the Bid]

REPUBLIC OF THE PHILIPPINES)
CITY/MUNICIPALITY OF _____) S.S.

AFFIDAVIT

I, _____, of legal age, [Civil Status], [Nationality], and residing at _____, after having been duly sworn in accordance with law, do hereby depose and state that:

1. I am the duly authorized and designated representative of _____ with office address at _____;

2. I am granted full power and authority to do, execute and perform any and all acts necessary to participate, submit the bid, and to sign and execute the ensuing contract for **Bataraza Port Expansion Project, Port of Bataraza, Brgy. Buliluyan, Bataraza, Palawan** of the **Philippine Ports Authority**, as shown in the attached [state title of attached document showing proof of authorization (e.g., duly notarized Secretary's Certificate, Board/Partnership Resolution, or Special Power of Attorney, whichever is applicable;)];

3. [Name of Bidder] is not "blacklisted" or barred from bidding by the Government of the Philippines or any of its agencies, offices, corporations, or Local Government Units, foreign government/foreign or international financing institution whose blacklisting rules have been recognized by the Government Procurement Policy Board, **by itself or by relation, membership, association, affiliation, or controlling interest with another blacklisted person or entity as defined and provided for in the Uniform Guidelines on Blacklisting;**

4. Each of the documents submitted in satisfaction of the bidding requirements is an authentic copy of the original, complete, and all statements and information provided therein are true and correct;

5. [Name of Bidder] is authorizing the Head of the Procuring Entity or its duly authorized representative(s) to verify all the documents submitted;

6. None of the officers and members of *[Name of Bidder]* is related to the Head of the Procuring Entity, members of the Bids and Awards Committee (BAC), the Technical Working Group, and the BAC Secretariat, the head of the Project Management Office or the end-user unit, and the project consultants by consanguinity or affinity up to the third civil degree;

7. *[Name of Bidder]* complies with existing labor laws and standards; and

8. *[Name of Bidder]* is aware of and has undertaken the responsibilities as a Bidder in compliance with the Philippine Bidding Documents, which includes:

   a. Carefully examining all of the Bidding Documents;
   b. Acknowledging all conditions, local or otherwise, affecting the implementation of the Contract;
   c. Making an estimate of the facilities available and needed for the contract to be bid, if any; and
   d. Inquiring or securing Supplemental/Bid Bulletin(s) issued for the *[Name of the Project]*.

9. *[Name of Bidder]* did not give or pay directly or indirectly, any commission, amount, fee, or any form of consideration, pecuniary or otherwise, to any person or official, personnel or representative of the government in relation to any procurement project or activity.

10. **In case advance payment was made or given, failure to perform or deliver any of the obligations and undertakings in the contract shall be sufficient grounds to constitute criminal liability for Swindling (Estafa) or the commission of fraud with unfaithfulness or abuse of confidence through misappropriating or converting any payment received by a person or entity under an obligation involving the duty to deliver certain goods or services, to the prejudice of the public and the government of the Philippines pursuant to Article 315 of Act No. 3815 s. 1930, as amended, or the Revised Penal Code.**

IN WITNESS WHEREOF, I have hereunto set my hand this __ day of ___, 20__ at _____, Philippines.

_____
Name of Bidder/ Authorized Representative
(Signatory's Legal Capacity)
AFFIANT

[Jurat]
[Format shall be based on the latest Rules on Notarial Practice]

Omnibus Sworn Statement for Corporation or Joint Venture

[shall be submitted with the Bid]

REPUBLIC OF THE PHILIPPINES)
CITY/MUNICIPALITY OF _____) S.S.

AFFIDAVIT

I, _____, of legal age, [Civil Status], [Nationality], and residing at _____, after having been duly sworn in accordance with law, do hereby depose and state that:

1. I am the duly authorized and designated representative of _____ with office address at _____;

2. I am granted full power and authority to do, execute and perform any and all acts necessary to participate, submit the bid, and to sign and execute the ensuing contract for **Bataraza Port Expansion Project, Port of Bataraza, Brgy. Buliluyan, Bataraza, Palawan**, as shown in the attached [state title of attached document showing proof of authorization (e.g., duly notarized Secretary's Certificate, Board/Partnership Resolution, or Special Power of Attorney, whichever is applicable;)];

3. [Name of Bidder] is not "blacklisted" or barred from bidding by the Government of the Philippines or any of its agencies, offices, corporations, or Local Government Units, foreign government/foreign or international financing institution whose blacklisting rules have been recognized by the Government Procurement Policy Board, **by itself or by relation, membership, association, affiliation, or controlling interest with another blacklisted person or entity as defined and provided for in the Uniform Guidelines on Blacklisting;**

4. Each of the documents submitted in satisfaction of the bidding requirements is an authentic copy of the original, complete, and all statements and information provided therein are true and correct;

5. [Name of Bidder] is authorizing the Head of the Procuring Entity or its duly authorized representative(s) to verify all the documents submitted;

6. None of the officers, directors, and controlling stockholders of *[Name of Bidder]* is related to the Head of the Procuring Entity, members of the Bids and Awards Committee (BAC), the Technical Working Group, and the BAC Secretariat, the head of the Project Management Office or the end-user unit, and the project consultants by consanguinity or affinity up to the third civil degree;

7. *[Name of Bidder]* complies with existing labor laws and standards; and

8. *[Name of Bidder]* is aware of and has undertaken the responsibilities as a Bidder in compliance with the Philippine Bidding Documents, which includes:

   a. Carefully examining all of the Bidding Documents;
   b. Acknowledging all conditions, local or otherwise, affecting the implementation of the Contract;
   c. Making an estimate of the facilities available and needed for the contract to be bid, if any; and
   d. Inquiring or securing Supplemental/Bid Bulletin(s) issued for the *[Name of the Project]*.

9. *[Name of Bidder]* did not give or pay directly or indirectly, any commission, amount, fee, or any

form of consideration, pecuniary or otherwise, to any person or official, personnel or representative of the government in relation to any procurement project or activity.

10. **In case advance payment was made or given, failure to perform or deliver any of the obligations and undertakings in the contract shall be sufficient grounds to constitute criminal liability for Swindling (Estafa) or the commission of fraud with unfaithfulness or abuse of confidence through misappropriating or converting any payment received by a person or entity under an obligation involving the duty to deliver certain goods or services, to the prejudice of the public and the government of the Philippines pursuant to Article 315 of Act No. 3815 s. 1930, as amended, or the Revised Penal Code.**

IN WITNESS WHEREOF, I have hereunto set my hand this __ day of ___, 20__ at _____, Philippines.

_____
Name of Bidder/ Authorized Representative
(Signatory's Legal Capacity)
AFFIANT

[Jurat]
[Format shall be based on the latest Rules on Notarial Practice]

Bid Securing Declaration Form

[shall be submitted with the Bid if bidder opts to provide this form of bid security]

REPUBLIC OF THE PHILIPPINES)
CITY OF _____) S.S.

BID SECURING DECLARATION
Project Identification No.: _____

To: **Philippine Ports Authority**
PPA Building, Bonifacio Drive,
South Harbor, Port Area, Manila

I/We, the undersigned, declare that:

1. I/We understand that, according to your conditions, bids must be supported by a Bid Security, which may be in the form of a Bid Securing Declaration.

2. I/We accept that: (a) I/we will be automatically disqualified from bidding for any procurement contract with any procuring entity for a period of two (2) years upon receipt of your Blacklisting Order; and, (b) I/we will pay the applicable fine provided under Section 6 of the Guidelines on the Use of Bid Securing Declaration, within fifteen (15) days from receipt of the written demand by the procuring entity for the commission of acts resulting to the enforcement of the bid securing declaration under Sections 23.1(b), 34.2, 40.1 and 69.1, except 69.1(f),of the IRR of RA No. 9184; without prejudice to other legal action the government may undertake.

3. I/We understand that this Bid Securing Declaration shall cease to be valid on the following circumstances:

   a. Upon expiration of the bid validity period, or any extension thereof pursuant to your request;
   b. I am/we are declared ineligible or post-disqualified upon receipt of your notice to such effect, and (i) I/we failed to timely file a request for reconsideration or (ii) I/we filed a waiver to avail of said right; and
   c. I am/we are declared the bidder with the Lowest Calculated Responsive Bid, and I/we have furnished the performance security and signed the Contract.

IN WITNESS WHEREOF, I/We have hereunto set my/our hand/s this ____ day of *[month] [year]* at *[place of execution]*.

_____
Name of Bidder/ Authorized Representative
(Signatory's Legal Capacity)
AFFIANT

[Jurat]
[Format shall be based on the latest Rules on Notarial Practice]

CONSTRUCTION METHODOLOGY

Name of Project : _____

Project Description : _____

Location : _____

MINIMUM SCOPE OF CONSTRUCTION METHODOLOGY

A. RC PIER AND RORO RAMP (Area = 1,619.10 sq.m.)

1. Remove and dispose existing roro ramp (deck and beam included) (125 sq.m.)
2. Chip-off of existing pile cap for build-up (19 no.)
3. Remove existing rubber dock fender and turn-over to the Authority (3 no.)
4. Chip-off RC curb and smoothened with mortar (17 l.m.)
5. Supply, deliver and drive 450mm x 450mm PSC Test piles (3 no.)
6. Supply and deliver to site PSC piles (450mm x 450mm) (5,982 l.m.)
7. Handle, pitch and drive vertical PSC piles (450mm x 450mm) (3,024 l.m.) and batter PSC piles (450mm x 450mm) (2,958 l.m.)
8. Chip/cut and dispose portion of driven PSC piles up to required elevation (213 no.)
9. Apply concrete epoxy to existing concrete prior to concrete pouring (19 sq.m)
10. Supply and place 3,500 psi concrete for the superstructure (815 cu.m.)
11. Supply and install steel reinforcement for the superstructure (122,755 kg.)
12. Supply and install 20mm thk. steel ramp protection plate (ASTM A572, Grade 50) including dowel connectors (5,616 kg.)
13. Supply and install hot-dipped galvanized 100mm x 100mm x 10mm angle bar for construction joints, including dowel bars (54 l.m.)
14. Supply, deliver to site and install Rubber Dock Fender (V600H x 2,000L) including accessories (12 sets)
15. Supply, deliver to site and install Rubber Dock Fender (V500H x 1,500L) including accessories (5 sets)
16. Supply, deliver to site and install Mooring Bollard (50-Tons, T-head) including accessories (5 sets)
17. Supply, deliver to site and install Mooring Bollard (35-Tons, T-head) including accessories (7 sets)

NOTES:

The narrative construction method will guide and familiarize the contractor and the PPA on how the project shall be carried out in accordance with the highest standard of workmanship.

The construction method shall be consistent with the Bar Chart / S-Curve Schedule, Equipment Schedule and Manpower Schedule.

_____
Name of Bidder/Authorized Representative
(Signatory's Legal Capacity)

MANPOWER SCHEDULE

Name of Project : _____

Project Description : _____

Location : _____

MANPOWER (Minimum)	CONTRACT DURATION (_____ Calendar Days)														
	MONTHLY														
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15
Project Manager															
Project Engineer															
Materials Engineer II															
Construction Safety and Health Officer															
Foreman															
Specify other applicable positions, ie.:															
- Carpenter															
- Steelman															
- Mason															
- Electrician															
- Rigger															
- Others															

_____
Name of Bidder/Authorized Representative
(Signatory's Legal Capacity)

EQUIPMENT UTILIZATION SCHEDULE

Name of Project : _____

Project Description : _____

Location : _____

EQUIPMENT (Minimum)	No. of Units	CONTRACT DURATION (_____ Calendar Days)														
		M O N T H L Y														
		1	2	3	4	5	6	7	8	9	10	11	12	13	14	15

_____
Name of Bidder/Authorized Representative
(Signatory's Legal Capacity)

Revised: September 2021

CASHFLOW BY QUARTER AND PAYMENT SCHEDULE

Name of Project: : _____

Project Description : _____

Location : _____

Project Duration (days or months)	Payment Schedule (Monthly, in Pesos)	Cash flow (Quarterly, in Pesos)
TOTAL		

NOTES

- The cash flow by quarter and payment schedule should be consistent with the Bar Chart and S-curb.
- Payment schedule shall not be more than once a month.

_____
Name of Bidder/Authorized Representative
(Signatory's Legal Capacity)

Revised: September 2021

Contract Agreement Form for the Procurement of Infrastructure Projects (Revised)

[not required to be submitted with the Bid, but it shall be submitted within ten (10) days after receiving the Notice of Award]

CONTRACT AGREEMENT

THIS AGREEMENT, made this _____ day of _____, _____ between **Philippine Ports Authority** with principal office at PPA Building, Bonifacio Drive, South Harbor, Port Area, Manila (hereinafter called the "Entity") and **[name and address of Contractor]** (hereinafter called the "Contractor").

WHEREAS, the Entity is desirous that the Contractor execute **[name and identification number of contract]** (hereinafter called "the Works") and the Entity has accepted the Bid for **[contract price in words and figures in specified currency]** by the Contractor for the execution and completion of such Works and the remedying of any defects therein.

NOW THIS AGREEMENT WITNESSETH AS FOLLOWS:

1. In this Agreement, words and expressions shall have the same meanings as are respectively assigned to them in the Conditions of Contract hereinafter referred to.

2. The following documents as required by the 2016 revised Implementing Rules and Regulations of Republic Act No. 9184 shall be deemed to form and be read and construed as part of this Agreement, *viz.*:

   a. Philippine Bidding Documents (PBDs);
      i. Drawings/Plans;
      ii. Specifications;
      iii. Bill of Quantities;
      iv. General and Special Conditions of Contract;
      v. Supplemental or Bid Bulletins, if any;

   b. Winning bidder's bid, including the Eligibility requirements, Technical and Financial Proposals, and all other documents or statements submitted;

   Bid form, including all the documents/statements contained in the Bidder's bidding envelopes, as annexes, and all other documents submitted (*e.g.*, Bidder's response to request for clarifications on the bid), including corrections to the bid, if any, resulting from the Procuring Entity's bid evaluation;

   c. Performance Security;

   d. Notice of Award of Contract and the Bidder's conforme thereto; and

   e. Other contract documents that may be required by existing laws and/or the Procuring Entity concerned in the PBDs. **Winning bidder agrees that additional contract documents or information prescribed by the GPPB that**

are subsequently required for submission after the contract execution, such as the Notice to Proceed, Variation Orders, and Warranty Security, shall likewise form part of the Contract.

3. In consideration for the sum of **[total contract price in words and figures]** or such other sums as may be ascertained, **[Named of the bidder]** agrees to **[state the object of the contract]** in accordance with his/her/its Bid.

4. The **Philippine Ports Authority** agrees to pay the above-mentioned sum in accordance with the terms of the Bidding.

IN WITNESS whereof the parties thereto have caused this Agreement to be executed the day and year first before written.

JAY DANIEL R. SANTIAGO General Manager	**Name of Bidder/ Authorized Representative** (Signatory's Legal Capacity)
for:	for:
Philippine Ports Authority	**Contractor**

Acknowledgment

[Format shall be based on the latest Rules on Notarial Practice]