
PHILIPPINE PORTS AUTHORITY

CONSTRUCTION OF CRANE RAILWAY & INSTALLATION OF QUAY CRANE

ILOILO COMMERCIAL PORT COMPLEX (ICPC), LOBOC, LAPAZ, ILOILO CITY

(HO-INFRA-PPDD-24-0023)

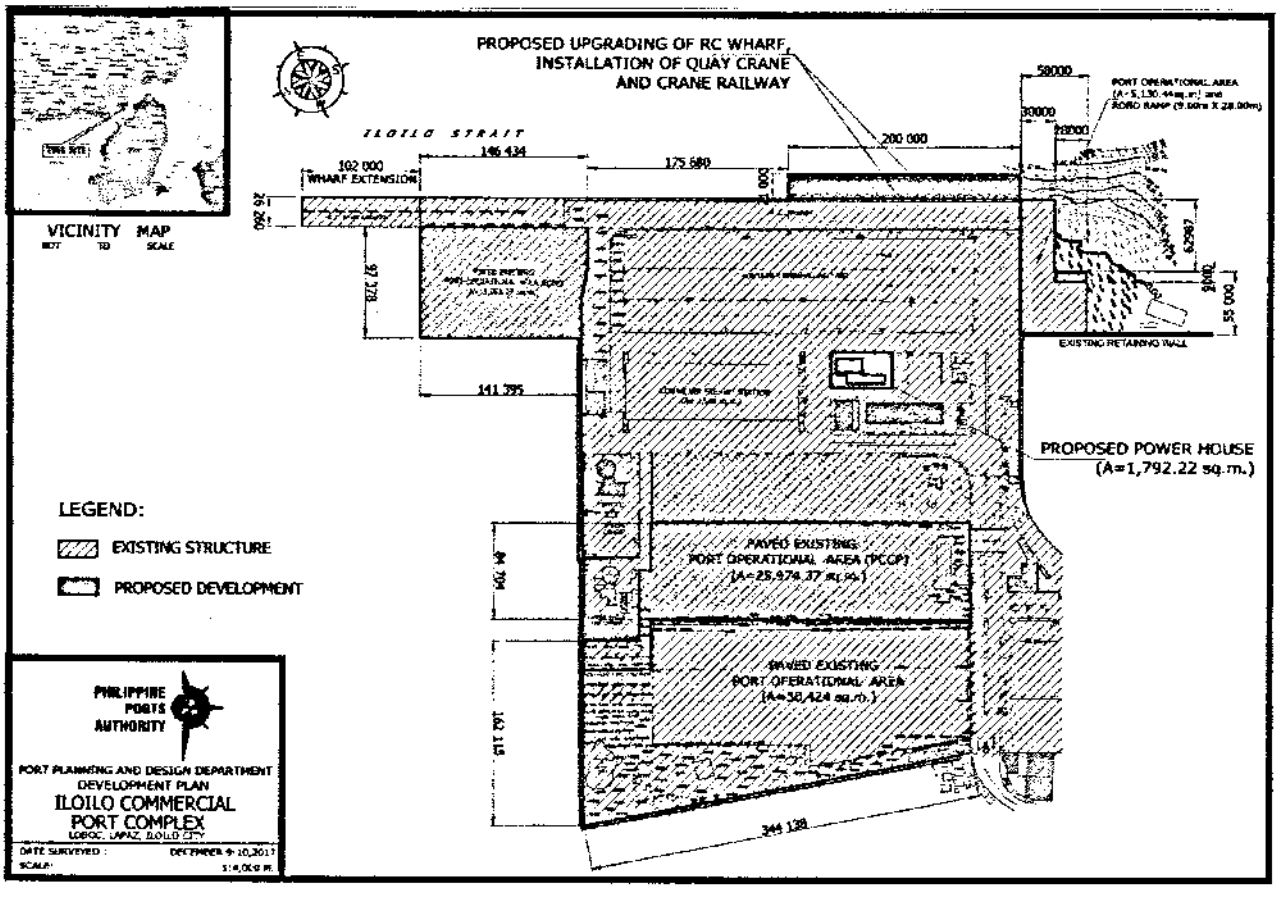

BID DOCUMENTS

DECEMBER 2024

TABLE OF CONTENTS

PAGE

Glossary of Terms, Abbreviations, and Acronyms ..... v-vi

SECTION I INVITATION TO BID 1-2

SECTION II INSTRUCTIONS TO BIDDERS ..... ITB 1-6

1. Scope of Bid 1
2. Funding Information 1
3. Bidding Requirements 1
4. Corrupt, Fraudulent, Collusive, Coercive, and Obstructive Practices 1
5. Eligible Bidders 2
6. Origin of Associated Goods 2
7. Subcontracts 2
8. Pre-Bid Conference 2
9. Clarification and Amendment of Bidding Documents 3
10. Documents Comprising the Bid: Eligibility and Technical Components 3
11. Documents Comprising the Bid: Financial Component 3
12. Alternative Bids 4
13. Bid Prices 4
14. Bid and Payment Currencies 4
15. Bid Security 4
16. Sealing and Marking of Bids 4
17. Deadline for Submission of Bids 5
18. Opening and Preliminary Examination of Bids 5
19. Detailed Evaluation and Comparison of Bids 5
20. Post Qualification 5
21. Signing of Contract 6

SECTION III BID DATA SHEET ..... BDS 1-2

SECTION IV GENERAL CONDITIONS OF CONTRACT ..... GCC 1-4

1. Scope of Contract 1
2. Sectional Completion of Works 1
3. Possession of Site 1
4. The Contractor's Obligations 1
5. Performance Security 2
6. Site Investigation Reports 2
7. Warranty 2
8. Liability of the Contractor 2
9. Termination for Other Causes 2
10. Dayworks 3
11. Program of Work 3
12. Instructions, Inspections and Audits 3
13. Advance Payment 3
14. Progress Payment 3
15. Operating and Maintenance Manuals 4

SECTION V SPECIAL CONDITIONS OF CONTRACT ..... SCC 1

SECTION VI TECHNICAL SPECIFICATIONS ..... TS 1-444

Item 1: Demolition and Removal Works
1. Description 1
2. Execution 2

Item 2: Excavation Works
1. Scope of Work 3
2. Execution 4

Item 3: Piling Works (SPP)
1. Scope of Work 6
2. Material Requirements 6
3. Execution 9

Item 4: Reinforced Concrete
1. Scope of Work 12
2. Material Requirements... 18
3. Execution 24

Item 5: Construction Joint
1. Scope of Work..... 36
2. Material Requirements 36
3. Execution 36

Item 6: Zinc (Hot-dip Galvanized) coatings on iron and steel
1. Scope of Work 37
2. Material Requirements 37
3. Execution 37

Item 7: Mooring and Fendering System
1. Scope of Work 43
2. Material Requirements 43
3. Execution..... 47

Item 8: Subgrade Preparations
1. Description 48
2. Material Requirements 48
3. Construction Requirements..... 48

Item 09: Aggregate Base Course
1. Description 50
2. Material Requirements 50
3. Construction Requirements 51

Item 10: Aggregate Sub base Course
1. . Description 54
2. Material Requirements 54
3. Construction Requirements 54

Item 11: Portland Cement Concrete Pavement
1. Scope of Work 57
2. Material Requirements 57
3. Execution 58

Item 12: Steel and Metal Works
1. Scope of Work 63
2. Material Requirements 63
3. Execution 64

Item 13: Masonry Works
1. Scope of Work 73
2. Material Requirements 73
3. Execution 74

Item 14: Security Fence
1. Description 77
2. Material Requirements 77
3. Construction Requirements 78

Item 15: Architectural
A. Finishes 80
B. Carpentry and Joinery Works 87
C. Roofing and Tinsmithry..... 92

D. Modulars, Tables and chairs of various type including accessories 94
E. Concrete Waterproofing 95
F. Painting 97
G. Termite proofing, Bukbok Proofing 105

Item 16: Plumbing and Sanitary Works
1. Scope of Work 108
2. Material Requirement..... 108
3. Execution..... 112

Item 17: Quayside Container Cranes
1. General 123
2. Overall Design Criteria..... 140

Item 18: Electrical Works
1. General Description 382
2. Material Requirements 386
3. Execution..... 395

Item 19: Grounding System and Lightning Protection
1. General 396
2. Material Requirement 397
3. Execution..... 398

Item 20: Underground Electrical Work
1. General 400
2. Products..... 400
3. Execution..... 401

Item 21: Pad Mounted Transformer
1. General 405
2. Products 405
3. Construction..... 405

Item 22: Diesel Engine Generator Sets Assembly
1. General 407
2. Products 413
3. Execution..... 428

Item 23: Low Voltage Switchgear
1. General 432
2. Products 434

Item 24: Automatic Transfer Switch
1. General 437
2. Products 437
3. Installation 438

Item 25: Unitary Air-conditioning Systems
1. General 439
2. Products 439
3. Execution 440

Item 26: Project Billboard
1. Specification 441
2. Standard Project Billboard..... 442
3. Billboard Frame 443

Item 37: Safety Signages and Barricades
1. Description 444
2. Specification 444

SECTION VII	DRAWINGS (APPROVED PLANS)	PD 1-3
SECTION VIII	BILL OF QUANTITIES AND ATTACHMENTS	BQ 1-38
	1a Bid Summary	1-1
	1b Bill of Quantities	1
	2. Annex 1 (Basis of Payments)	11
	3. Annex 2 (Facilities to be Provided)	25
	4. Annex 2A (Reimbursable items)	26
	5. Annex 3 (Minimum Equipment Requirements)	27
	6. Annex 4 (Construction Safety and Health Requirements)	28
	7. Annex 5 (Minimum Testing Requirements)	29
SECTION IX	Checklist of Technical and Financial Documents	CL 1-2
SECTION X	BIDDING FORMS	BF 1-22
	1. Bid Form	1
	2. Statement of all On-going Government and Private Contracts, including contracts awarded but not yet started	3
	3. Statement of the Bidder's Single Largest Completed Contracts (SLCC) Similar to the Contract to be Bid	4
	4. Experience Record on Similarly Completed Projects	5
	5. Financial Data	6
	6. List of Contractor's Personnel	7
	7. List of Contractor's Equipment Units	8
	8. Omnibus Sworn Statement for Sole Proprietorship	9
	9. Omnibus Sworn Statement for Partnership or Cooperative	11
	10. Omnibus Sworn Statement for Corporation or Joint Venture	13
	11. Bid-Securing Declaration	15
	12. Construction Methodology	16
	13. Manpower Schedule	18
	14. Equipment Utilization Schedule	19
	15. Cash Flow by Quarter and Payment Schedule	20
	16. Contract Agreement	21

GLOSSARY OF TERMS, ABBREVIATIONS, AND ACRONYMS

Glossary of Terms, Abbreviations, and Acronyms

ABC – Approved Budget for the Contract.

ARCC – Allowable Range of Contract Cost.

BAC – Bids and Awards Committee.

Bid – A signed offer or proposal to undertake a contract submitted by a bidder in response to and in consonance with the requirements of the bidding documents. Also referred to as *Proposal* and *Tender.* (2016 revised IRR, Section 5[c])

Bidder – Refers to a contractor, manufacturer, supplier, distributor and/or consultant who submits a bid in response to the requirements of the Bidding Documents. (2016 revised IRR, Section 5[d])

Bidding Documents – The documents issued by the Procuring Entity as the bases for bids, furnishing all information necessary for a prospective bidder to prepare a bid for the Goods, Infrastructure Projects, and/or Consulting Services required by the Procuring Entity. (2016 revised IRR, Section 5[e])

BIR – Bureau of Internal Revenue.

BSP – Bangko Sentral ng Pilipinas.

CDA – Cooperative Development Authority.

Consulting Services – Refer to services for Infrastructure Projects and other types of projects or activities of the GOP requiring adequate external technical and professional expertise that are beyond the capability and/or capacity of the GOP to undertake such as, but not limited to: (i) advisory and review services; (ii) pre-investment or feasibility studies; (iii) design; (iv) construction supervision; (v) management and related services; and (vi) other technical services or special studies. (2016 revised IRR, Section 5[i])

Contract – Refers to the agreement entered into between the Procuring Entity and the Supplier or Manufacturer or Distributor or Service Provider for procurement of Goods and Services; Contractor for Procurement of Infrastructure Projects; or Consultant or Consulting Firm for Procurement of Consulting Services; as the case may be, as recorded in the Contract Form signed by the parties, including all attachments and appendices thereto and all documents incorporated by reference therein.

Contractor – is a natural or juridical entity whose proposal was accepted by the Procuring Entity and to whom the Contract to execute the Work was awarded. Contractor as used in these Bidding Documents may likewise refer to a supplier, distributor, manufacturer, or consultant.

CPI – Consumer Price Index.

DOLE – Department of Labor and Employment.

DTI – Department of Trade and Industry.

Foreign-funded Procurement or Foreign-Assisted Project – Refers to procurement whose funding source is from a foreign government, foreign or international financing institution as specified in the Treaty or International or Executive Agreement. (2016 revised IRR, Section 5[b]).

GFI – Government Financial Institution.

GOCC – Government-owned and/or –controlled corporation.

Goods – Refer to all items, supplies, materials and general support services, except Consulting Services and Infrastructure Projects, which may be needed in the transaction of public businesses or in the pursuit of any government undertaking, project or activity, whether in the nature of equipment, furniture, stationery, materials for construction, or personal property of any kind, including non-personal or contractual services such as the repair and maintenance of equipment and furniture, as well as trucking, hauling, janitorial, security, and related or analogous services, as well as procurement of materials and supplies provided by the Procuring Entity for such services. The term "related" or "analogous services" shall include, but is not limited to, lease or purchase of office space, media advertisements, health maintenance services, and other services essential to the operation of the Procuring Entity. (2016 revised IRR, Section 5[r])

GOP – Government of the Philippines.

Infrastructure Projects – Include the construction, improvement, rehabilitation, demolition, repair, restoration or maintenance of roads and bridges, railways, airports, seaports, communication facilities, civil works components of information technology projects, irrigation, flood control and drainage, water supply, sanitation, sewerage and solid waste management systems, shore protection, energy/power and electrification facilities, national buildings, school buildings, hospital buildings, and other related construction projects of the government. Also referred to as *civil works or works*. (2016 revised IRR, Section 5[u])

LGUs – Local Government Units.

NFCC – Net Financial Contracting Capacity.

NGA – National Government Agency.

PCAB – Philippine Contractors Accreditation Board.

PhilGEPS - Philippine Government Electronic Procurement System.

Procurement Project – refers to a specific or identified procurement covering goods, infrastructure project or consulting services. A Procurement Project shall be described, detailed, and scheduled in the Project Procurement Management Plan prepared by the agency which shall be consolidated in the procuring entity's Annual Procurement Plan. (GPPB Circular No. 06-2019 dated 17 July 2019)

PSA – Philippine Statistics Authority.

SEC – Securities and Exchange Commission.

SLCC – Single Largest Completed Contract.

UN – United Nations.

SECTION I

INVITATION TO BID

BAGONG PILIPINAS

PHILIPPINE PORTS AUTHORITY

INVITATION TO BID

FOR THE

CONSTRUCTION OF CRANE RAILWAY & INSTALLATION OF QUAY CRANE, ILOILO COMMERCIAL PORT COMPLEX (ICPC), LOBOC, LAPAZ, ILOILO CITY

The Philippine Ports Authority, through the Corporate Budget of the Authority for CY 2024, intends to apply the sum of **P1,790,369,324.03** being the Approved Budget for the Contract (ABC) to payments under the contract for the **CONSTRUCTION OF CRANE RAILWAY & INSTALLATION OF QUAY CRANE, ILOILO COMMERCIAL PORT COMPLEX (ICPC), LOBOC, LAPAZ, ILOILO CITY (HO-INFRA-PPDD-24-0023)**. Bids received in excess of the ABC shall be automatically rejected at bid opening.

The Philippine Ports Authority now invites bids for the above Procurement Project. Completion of the Works is required in **Seven Hundred Twenty (720) calendar days** from the receipt by the successful bidder of the Notice to Proceed. Bidders should have completed a contract similar to the Project. The description of an eligible bidder is contained in the Bidding Documents, particularly, in Section II (Instructions to Bidders).

Bidding will be conducted through open competitive bidding procedures using a non-discretionary "pass/fail" criterion as specified in the 2016 Revised Implementing Rules and Regulations (IRR) of Republic Act (RA) 9184.

Interested bidders may obtain further information from the Philippine Ports Authority Bids and Awards Committee (BAC) and inspect the Bidding Documents at the address given below from 8:00 a.m. to 5:00 p.m., Monday to Friday.

A complete set of Bidding Documents may be acquired by interested Bidders on **13 December 2024** from the given address and website(s) below and upon payment of the applicable fee for the Bidding Documents, pursuant to the latest Guidelines issued by the GPPB, in the amount of **SEVENTY FIVE THOUSAND PESOS (P75,000.00)**. The Procuring Entity shall allow the bidder to present its proof of payment for the fees in person.

The Philippine Ports Authority's Bids and Awards Committee will hold a Pre-Bid Conference on **06 January 2025 at 10:00 a.m.** at the PPA Function Room, 7th Floor, PPA Bldg., Bonifacio Drive, South Harbor, Port Area, Manila, which shall be open to all prospective bidders.

Bids must be duly received by the BAC Secretariat through manual submission at the office address indicated below on or before **20 January 2025 at 8:00 a.m.** Late bids shall not be accepted.

All bids must be accompanied by a bid security in any of the acceptable forms and in amount stated in ITB Clause 16.

Bid opening shall be on **20 January 2025 at 9:00 a.m.** at the 7th Floor, PPA Building, A. Bonifacio Drive, South Harbor, Port Area, Manila. Bids will be opened in the presence of the bidders' representatives who choose to attend the activity.

The Philippine Ports Authority reserves the right to reject any and all bids, declare a failure of bidding, or not award the contract at any time prior to contract award in accordance with Sections 35.6 and 41 of the 2016 revised Implementing Rules and Regulations of RA No. 9184, without thereby incurring any liability to the affected bidder or bidders.

- **Required PCAB Registration: LARGE B - Port, Harbor & Offshore Engineering**

For further information, please refer to:

BAC Secretariat, Philippine Ports Authority
5th Floor, PPA Bldg., A. Bonifacio Drive,
South Harbor, Port Area, Manila
Telephone Nos. 8 527-47-35
8 527-83-56 to 83 loc. 539
PPA Website: www.ppa.com.ph
PhilGEPS Website: www.philgeps.gov.ph

MARK JON S. PALOMAR
Chairperson, PPA Head Office Bids and Awards
Committee for Engineering Projects (HO-BAC-EP)

SECTION II

INSTRUCTIONS TO BIDDERS

1. Scope of Bid

The Procuring Entity, ***Philippine Ports Authority*** invites Bids for ***Construction of Crane Railway & Installation of Quay Crane, Iloilo Commercial Port Complex (ICPC), Loboc, Lapaz, Iloilo City*** with Project Identification Number ***HO-INFRA-PPDD-24-0023.***

The ***Construction of Crane Railway & Installation of Quay Crane, Iloilo Commercial Port Complex (ICPC), Loboc, Lapaz, Iloilo City*** is for the construction of Works, as described in Section VI (Specifications).

2. Funding Information

2.1. The ***Philippine Ports Authority*** through the source of funding as indicated below for ***CY2024*** in the amount of **₱ 1,790,369,324.03**

2.2. The source of funding is:

PPA Corporate Fund.

3. Bidding Requirements

The Bidding for the Project shall be governed by all the provisions of RA No. 9184 and its 2016 revised IRR, including its Generic Procurement Manual and associated policies, rules and regulations as the primary source thereof, while the herein clauses shall serve as the secondary source thereof.

Any amendments made to the IRR and other GPPB issuances shall be applicable only to the ongoing posting, advertisement, or invitation to bid by the BAC through the issuance of a supplemental or bid bulletin.

The Bidder, by the act of submitting its Bid, shall be deemed to have inspected the site, determined the general characteristics of the contracted Works and the conditions for this Project, such as the location and the nature of the work; (b) climatic conditions; (c) transportation facilities; (c) nature and condition of the terrain, geological conditions at the site communication facilities, requirements, location and availability of construction aggregates and other materials, labor, water, electric power and access roads; and (d) other factors that may affect the cost, duration and execution or implementation of the contract, project, or work and examine all instructions, forms, terms, and project requirements in the Bidding Documents.

4. Corrupt, Fraudulent, Collusive, Coercive, and Obstructive Practices

The Procuring Entity, as well as the Bidders and Contractors, shall observe the highest standard of ethics during the procurement and execution of the contract. They or through an agent shall not engage in corrupt, fraudulent, collusive, coercive, and obstructive practices defined under Annex "I" of the 2016 revised IRR of RA No. 9184 or other integrity violations in competing for the Project.

5. Eligible Bidders

5.1 Only Bids of Bidders found to be legally, technically, and financially capable will be evaluated.

5.2 The Bidder must have an experience of having completed a Single Largest Completed Contract (SLCC) that is similar to this Project, equivalent to at least fifty percent (50%) of the ABC adjusted, if necessary, by the Bidder to current prices using the PSA's CPI, except under conditions provided for in Section 23.4.2.4 of the 2016 revised IRR of RA No. 9184.

A contract is considered to be "similar" to the contract to be bid if it has the major categories of work stated in the **BDS**.

5.3. For Foreign-funded Procurement, the Procuring Entity and the foreign government/foreign or international financing institution may agree on another track record requirement, as specified in the Bidding Document prepared for this purpose.

5.4. The Bidders shall comply with the eligibility criteria under Section 23.4.2 of the 2016 IRR of RA No. 9184.

6. Origin of Associated Goods

There is no restriction on the origin of Goods other than those prohibited by a decision of the UN Security Council taken under Chapter VII of the Charter of the UN.

7. Subcontracts

7.1. The Bidder may subcontract portions of the Project to the extent allowed by the Procuring Entity as stated herein, but in no case more than fifty percent (50%) of the Project.

The Procuring Entity has prescribed that:

Subcontracting is not allowed.

7.2. Subcontracting of any portion of the Project does not relieve the Contractor of any liability or obligation under the Contract. The Supplier will be responsible for the acts, defaults, and negligence of any subcontractor, its agents, servants, or workmen as fully as if these were the Contractor's own acts, defaults, or negligence, or those of its agents, servants, or workmen.

8. Pre-Bid Conference

The Procuring Entity will hold a pre-bid conference for this Project on the specified date and time and either at its physical address and/or through videoconferencing/webcasting as indicated in paragraph 6 of the **IB**.

9. Clarification and Amendment of Bidding Documents

Prospective bidders may request for clarification on and/or interpretation of any part of the Bidding Documents. Such requests must be in writing and received by the Procuring Entity, either at its given address or through electronic mail indicated in the **IB**, at least ten (10) calendar days before the deadline set for the submission and receipt of Bids.

10. Documents Comprising the Bid: Eligibility and Technical Components

10.1 The first envelope shall contain the eligibility and technical documents of the Bid as specified in **Section IX. Checklist of Technical and Financial Documents.**

10.2 If the eligibility requirements or statements, the bids, and all other documents for submission to the BAC are in foreign language other than English, it must be accompanied by a translation in English, which shall be authenticated by the appropriate Philippine foreign service establishment, post, or the equivalent office having jurisdiction over the foreign bidder's affairs in the Philippines. For Contracting Parties to the Apostille Convention, only the translated documents shall be authenticated through an apostille pursuant to GPPB Resolution No. 13-2019 dated 23 May 2019. The English translation shall govern, for purposes of interpretation of the bid.

10.3 A valid PCAB License is required, and in case of joint ventures, a valid special PCAB License, and registration for the type and cost of the contract for this Project. Any additional type of Contractor license or permit shall be indicated in the **BDS**.

10.4 A List of Contractor's key personnel (e.g., Project Manager, Project Engineers, Materials Engineers, and Foremen) assigned to the contract to be bid, with their complete qualification and experience data shall be provided. These key personnel must meet the required minimum years of experience set in the **BDS**.

10.5 A List of Contractor's major equipment units, which are owned, leased, and/or under purchase agreements, supported by proof of ownership, certification of availability of equipment from the equipment lessor/vendor for the duration of the project, as the case may be, must meet the minimum requirements for the contract set in the **BDS**.

11. Documents Comprising the Bid: Financial Component

11.1. The second bid envelope shall contain the financial documents for the Bid as specified in Section **IX. Checklist of Technical and Financial Documents**.

11.2. Any bid exceeding the ABC indicated in paragraph 1 of the **IB** shall not be accepted.

11.3. For Foreign-funded procurement, a ceiling may be applied to bid prices provided the conditions are met under Section 31.2 of the 2016 revised IRR of RA No. 9184.

12. Alternative Bids

Bidders shall submit offers that comply with the requirements of the Bidding Documents, including the basic technical design as indicated in the drawings and specifications. Unless there is a value engineering clause in the BDS, alternative Bids shall not be accepted.

13. Bid Prices

All bid prices for the given scope of work in the Project as awarded shall be considered as fixed prices, and therefore not subject to price escalation during contract implementation, except under extraordinary circumstances as determined by the NEDA and approved by the GPPB pursuant to the revised Guidelines for Contract Price Escalation guidelines.

14. Bid and Payment Currencies

14.1. Bid prices may be quoted in the local currency or tradeable currency accepted by the BSP at the discretion of the Bidder. However, for purposes of bid evaluation, Bids denominated in foreign currencies shall be converted to Philippine currency based on the exchange rate as published in the BSP reference rate bulletin on the day of the bid opening.

14.2. *Payment of the contract price shall be made in:*

Philippine Pesos.

15. Bid Security

15.1. The Bidder shall submit a Bid Securing Declaration or any form of Bid Security in the amount indicated in the BDS, which shall be not less than the percentage of the ABC in accordance with the schedule in the BDS.

15.2. The Bid and bid security shall be valid until **One Hundred Twenty (120) days from the date set for Bid Opening**. Any bid not accompanied by an acceptable bid security shall be rejected by the Procuring Entity as non-responsive.

16. Sealing and Marking of Bids

Each Bidder shall submit one copy of the first and second components of its Bid.

The Procuring Entity may request additional hard copies and/or electronic copies of the Bid. However, failure of the Bidders to comply with the said request shall not be a ground for disqualification.

If the Procuring Entity allows the submission of bids through online submission to the given website or any other electronic means, the Bidder shall submit an electronic copy of its Bid, which must be digitally signed. An electronic copy that cannot be opened or is corrupted shall be considered non-responsive and, thus, automatically disqualified.

17. Deadline for Submission of Bids

The Bidders shall submit on the specified date and time and either at its physical address or through online submission as indicated in paragraph 7 of the **IB**.

18. Opening and Preliminary Examination of Bids

18.1. The BAC shall open the Bids in public at the time, on the date, and at the place specified in paragraph 9 of the **IB**. The Bidders' representatives who are present shall sign a register evidencing their attendance. In case videoconferencing, webcasting or other similar technologies will be used, attendance of participants shall likewise be recorded by the BAC Secretariat.

In case the Bids cannot be opened as scheduled due to justifiable reasons, the rescheduling requirements under Section 29 of the 2016 revised IRR of RA No. 9184 shall prevail.

18.2. The preliminary examination of Bids shall be governed by Section 30 of the 2016 revised IRR of RA No. 9184.

19. Detailed Evaluation and Comparison of Bids

19.1. The Procuring Entity's BAC shall immediately conduct a detailed evaluation of all Bids rated "passed" using non-discretionary pass/fail criteria. The BAC shall consider the conditions in the evaluation of Bids under Section 32.2 of 2016 revised IRR of RA No. 9184.

19.2. If the Project allows partial bids, all Bids and combinations of Bids as indicated in the **BDS** shall be received by the same deadline and opened and evaluated simultaneously so as to determine the Bid or combination of Bids offering the lowest calculated cost to the Procuring Entity. Bid Security as required by **ITB** Clause 16 shall be submitted for each contract (lot) separately.

19.3 In all cases, the NFCC computation pursuant to Section 23.4.2.6 of the 2016 revised IRR of RA No. 9184 must be sufficient for the total of the ABCs for all the lots participated in by the prospective Bidder.

20. Post Qualification

Within a non-extendible period of five (5) calendar days from receipt by the Bidder of the notice from the BAC that it submitted the Lowest Calculated Bid, the Bidder shall submit its latest income and business tax returns filed and paid through the BIR Electronic Filing and Payment System (eFPS), and other appropriate licenses and permits required by law and stated in the **BDS**.

21. Signing of the Contract

The documents required in Section 37.2 of the 2016 revised IRR of RA No. 9184 shall form part of the Contract. Additional Contract documents are indicated in the **BDS**.

SECTION III

BID DATA SHEET

Bid Data Sheet

<table>
<tr><td>ITB Clause</td><td colspan="3"></td></tr>
<tr><td>5.2</td><td colspan="3">For this purpose, contracts similar to the Project refer to contracts which have the same Major Categories of Works which shall be:
<table>
<tr><th>Description/Clarification</th><th>Unit of Measure</th><th>Quantity (at least)</th></tr>
<tr><td>1. Pile Driving Works
2. Reinforced Concrete Works
3. Installation of Cargo Handling Equipment or similar</td><td>l.m.
cu.m.
set</td><td>2,279
1,976
1</td></tr>
</table></td></tr>
<tr><td>7.1</td><td>Portion of Works allowed to be subcontracted:

Subcontracting is not allowed</td><td colspan="2">Maximum Percentage allowed to be subcontracted:

Subcontracting is not allowed</td></tr>
<tr><td>10.3</td><td colspan="3">For Joint Venture:
Special PCAB License</td></tr>
<tr><td>10.4</td><td colspan="3">The key personnel must meet the required minimum years of experience set below:
<table>
<tr><th>Key Personnel</th><th>General Experience</th><th>Relevant Experience (Minimum)</th></tr>
<tr><td>a. Project Manager
b. Project Engineer
c. Project Architect
d. Materials Engineer II
e. Construction Safety and Health Officer
f. Foreman</td><td></td><td>Five (5) years
Three (3) years
Three (3) years
One (1) year
One (1) year
Five (5) years</td></tr>
</table></td></tr>
<tr><td>10.5</td><td colspan="3">The minimum major equipment requirements are the following:</td></tr>
</table>

	Please refer to Section 8, *Annex 3 Minimum Major Equipment Requirements*
12	*Value Engineering Clause:* **Not Allowed**
15.1	The bid security shall be in the form of a Bid Securing Declaration or any of the following forms and amounts: a. The amount of not less than **₱ 35,807,386.48,** if bid security is in cash, cashier's/manager's check, bank draft/guarantee or irrevocable letter of credit; b. The amount of not less than **₱ 89,518,466.20**, if bid security is in Surety Bond.
16	Each bidder shall submit one (1) original and six (6) copies of the Technical and Financial Proposals, properly labelled, book-bound, with hard cover and corresponding index tabs. Failure to comply with the requirements is a ground for the automatic disqualification of the bidder.
19.2	Partial bids: **Not Allowed**
20	*Other appropriate licenses and permits required:* **None**
21	*Other contract documents are as follows:* *Construction Schedule and S-Curve, Manpower Schedule, Construction Methods, Equipment Utilization Schedule, Construction Safety and Health Program approved by the Department of Labor and Employment and PERT/CPM or other acceptable tools of project scheduling.*

SECTION IV

GENERAL CONDITIONS OF CONTRACT

1. Scope of Contract

This Contract shall include all such items, although not specifically mentioned, that can be reasonably inferred as being required for its completion as if such items were expressly mentioned herein. All the provisions of RA No. 9184 and its 2016 revised IRR, including the Generic Procurement Manual, and associated issuances, constitute the primary source for the terms and conditions of the Contract, and thus, applicable in contract implementation. Herein clauses shall serve as the secondary source for the terms and conditions of the Contract.

This is without prejudice to Sections 74.1 and 74.2 of the 2016 revised IRR of RA No. 9184 allowing the GPPB to amend the IRR, which shall be applied to all procurement activities, the advertisement, posting, or invitation of which were issued after the effectivity of the said amendment.

2. Sectional Completion of Works

If sectional completion is specified in the **Special Conditions of Contract (SCC)**, references in the Conditions of Contract to the Works, the Completion Date, and the Intended Completion Date shall apply to any Section of the Works (other than references to the Completion Date and Intended Completion Date for the whole of the Works).

3. Possession of Site

4.1. The Procuring Entity shall give possession of all or parts of the Site to the Contractor based on the schedule of delivery indicated in the **SCC**, which corresponds to the execution of the Works. If the Contractor suffers delay or incurs cost from failure on the part of the Procuring Entity to give possession in accordance with the terms of this clause, the Procuring Entity's Representative shall give the Contractor a Contract Time Extension and certify such sum as fair to cover the cost incurred, which sum shall be paid by Procuring Entity.

4.2. If possession of a portion is not given by the above date, the Procuring Entity will be deemed to have delayed the start of the relevant activities.

The resulting adjustments in contract time to address such delay may be addressed through contract extension provided under Annex "E" of the 2016 revised IRR of RA No. 9184.

4. The Contractor's Obligations

The Contractor shall employ the key personnel named in the Schedule of Key Personnel indicating their designation, in accordance with **ITB** Clause 10.3 and specified in the **BDS**, to carry out the supervision of the Works.

The Procuring Entity will approve any proposed replacement of key personnel only if their relevant qualifications and abilities are equal to or better than those of the personnel listed in the Schedule.

5. Performance Security

5.1. Within ten (10) calendar days from receipt of the Notice of Award from the Procuring Entity but in no case later than the signing of the contract by both parties, the successful Bidder shall furnish the performance security in any of the forms prescribed in Section 39 of the 2016 revised IRR.

5.2. The Contractor, by entering into the Contract with the Procuring Entity, acknowledges the right of the Procuring Entity to institute action pursuant to RA No. 3688 against any subcontractor be they an individual, firm, partnership, corporation, or association supplying the Contractor with labor, materials and/or equipment for the performance of this Contract.

6. Site Investigation Reports

The Contractor, in preparing the Bid, shall rely on any Site Investigation Reports referred to in the **SCC** supplemented by any information obtained by the Contractor.

7. Warranty

7.1. In case the Contractor fails to undertake the repair works under Section 62.2.2 of the 2016 revised IRR, the Procuring Entity shall forfeit its performance security, subject its property(ies) to attachment or garnishment proceedings, and perpetually disqualify it from participating in any public bidding. All payables of the GOP in his favor shall be offset to recover the costs.

7.2. The warranty against Structural Defects/Failures, except that occasioned-on force majeure, shall cover the period from the date of issuance of the Certificate of Final Acceptance by the Procuring Entity. Specific duration of the warranty is found in the **SCC**.

8. Liability of the Contractor

Subject to additional provisions, if any, set forth in the **SCC**, the Contractor's liability under this Contract shall be as provided by the laws of the Republic of the Philippines.

If the Contractor is a joint venture, all partners to the joint venture shall be jointly and severally liable to the Procuring Entity.

9. Termination for Other Causes

Contract termination shall be initiated in case it is determined prima facie by the Procuring Entity that the Contractor has engaged, before, or during the implementation of the contract, in unlawful deeds and behaviors relative to contract acquisition and implementation, such as, but not limited to corrupt, fraudulent, collusive, coercive, and obstructive practices as stated in **ITB** Clause 4.

10. Dayworks

Subject to the guidelines on Variation Order in Annex "E" of the 2016 revised IRR of RA No. 9184, and if applicable as indicated in the SCC, the Dayworks rates in the Contractor's Bid shall be used for small additional amounts of work only when the Procuring Entity's Representative has given written instructions in advance for additional work to be paid for in that way.

11. Program of Work

11.1. The Contractor shall submit to the Procuring Entity's Representative for approval the said Program of Work showing the general methods, arrangements, order, and timing for all the activities in the Works. The submissions of the Program of Work are indicated in the **SCC.**

11.2. The Contractor shall submit to the Procuring Entity's Representative for approval an updated Program of Work at intervals no longer than the period stated in the **SCC.** If the Contractor does not submit an updated Program of Work within this period, the Procuring Entity's Representative may withhold the amount stated in the **SCC** from the next payment certificate and continue to withhold this amount until the next payment after the date on which the overdue Program of Work has been submitted.

12. Instructions, Inspections and Audits

The Contractor shall permit the GOP or the Procuring Entity to inspect the Contractor's accounts and records relating to the performance of the Contractor and to have them audited by auditors of the GOP or the Procuring Entity, as may be required.

13. Advance Payment

The Procuring Entity shall, upon a written request of the Contractor which shall be submitted as a Contract document, make an advance payment to the Contractor in an amount not exceeding fifteen percent (15%) of the total contract price, to be made in lump sum, or at the most two installments according to a schedule specified in the **SCC**, subject to the requirements in Annex "E" of the 2016 revised IRR of RA No. 9184.

14. Progress Payments

The Contractor may submit a request for payment for Work accomplished. Such requests for payment shall be verified and certified by the Procuring Entity's Representative/Project Engineer. Except as otherwise stipulated in the **SCC**, materials and equipment delivered on the site but not completely put in place shall not be included for payment.

15. Operating and Maintenance Manuals

15.1. If required, the Contractor will provide "as built" Drawings and/or operating and maintenance manuals as specified in the **SCC.**

15.2. If the Contractor does not provide the Drawings and/or manuals by the dates stated above, or they do not receive the Procuring Entity's Representative's approval, the Procuring Entity's Representative may withhold the amount stated in the **SCC** from payments due to the Contractor.

SECTION V

SPECIAL CONDITIONS OF CONTRACT

Special Conditions of Contract

GCC Clause	
2	*Sectional Completion:* **None**
4.1	The Procuring Entity shall give possession of all parts of the Site to the Contractor upon commencement of the project.
6	*Site Investigation Report:* **None**
7.2	*Permanent structures: Fifteen (15) years* Buildings of types 4 and 5 as classified under the National Building Code of the Philippines and other structures made of steel, iron, or concrete which comply with relevant structural codes (e.g., DPWH Standard Specifications), such as, but not limited to, steel/concrete bridges, flyovers, aircraft movement areas, ports, dams, tunnels, filtration and treatment plants, sewerage systems, power plants, transmission and communication towers, railway system, and other similar permanent structures
10	No dayworks are applicable to the contract.
11.1	The Contractor shall submit the Program of Work to the Procuring Entity's Representative within ____ days of delivery of the Notice of Award.
11.2	The amount to be withheld for late submission of an updated Program of Work is _____.
13	The provision on advance payments or mobilization fees in the terms and conditions of all contracts/ purchase orders/ job orders for goods, services and infrastructure projects that will be signed or executed shall henceforth be excluded.
14	No further instructions.
15.1	The date by which operating and maintenance manuals are required is _____. The date by which "as built" drawings are required is _____.
15.2	The amount to be withheld for failing to produce "as built" drawings and/or operating and maintenance manuals by the date required is _____.

SECTION VI

TECHNICAL SPECIFICATIONS

ITEM 01 : DEMOLITION AND REMOVAL WORKS

DESCRIPTION

The work includes the furnishing of all labor, materials and equipment required to carry out the demolition and removal of old structures, port accessories and obstructions including demolition of miscellaneous concrete curbs etc., as required for the execution of the Contract.

The Contractor shall submit the proposed methodology or procedure of demolition work with detailed drawings and calculations if necessary, to the Engineer for approval, before the execution of the Works.

The Contractor shall keep all pavements and landing areas to and from the site of the disposal area clean and free of mud, dirt and debris during and after the execution of disposal. Disposal of debris and materials shall be as directed by the Engineer.

GENERAL PROVISIONS

1. The Contractor shall be deemed to have satisfied himself of the site conditions, and to have included in his unit prices provision for all risks that may arise during or in connection with the work.

2. The demolition shall be carried out by approved methods and equipment such as concrete breakers, gas-cutters, hydraulic jacks, compressed air disintegrators, etc., however, no blasting shall be used unless approved in writing by the Engineer and after obtaining the written permission of the concerned authorities.

3. The Contractor shall provide suitable equipment, skilled labor and appropriate temporary works such as scaffoldings to ensure safety in his demolition works as well as in the adjacent area.

4. Contractor shall demolish all the structural members above the level on which the subsequent and permanent works under this Contract will begin. To this end, the temporary construction works such as excavation shall be conducted by the Contractor.

5. Materials coming from the demolition works, except general earth, shall remain the property of the Procuring Entity, the designated part of which shall be stored by the Contractor at places specified by the Engineer/ Accepting authority. Receiving copy of Turn-Over Report shall be provided.

6. In case of demolition of wharf deck and platform, the contractor shall ensure that no debris will be remained/deposited at seabed.

INTERFERENCE WITH PORT OPERATIONS

During the execution of the work, the Contractor shall not interfere with the shipping, navigation and other traffic in the port.

The Contractor shall make arrangements with the operations people on the schedule of demolition and related works to keep port operation activities undisturbed at all times.

Prior to commencement of the demolition works, the Contractor shall inform/announce to port users the schedule of disconnection of utilities.

STORAGE AND DUMPING

Prior to the commencement of the demolition work, the Engineer shall submit to the Contractor a list in which all the materials to be salvaged and overhauled, as property of PPA, and the description of the location of their storage. Materials embedded in concrete units shall not be salvaged.

The Contractor shall separate materials to be salvaged from debris. Salvaged materials shall be loaded, transported and unloaded by the Contractor at the specified locations.

The Contractor may dump debris or extracted rocks on land areas but out of the site, which areas shall be procured and prepared at his own expense. In this case, safety measures shall be undertaken in the transporting, unloading, covering and others as requested by the Engineer.

The approximate distance of the disposal site from the project site is about five (5) kms., as designated by the PMO thru the implementing office.

EXECUTION

1. Prior to the commencement of demolition works, the alignments of the new construction works to existing structure shall be checked.

2. The width and alignment of portion of existing structure to be demolished shall be marked by paint.

3. With these lines as guides, concrete shall be broken and reinforcing bars cut, such that panels or portions of the structure can be lifted out for disposal elsewhere outside of the operational work area.

4. Rocks removed from existing slope protection shall be stored for re-use in new construction.

5. Demolish pavements, curbs, fences, utilities, services, navigation aids and the likes as determined in the field for each project and as shown on the drawings or as directed by the Engineer.

6. Materials coming from the demolition works shall be properly disposed by the Contractor.

SAFETY

During the course of survey and clearing, any obstacles which are recognized and seemed to be explosive or hazardous to workers shall be removed from the site by the proper Authority.

At the end of each day's work, the Contractor shall keep the workplace in safe condition and clean so that no part is in danger of falling or creating hazard to personnel or equipment.

ITEM 02 : EXCAVATION WORKS

SCOPE OF WORK

General Provisions

1. The area shall be excavated at the *required depth* as indicated on the Drawing/s.

2. The work includes furnishing of all labor, materials, plants and equipment required to complete/finish the excavation works.

Work Schedules

1. After examinations of all relevant data, coordination needs, work constrains, equipment to be used and other matters, a PERT/CPM diagram showing the detailed schedule/duration and sequences for the execution of excavation work shall be submitted to the Engineer for approval within 15 days before the proposed commencement of the Works.

2. Before the commencement of excavation works, the Contractor together with the Authority's Representatives and Surveyors shall conduct a pre-joint hydrographic and topographic survey which will form basis of actual quantity of excavated materials to be removed/excavated.

3. Prior to excavation works, the Contractor shall establish visible markers to clearly define the limits of the excavation.

EQUIPMENT/LAYOUT OF WORK

Plant

1. The Contractor shall keep on the job sufficient equipment/plant to meet the requirement of the project.

2. The equipment/plant shall be in satisfactorily operating conditions and capable of efficiently performing the excavation works with safety as set forth herein and shall be subject to inspection by the Engineer at all times.

Physical Data/Layout of Work

1. The Authority does not guarantee to keep the project excavation area free from obstructions.

2. The Contractor shall conduct the work in such manner not to disrupt the port operational activities at all times.

3. The Contractor shall layout his work from the government established ranges and gauges which shall be pointed out to him prior to commencement of the excavation work but shall be responsible for all measurements in connection therewith.

4. The Contractor shall furnish, at his own expense, survey equipment, range markers, poles, buoys, etc., and labor as may be required in laying out any part of the excavation work.

5. The Contractor shall be responsible for the installation, maintenance and preservation of all gauges, ranges, platforms, excavation limit markers. Upon completion of the work, the Contractor shall promptly remove all ranges, markers, and other marker placed by him that may be detrimental to port operation.

EXECUTION

EXCAVATION WORKS

Description

1. This item shall consist for the removal of existing seabed/fill in conformity with the dimensions shown in hydrographic and topographic survey plan or as established by the Engineer.

2. The excavated suitable materials shall be used if proven to pass the requirements as backfilling materials.

3. The excavated good materials shall be stockpiled within the project site to be designated by the Engineer. The good materials shall be used for backfilling as directed by the Engineer.

Progress of Work

1. Upon mobilizing sufficient labors, materials, plants and equipment, the Contractor shall works at such hours as may be necessary, subject to existing laws, to ensure the prosecution of work in accordance with the approved schedule (PERT/CPM). If the Contractor falls behind the approved excavation schedule, the Engineer may require the Contractor to increase the number of shifts and/or equipment without extra cost to the Authority.

2. Failure of the Contractor to comply with the requirements shall be reasonable grounds to assume that the Contractor is not performing the excavation work with such diligence as will insure completion within the specified time, in which case, the Engineer may be compelled to take steps to protect the interest of the PPA.

3. When the Contractor elects to work overtime and on Sundays and legal holidays, appropriate authority from those concern must be secured and notice of his intention to do so shall be submitted to the Engineer within the reasonable time in advance thereof.

4. The Contractor shall *submit daily excavation reports in duplicate* within two (2) days after the end of the day covered by the report duly signed by the Contractor or his duly authorized representative and the Engineer. The report shall be made in forms and to be provided by the Authority.

5. The Contractor shall take necessary measures to protect the life and health of his men in accordance with the existing laws and regulations of the Government. The Contractor shall provide safety devices to Engineer and personnel while on board the equipment/plant in performance of their official duties.

6. The Contractor shall put up and maintain such markers and buoys as will prevent any accident in consequence of his excavation work. No liability whatsoever attaches to the Authority, if as a result of the operations or installation, an accident happens in the project area. The Contractor shall hold the Authority free and harmless against any or all claims of persons involve in such accidents.

EXCAVATED MATERIALS

1. Disposal of excavated unsuitable materials from seabed shall be transported and deposited at 10.00 kms. (minimum) away from the area to be excavated.

2. Stockpiling and usage of excavated materials from existing backfill shall be approved by the Engineer in coordination with the Agency.

Displace Materials

1. Should the Contractor, during the progress of the excavation works, lose, dump, throw overboard, sink, misplace any materials, plant, machinery or appliance which may be dangerous to or obstruct navigation and/or port operations activities, the Contractor shall immediately give notice with description and location of such obstruction to the Authority and when required, shall mark the obstruction until such time the same is removed.

2. Should the Contractor refuse, neglect or delay compliance with the above requirements, such obstructions shall be removed by the Authority and the cost of its removal shall be deducted from any money due or to become due to the Contractor or proceeded against his performance bond.

3. Any excavated materials that is deposited other than the designated area will not be paid and the Contractor shall be required to remove such misplaced materials and deposit it to where directed at his expense.

INSPECTION

1. No PPA Project Engineer or Authority's Representative is authorized to change any provisions of the excavation specifications without written authorization of the Authority.

2. Nor shall the presence or absence of a PPA project Engineer or Authority's Representative relieve the Contractor from any of his responsibility under the Contract.

PAY LIMITS

It is to be clearly understood that no payments will be made for excavation beyond the excavation limits. The Contractor shall bear all the cost of over excavation beyond the project depth and in addition, of any remedial measures ordered by the Authority or its representative to be taken in areas over excavation is not permitted.

SOUNDINGS

1. The Contractor, in the presence or joint with the Authority's Representative and during the progress of the excavation works, shall perform continuous checking of the depth thru soundings.

2. For the purpose of work progress payments; the Contractor, jointly with the Authority's Representative and/or Surveyors, shall conduct soundings on areas subjected to excavation activities during the month or the preceding period for which payment is being claimed.

3. The Contractor will be responsible for all costs involved in the above mentioned such as costs for the survey equipment, measurement, markings, materials and other cost related thereto.

ITEM 03 : PILING WORKS (SPP)

SCOPE OF WORK

This section covers the minimum requirements for the fabrication, hauling, spotting, driving and finishing of all foundation piles to be used as containment for the proposed pier.

The Contractor may however, adopt, in addition to this minimum requirements additional provisions as may be necessary to insure the successful prosecution of the work related to the said undertaking.

METHOD STATEMENT

Before the commencement of any piling works, the Contractor shall submit (allowing sufficient time for consideration) to the Engineer for approval a Safety Policy and a Method Statement which shall include the following information:

1. Program of Works detailing sequence and timing of individual portions of works.

2. Maximum proposed lead at any stage of driving between a pile and its neighbor and the limitations of same if hard driving is encountered.

3. Contingency plan in the event of encountering obstructions or reaching driving refusal to minimize disruption/delay especially when using pitch and drive methods.

MATERIAL REQUIREMENTS

STEEL PIPE PILES

Steel tubular piles required under this heading may either be fluted or plain, tapered or cylindrical, seamless or welded type or as indicated in the drawing conforming to the requirements of ASTM A 252, equal or better. Minimum shell thickness shall be as indicated in the drawings.

Manufacturing processes, grades and test requirements shall conform to the requirements of ASTM A 252. Other materials, equal or better, than this standard may be allowed upon approval of the implementing agency.

Type of Test		**Requirements**
Chemical Composition	-	ASTM A252, ASTM A751
Mechanical/ Tensile Test	-	ASTM A252, ASTM A370
Physical /Test	-	ASTM A252

REINFORCING BAND AND BACKING CYLINDER PLATE

Manufacturing processes, grades and test requirements shall conform to the requirements of ASTM A 252. Other materials, equal or better, than this standard may be allowed upon approval of the implementing agency.

CONCRETE AND REINFORCEMENT WORKS

Concrete and reinforcement works for filler of steel pipe piles, concrete jacket and pile cap shall be in accordance with the Section "Reinforced Concrete" where the compressive strength of concrete at 28 days and yield strength of reinforcement shall be 24MPa (3,500 psi) and 276MPa (40 000psi) respectively.

PROTECTIVE COATING

Coating System

The corrosion protective coating shall be polyurethane-base.

The protective coating supplier is required to certify that the materials delivered to the fabrication site will be proven to meet or exceed the following properties:

TECHNICAL PROPERTIES	UNIT	MINIMUM	TEST STANDARD
A. Physical Characteristics:			
Thickness	microns	1500	ASTM D1186
B. Mechanical Properties:			
Tensile Strength	N/mm^2	18	DIN 53504
Elongation	%	19	ASTM D2370
Impact	J/mm	8	ASTM 2794-69/14
Bond Strength	kg/cm^2	234	DIN 53232

Application of the protective coating shall be one meter (1) below the design depth up to the pile butt of the steel pipe piles, as illustrated in Figure 1.

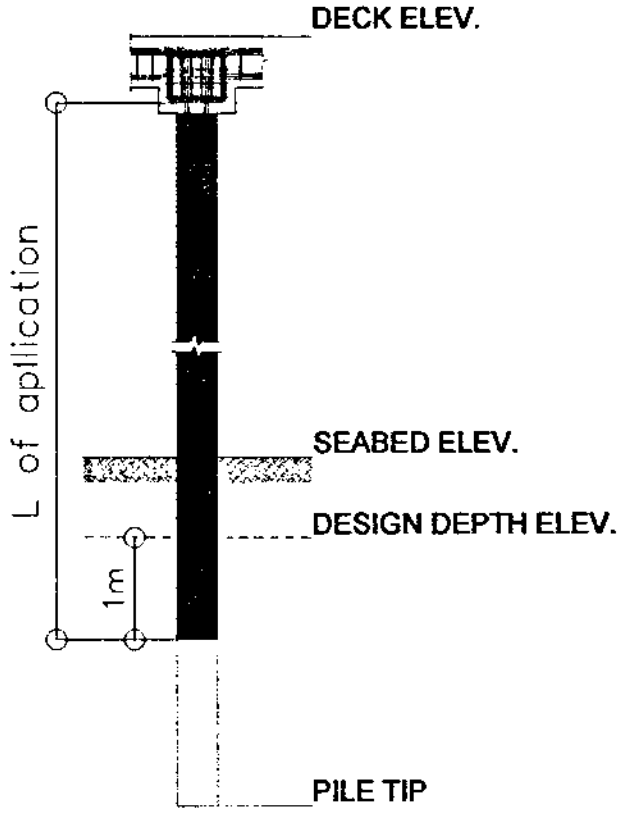


Figure 1: Illustration showing the application of Protective Coating System

Surface Preparation

The surface areas of the sections of piles that are intended to be coated are cleaned in accordance with standard ISO 8501-1 "Pictorial Standard of Cleanliness". These standards for surface cleaning outline the visual characteristics of the substrate as viewed by the naked eye. Once the substrate is cleaned, it is compared to reference pictures contained within the standards. The Sa 2½ is to be used for this undertaking, which is defined in ISO 8501-1 as having the following characteristics:

"Very thorough blast cleaning: Near white metal, 85% clean. The surface shall be free from visible oil, dirt and grease, from poorly adhering mill scale, rust, paint coatings and foreign matter. The metal has a greyish color. Any traces of contamination shall be visible only as slight stains in the form of spots or stripes."

Spraying Method

Airless spraying techniques involve paint being "forced out of an orifice at high pressure, 5 to 35 MPa". The paint appears to form a coating "sheet" to ensure a uniform and continuous coating layer. This uniformity is important as even the smallest discrepancy in the coating can lead to accelerated corrosion. Once any small-sized area of the substrate becomes exposed it will begin to corrode. This corrosion continues under the protective layer in the adjoining coated areas in all directions, even if the coating has not been damaged.

Good surface preparation is essential and it profoundly effects the performance of the protective coating. Poor surface preparation invariably develops a poor adhesive bond between the coating and the substrate and causes premature coating failure. Hence, the surface preparation and airless spraying shall be done in an "Enclosed Area" wherein humidity and corrosion may be controlled prior to delivery of the Steel Pipe Piles at the project site.

On-site repairs

A special touch up materials shall be provided by the supplier/contractor and shall be done either by the use of a spray or manual brush with the objective of having a final homogeneous coating. The special touch up materials shall be used in repairing damages caused by handling and transporting of the Steel Pipe Piles.

WELDING REQUIREMENTS

The welding material used for the production of steel piles by circumferential welding of steel pile or in the attachment of accessories shall have a tensile strength not less than the following test standards.

JIS Z 3211	-	Covered Electrodes for Mild Steel
JIS Z 3213	-	Covered Electrodes for High Tensile Strength Steel
JIS Z 3312	-	MAG Welding Solid Wires for Mild
JIS Z 3313	-	Flux Cored Wives for Gas Shielded and self-shielded Metal Arc Welding of Mild Steel, High Strength Steel and Low Temperature Service Steel
JIS Z 3352	-	Submerged Arc Welding Fluxes for Carbon Steel and Low Alloy Steel

EXECUTION

MARKING

The pile shall be marked on with durable paint indicating:

1. Serial Number, marked close to both ends
2. Date of Arrival, marked same as (1)
3. Length of pile, marked same as (1)
4. Meters mark in two faces, throughout the length

DOCUMENTS TO BE SUBMITTED

1. Steel Pipe manufacturing plan (Steel pipe production plan, welding method, welding material, production location, production method, transportation, etc.)
2. Design plan
3. Manufacturing process
4. Shipment method and stacking plan
5. Steel pipe inspection certificate
6. Size inspection record
7. Radiographic Test record

STEEL PIPE PILES

The Contractor shall submit to the Engineer three (3) copies of test reports by the approved steel mill certifying that the steel pipe pile meets the requirements specified in these technical specifications.

PILE SPLICING

General Provision

1. The alignment of piles shall be plumb and the length of upper and lower segment shall be in accordance in the approved plans.
2. Lower segment of piles should be spliced with the upper segment piles prior to the conduct of actual driving.
3. The splice shall be embedded at least 4m from the design depth elevation.
4. Splice welding shall conform to the welding requirements of this section.
5. The welder shall be accredited by TESDA.

REINFORCED CONCRETE

The requirements regarding testing of concrete and reinforcement used in the concrete filler and cage bars of steel pipe piles shall be in accordance with Section "Reinforced Concrete".

STORAGE AND HANDLING

1. Piles may be stored in open air but on wooden sleepers to be placed in a manner so as not to cause excessive bending.

2. Piles shall be stacked on a stable yard and shall not be stacked more than three (3) tiers high.

3. All piles shall be carefully lifted at the location of the lifting points as indicated in the Drawings. Other practical and convenient methods may be used subject to the approval of the Engineer.

DRIVING OF PILES

A diesel or hydraulic pile hammer shall be used for driving the steel pipe piles.

The required weight of ram for the diesel pile hammer 2.5 tons or at least 25% (1/4) of the weight of longest pile.

Piles driven shall be held firmly in position in axial alignment with the hammer by means of leads of adequate length. Approved cushions shall be provided to the pile butts.

BEARING POWER OF PILES

Each pile shall be driven to attain not less than the required minimum bearing power shown in the pile schedule, as determined by the Hiley's Formula as follows:

$$\text{For Diesel Pile Hammer :} \qquad R = \frac{1}{6} \times \frac{2WH}{S + 2.54}$$

where : R = allowable bearing capacity of pile (tf)

W = weight of ram (tf)

H = fall of ram (cm)

S = set (cm)

In case of the use of hydraulic pile hammer, the computed minimum bearing power shall be submitted to the Project Development Department (PDD) and shall be evaluated and approved by the Designing Engineer.

DRIVING RECORDS

The Contractor shall keep complete and accurate piling records. Two (2) signed copies of these records shall be submitted to the Engineer not more than 48 hours from the date of works detailed therein. The pile records shall always be submitted with sufficient time for the Engineer's approval.

The records shall contain the following information:

1. Pile reference number

2. Pile type and Steel Grade

3. Pile Length

4. Commencing surface level and final toe level

5. Depth driven, time, date when piles were driven

6. Where required the number of blows to drive each 250 mm over the last 2.5 meter shall be recorded

7. Comments regarding unusual/unexpected driving conditions

INTERRUPTED DRIVING

When driving is stopped before final penetration is reached and/or refusal is attained, the record of pile penetration shall be taken only after a minimum of 30 cm. (12 in.) total penetration has been obtained on resumption of driving.

ALIGNMENT TOLERANCE

Piles driven shall be within the allowable tolerance in alignment of 10 cm. (4 in.) in any direction.

DAMAGED AND MISDRIVEN PILES

1. Piles shall not be more than 10 cm. (4 in.) out of place at cut-off level. All steel pipe piles shall not be more than 2% out of plumb.

2. Any pile damaged by improper driving or driven out of its proper location, or driven out of elevation fixed on the plans, shall be corrected correspondingly at the Contractor's expense by any of the following methods:

    a. Withdrawal of the pile and replacement by a new pile.

    b. Driving a second pile adjacent to the defective one.

    c. Splicing an additional length.

The method to be adopted in each case shall be at the discretion of the Engineer.

ITEM 04 : REINFORCED CONCRETE

SCOPE OF WORK

All works falling under this Section shall include reinforced concrete for all kinds and parts of any reinforced concrete structure.

GENERAL PROVISIONS

1. Full cooperation shall be given to the other trades to install embedded items. Suitable templates or instructions will be provided for setting, items shall have been inspected, and tests for concrete or other materials or for mechanical operations shall have been completed and approved.

2. The following publications of the issues listed below, but referred to thereafter by basic designation only, form as an integral part of this Specification to the extent indicated by the reference thereto:

   a. American Concrete Institute (ACI) Standards:

ACI 117	Standard Specifications for Tolerances for Concrete Construction and Materials
ACI 121R	Quality Management System for Concrete Construction
ACI 201.2R	Guide to Durable Concrete
ACI 211.1	Standard Practice for Selecting Proportions for Normal, Heavyweight, and Mass Concrete
ACI 214R	Recommended Practice for Evaluation of Strength Test Results of Concrete
ACI 301	Specifications for Structural Concrete
ACI 304.2R	Placing Concrete by Pumping Methods
ACI 304R	Guide for Measuring, Mixing, Transporting, and Placing Concrete
ACI 305R	Hot Weather Concreting
ACI 306.1	Standard Specification for Cold Weather Concreting
ACI 308R	Guide to Curing Concrete
ACI 309R	Guide for Consolidation of Concrete
ACI 311.4R	Guide for Concrete Inspection
ACI 318M	Metric Building Code Requirements for Structural Concrete and Commentary

ACI 347 Guide to Formwork for Concrete

ACI SP-15 Field Reference Manual: Standard Specifications for Structural Concrete with Selected ACI and ASTM References

ACI SP-2 ACI Manual of Concrete Inspection

b. American Society for Testing and Materials (ASTM) Publications:

ASTM C 150 Standard Specification for Portland Cement

ASTM C 114 Standard Method for Chemical Analysis of Hydraulic Cement

ASTM C 185 Standard Method for Air Content of Hydraulic Cement

ASTM C 115 Standard Test Method for Fineness of Portland Cement by the Turbidimeter

ASTM C 204 Standard Test Method for Fineness of Hydraulic Cement by Air-Permeability Apparatus

ASTM C 151 Standard Test Method for Autoclave Expansion of Portland Cement

ASTM C 109 Standard Test Method for Compressive Strength of Hydraulic Cement Mortars

ASTM C 266 Standard Test Method for Time of Setting of Hydraulic-Cement Paste Gilmore Needles

ASTM C 191 Standard Test Method of Time Setting of Hydraulic Cement by Vicat Needle

ASTM C 33 Standard Specification for Concrete Aggregates

ASTM C 136 Standard Test Method for Sieve Analysis of Fine and Coarse Aggregates

ASTM C 117 Standard Test Method for Materials Finer than 75 micron (No. 200) Sieve in Mineral Aggregates by Washing

ASTM C 29 Standard Test Method for Bulk Density (Unit Weight") and Voids in Aggregate

ASTM C 128 Standard Test Method for Density, Relative Density (Specific Gravity), and Absorption of Fine Aggregates

ASTM C 87 Standard Test Method for Effect of Organic Impurities in Fine Aggregate on Strength of Mortar

ASTM C 88 Standard Test Method for Soundness of Aggregates by Use of Sodium Sulfate or Magnesium Sulfate

ASTM C 142	Standard Test Method for Clay Lumps and Friable Particles in Aggregates
ASTM C 97	Standard Test Method for Absorption and Bulk Specific Gravity of Dimension Stone
ASTM C 127	Test Method for Specific Gravity and Absorption of Coarse Aggregate
ASTM C 535	Standard Test Method for Resistance to Degradation of Large-Size Aggregate by Abrasion and Impact in the Los Angeles Machine
ASTM C 88	Standard Test Method for Soundness of Aggregates by Use of Sodium Sulfate or Magnesium Sulfate
ASTM C 131	Test Method for Resistance to Degradation of Small-size Coarse Aggregate by Abrasion and Impact in the Los Angeles Machine
ASTM C 94	Standard Specification for Ready-Mixed Concrete
ASTM D 512	Chloride Ion in Water
ASTM D 516	Sulfate Ion in Water
ASTM A 615	Standard Specification for Deformed and Plain Carbon-Steel Bars for Concrete Reinforcement
ASTM A 370	Standard Test Methods and Definitions for Mechanical Testing of Steel Products
ASTM A 510	Standard Specification for General Requirements for Wire Rods and Coarse Round Wire, Carbon Steel
ASTM A 6	Standard Specification for General Requirements for Rolled Structural Steel Bars, Plates, Shapes, and Sheet Piling
ASTM C 31	Standard Practice for Making and Curing Concrete Test Specimens in the Field
ASTM C 39	Standard Test Method for Compressive Strength of Cylindrical Concrete Specimens
ASTM C 172	Standard Practice for Sampling Freshly Mixed Concrete
ASTM C 192	Standard Practice for Making and Curing Concrete Test Specimens in the Laboratory
ASTM C 293	Standard Test Method for Flexural Strength of Concrete (Using Simple Beam with Center-Point Loading)
ASTM C 78	Standard Test Method for Flexural Strength of Concrete (Using Simple Beam with Third-Point Loading)
ASTM C 42	Standard Test Method for Obtaining and Testing Drilled Cores and Sawed Beams of Concrete

ASTM C 174 Standard Test Method for Measuring Thickness of Concrete Elements Using Drilled Concrete Cores

ASTM C 143 Standard Test Method for Slump of Hydraulic-Cement Concrete

ASTM C 494 Standard Specification for Chemical Admixtures for Concrete

ASTM C 1017 Standard Specification for Chemical Admixtures for use in Producing Flowing Concrete

ASTM C 171 Standard Specification for Sheet Materials for Curing Concrete

ASTM C 309 Standard Specification for Liquid Membrane-Forming Compounds for Curing Concrete

ASTM 5329 Standard Test Methods for Sealants and Fillers, Hot Applied, For Joints and Cracks in Asphaltic and Portland Cement Concrete Pavements

ASTM D 5167 Standard Practice for Melting of Hot Applied Joint and Crack Sealant and Filler for Evaluation

ASTM A 706 Standard Specification for Low-Alloy Steel Deformed and Plain Bars for Concrete Reinforcement

ASTM A 966 Standard Test Method for Magnetic Particle Examination of Steel Forgings using Alternating Current

ASTM C 1064 Standard Test Method for Temperature of Freshly Mixed Hydraulic-Cement Concrete

ASTM C 1077 Standard Practice for Laboratories Testing Concrete and Concrete Aggregates for use in Construction and Criteria for Laboratory Evaluation

ASTM C 1107 Standard Specification for Packaged Dry, Hydraulic-Cement Grout (Non-shrink)

ASTM C 1116 Standard Specification for Fiber-Reinforced Concrete

ASTM C 1157 Standard Specification for Hydraulic Cement

ASTM C 138 Standard Test Method for Density ("Unit Weight"), Yield, and Air Content (Gravimetric) of Concrete

ASTM C 173 Standard Test Method for Air Content of Freshly Mixed Concrete by the Volumetric Method

ASTM C 260 Standard Specification for Air-Entraining Admixtures for Concrete

ASTM C 295 Petrographic Examination of Aggregates for Concrete

ASTM C 33 Standard Specification for Concrete Aggregates

ASTM C 42 Standard Test Method for Obtaining and Test Drilled cores and Sawed Beams of Concrete

ASTM C 469 Static Modulus of Elasticity and Poisson's Ratio of Concrete in Compression

ASTM C 595 Standard Specification for Blended Hydraulic Cements

ASTM C1116 Standard Specification for Fiber-Reinforced Concrete and Shotcrete

ASTM C 1751 Preformed Expansion Joint Fillers for Concrete Paving and Structural Construction.(Non-extruding and Resilient Bituminous Types).

ASTM D 1179 Fluoride Ion in Water

ASTM D 1190 Standard Specification for Concrete Joint Sealer, Hot-Applied Elastic Type

ASTM D 1751 Standard Specification for Preformed Expansion Joint Filler for Concrete Paving and Structural Construction (Non-extruding and Resilient Bituminous Types)

ASTM E 329 Standard Specification for Agencies Engaged in the Testing and/ or Inspection of Materials used in Construction

c. American Welding Society (AWS)

D 12 Welding Reinforcing Steel, Metal Inserts and Connections in Reinforced Concrete Construction.

d. Philippine National Standard (PNS)

PNS 49 Steel Bars for Concrete Reinforcement

e. DPWH Standard Specifications

e. All other standards hereinafter indicated.

f. The edition or the revised version of such codes and standards current at the date twenty eight (28) days prior to date of bid submission shall apply. During Contract execution, any changes in such codes and standards shall be applied after approval by the Owner.

SUBMITTALS

1. Test Reports and Certificates shall be furnished and approval received before delivery of certified or tested materials to the Project Sites.

a. Submit Test Reports for the following:

a.1 Concrete mixture proportions

Submit copies of test reports by independent test labs conforming to ASTM C 1077 showing that the mixture has been successfully tested to produce concrete with the properties specified and that mixture will be

suitable for the job conditions. Test reports shall be submitted along with the concrete mixture proportions. Obtain approval before concrete placement. Fully describe the processes and methodology whereby mixture proportions were developed and tested and how proportions will be adjusted during progress of the work to achieve, as closely as possible, the designated levels of relevant properties.

a.2 Aggregates

Submit test results for aggregate quality in accordance with ASTM C 33. Where there is potential for alkali-silica reaction, provide results of tests conducted in accordance with ASTM C 227 or ASTM C 1260. Submit results of all tests during progress of the work in tabular and graphical form as noted above, describing the cumulative combined aggregate grading and the percent of the combined aggregate retained on each sieve.

a.3 Admixtures

Submit test results in accordance with ASTM C 494 and ASTM C 1017 for concrete admixtures, ASTM C 260 for air-entraining agent, and manufacturer's literature and test reports for corrosion inhibitor and anti-washout admixture. Submitted data shall be based upon tests performed within 6 months of submittal.

a.4 Cement

Submit test results in accordance with ASTM C 150 Portland cement. Submit current mil data.

a.5 Water

Submit test results in accordance with ASTM D 512 and ASTM D 516.

b. Submit Certificates for the following:

b.1 Curing concrete elements

Submit proposed materials and methods for curing concrete elements.

b.2 Form removal schedule

Submit proposed materials and methods for curing concrete elements.

b.3 Concrete placement and compaction

Submit technical literature for equipment and methods proposed for use in placing concrete. Include pumping or conveying equipment including type, size and material for pipe, valve characteristics, and the maximum length and height concrete will be pumped. No adjustments shall be made to the mixture design to facilitate pumping.

Submit technical literature for equipment and methods proposed for vibrating and compacting concrete. Submittal shall include technical literature describing the equipment including vibrator diameter, length, frequency, amplitude, centrifugal force, and manufacturer's description of the radius of influence under load. Where flat work is to be cast, provide similar information relative to the proposed compacting screed or other method to ensure dense placement.

b.4 Mixture designs

Provide a detailed report of materials and methods used, test results, and the field test strength (fcr) for marine concrete required to meet durability requirements.

2. The Contractor shall submit shop drawings and erection drawings for formwork and scaffolding at least 14 days prior to commencing the work.

Each shop drawing and erection drawing shall bear the signature of a Contractor's qualified Engineer. Details of all proposed formwork to be prefabricated and formwork to produce special finishes shall be submitted to the Engineer for approval before any materials are ordered. If the Engineer so requires, samples of proposed formworks shall be constructed and concrete placed at the Contractor's expense so that the proposed methods and finished effect can be demonstrated.

The Contractor shall submit shop drawings showing reinforcing bar placing and bar lists for the Engineer's approval. Such shop drawings shall show also supplemental bars for forming, strengthening frames of bars of sufficient rigidity to withstand forces during placing concrete. If necessary, shaped steel may be added to improve rigidity of the frame of bar.

Such shop drawings shall clearly indicate bar sizes, spacing, location and quantities of reinforcement, mesh, chairs, spacers and other details to be as per ACI Manual of Standard Practice for Detailing Reinforced Concrete Structures.

Details shall be prepared for placement of reinforcement where special conditions occur, including most congested areas and connection between pre-cast concrete and concrete in-situ.

All shop drawings shall be reviewed by the Engineer within seven (7) days after receiving them. At least two (2) days prior to pouring concrete, the Contractor shall submit to the Engineer a pouring permit for his inspection and approval.

MATERIAL REQUIREMENTS

CEMENT

Unless otherwise specified in the Drawings, only one (1) brand of cement shall be used for any individual structure. In determining the approved mix, only Portland cement shall be used as the cementitious material.

1. Portland Cement: ASTM C 150

Type I (for general use in construction)

ADMIXTURE (IF NECESSARY)

Unless otherwise required by field conditions, admixture may be used subject to the expressed approval of the Engineer. The cost of which shall already be included in the unit cost bid of the Contractor for the concrete.

1. Air Entraining Admixture shall conform to ASTM C 260.
2. Admixture other than air entraining agent shall conform to ASTM C 494.
3. Admixture containing chloride ions, or other ions producing deleterious effect shall not be used.

AGGREGATES

1. Crushed Coarse Aggregate

Conforming to ASTM C 33 and having nominal sizes passing 38.0 mm to 19.0 mm, 19.0 mm to 9.5 mm to No. 4 sieve. The material shall be well graded between the limits indicated and individually stockpiled. It shall be the Contractor's responsibility to blend the materials to meet the gradation requirements for various types of concrete as specified herein.

Nominal sizes for combined gradation shall be as follows:

ASTM Sieves	Nominal Size of Coarse Aggregates			
	% by Weight Passing			
	40mm	25mm	19mm	10mm
50.0mm (2")	100	-	-	-
38.0mm (1 1/2")	95 - 100	100	-	-
31.8mm (1 1/4")	-	90 - 100	100	-
25.0mm (1")	-	-	90 - 100	-
19.0mm (3/4")	35 - 70	25 - 90	-	100
16.0mm (5/8")	-	-	20 - 55	85 - 100
9.5mm (3/8")	10 - 30	0 - 10	0 - 10	0 - 20
No. 4	0 - 5			

2. Fine Aggregate

ASTM C 33 except for gradation which has been revised to meet local conditions unless otherwise required by the Engineer, grading of find aggregate shall be as follows:

ASTM Sieves	% by Weight Passing
9.5mm (3/8")	100
No.4	90 - 100
No. 8	80 - 100
No. 16	50 - 90
No. 30	25 - 60
No. 50	5 - 30
No. 100	0 - 10

a. Grading of fine aggregates shall be reasonably uniform and fineness modulus thereof shall not vary more than 0.2 from that of the representative sample in which mix proportions of concrete are based.

b. Due care shall be taken to prevent segregation.

WATER

The mixing water shall be clear and apparently clean. If it contains quantities or substances that discolor it or make it smell or taste unusual or objectionable, or cause suspicion, it shall not be used unless service records of concrete made with it (or other information) indicated that it is not injurious to the quality, shall be subject to the acceptance criteria as shown in Table 6.3 and Table 6.4 or as designated by the purchaser.

When wash water is permitted, the producer will provide satisfactory proof or data of non-detrimental effects if potentially reactive aggregates are to be used. Use of wash water will be discontinued if undesirable reactions with admixtures or aggregates occur.

Table 6.3 Acceptance Criteria for Questionable Water Supplies

Test	Limits
Compressive strength, min. % Control at 7 days	90
Time of Setting deviation from control	from 1:00 earlier to 1:30 later
Time of Setting (Gillmore Test) Initial Final Set	 No marked change No marked change
Appearance	Clear

Color	Colorless
Odor	Odorless
Total Solids	500 parts/million max.
PH value	4.5 to 8.5

Table 6.4 Chemical Limitation for Wash Water

	Limits
Chemical Requirements, Minimum Concentration Chloride as $C1^{(-1)}$ expressed as a mass percent of cement when added to the $C1^{(-1)}$ in the other components of the concrete mixtures shall not exceed the following levels:	
1. Prestressed Concrete	0.06 percent
2. Conventionally reinforced concrete in a moist environment and exposed to chloride	0.10 percent
3. Conventionally reinforced concrete in a moist environment but not exposed to chloride	0.15 percent
4. Above ground building construction where the concrete will stay dry	No limit for corrosion
Sulfate as SO_4, ppm[A]	3,000
Alkalies as (Na_2O + 0.658 K_2O), ppm	600
Total Solids, ppm	50,000

Wash water reused as mixing water in concrete may exceed the listed concentrations of sulfate if it can be shown that the concentration calculated in the total mixing water, including mixing water on the aggregate and other sources, does not exceed that stated limits.

Water will be tested in accordance with, and shall meet the suggested requirements of AASHTO T 26.

Water known to be of potable quality may be used without test.

CURING MATERIALS

1. Impervious Sheet Materials

   ASTM C 171 type, optional, except that polyethylene film, if used, shall be white opaque.

2. Burlap of commercial quality, non-staining type, consisting of 2 layers minimum.

3. Membrane Forming Curing Compound

   ASTM C 309; submit evidence that product conforms to specifications.

JOINTING MATERIALS

1. Sealant

   Sealant shall be multi-component, polyurethane base compound, gray in color, self-leveling for horizontal joints, 2 part polythremdyne, terpolymer compound, gray in color; non-sag for vertical joints.

   Sealant shall be compatible with materials in contact and to perform satisfactorily under salt water and traffic conditions, and be capable of making joint watertight and allow movement 25% of the width of joint in any direction.

   Sealant shall be guaranteed against leakage, cracking, crumbling, melting, shrinkage, running, loss of adhesion for a period of five years from the date of acceptance of work.

2. Joint backing shall be expanded extruded polyethylene, low density, oval in shape to fit the joints as indicated on the drawings and to be compatible with sealant.

3. Where required, primer shall be compatible with joint materials and installed in accordance with manufacturer's instructions.

4. Joint filler shall conform to ASTM D1751 (AASHTO M213) non-extruding, resilient bituminous type. Filler shall be furnished for each joint in single piece for depth and width required for joint, unless otherwise authorized by the Engineer. When more than one piece is authorized for a joint, abutting ends shall be fastened and hold securely to shape by stapling or other positive fastening.

EPOXY BONDING COMPOUND

ASTM C 881. Provide Type I for bonding hardened concrete to hardened concrete; Type II for bonding freshly mixed concrete to hardened concrete; and Type III as a binder in epoxy mortar or concrete, or for use in bonding skid-resistant materials to hardened concrete. Provide Class B if placement temperature is between 4 and 16°C; or Class C if placement temperature is above 16°C.

REINFORCEMENT

Steel reinforcement, other than Steel for Pre-stressing, used in Reinforced Concrete, shall conform to ASTM and PNS as follows:

ASTM Designation A615 - Deformed Billet Steel Bars for Concrete Reinforcement. Minimum yield strength of 276 MPa (40,000 psi).

PNS 49 - Steel Bars for Concrete Reinforcement

TIE WIRE

Tie wire shall be plain, cold drawn annealed steel wire 1.6 mm diameter.

SAMPLES AND TESTING

1. Cement

Sampled either at the mill or at the site of work and tested by an independent commercial or government testing laboratory duly accredited by the Bureau of Research and Standards (BRS) of the DPWH, Department of Science and Technology (DOST) or the Department of Trade and Industry (DTI) at no additional cost to PPA. Certified copies of laboratory test reports shall be furnished for each lot of cement and shall include all test data, results, and certificates that the sampling and testing procedures are in conformance with the Specifications. No cement shall be used until notice has been given by the Engineer that the test results are satisfactory. Cement that has been stored, other than in bins at the mills, for more than 3 months after delivery to the Site shall be re-tested before use. Cement delivered at the Site and later found after test to be unsuitable shall not be incorporated into the permanent works.

2. Aggregates: Tested as prescribed in ASTM C 33

At least 28 days prior to commencing the work, the Contractor shall inform the Engineer of the proposed source of aggregates and provide access for sampling.

Gradation tests will be made on each sample without delay. All other aggregates tests required by these Specifications shall be made on the initial source samples, and shall be repeated whenever there is a change of source. The tests shall include an analysis of each grade of material and an analysis of the combined material representing the aggregate part of the mix.

3. Reinforcement

Certified copies of mill certificates shall accompany deliveries of steel bar reinforcement. If requested by the Engineer additional testing of the materials shall be made at the Contractor's expense.

4. Concrete Tests

For test purposes, provide 1 set of three (3) concrete cylinder samples taken from each day's pouring and to represent not more than 75 cu.m. of concrete class or fraction thereof of concrete placed. Samples shall be secured in conformance with ASTM C 172. Tests specimens shall be made, cured, and packed for shipment in accordance with ASTM C 31. Cylinders will be tested by and at the expense of the Contractor in accordance with ASTM C 39. Test specimens will be evaluated separately by the Engineer, for meeting strength level requirements for each with concrete quality of ACI 318. When samples fail to conform to the requirements for strengths, the Engineer shall have the right to order a change in the proportions of the concrete mix for the remaining portions of the work at no additional cost to the Authority.

5. Test of Hardened Concrete in or Removed from the Structure

When the results of the strength tests of the concrete specimens indicates the concrete as placed does not meet the Specification requirements or where there are other evidences that the quality of concrete is below the specification requirement in the opinion of the Engineer, tests on cores of in-place concrete shall be made in conformance with ASTM C 42.

Core specimens shall be obtained by the Contractor and shall be tested. Any deficiency shall be corrected or if the Contractor elects, he may submit a proposal for approval before the load test is made. If the proposal is approved, the load test shall be made by the Contractor and the test results evaluated by the Engineer in conformance with Chapter 20 of ACI 318. The cost of the load tests shall be borne by the Contractor. If any concrete shows

evidence of failure during the load test, or fails the load test as evaluated, the deficiency be corrected in a manner approved by the Engineer at no additional cost to the Authority.

6. Chemical Admixtures/Additives

The admixtures/additives if approved shall conformed to ASTM C 494 and ASTM C 1017. The testing shall be conducted with cement and aggregate proposed for the Project. The admixtures/additives shall be tested and those that have been in storage at the Project Site for longer than six (6) months shall not be used until proven by retest to be satisfactory.

Samples of any admixtures/additives proposed by the Contractor shall be submitted for testing at least 56 days in advance of use, which shall require approval of the Engineer. Testing of admixtures/additives proposed by the Contractor including test mixing and cylinder test shall be at the Contractor's expense.

7. Jointing Materials and Curing Compound Samples

At least 28 days prior to commencing the work, the Contractor shall submit to the Engineer for his approval samples of the following materials proposed for use together with manufacturer's certificate.

a. 10 kg of joint sealant
b. 1m length of joint filler
c. 5 li. of curing compound
d. 1m length of joint backing

The Engineer shall deliver to the Contractor his assessment on the materials within seven (7) days after receiving them.

EXECUTION

DELIVERY, STORAGE AND HANDLING OF MATERIALS

1. Cement

Do not deliver concrete until vapor barrier, forms, reinforcement, embedded items, and chamfer strips are in place and ready for concrete placement. ACI 301 and ASTM A 934 for job site storage of materials. Protect materials from contaminants such as grease, oil, and dirt. Ensure materials can be accurately identified after bundles are broken and tags removed.

Immediately upon receipt at the Site, the cement shall be stored separately in a dry weathertight, properly ventilated structures with adequate provisions for prevention of absorption of moisture. Storage accommodations for concrete materials shall be subject to approval and shall afford easy access for inspection and identification of each shipment in accordance with test reports.

Cement shall be delivered to the Site in bulk or in sound and properly sealed bags and while being loaded or unloaded and during transit to the concrete mixers whether conveyed in vehicles or in mechanical means, cement shall be protected from whether by effective coverings. Efficient screens shall be supplied and erected during heavy winds.

If the cement is delivered in bulk, the Contractor shall provide, at his own cost, approved silos of adequate size and numbers to store sufficient cement to ensure continuity of work and the cement shall be placed in these silos immediately after it has been delivered to the Site. Approved precautions shall be taken into consideration during unloading to ensure that the resulting dust does not constitute a nuisance.

If the cement is delivered in bags, the Contractor shall provide, at his own cost, perfectly waterproofed and well ventilated sheds having a floor of wood or concrete raised at least 0.5m above the ground. The sheds shall be large enough to store sufficient cement to ensure continuity of the work and each consignment shall be stacked separately therein to permit easy access for inspection, testing and approval. Upon delivery, the cement shall at once be placed in these sheds and shall be used in the order in which it has been delivered.

Cement bags should not be stacked more than 13 bags high. All cement shall be used within two months of the date of manufacture. If delivery conditions render this impossible, the Engineer may permit cement to be used up to three (3) month after manufacturing, subject to such conditions including addition of extra cement as he shall stipulate.

2. Aggregate

All fine and coarse aggregate for concrete shall be stored on close fitting, steel or concrete stages design with drainage slopes or in bins of substantial construction in such a manner as to prevent segregation of sizes and to avoid the inclusion of dirt and other foreign materials in the concrete. All such bins shall be emptied and cleaned at intervals of every six (6) months or as required by the Engineer. Each size of aggregate shall be stored separately unless otherwise approved by the Engineer.

Stockpiles of coarse aggregate shall be built in horizontal layers not exceeding 1.2 m in depth to minimize segregation.

FORMWORK

1. Forms

Designed, constructed, and maintained so as to insure that after removal of forms the finished concrete members will have true surfaces free of offset, waviness or bulges and will conform accurately to the indicated shapes, dimensions, lines, elevations and positions. Form surfaces that will be in contact with concrete shall be thoroughly cleaned before each use.

2. Design

Studs and wales shall be spaced to prevent deflection of form material. Forms and joints shall be sufficiently tight to prevent leakage of grout and cement paste during placing of concrete. Juncture of formwork panels shall occur at vertical control joints, and construction joints. Forms placed on successive units for continuous surfaces shall be fitted in accurate alignment to assure smooth completed surfaces free from irregularities and signs of discontinuity. Temporary opening shall be arranged to wall and where otherwise required to facilitate cleaning and inspection. Forms shall be readily removable without impact, shock, or damage to the concrete.

3. Form Ties

Factory fabricated, adjustable to permit tightening of the forms, removable or snap-off

metal of design that will not allow form deflection and will not spall concrete upon removal. Bolts and rods that are to be completely withdrawn shall be coated with a non-staining bond breaker. Ties shall be of the type which provide watertight concrete.

4. Chamfering

External corners that will be exposed shall be chamfered, beveled, or rounded by mouldings placed in the forms or as indicated in the drawings.

5. Coatings

Forms for exposed surfaces shall be coated with form oil or form-release agent before reinforcement is placed. The coating shall be a commercial formulation of satisfactory and proven performance that will not bond with, stain, or adversely affect concrete surfaces, and shall not impair subsequent treatment of concrete surfaces depending upon bond or adhesion nor impede the wetting of surfaces to be cured with water or curing compounds. The coating shall be used as recommended in the manufacturer's printed or written instructions. Forms for unexposed surfaces may be wet with water in lieu of coating immediately before placing of concrete. Surplus coating on form surfaces and coating on reinforcement steel and construction joints shall be removed before placing concrete.

6. Removal of Forms shall be done in a manner as to prevent injury to the concrete and to insure complete safety of the structure after the following conditions have been met. Where the structure as a whole is supported on shores, forms for beam and girder sides, and similar vertical structural members may be removed before expiration of curing period. Care shall be taken to avoid spalling the concrete surface or damaging concrete edges. Wood forms shall be completely removed.

Minimum stripping and striking time shall be as follows unless otherwise approved by the Engineer.

Vertical sides of beams, walls, and columns, lift not 12 hours exceeding 1.2 m

Vertical sides of beams and walls, lift exceeding 1.2 m 36 hours Softlifts of main slabs and beams (props left under) 5 days

Removal of props from beams and mains slabs and other work 10 days

7. Control Test

If the Contractor proposes to remove forms earlier than the period stated above, he shall be required to submit the results of control tests showing evidence that concrete has attained sufficient strength to permit removal of supporting forms. Cylinders required for control tests shall be provided in addition to those otherwise required by this Specification. Test specimens shall be removed from molds at the end of 24 hours and stored in the structure as near the points as practicable, the same protection from the elements during curing as is given to those portions of the structure which they represent, and shall not be removed from the structure for transmittal to the laboratory prior to expiration of three fourths of the proposed period before removal of forms. Cylinders will be tested by and at the expense of the Contractor. Supporting forms or shoring shall not be removed until control test specimens have attained strength of at least 160 kg/sq cm. The newly unsupported portions of the structure shall not be subjected to heavy construction or material loading.

REINFORCEMENT

1. Reinforcement

   Fabricated to shapes and dimensions shown and shall be placed where indicated. Reinforcement shall be free of loose or flaky rust and mill scale, or coating, and any other substance that would reduce or destroy the bond. Reinforcing steel reduced in section shall not be used. After any substantial delay in the work, previously placed reinforcing steel for future bonding shall be inspected and cleaned. Reinforcing steel shall not be bent or straightened in a manner injurious to the steel or concrete. Bars with kinks or bends not shown in the drawings shall not be placed. The use of heat to bend or straighten reinforcing steel shall not be permitted. Bars shall be moved as necessary to avoid interference with other reinforcing steel, conduits, or embedded items. If bars are moved more than one bar diameter, the resulting arrangement of bars including additional bars necessary to meet structural requirements shall be approved before concrete is placed. In slabs, beams and girders, reinforcing steel shall not be spliced at points of maximum stress unless otherwise indicated. Unless otherwise shown in the drawings, laps or splices shall be 40 times the reinforcing bar diameter.

2. The nominal dimensions and unit weights of bars shall be in accordance with the following table:

Nominal Diameter (mm)	Nominal Perimeter (mm)	Nominal Sectional Area (sq. mm)	Unit Weight (kg/m)
10	31.4	78.54	0.616
12	37.7	113.10	0.888
16	50.3	201.10	1.579
20	62.8	314.20	2.466
25	78.5	490.90	3.854
28	88.0	615.70	4.833
32	100.5	804.20	6.313
36	113.1	1,017.60	7.991
40	125.7	1,256.60	9.864
50	157.1	1,963.50	15.413

3. Welding of reinforcing bars shall only be permitted where shown; all welding shown shall be performed in accordance with AWS D 12.1.

4. Exposed reinforcement bars, dowels and plates intended for bonding with future extensions shall be protected from corrosion.

5. Supports shall be provided in conformance with ACI 315 and ACI 318, unless otherwise indicated or specified.

6. Concrete Protection for Reinforcement

a. The minimum concrete cover of reinforcement shall be as shown below unless otherwise indicated in the drawings.

b. Tolerance for Concrete Cover of Reinforcing Steel other than Tendons.

Minimum Cover

7.5cm or more (marine structures and concrete cast against and permanently exposed to earth)

DESIGN STRENGTH OF CONCRETE

Concrete for structural parts or members such as beams, slabs, curtain wall, pile caps and fender/mooring blocks shall develop a minimum 28-day compressive cylinder strength of 24 MPa (3,500 psi) as indicated in the drawings. While for pre-stressed concrete piles a compressive strength of 35 MPa (5,000psi).

TRIAL BATCH FOR CONCRETE

Thirty (30) calendar days before the start of concreting works, the Contractor shall submit design mixes and the corresponding test result made on sample thereof. Sampling and testing shall be in accordance with the ASTM Standard procedures for sampling and testing for the particular design strength(s) required.

The particulars of the mix such as the slump and the proportionate weights of cement, saturated surface dry aggregates and water used shall be stated.

The design mix for concrete to be used shall be submitted together with at least three (3) standard cylinder samples for approval at least one (1) month prior to the start of each concreting schedule. Such samples shall be prepared in the presence of the Engineer.

Standard laboratory strength tests for the 7, 14 and 28 days periods shall be taken to all concrete samples in addition to routine field tests, at cost to the Contractor. Only design mixes represented by test proving the required strength for 7, 14 and 28 days tests shall be allowed.

The cost of sampling, handling and transporting samples from jobsite to the laboratory and the cost of subsequent tests made until the desired mix is attained shall be for the account of the Contractor.

Slump Test shall be made in conformance with ASTM C143, and unless otherwise specified by the Engineer, slump shall be within the following limits:

Structural Element	Slump for Vibrated Concrete	
	Minimum	Maximum
Pavement Concrete	25mm	50mm

Pre-cast Concrete	50mm	70mm
Lean Concrete	100mm	200mm
Sacked Concrete	25mm	50mm
All other Concrete	50mm	90mm

Sampling : Provide suitable facilities and labor for obtaining representative samples of concrete for the Contractor's quality control and the Engineer's quality assurance testing. All necessary platforms, tools and equipment for obtaining samples shall be furnished by the Contractor.

MIXING CONCRETE

1. GENERAL

a. Concrete shall be thoroughly mixed in a mixer of an approved size and type that will insure a uniform distribution of the materials throughout the mass.

b. All concrete shall be mixed in mechanically operated mixers. Mixing plant and equipment for transporting and placing concrete shall be arranged with an ample auxiliary installation to provide a minimum supply of concrete in case of breakdown of machinery or in case the normal supply of concrete is disrupted. The auxiliary supply of concrete shall be sufficient to complete the casting of a section up to a construction joint that will meet the approval of the Engineer.

c. Equipment having components made of aluminum or magnesium alloys, which would be in contact with plastic concrete during mixing, transporting or pumping of Portland cement concrete, shall not be used.

d. Concrete mixers shall be equipped with adequate water storage and a device for accurately measuring and automatically controlling the amount of water used.

e. Materials shall be measured by weighing. The apparatus provided for weighing the aggregates and cement shall be suitably designed and constructed for this purpose. The accuracy of all weighing devices except that for water shall be such that successive quantities can be measured to within one percent of the desired amounts. The water measuring device shall be accurate to plus or minus 0.5 percent. All measuring devices shall be subject to the approval of the Engineer. Scales and measuring devices shall be tested at the expense of the Contractor as frequently as the Engineer may deem necessary to insure their accuracy.

f. Weighing equipment shall be insulated against vibration or movement of other operating equipment in the plant. When the entire plant is running, the scale reading at cut-off shall not vary from the weight designated by the Engineer by more than one percent for cement, 1-½ percent for any size of aggregate, or one percent for the total aggregate in any batch.

g. Manual mixing of concrete shall not be permitted unless approved by the Engineer.

2. MIXING CONCRETE AT SITE

a. Concrete mixers may be of the revolving drum or the revolving blade type and

the mixing drum or blades shall be operated uniformly at the mixing speed recommended by the manufacturer.

The pick-up and throw-over blades of mixers shall be restored or replaced when any part or section is worn 20 mm or more below the original height of the manufacturer's design. Mixers and agitators which have an accumulation of hard concrete or mortar shall not be used.

b. When bulk cement is used and the volume of the batch is 0.5 m^3 or more, the scale and weigh hopper for Portland cement shall be separate and distinct from the aggregate hopper or hoppers.

The discharge mechanism of the bulk cement weigh hopper shall be interlocked against opening before the full amount of cement is in the hopper. The discharging mechanism shall be interlocked against opening when the amount of cement in the hopper is underweight by more than one percent or overweight by more than 3 percent of the amount specified.

c. When the aggregates contain more water than the quantity necessary to produce a saturated surface dry condition, representative samples shall be taken and the moisture content determined for each kind of aggregate.

d. The batch shall be so charged into the mixer that some water enter in advance of cement and aggregates. All water shall be in the drum by the end of the first quarter of the specified mixing time.

e. Cement shall be batched and charged into the mixer by such means that it will not result in loss of cement due to the effect of wind, or in accumulation of cement on surfaces of conveyors or hoppers, or in other conditions which reduce or vary the required quantity of cement in the concrete mixture.

f. Where required, synthetic fibrous reinforcement shall be added directly to the concrete mixer after placing the sufficient amount of mixing water, cement and aggregates.

g. The entire contents of a batch mixer shall be removed from the drum before materials for a succeeding batch are place therein. The materials composing a batch except water shall be deposited simultaneously into the mixer.

h. All concrete shall be mixed for a period of not less that 3 minutes after all materials, including water, are in the mixer. During the period of mixing, the mixer shall operate at the speed for which it has been designed.

i. Mixers shall be operated with an automatic timing device that can be locked by the Engineer. The time device and discharge mechanism shall be so interlocked that during normal operation no part of the batch will be discharged until the specified mixing time has elapsed.

j. The first batch of concrete materials placed in the mixer shall contain a sufficient excess of cement, sand, and water to coat the inside of the drum without reducing the required mortar content of the mix. When mixing is to cease for a period of one hour or more, the mixer shall be thoroughly cleaned.

k. In case of rubble concrete, proper mixture and placing of concrete and stones/rocks

shall be in accordance to the approved plan. Methodology of work shall be approved by the Engineer.

3. MIXING CONCRETE IN TRUCKS

a. Truck mixers, unless otherwise authorized by the Engineer, shall be of the revolving drum type, watertight, and so constructed that the concrete can be mixed to insure a uniform distribution of materials throughout the mass. All solid materials for the concrete shall be accurately measured and charged into the drum at the proportioning plant. Except as subsequently provided, the truck mixer shall be equipped with a device by which the quantity of water added can be readily verified. The mixing water may be added directly to the batch, in which case a tank is not required. Truck mixers may be required to be provided with a means by which the mixing time can be readily verified by the Engineer.

b. The maximum size of batch in truck mixers shall not exceed the minimum rated capacity of the mixer as stated by the manufacture and stamped in metal on the mixer. Truck mixing shall, unless otherwise directed, be continued for not less than 100 revolutions after all ingredients, including water, are in the drum. The mixing speed shall not be less than 4 rpm, nor more than 6 rpm.

c. Mixing shall begin within 30 minutes after the cement has been added either to the water or aggregate, but when cement is charged into a mixer drum containing water or surface-wet aggregate and when the temperature is above 32 °C, this limit shall be reduced to 15 minutes. The limitation in time between the introduction of the cement to the aggregate and the beginning of the mixing may be waived when, in the judgment of the Engineer, the aggregate is sufficiently free from moisture, so that there will be no harmful effects on the cement.

d. When a truck mixer is used for transportation, the mixing time in stationary mixer may be reduced to 30 seconds and the mixing completed in a truck mixer. The mixing time in truck mixer shall be as specified for truck mixing.

JOINTS

1. No reinforcement, corner protection angles or other fixed metal items shall be run continuously through joints containing expansion-joint filler, through crack-control joints in slabs on grade and vertical surfaces.

2. Preformed Expansion Joint Filler

a. Joints with Joint Sealant

At expansion joints in concrete slabs to be exposed, and at other joints indicated to receive joint sealant, preformed expansion-joint filler strips shall be installed at the proper level below the elevation with a slightly tapered, dressed-and-oiled wood strip temporarily secured to the top thereof to form a groove. When surface dry, the groove shall be cleaned of foreign matter, loose particles, and concrete protrusions, then filled flush approximately with joint sealant so as to be slightly concave after drying.

b. Finish of concrete at joints

Edges of exposed concrete slabs along expansion joints shall be neatly finished with a slightly rounded edging tool.

c. Construction Joints

Unless otherwise specified herein, all construction joints shall be subject to approval of the Engineer. Concrete shall be placed continuously so that the unit will be monolithic in construction. Fresh concrete may be placed against adjoining units, provided the set concrete is sufficiently hard not to be injured thereby. Joints not indicated shall be made and located in a manner not to impair strength and appearance of the structure. Placement of concrete shall be at such rate that the surface of concrete not carried to joint levels will not have attained initial set before additional concrete is placed thereon. Lifts shall terminate at such levels as are indicated or as to conform to structural requirements as directed. If horizontal construction joints are required, a strip of 25mm square-edged lumber, beveled to facilitate removal shall be tacked to the inside of the forms at the construction joint. Concrete shall be placed to a point 25mm above the underside of the strip. The strip shall be removed one hour after the concrete has been placed. Any irregularities in the joint line shall be leveled off with a wood float, and all laitance removed. Prior to placing additional concrete, horizontal construction joints shall be prepared.

Construction Joint which is not indicated in the Drawings shall be located as to least affect the strength of the structure. Such locations will be pointed out by the Engineer.

PREPARATION FOR PLACING

Hardened concrete, debris and foreign materials shall be removed from the interior of forms and from inner surfaces of mixing and conveying equipment. Reinforcement shall be secured in position, and shall be inspected, and approved before placing concrete. Runways shall be provided for wheeled concrete-handling equipment. Such equipment shall not be wheeled over reinforcement nor shall runways be supported on reinforcement.

Notice of any concreting operations shall be served to the Engineer at least three (3) days ahead of each schedule.

PLACING CONCRETE

1. Handling Concrete

Concrete shall be handled from mixers and transported to place for final deposit in a continuous manner, as rapidly as practicable, and without segregation or loss of ingredients until the approved unit of work is completed. Placing will not be permitted when the sun, heat, wind or limitations of facilities furnished by the Contractor prevent proper finishing and curing of the concrete. Concrete shall be placed in the forms, as close as possible in final position, in uniform approximately horizontal layers not over 40cm deep. Forms splashed with concrete and reinforcement splashed with concrete or form coating shall be cleaned in advance of placing subsequent lifts. Concrete shall not be allowed to drop freely more than 1.5m in unexposed work nor more than 1.0 m in exposed work; where greater drops are required, tremie or other approved means shall be employed.

2. Time Interval between Mixing and Placing

Concrete mixed in stationary mixers and transported by non-agitating equipment shall be

placed in the forms within 30 minutes from the time ingredients are charged into the mixing drum. Concrete transported in truck mixers or truck agitators shall be delivered to the site of work, discharged in the forms within 45 minutes from the time ingredients are discharged into the mixing drum. Concrete shall be placed in the forms within 15 minutes after discharged from the mixer at the jobsite.

3. Hot Weather Requirements

The temperature of concrete during the period of mixing while in transport and/or during placing shall not be permitted to rise above 36 °C. Any batch of concrete which had reached a temperature greater than 36 °C at any time in the aforesaid period shall not be placed but shall be rejected, and shall not thereafter be used in any part of the permanent works.

a. Control Procedures

Provide water cooler facilities and procedures to control or reduce the temperature of cement, aggregates and mixing handling equipment to such temperature that, at all times during mixing, transporting, handling and placing, the temperature of the concrete shall not be greater than 36 °C.

b. Cold Joints and Shrinkage

Where cold joints tend to form or where surfaces set and dry too rapidly or plastic shrinkage cracks tend to appear, concrete shall be kept moist by fog sprays, or other approved means, applied shortly after placement, and before finishing.

c. Supplementary Precautions

When the aforementioned precautions are not sufficient to satisfy the requirements herein above, they shall be supplemented by restricting work during evening or night. Procedure shall conform to American Concrete Institute Standard ACI 305.

4. Conveying Concrete by Chute, Conveyor or Pump

Concrete may be conveyed by chute, conveyor, or pump if approved in writing. In requesting approval, the Contractor shall submit his entire plan of operation from the time of discharge of concrete from the mixer to final placement in the forms, and the steps to be taken to prevent the formation of cold joints in case the transporting of concrete by chute, conveyor or pump is disrupted. Conveyors and pumps shall be capable of expeditiously placing concrete at the rate most advantageous to good workmanship. Approval will not be given for chutes or conveyors requiring changes in the concrete materials or design mix for efficient operation.

a. Chutes and Conveyors

Chutes shall be of steel or steel lined wood, rounded in cross section rigid in construction, and protected from overflow. Conveyors shall be designed and operated and chute sections shall be set, to assure a uniform flow of concrete from mixer to final place of deposit without segregation of ingredients, loss of mortar, or change in slump. The discharged portion of each chute or conveyor shall be provided with a device to prevent segregation. The chute and conveyor shall be thoroughly cleaned before and after each run. Waste material and flushing water shall be discharged outside the forms.

b. Pumps shall be operated and maintained so that a continuous stream of concrete is delivered into the forms without air pockets, segregation or changes in slump. When pumping is completed, concrete remaining in the pipeline shall be ejected and wasted without contamination of concrete already placed. After each operation, equipment shall be thoroughly cleaned and the flushing water shall be splashed outside the forms.

5. Wall and Abutments

No load shall be placed upon finished walls, foundations or abutments until authorized by the Engineer. Minimum time before loading shall be 7 days.

6. Concrete Placing on Wharf

When placing concrete on wharf decks, the Contractor shall:

Ensure that rate of placing is sufficient to complete proposed placing, finishing and curing operations within the scheduled time; that experienced finishing machine operators and concrete finishers are provided to finish the deck; that curing equipment and finishing tools and equipment are at the site of work and in satisfactory condition for use.
Immediately prior to placing, the Contractor shall place scaffolding and wedges and make necessary adjustments. Care shall be taken to ensure that settlement and deflection due to added weight of concrete will be minimal. The Contractor shall provide suitable means to readily permit measurement of settlement deflection as it occurs.

Should any event occur which, in opinion of the Engineer, would prevent the concrete conforming to specified requirements, the Contractor shall discontinue placing of concrete until corrective measures are provided satisfactory to the Engineer. If satisfactory measures are not provided prior to initial set of concrete in affected areas, the Contractor shall discontinue placing concrete and install a bulkhead at a location determined by the Engineer. Concrete in place beyond bulkheads shall be removed. The Contractor shall limit the size of casting to that which can be finished before beginning of initial set.

COMPACTION

1. Immediately after placing, each layer of concrete shall be completed by internal concrete vibrators supplemented by hand-spading, rodding, and tamping. Tapping or other external vibration of forms will not be permitted unless specifically approved by the Engineer. Vibrators shall not be used to transport concrete inside the forms. Internal vibrators submerged in concrete shall maintain a speed of not less than 7,000 impulses per minute. The vibrating equipment shall at all times be adequate in number of units and power to properly consolidate all concrete.

2. Spare units shall be on hand as necessary to insure such adequacy. The duration of vibrating equipment shall be limited to the time necessary to produce satisfactory consolidation without causing objectionable segregation. The vibrator shall not be inserted into the lower courses that have begun to set. Vibrator shall be applied vertically at uniformly spaced points not further apart than the visible effectiveness of the machine.

EPOXY BONDING COMPOUND

Before depositing new concrete on or against concrete that has set, the surfaces of the set concrete shall be thoroughly cleaned so as to expose the coarse aggregate and be free of laitance, coatings, foreign matter and loose particles. Forms shall be re-tightened. The cleaned surfaces shall be moistened, but shall be without free water when concrete is placed. ASTM C 881. Provide Type I for bonding hardened concrete to hardened concrete; Type II for bonding freshly mixed concrete to hardened concrete; and Type III as a binder in epoxy mortar or concrete, or for use in bonding skid-resistant materials to hardened concrete. Provide Class B if placement temperature is between 4 to 16 °C; or Class C if placement temperature is above 16°C.

FINISHES OF CONCRETE

Within 12 hours after the forms are removed, surface defects shall be remedied as specified herein. The Temperature of the concrete, ambient air and mortar during remedial work including curing shall be above 10 °C. Fine and loose material shall be removed. Honeycomb, aggregate pockets, voids over 13mm in diameter, and holes left by the rods or bolts shall be cut out to solid concrete, reamed, thoroughly wetted, brush-coated with neat cement grout, and filled with mortar. Mortar shall be a stiff mix of one part Portland cement to not more than 2 parts fine aggregate passing the No. 16 mesh sieve, with a minimum amount of water. The color of the mortar shall match the adjoining concrete color. Mortar shall be thoroughly compacted in place. Holes passing entirely through walls shall be completely filled from the inside face by forcing mortar through the outside face. Holes which do not pass entirely through wall shall be packed full. Patchwork shall be finished flush and in the same plane as adjacent surfaces. Exposed patchwork shall be finished to match adjoining surfaces in texture and color. Patchwork shall be damp-cured for 72 hours. Dusting of finish surfaces with dry material or adding water to concrete surfaces will not be permitted.

CONCRETE FINISHING DETAILS

1. Concrete Paving

   After concrete is placed and consolidated, slabs shall be screeded or struck off. No further finish is required.

2. Smooth Finish

   Required only where specified; screed concrete and float to required level with no coarse aggregate visible. After surface moisture has disappeared and laitance has been removed, the surface shall be finished by float and steel trowel. Smooth finish shall consist of thoroughly wetting and then brush coating the surfaces with cement to not more than 2 parts fine aggregate passing the no. 30 mesh sieve and mixed with water to the consistency of thick paint.

3. Broom Finish

   Required for paving; the concrete shall be screeded and floated to required finish level with no coarse aggregate visible. After the surface moisture has disappeared and laitance has been removed, surface shall be float-finished to an even, smooth finish. The floated surfaces shall be broomed with a fiber bristle brush in a direction transverse to the direction of the main traffic.

ITEM 05 : CONSTRUCTION JOINTS

SCOPE OF WORK

This item shall consist of the manufacturing and installation of construction joints / expansion joints in accordance with the details, and at the locations, lines, grades and dimensions shown in the drawings.

MATERIAL REQUIREMENTS

1. All construction joints / expansion joints shall be hot-dipped galvanized inside and out in accordance with international standards for galvanizing BS EN1460.

2. Painted finish shall be rejected.

3. All steel gratings and angle bars for construction joints / expansion joints shall be hot-dipped galvanized except for the nuts, washers and bolts which shall be stainless steel.

4. Welding shall be in accordance with the AWS Code and as herein specified or any other welding standard, approved by the Engineer.

The Contractor shall be required to submit test certificates for steel materials for the construction / expansion joints joints used in its manufacture; and for hot-dip galvanizing which shall meet or exceed the specifications under "Zinc Coating".

EXECUTION

DELIVERY, STORAGE AND INSTALLATION

1. Upon delivery at site, the hot-dipped galvanized construction joints / expansion joints shall not be subjected to the following activities:

    a. Re-fabrication
    b. Cutting
    c. Grinding
    d. Welding
    e. Sawing
    f. Any hot works or similar activities

2. Stainless steel nuts and bolts may be tack welded using stainless steel welding rods.

3. The construction joints / expansion joints shall not be exposed to sea water and other corrosive chemicals or
substances prior to installation.

ITEM 06 : ZINC (HOT-DIP GALVANIZED) COATINGS ON IRON AND STEEL

SCOPE OF WORK

This specification covers the requirements for zinc coating (galvanizing) by the hot-dip process on iron and steel products made from rolled pressed and forged shapes, casting, plates, bars and strips.

This specification covers both fabricated and un-fabricated products, for example, assembled steel products, structural steel fabrications, large tubes already bent or welded before galvanizing, and wire work fabricated from uncoated steel wire. It also covers steel forgings and iron castings incorporated into pieces fabricated before galvanizing or which are too large to be centrifuged (or otherwise handled to remove excess galvanizing bath metal).

MATERIAL REQUIREMENTS

STEEL OR IRON

The specification, grade or designation, and type and degree of surface contamination of the iron or steel in articles to be galvanized shall be supplied by the purchaser to the hot-dip galvanizer prior to galvanizing.

The presence in steels and weld metal, in certain percentages, of some elements such as silicon, carbon and phosphorus tends to accelerate the growth of the zinc-iron alloy layer so that the coating may have a matte finish with a little or no outer zinc layer.

EXECUTION

FABRICATION

The design and fabrication of the product to be galvanized shall be in accordance to the plans and specifications. ASTM Practices A 143, A 384 and A 385 provide guidance for steel fabrication for optimum hot-dip galvanizing and shall be complied with in both design and fabrication.

CASTINGS

The composition of heat treatment of iron and steel castings shall conform to specifications designated by the purchaser. Some types of castings have been known to show potential problems being embritttled during normal thermal cycle of hot-dip galvanizing. The requirements for malleable iron castings to be galvanized are stipulated in ASTM specification A 47.

ZINC

The zinc used in the galvanizing bath shall conform to ASTM Specification B 6. If a zinc alloy is used as the primary feed to the galvanizing bath, then the base material used to make that alloy shall conform to ASTM Specification B 6.

BATH COMPOSITION

The molten metal in the working volume of the galvanizing bath shall contain not less than an average value of 98.0% zinc by weight.

COATING PROPERTIES

Table 1 – Minimum Average Coating Thickness Grade by Material Category

Material Category	All Specimens Tested Steel Thickness Range (Measured), mm (in.)				
	< 1/16 (<1.6)	1/16 to < 1/8 (1.6 to < 3.2)	1/8 to < 3/16 (3.2 to 4.8)	> 3/16 to < 1/4 (> 4.8 to < 6.4)	≥ 1/4 (≥ 6.4)
Structural Shapes & Plate	45	65	75	85	100
Strip and Bar	45	65	75	85	100
Pipe and Tubing	45	45	75	75	75
Wire	35	50	60	65	80

COATING THICKNESS

The average thickness of coating for all specimens tested shall conform to the requirements of Table 1 for the categories and thickness of the material being galvanized. Minimum average thickness of coating for any individual specimen is one coating grade less than that required in Table 1. Where products consisting of various material thicknesses or categories are galvanized, the coating thickness grades of each thickness range and material category of material shall be shown in Table 1. The specification of coating thickness heavier than those required by Table 1 shall be subject to mutual agreement between the galvanizer and Engineer.

For articles whose surface area is greater than 100,000 mm^2 (160 $in.^2$) (multi-specimen articles), each test article in the sample must meet the appropriate minimum average coating thickness grade requirements of Table 1. Each specimen coating thickness grade comprising that overall average for each test article shall average not less than one coating grade below that required in Table 1.

For articles whose surface area is equal to or less than 100,000 mm^2 (160 $in.^2$) (single-specimen articles), the average of all test articles in the sample must meet the appropriate minimum average coating thickness grade requirements of Table 1. For each test article, its specimen coating thickness shall not be less than one coating grade below that required in Table 1.

No individual measurement or cluster of measurements at the same general location on a test specimen shall be cause for rejection under this specification provided that when those measurements are averaged with the other dispersed measurements to determine the specimen coating thickness grade for that specimen, the requirements of the above specifications as appropriate are met.

The coating thickness grades in Table 1 represent the minimum value obtainable with a high level of confidence for the ranges typically found in each material category. While most coating thicknesses will be in excess of those values, some materials in each category may be less reactive (for example, because of chemistry or surface condition) than other materials of the steel category spectrum. Therefore, some articles may have a coating grade at or close to the minimum requirements shown in Table 1. In such cases, the precision and accuracy of the coating thickness measuring technique should be taken into consideration when rejecting such articles for coating thickness below that is required by this specification.

FINISH

The coating shall be continuous (except as provided below), and as reasonably smooth and uniform in thickness as the weight size and shape of the item. Except for local excess coating thickness which would interfere with the use of the product or make it dangerous to handle (edge tears or spikes), rejection for non-uniform coating shall be made only for plainly visible excess coating not related to design factors such as holes, joints, or special drainage problems. Since surface smoothness is a relative term, minor roughness that does not interfere with the intended use of the product, or roughness that is related to the as-received (un-galvanized) surface condition, steel chemistry to zinc shall not be grounds for rejection.

Surfaces that remain uncoated after galvanizing may be renovated in accordance with the methods in ASTM Practice A 780 provided that the following conditions are met:

1. Each area subject to renovation shall be 25mm (1 in.) or less in its narrowest dimension.

2. The total area subject to renovation on each article shall be no more than ½ of 1% of the accessible surface area to be coated on that article, or 22,500mm^2 (36 in.^{2}) per ton of piece weight, whichever is less. Inaccessible surface areas are those which cannot be reached for appropriate surface preparation and application of repair materials as described in ASTM Practice A 780.

3. The thickness of renovation shall be that is required by the thickness grade for the appropriate material category and thickness range in Table 1 in accordance with the coating thickness requirements, except that for renovation using zinc paints, the thickness of renovation shall be 50% higher than that required by table 1, but not greater than 0.0254mm (4.0 mils).

4. When areas requiring renovation exceed the criteria previously provide, or are inaccessible for repair, the coating shall be rejected.

THREADED COMPONENTS IN ASSEMBLIES

The zinc coating on external threads shall not be subjected to a cutting, rolling or finishing tool operation, unless specifically authorized by the purchaser. Internal threads may be tapped or retapped after galvanizing. Coatings shall conform to the requirements of ASTM Specification A 153/A 153 M.

APPEARANCE

Upon shipment from the galvanizing facility, galvanized articles shall be free from uncoated areas, blisters, flux deposits and gross dross inclusions. Lumps, projections, globules or heavy deposits of zinc which will interfere with the intended use of the material will not be permitted. Plain holes of 12.5mm (1/2 in.) diameter or more shall be clean and reasonably free from excess zinc. Marks in the zinc coating caused by tongs or other items used in handling the article during the galvanizing operation shall not be cause for rejection unless such marks have exposed the base metal, and the bare metal areas exceed the criteria provided in number 1 and 2 of Subsection "Finish".

Whenever dross is present in a form other than finely dispersed pimples in the coating and is present in such amount as to be susceptible to mechanical damage, it will be considered as "gross".

ADHERENCE

The zinc coating shall withstand handling consistent with the nature and thickness of the coating and the normal use of the article, without peeling or flanking. Although some material may be formed after galvanizing, in general the zinc coating on the articles covered by this specification is too heavy to permit severe bonding without damaging the coating.

SAMPLING

A lot is a unit of production or shipment from which a sample may be taken for testing. Unless otherwise agreed upon between the galvanizer and the purchaser, or established within this specification, the lot shall be as follows:

1. For testing at a galvanizer's facility, a lot is one or more articles of the same type and size comprising a single order or a single delivery load, whichever is smaller, or any number of articles identified as a lot by the galvanizer, when these have been galvanized within a single production shift and in the same bath.

2. For test by the purchaser after delivery, the lot consists of the single order or the single delivery load, whichever is smaller, unless the lot identify, established in accordance with the above, is maintained and clearly indicated in the shipment by the galvanizer.

The method of selection and number of test specimens shall be agreed upon between the galvanizer and the purchaser. Otherwise, the test specimens shall be selected random from each lot. In this case, the minimum number of specimens from each lot shall be as follows:

Number of Pieces in Lot	Number of Specimens
3 or less	All
4 to 500	3
501 to 1,200	5
1,201 to 3,200	8
3,201 to 10,000	13
10,001 and over	20

A test specimen which fails to conform to any requirement of this specifications shall not be used to determine the conformance to other requirements.

TEST REQUIREMENTS

Magnetic Thickness Measurements:

The thickness of the coating shall be determined by magnetic thickness gauge measurements in accordance with ASTM Practice E 376. For each specimen, five or more measurements shall be made at points widely dispersed throughout the volume occupied by the specimen so as to represent as much as practical, the entire surface area of the test specimen. The average of the five or more measurements thus made for each specimen is the specimen coating thickness.

For articles whose surface area is greater than 100,000 mm^2 (160 in^2), in the average of the three specimen coating thickness grades comprising each test article is the average coating thickness for that test article. A specimen must be evaluated for each steel category and material thickness within the requirements for each specimen of the test article

For articles whose surface area is equal to or less than 100,000 mm^2 (160 in^2), the average of all specimen coating thickness grades is the average coating thickness for the sample.

The use of magnetic measurement method is appropriate for larger articles, and may be appropriate for smaller articles when such is practical using ASTM Practice E 376.

Stripping Method

The average weight of coating may be determined by stripping a test article, a specimen removed from a test article, or group of test articles in the case of very small items such as nails, etc., in accordance with Test method ASTM A 90/A 90m. The weight of coating per unit area thus determined is converted to equivalent coating thickness values in accordance with Table 2, Coating Thickness Grade (rounding up or down as appropriate). The thickness of coating thus obtained is the test article coating thickness, or in the case of a specimen removed from a test article, is the specimen average coating thickness.

Table 2 – Coating Thickness Grade [A]

Coating Grade	mils	oz/ft^2	µm	g/m^2
35	1.4	0.8	35	245
40	1.4	1.0	45	320
50	2.0	1.2	50	355
55	2.2	1.3	55	390
60	2.4	1.4	60	425
65	2.6	1.5	65	460
75	3.0	1.7	75	530
80	3.1	1.9	80	565
85	3.3	2.0	85	600
100	3.9	2.3	100	705

[A] Conversions in Table 2 are based on the metric thickness value equivalents from the next earlier version, using conversion factors consistent with Table X 2.1 in Specification A 653/A 653M, rounded to the nearest 5 µm (0.0002 in.). The conversion factors used are: mils = µm x 0.03937; oz/ft^2 = µm x 0.002316; g/m^2 = µm x 7.067.

Weighing Before or After Galvanizing

The average of coating may be determined by weighing articles before and after galvanizing, subtracting the first weigh from the second and dividing the result by the surface area. The first weigh shall be determined after pickling and drying, and the second after cooling to ambient temperature. The weight of coating per unit area thus determined is converted to equivalent coating thickness values according to Table 2 (rounding up or sown as appropriate). The thickness of coating thus obtained is the test article coating thickness.

Microscopy

The thickness of coating may be determined by cross-sectional and optical measurement in accordance with ASTM Test Method B 487. The thickness thus determined is a point value. No less than five such measurements shall be made at locations on the test article which are as widely dispersed as practical, so as to be representative of the whole surface of the test article. The average of no less than five such measurement is the specimen coating thickness.

Adhesion

Determine adhesion of the zinc coating to the surface of the base metal by cutting or prying with the point of a stout knife, applied with considerable pressure in a manner tending to remove a portion of the coating. The adhesion shall be considered inadequate if the coating flakes off in the form of a layer of the coating so as to expose the base metal in advance of the knifepoint. Do not use testing carried out at edges or corners (points of lowest coating adhesion) to determine adhesion of the coating. Likewise, do not use removal of small particles of the coating by paring or whittling to determine failure.

Embrittlement

Test for embrittlement may be made in accordance with ASTM Practice A 143

The galvanized article should withstand a degree of bending substantially the same as the ungalvanized article. Flaking or spalling of the galvanized coating is not be constructed as anembrittlement failure.

Inspection, Rejection and Retest

The material shall be inspected at the galvanizer's plant prior to shipment. However, by agreement the purchaser may make the tests which govern the acceptance or rejection of the materials in his own laboratory or elsewhere.

When inspection of materials to determine conformity with the visual requirements of Subsection "Finish" warrants rejection of a lot, the galvanizer may sort the lot and submit it once again for acceptance after he has removed any nonconforming articles and replace them with conforming articles.

Materials have been rejected for reasons other than embrittlement may be stripped and regalvanized, and again submitted for inspection and test at which time they shall conform to the requirements of this inspection.

Transport and Storage

Galvanized components shall, wherever possible, be transported and stored under dry, well-ventilated conditions to prevent the formation of wet storage staining.

Either zinc phosphate or chromate passivation treatment after galvanizing may be used to minimize the wet storage staining which may occur on articles unable to be stored in dry, well-ventilated conditions.

Provided the coating thickness complies with the requirements of Subsection "Coating Thickness", no further remedial action is required to the stained areas.

ITEM 07 : MOORING AND FENDERING SYSTEM

SCOPE OF WORK

1. The work includes furnishing of all labor, materials and equipment to complete the installation of mooring bollards and fenders in piers/wharves.

2. The work shall include the supply, transport, handling, storage and installation of fenders systems in the newly constructed piers.

3. The Contractor shall furnish and install the necessary fittings as shown on the drawings and/or specified.

Supplementary parts necessary to complete and install each item of works shall be included whether or not shown or specified. The Contractor shall furnish to relevant trades all anchors, fastenings, inserts, fittings, fixtures or the like to be installed on or required for securing the works.

The Contractor shall submit shop drawings of all fitting works prior to placing orders and commencement of any fabrication.

MATERIAL REQUIREMENTS

MOORING SYSTEM

Designated load capacity of mooring bollards shall be as shown in the drawings, and shall be referred to as the maximum load capacity. The mooring bollards shall be at rupture stage upon reaching the maximum load capacity.

Mooring bollards shall be of the dimensions, weights, capacities and designs as shown in the drawings and shall be fabricated by approved manufacturer with cast steel conforming to the requirements indicated in the plan/drawings, or approved equivalent.

The size of the bolts, nuts and washers shall be in accordance with the specifications provided in the plans/drawings. The anchor plate shall be connected to the holding down bolt as shown in the plans/drawings. All bolts, nuts, washers etc., that are exposed shall be hot-dip galvanized.

Samples of the bolts, nuts, washers and anchor plates shall be submitted to the Engineer for approval before being used in the Works.

The upper part of bollards and base plates which are not embedded in concrete shall be painted. The surface of bollards shall be cleaned thoroughly by wire brush or other means prior to painting to remove rust or any other contamination which may interfere with bond of paint to metal.

The exposed surface shall be coated with rust proof paint and finishing paint, which shall be coal-tar epoxy of 120m micron thickness in accordance with JIS K5623 or the approved standard.

Base Steel:

Chemical composition and mechanical properties of base metal to be used for fabrication of mooring bollard and its accessories shall comply with ASTM A36 and other required standard stated therein.

Concrete Foundation :

Concrete foundation for mooring bollards shall conform to the requirements of the Section concerning "Reinforced Concrete".

Visual Inspection :

All mooring bollards delivered to Site shall be inspected by the Engineer for any signs of flaws or defect inimical to usage.

Mill Test Certificates:

Two (2) copies of mill test reports shall be submitted certifying that materials meet the specified standards.

Test Inspection:

Inspection of all materials and methods of fabrication shall be carried out by the Contractor. However, the Engineer reserves the right to inspect all facilities at any time during the manufacture to ensure that the materials and workmanship are in accordance with Specifications and the best of workmanship.

FENDER SYSTEM

The rubber fenders should comply with the performance requirements specified in the table provided on the plan/drawings of Rubber Dock Fenders (RDF).

PHYSICAL PROPERTIES OF MATERIALS

The rubber for the fenders shall be of high quality natural rubber, synthetic rubber or mixed rubber blended with carbon black used in the rubber industry and shall have sufficient resilience and anti-ageing, weathering, abrasion, wear and oil resistant properties. The rubber dock fenders shall be free from bubbles, cracks and other harmful defects.

The physical properties of the rubber compound used for the fenders shall comply with the following requirements:

Physical Properties and Test Method

Test Item			Properties	Test Method	
Physical Test	Before Aging	Tensile Strength	160kg/sq.m minimum	Test piece: Dumbell No. 3	ASTM D412
		Elongation	350% minimum		ASTM D1456
		Hardness	76Hs maximum	Spring Type hardness test (Type A)	ASTM D2240
	After Aging	Tensile Strength	Not less than 80% of original value	Aging by air heating: 70±1°C x 96 hours.	ASTM D412
		Elongation			ASTM D1456
		Hardness	Not more than original value +8°		ASTM D2240
	Compression Test		30% maximum	Heat treatment: 70±1°C x 22 hours.	ASTM D395

Note: Equivalent Standards are acceptable.

FITTINGS AND ANCHORAGE

Anchor bolts and connecting hardware shall be fabricated using type of steel specified and to the required shapes and sizes shown on the approved plan/drawings.

TESTING, SAMPLING, INSPECTION, ACCEPTANCE, MARKING AND PACKAGING

Testing

All rubber dock fenders shall be tested for performance. It shall pass the required energy absorption and reaction force at a certain deflection as indicated in the plan.

The Contractor shall be required to submit test certificates showing compliance to the above requirements. The test certificates shall be certified by an independent testing institute / organization recognized by the Authority.

The standard performance testing methodology shall be Method B, to wit:

1. Fender temperature shall be stabilized at 23 degrees plus or minus 5 degrees centigrade for at least 24 hours before compression testing.

2. Break-in of fender by deflecting 3 times to rated deflection.

3. Removed load from the RDF and allow recovering for a minimum of 1 hour.

4. Deflect RDF at speed of 2-8 cm/min once to rated deflection.

The testing apparatus shall be calibrated and certified within plus or minus 1% in accordance with ISO or equivalent JIS or ASTM requirements. Calibration shall be traceable to a national/international standard and shall be performed annually by an accredited third party organization. The RDF performance testing center shall be subjected to accreditation by PPA and notation and /or certification by DPWH-BRS prior to acceptance.

Inspection

All fenders of each type shall be inspected for compliance to specified dimensions and all fenders shall be inspected by the Engineer for any sign of flaw or defect inimical to its use.

All anchor bolts and fittings shall be inspected. The material used for the fabrication of bolts and fittings shall be covered by the manufacturer's certified mill certificate and shall be verified by the Authority.

All RDF items/units shall be clearly numbered and marked indicated the following:

Acceptance Tolerance

The acceptance tolerance shall be based on the following:

1. Fender Dimension

Length	:	-2% to +4%
Width	:	-2% to +4%
Height	:	-2% to +4%
Thickness	:	-2% to +8%

2. Anchor Bolt Holes in Fender

Diameter of the Hole	:	+2.0mm
Pitch of the Hole	:	+4.0mm

3. Acceptance tolerance for all fenders supplied shall be as follows:

E = Energy absorption,	E ≥ Specified E but not less than 10% of the specified E
R = Reaction force,	R ≤ Specified R but not more than 10% of the specified R

Marking

All fender units shall be clearly numbered and marked. Each fender shall have the following markings.

1. Fender type and manufacturer's name or trade mark
2. Production serial number
3. Date of manufacture or its abbreviation
4. Main dimensions
5. Project identification as follows:

Name of Port/Project:_____

Year supplied _____

Packaging

The fenders shall be packaged on wooden crate or wrapped individually with Polypropylene sheets except when shipped containerized. The bolts and fittings should be placed in crates and suitably treated for protection when transported by sea and stored in port areas.

EXECUTION

MOORING / FENDERING SYSTEM

All units shall be installed at the locations shown on the drawings and as directed by the Engineer.

ITEM 08 : SUBGRADE PREPARATION

DESCRIPTION

This Item shall consist of the preparation of the subgrade for the support of overlying structural layers. It shall extend to full width of the pavement.

MATERIAL REQUIREMENTS

Embankments shall be constructed of suitable materials, in consonance with the following definitions:

1. Suitable Material – Material which is acceptable in accordance with the Contract and which can be compacted in the manner specified in this Item.

   Selected Borrow, for topping – soil of such gradation that all particles will pass a sieve with 75 mm (3 inches) square openings and not more than 15 mass percent will pass the 0.075 mm (No. 200) sieve, as determined by AASHTO T 11. The material shall have a plasticity index of not more than 6 as determined by ASSHTO T 90 and a liquid limit of not more than 30 as determined by AASHTO T 89.

2. Unsuitable Material – Material other than suitable materials such as:

   (a) Materials containing detrimental quantities of organic materials, such as grass, roots and sewerage.

   (b) Organic soils such as peat and muck.

   (c) Soils with liquid limit exceeding 80 and/or plasticity index exceeding 55.

   (d) Soils with a natural water content exceeding 100%.

   (e) Soils with very low natural density, 800 kg/m3 or lower.

   (f) Soils that cannot be properly compacted as determined by the Engineer.

CONSTRUCTION REQUIREMENTS

PRIOR WORKS

Prior to commencing preparation of the subgrade, all culverts, cross drains, ducts and the like (including their fully compacted backfill), ditches, drains and drainage outlets shall be completed. Any work on the preparation of the subgrade shall not be started unless prior work herein described shall have been approved by the Engineer.

SUBGRADE LEVEL TOLERANCE

The finished compacted surface of the subgrade shall conform to the allowable tolerances as specified hereunder:

Permitted variation from design LEVEL OF SURFACE	+ 20 mm - 30 mm
Permitted SURFACE IRREGULARITY MEASURED BY 3-m STRAIGHT EDGE	30 mm
Permitted variation from design CROSSFALL OR CAMBER	± 0.5 %
Permitted variation from design LONGITUDINAL GRADE over 25 m length	± 0.1 %

SUBGRADE IN COMMON EXCAVATION

Unless otherwise specified, all materials below subgrade level in earth cuts to a depth 150 mm or other depth shown on the Plans or as directed by the Engineer shall be excavated. The material, if suitable, shall be set aside for future use or, if unsuitable, shall be disposed as directed by the Engineer.

Where material has been removed from below subgrade level, the resulting surface shall be compacted to a depth of 150 mm.

All materials immediately below subgrade level in earth cuts to a depth of 150 mm, or to such greater depth as may be specified, shall be compacted in accordance with the materials requirement.

SUBGRADE ON EMBANKMENT

After the embankment has been completed, the full width shall be conditioned by removing any soft or other unstable material that will not compacted properly. The resulting areas and all other low sections, holes, or depressions shall be brought to grade with suitable material. Scarifying, blading, dragging, rolling, or other methods of work shall be performed or used as necessary to provide a thoroughly compacted subgrade shaped to the cross-sections shown on the Plans.

PROTECTION OF COMPLETED WORK

The Contractor shall be required to protect and maintain at his own expense the entire work within the limits of his Contract in good condition satisfactory to the Engineer from the time he first started work until all work shall have been completed. Maintenance shall include repairing and recompacting ruts, ridges, soft spots and deteriorated sections of the subgrade caused by the traffic of the Contractor's vehicle/equipment or that of the public.

ITEM 09 : AGGREGATE BASE COURSE

DESCRIPTION

This Item shall consist of furnishing, placing and compacting an aggregate base course on a prepared subgrade/subbase in accordance with this Specification and the lines, grades, thickness and typical cross-sections shown on the Plans, or as established by the Engineer.

MATERIAL REQUIREMENTS

Aggregate for base course shall consist of hard, durable particles or fragments of crushed stone, crushed slag or crushed or natural gravel and filler of natural or crushed sand or other finely divided mineral matter. The composite material shall be free from vegetable matter and lumps or balls of clay, and shall be of such nature that it can be compacted readily to form a firm, stable base.

In some areas where the conventional base course materials are scarce or non-available, the use of 40% weathered limestone blended with 60% crushed stones or gravel shall be allowed, provided that the blended materials meet the requirements of this Item.

The base course material shall conform to the following Grading Requirements

Grading Requirements

Sieve Designation		Mass Percent Passing	
Standard mm	Alternate US Standard	Grading A	Grading B
50	2"	100	
37.5	1 – 1/2"	-	100
25.0	1"	60 - 85	-
19.0	3/4"	-	60 - 85
12.5	1/2"	35 - 65	-
4.75	No. 4	20 - 50	30 - 55
0.425	No. 40	5 - 20	8 - 25
0.075	No. 200	0 - 12	2 - 14

The fraction passing the 0.075 mm (No. 200) sieve shall not be greater than 0.66 (two thirds) of the fraction passing the 0.425 mm (No. 40) sieve.

The fraction passing the 0.425 mm (No. 40) sieve shall have a liquid limit not greater than 25 and plasticity index not greater than 6 as determined by AASHTO T 89 and T 90, respectively.

The coarse portion, retained on a 2.00 mm (No. 10) sieve shall have a mass percent of wear not exceeding 50 by the Los Angeles Abrasion test determined by AASHTO T 96.

The material passing the 19 mm (3/4 inch) sieve shall have a soaked CBR value of not less than **80%** as determined by AASHTO T 193. The CBR value shall be obtained at the maximum dry density (MDD) as determined by AASHTO T 180, Method D.

If filler, in addition to that naturally present, is necessary for meeting the grading requirements or for satisfactory bonding, it shall be uniformly blended with the base course material on the road or in a pug mill unless otherwise specified or approved. Filler shall be taken from sources approved by the Engineer, shall be free from hard lumps and shall not contain more than 15 percent of material retained on the 4.75 mm (No. 4) sieve.

CONSTRUCTION REQUIREMENTS

PLACING

The aggregate base material shall be placed at a uniform mixture on a prepared sub-base/ subgrade in a quantity which will provide the required compacted thickness. When more than one layer is required, each layer shall be shaped and compacted before the succeeding layer is placed.

The placing of material shall begin at the point designated by the Engineer. Placing shall be from vehicles especially equipped to distribute the material in a continuous uniform layer or windrow.

The layer or windrow shall be of such size that when spread and compacted the finished layer be in reasonably close conformity to the nominal thickness shown on the Plans.

When hauling is done over previously placed material, hauling equipment shall be dispersed uniformly over the entire surface of the previously constructed layer, to minimize rutting or uneven compaction.

SPREADING AND COMPACTING

When uniformly mixed, the mixture shall be spread to the plan thickness, for compaction.

Where the required thickness is 150mm or less, the material may be spread and compacted in one layer. Where the required thickness is more than 150 mm, the aggregate base shall be spread and compacted in two or more layers of approximately equal thickness, and the maximum compacted thickness of any layer shall not exceed 150 mm. All subsequent layers shall be spread and compacted in a similar manner.

The moisture content of sub-base material shall, if necessary, be adjusted prior to compaction by watering with approved sprinklers mounted on trucks or by drying out, as required in order to obtain the required compaction.

Immediately following final spreading and smoothening, each layer shall be compacted to the full width by means of approved compaction equipment. Rolling shall progress gradually from the sides to the center, parallel to the centerline of the road and shall continue until the whole surface has been rolled. Any irregularities or depressions that develop shall be corrected by loosening the material at these places and adding or removing material until surface is smooth and uniform. Along curbs, headers, and walls, and at all places not accessible to the roller, the base material shall be compacted thoroughly with approved tampers or compactors.
If the layer of base material, or part thereof, does not conform to the required finish, the Contractor shall, at his own expense, make the necessary corrections.

Compaction of each layer shall continue until **a field density of at least 100 percent** of the maximum dry density determined in accordance with AASHTO T 180, Method D has been achieved. In-place density determination shall be made in accordance with AASHTO T 191/ASTM D 1556.

TRIAL SECTION

Before base construction is started, the Contractor shall spread and compact trial sections as directed by the Engineer. The purpose of the trial sections is to check the suitability of the materials and the efficiency of the equipment and construction method which is proposed to be used by the Contractor. Therefore, the Contractor must use the same material, equipment and procedures that he proposes to use for the main work. One trial section of about 500 m^2 shall be made for every type of material and/or construction equipment/procedure proposed for use.

After final compaction of each trial section, the Contractor shall carry out such field density tests and other tests required as directed by the Engineer.

If a trial section shows that the proposed materials, equipment or procedures in the Engineer's opinion are not suitable for subbase, the material shall be removed at the Contractor's expense, and a new trial section shall be constructed.

If the basic conditions regarding the type of material or procedure change during the execution of the work, new trial sections shall be constructed.

SURVEYS AND SETTING OUT WORKS

Before the commencement of the pavement works, the Contractor together with the Engineer shall conduct topographic survey which will form the basis of quantity measurement.

The Contractor shall set out the works and shall be solely responsible for the accuracy of such setting-out.

Prior to placement of any material, the Contractor shall establish visible construction markers to clearly define horizontal limits of the Work.

TOLERANCES

The aggregate base course shall be laid to the designed level and transverse slopes shown on the Plans. The allowable tolerances shall be in accordance with following:

Permitted variation from design THICKNESS OF LAYER	± 10 mm
Permitted variation from design LEVEL OF SURFACE	+ 5 mm -10 mm
Permitted SURFACE IRREGULARITY Measured by 3-m straight-edge	5 mm
Permitted variation from design CROSSFALL OR CAMBER	± 0.2%
Permitted variation from design LONGITUDINAL GRADE over 25 m in length	± 0.1%

METHOD OF MEASUREMENT

Aggregate Base Course will be measured by the cubic meter (m3). The quantity to be paid for shall be the design volume compacted in-place as shown on the Plans, and accepted in the completed base course. No allowance shall be given for materials placed outside the design limits shown on the cross-sections. Trial sections shall not be measured separately but shall be included in the quantity of aggregate base course.

ITEM 10 : AGGREGATE SUB BASE COURSE

DESCRIPTION

This item shall consist of furnishing, placing and compacting an aggregate subbase course on a prepared subgrade in accordance with this Specification and the lines, grades and cross-sections shown on the Plans, or as directed by the Engineer.

MATERIAL REQUIREMENTS

Aggregate for subbase shall consist of hard, durable particles or fragments of crushed stone, crushed slag, or crushed or natural gravel and filler of natural or crushed sand or other finely divided mineral matter. The composite material shall be free from vegetable matter and lumps or balls of clay, and shall be of such nature that it can be compacted readily to form a firm, stable subbase.

The subbase material shall conform to the following Grading Requirements

Grading Requirements

Sieve Designation		Mass Percent Passing
Standard, mm	Alternate US Standard	
50	2"	100
25	1"	55 – 85
9.5	3/8"	40 – 75
0.075	No. 200	0 - 12

The fraction passing the 0.075 mm (No. 200) sieve shall not be greater than 0.66 (two thirds) of the fraction passing the 0.425 mm (No. 40) sieve.

The fraction passing the 0.425 mm (No. 40) sieve shall have a liquid limit not greater than 35 and plasticity index not greater than 12 as determined by AASHTO T 89 and T 90, respectively.

The coarse portion, retained on a 2.00 mm (No. 10) sieve, shall have a mass percent of wear not exceeding 50 by the Los Angeles Abrasion Tests as determined by AASHTO T 96.

The material shall have a soaked **CBR value of not less than 25%** as determined by AASHTO T 193. The CBR value shall be obtained at the maximum dry density and determined by AASHTO T 180, Method D.

CONSTRUCTION REQUIREMENTS

PLACING

The aggregate subbase material shall be placed at a uniform mixture on a prepared subgrade in a quantity which will provide the required compacted thickness. When more than one layer is required, each layer shall be shaped and compacted before the succeeding layer is placed.

The placing of material shall begin at the point designated by the Engineer. Placing shall be from vehicles especially equipped to distribute the material in a continuous uniform layer or windrow. The layer or windrow shall be of such size that when spread and compacted the finished layer be in reasonably close conformity to the nominal thickness shown on the Plans.

When hauling is done over previously placed material, hauling equipment shall be dispersed uniformly over the entire surface of the previously constructed layer, to minimize rutting or uneven compaction.

SPREADING AND COMPACTING

When uniformly mixed, the mixture shall be spread to the plan thickness, for compaction.

Where the required thickness is 150mm or less, the material may be spread and compacted in one layer. Where the required thickness is more than 150 mm, the aggregate base shall be spread and compacted in two or more layers of approximately equal thickness, and the maximum compacted thickness of any layer shall not exceed 150 mm. All subsequent layers shall be spread and compacted in a similar manner.

The moisture content of sub-base material shall, if necessary, be adjusted prior to compaction by watering with approved sprinklers mounted on trucks or by drying out, as required in order to obtain the required compaction.

Immediately following final spreading and smoothening, each layer shall be compacted to the full width by means of approved compaction equipment. Rolling shall progress gradually from the sides to the center, parallel to the centerline of the road and shall continue until the whole surface has been rolled. Any irregularities or depressions that develop shall be corrected by loosening the material at these places and adding or removing material until surface is smooth and uniform. Along curbs, headers, and walls, and at all places not accessible to the roller, the base material shall be compacted thoroughly with approved tampers or compactors.

If the layer of base material, or part thereof, does not conform to the required finish, the Contractor shall, at his own expense, make the necessary corrections.

Compaction of each layer shall continue until a **field density of at least 100 percent** of the maximum dry density determined in accordance with AASHTO T 180, Method D has been achieved. In-place density determination shall be made in accordance with AASHTO T 191/ASTM D 1556.

TRIAL SECTION

Before subbase construction is started, the Contractor shall spread and compact trial sections as directed by the Engineer. The purpose of the trial sections is to check the suitability of the materials and the efficiency of the equipment and construction method which is proposed to be used by the Contractor. Therefore, the Contractor must use the same material, equipment and procedures that he proposes to use for the main work. One trial section of about 500 m^2 shall be made for every type of material and/or construction equipment/procedure proposed for use.

After final compaction of each trial section, the Contractor shall carry out such field density tests and other tests required as directed by the Engineer.

If a trial section shows that the proposed materials, equipment or procedures in the Engineer's opinion are not suitable for subbase, the material shall be removed at the Contractor's expense, and a new trial section shall be constructed.

If the basic conditions regarding the type of material or procedure change during the execution of the work, new trial sections shall be constructed.

SURVEYS AND SETTING OUT WORKS

Before the commencement of the pavement works, the Contractor together with the Engineer shall conduct topographic survey which will form the basis of quantity measurement.

The Contractor shall set out the works and shall be solely responsible for the accuracy of such setting-out.

Prior to placement of any material, the Contractor shall establish visible construction markers to clearly define horizontal limits of the Work.

TOLERANCES

The aggregate base course shall be laid to the designed level and transverse slopes shown on the Plans. The allowable tolerances shall be in accordance with following:

Permitted variation from design THICKNESS OF LAYER	± 20 mm
Permitted variation from design LEVEL OF SURFACE	+ 10 mm -20 mm
Permitted SURFACE IRREGULARITY Measured by 3-m straight-edge	20 mm
Permitted variation from design CROSSFALL OR CAMBER	± 0.3%
Permitted variation from design LONGITUDINAL GRADE over 25 m in length	± 0.1%

METHOD OF MEASUREMENT

Aggregate Subbase Course will be measured by the cubic meter (m3). The quantity to be paid for shall be the design volume compacted in-place as shown on the Plans, and accepted in the completed course. No allowance will be given for materials placed outside the design limits shown on the cross-sections. Trial sections shall not be measured separately but shall be included in the quantity of subbase herein measured.

ITEM 11 : PORTLAND CEMENT CONCRETE PAVEMENT

SCOPE OF WORK

The works include the furnishing of all labor, materials and equipment required for the construction of gravel base course and concrete pavement. The works shall be in accordance with the lines and grades shown on the Drawings and in conformity with the Specifications.

MATERIAL REQUIREMENTS

Cement

Portland cement shall conform to the requirements of the Section "Reinforced Concrete".

Fine Aggregate

The fine aggregate shall be well-graded from coarse to fine and shall conform to the requirements of the Section "Reinforced Concrete".

Coarse Aggregate

Coarse aggregate shall conform to the requirements of the Section "Reinforced Concrete".

Water

Clean, fresh, potable water shall be used for the mixing of all concrete and mortar and shall be from a source approved by the Engineer. Sea water or brackish water shall not be used.

Admixture

Admixture shall only be used with the written permission of the Engineer. If air-entraining agents, water reducing agents, set retarders or strength accelerators are permitted to be used, they shall not be used in greater dosages than those recommended by the manufacturer, or as permitted by the Engineer. The cost shall be considered as already in the Contractor's unit cost bid for concrete.

TIE BARS AND SLIP BARS

Tie bars shall be deformed bars conforming to the requirements specified in AASHTO M 31 or M 42, except that rail steel shall not be used for tie bars that are to be bent and re-straightened during construction, sizes as indicated on the Drawings. The deformed bars shall be Grade 40 and shall be shipped in standard bundles, tagged and marked in accordance with the Code of Standard practice of the Concrete Reinforcement Steel Institute.

Slip bars shall be smooth round steel bars conforming to the requirements specified in AASHTO M 31 or plain M 42.

Joint Filler

Poured filler for joint shall conform to the requirements of AASHTO M173.

EXECUTION

Concrete Class

The concrete for pavement shall satisfy the following requirements:

Minimum 28-day comprehensive strength	:	24 MPa
Minimum Flexural Strength	:	3.8 MPa
Maximum Aggregate size	:	25 mm
Maximum water cement ratio	:	0.52

Proportioning, Consistency and Mixing of Concrete

The proportioning, consistency and mixing of concrete shall conform to the requirements of the Section "Reinforced Concrete".

Preparation

The base shall be watered and thoroughly moistened prior to placing of the concrete.

Formwork Construction

Formwork shall comply with the requirements of the Section "Reinforced Concrete". Forms shall be of steel, of an approved section and shall be straight and of a depth equal to thickness of the pavement at the edge. The base of the forms shall be of sufficient width to provide necessary stability in all directions. The flange braces must extend outward on the base not less than 2/3 the height of the form.

All forms shall be rigidly supported on a bed of thoroughly compacted material during the entire operation of placing and finishing the concrete. They shall be set with their faces vertical so as to produce a surface complying with the required tolerance.

Adjacent lanes may be used in lieu of forms for supporting finishing equipment provided that proper protection is afforded to the concrete of the adjacent lanes to prevent damage, and provided further that the surface of the concrete carrying the finishing equipment does not vary by more than 3mm in each meter length. Adjacent lanes in lieu of forms may not be used until the concrete is at least seven (7) days old. Flanged wheels of the finishing equipment shall not be operated on the concrete surface. The inside edge of supporting wheels of the finishing machine shall not operate closer than 100mm from the edge of the concrete lane.

Alternative to placing forms, slip-forming may be used. Slip-form paving equipment shall be equipped with the traveling side forms of sufficient dimensions, shape and strength to support the concrete laterally for a sufficient length of time during placement to produce pavement of the required cross section. No abrupt changes in longitudinal alignment of the pavement will be permitted. The horizontal deviation shall not exceed 20mm from the proper alignment established by the Engineer.

Joints

All joints, longitudinal, transverse, etc., shall be constructed as shown on the Drawings and shall be clean and free of all foreign material after completion of shoulder work prior to acceptance of the work and in accordance with the following provisions:

Longitudinal and Transverse Contact Joints:

Longitudinal contact joints are joints formed between lanes that are poured separately. Transverse contact joints are joints formed between segments of a lane that are poured separately. Transverse contact joints shall be formed perpendicular to pavement centerline at the end of each day of concrete placing, or where concreting has been stopped for 30 minutes or longer but not nearer than 1.5 meters from sawed contraction joints. All contact joints shall have faces perpendicular to the surface of the pavement. Tie bars of the size, length and spacing shown on the Drawings shall be placed across longitudinal and transverse contact joints.

Placing Concrete

The concrete shall be deposited and spread in order that segregation will not occur and place a uniform layer of concrete whose thickness is approximately 20 mm greater than that required for the finished pavement is placed. Rakes shall not be used for handling concrete.

In order to prevent the introduction into the concrete of earth and other foreign materials, the men whose duties require them to work in the concrete, shall in general, confine their movements to the area already covered with fresh concrete. Whenever it becomes necessary for these men to step out of the concrete, their footwear shall be washed or otherwise thoroughly cleaned before returning to the concrete. Repeated carelessness with regard to this detail will be deemed sufficient cause for removing and replacing such worker.

During the operation of striking off the concrete, a uniform ridge of concrete at least 70 mm in height shall be maintained ahead of the strike-off screed for its entire length. Except when making a construction joint, the finishing machine shall at no time be operated beyond that point where this surplus can be maintained in front of the strike-off screed.

After the first operation of the finishing machine, additional concrete shall be added to all low places and honeycombed spots and the concrete rescreeded. In any rescreeding, a uniform head of concrete shall be maintained ahead of the strike-off for its entire length. Honeycombed spots shall not be eliminated by tamping or grouting.

Workers on the job shall have mobile footbridges at their disposal so that they need not walk on the wet concrete.

In conjunction with the placing and spreading, the concrete shall be thoroughly spaded and vibrated along the forms, bulkhead, and joints.

The internal vibrators shall be of pneumatic, gas-driven, or electric type, and shall operate at a frequency of not less than 3,200 pulsations per minute.

Whenever the placing of the concrete is stopped or suspended for any reason, for a period of 30 minutes or longer, a suitable bulkhead shall be placed so as to produce a vertical transverse joint. If an emergency stop occurs within 2.5 meters of the contraction or an expansion joint the concrete shall be removed back to the joint. When the placing of the concrete is resumed, the bulkhead shall be removed and a new concrete placed and vibrated evenly and solidly against the face of previously deposited concrete. Any concrete

in excess of the amount needed to complete a given section or that has been deposited outside the forms shall not be used in the work.

The Contractor shall provide suitable equipment for protecting the fresh concrete in case of rain, such as screens which will cause the rain water to run off beyond the edges of the paving, rain proof tarpaulins or other methods approved by the Engineer. The equipment shall be sufficient to shelter from rain all areas equal to that paved in two hours of work.

Finishing Concrete

The concrete shall be compacted and finished by a mechanical, self-propelled finishing machine of approved type, having two independently operated screeds. If a machine possessing only one screed is approved, the screed will not be less than 450 mm wide and shall be equipped with compensating springs to minimize the effect of the momentum of the screed on the side forms. The number of driving wheels, the weight of the machine and the power of the motor shall be so coordinated as to prevent slippage. The top of the forms and the surface of the finishing machine wheels shall be kept free from concrete or dirt.

The machine shall at all times be in first-class mechanical condition and shall be capable of compacting and finishing the concrete are herein described. Any machine which causes displacement of the side forms from the line or grade to which they have been properly set, or causes undue delay due to mechanical difficulties, shall be removed from the work and replaced by a machine meeting the Specifications.

The finishing machine shall be operated over each section of pavement two or more times and at such intervals as will produce the desired results. Generally, two passes of the finishing machine are considered the maximum desirable.

The concrete shall be vibrated, compacted, and finished by a vibratory finishing machine. The vibratory machine shall meet the requirements for ordinary finishing, and shall be one of the following type:

1. The machine shall have two independently operated screeds; the front screed shall be equipped with vibratory units with a frequency of not less than 3,500 pulsations per minute. There shall be not less than one vibratory unit for each 2.5 meters length or portion thereof, of vibratory screed surface. The front screed shall not be less than 300mm wide and shall be equipped with a "bull nose" front edge built on a radius of not less than 50mm. This type of vibratory finishing machine shall be operated in such manner that each section of pavement will receive at least one vibratory pass, but not more than two passes, unless otherwise directed, or ;

2. The machine shall be equipped with an independently operated vibratory "pan" (or pans) and two (2) independently operated screeds, the "pan" shall be mounted in a manner that will permit it to come in contact with the forms and will permit vibration of the full width of lane simultaneously.

   There shall be not less than one vibratory unit for each 2 m. length or portion thereof, of vibrating pan surface. The vibratory units in any individual pan shall be synchronized and have a frequency of not less than 3,500 pulsations per minute. The front screed shall be capable of operating in a position that will strike off the concrete at a sufficient height above the top of the forms to allow for proper compaction with the vibrating pan. This type of vibratory finishing machine shall be operated in such manner than each section of pavement will receive at least one vibratory pass but not more than two passes, unless otherwise directed.

After the final pass of the finishing machine and when the concrete has started to dry, the surface of the pavement shall be finished with an approved longitudinal float. The float may be operated either manually or by mechanical means. The float may be either of wood or metal shall be straight and smooth and light in weight so as not to displace or sink into the concrete surface.

To be effective, the float shall be at least 300mm wide and 3m long. When manually operated, the float shall be moved from edge to edge with a wiping motion and advance one (1) meter or more.

The succeeding trip shall overlap the previous trip. A light smoothing lute at least 3 meters long may be used provided approved by the Engineer.

The surface of the pavement shall be tested by the Contractor, before the final belting, with an approved standard straightedge 3 meter in length. Irregularities so detected shall be corrected immediately. Special attention shall be given to the concrete adjacent to transverse joints to insure that the edges thereof are not above the grade specified or the adjacent concrete below grade. All depressions or projections shall be corrected before any initial set has developed in the concrete.

After the concrete has been brought to the required grade, contour and smoothness, it shall be finished by passing over the concrete a drag of one or two burlap clothes, which give the surface the required roughness. The vehicles used to carry these cloths may be independent of the concrete-laying machine or may be incorporated with it and may be operated either by hand or mechanically.

Hand finishing will be permitted only on variable width sections of the pavement and other places where the use of the finishing machine would be impractical. Hand finishing shall be accomplished by means of the hand-operated strike-off template of either steel or steel-shod wood construction. The striking template shall be operated forward with a combined longitudinal and transverse motion and shall be so manipulated that neither end will be raised off the side forms. A similar tamper shall be used for tamping the concrete.

As soon as the concrete has attained its initial set, the edges of the pavement, the longitudinal joints, the construction dummy and expansion joints not sawn shall be carefully finished with an edging tool having radius of at least 5mm. The tools, the special accessories for cutting impressed joints and methods of workmanship shall be such as will produce a joint whose edges are of the same quality of concrete as the other portion of the pavement. Methods and workmanship which make use of excess mortar or grout in this area shall be eliminated. Unnecessary tool marks shall be eliminated during work, and the edges left smooth and true to line.

Striking Forms

Forms shall remain in place at least 12 hours after the concrete has been placed. When working conditions are such that the early strength gain of the concrete is delayed, the forms shall remain in place for a longer period, as directed by the Engineer. Bars or heavy load shall not be used against the concrete when still in the forms. Any damage to concrete resulting from form removal shall be repaired promptly by the Contractor as directed by the Engineer without any additional payment to the Contractor.

Curing Concrete

Unless otherwise ordered by the Engineer, curing of concrete shall be done by any method specified in the Section "Reinforced Concrete".

Cleaning and Sealing Joints

After completion of the required curing and before opening of the pavement to traffic, all joints shall be thoroughly cleaned of all concrete aggregate fragments or other materials.

After removal of side forms, the ends at transverse expansion joints at the edges of the pavement shall be carefully cleaned of any concrete within the expansion spaces for the entire depth of slab, care being taken not to injure the ends of the joints. Expansion and contraction joints shall then be poured with a hot joint sealer to the depth as indicated on the Drawings. Joint sealer shall be poured using approved hand pouring pots, with liquid at a temperature not less than that recommended by the approved manufacturer.

Opening to Traffic

The pavement shall be closed to traffic, including the vehicles of the Contractor, for a period of 10 days after the concrete is placed or longer if in the opinion of the Engineer, the weather conditions make it necessary to extend this time. The Contractor shall furnish, place and maintain satisfactory barricades and lights as directed, to exclude all traffic from the pavement.

Any damage to the pavement due to traffic shall be repaired or replaced at the expense of the Contractor. Paving mixers, mechanical concrete spreaders and finishers and other heavy paving equipment shall not be operated on completed concrete lanes in order to construct alternate lanes until after the regular curing period is completed. Even then, planks shall be laid on the finished pavement or other precautions taken to prevent damage to the concrete pavement.

Pavement Smoothness, Thickness and Tolerance

Portland cement concrete pavement shall be constructed to the designed level and transverse slope shown on the Drawing. The allowable tolerance shall be as listed hereunder:

1.	Permitted variation from design thickness of layer	+- 5mm
2.	Permitted variation from design level of surface	+- 5mm

The thickness of the pavement will be determined by measurement of cores from the completed pavement in accordance with AASHTO T 148.

The completed pavement shall be accepted on a lot basis. A lot shall be considered as 2,500 sq.m of pavement. The last unit in each slab constitutes a lot in itself when its length is at least ½ of the normal lot length. If the length of the last unit is shorter than ½ of the normal lot length, it shall be included in the previous lot.

Other areas such as intersections, entrances, crossovers, ramp, etc., will be grouped together to form a lot. Small irregular areas may be included with other unit areas to form a lot.

ITEM 12 : STEEL AND METAL WORKS

GENERAL

General Requirements contain provisions and requirements essential to these specifications; and apply to this Section, whether or not referred to herein.

SCOPE OF WORK

The work includes the furnishing of all labor, materials, equipment and other incidentals necessary for the fabrication and installation of structural steel and miscellaneous metal works as specified in relevant items of these specifications and as indicated on the drawings.

SUBMITTAL

1. Before placing orders for materials for the steel and metal works, the Contractor shall submit to the Engineer for approval shop drawings for all steelwork. All project shop drawings shall show the dimension of all parts, method of construction, bolts, welding sectional areas and other details.

2. The detail of connections shown on the shop drawings shall be such as to minimize formation of pockets to hold condensation, water or dirt. A minimum gap between abutting angles and the like shall be provided wherever possible to eliminate any traps and facilitate maintenance painting.

3. No materials shall be ordered nor fabrication commenced until the shop drawings are approved by the Engineer.

STORAGE OF MATERIALS

Structural materials, either plain or fabricated, shall be stored above the ground upon platforms, skids, or other supports. Materials shall be kept free from dirt, grease, and other foreign matter and shall be protected from corrosion.

MATERIAL REQUIREMENTS

1. Unless specified herein all steel structures and metals shall conform with the requirements of "Steel and Metal Works." Connections where details are not specified or indicated herein, shall be designed in accordance with the American Institute of Steel Construction (AISC), Manual of Steel Construction, latest edition.

2. Structural steel works consisting of channels, gusset plates and other structural steel shape shall be as indicated on the drawings and shall be structural carbon steel conforming to ASTM A 36. Shapes shall be as given in AISC, Manual of Steel Construction.

3. High strength structural bolts, shall conform to ASTM A 325, Types 1 or 2. Nuts shall conform to ASTM A 560, Grade A, heavy hex style, except nuts 38 mm (1-1/2 inch) may be provided in hex style. Washers shall conform to ANSI B 18.22.1, Type B.

4. Electrodes for arc welding shall be E70 series conforming to American Welding Society Specifications A5.1.

5. Tests are required under the ASTM Standards for steel to be used in the Works and shall be carried out in the presence of the Engineer and at least four (4) days notice must be given to him of the dates proposed for such tests. Four (4) calendar days notice on which fabricated steelwork will be ready for inspection in the Contractor's yard.

6. Standard bolt shall conform to ASTM A 307 Carbon Steel Externally Threaded Standard Fasteners.

EXECUTION

QUALIFICATION

Qualification of steel fabricators, erectors and welders shall comply with the requirements.

FABRICATION REQUIREMENTS

1. Workmanship

   Fabrication shall be performed within the permissible tolerance by the approved fabricator. All workmanship shall be of the best quality with respect to internationally recognized standards of practice.

2. Cutting

   Low-carbon structural steel may be cut by machine-guided torch instead of by shears or saw. Harmful notches, burrs, irregularities, etc., shall not be developed at the cut surface.

3. Contact Faces

   Contact surfaces between bases or other elements bearing directly upon bearing plates shall be ground or milled as necessary for full effective bearing. Edges for welding shall likewise be properly prepared.

4. Bolt Holes

   Bolt holes shall be according to engineering practice and as specified in these specifications. Gas burning of holes will not be permitted.

5. High Strength Bolt Assembly Preparation

   Surfaces of high strength bolted parts in contact with bolt heads and nuts shall not have a slope of more than 1:20 with respect to a plane normal to the bolt axis.

   Where the surface of a high strength bolted part has a slope of more than 1:20, a beveled washer shall be used to compensate for lack of parallelism.

   High strength bolted parts shall fit solidly together when assembled and shall not be separated by gaskets or any other interposed compressible materials.

   When assembled, all joint surfaces including those adjacent to washers shall be free of scale except tight mill scale, and shall be free from dirt, loose scale, burrs, and other defects that would prevent solid seating of parts.

   Contact surfaces of friction-type joints shall be free from oil, paint, lacquer or galvanizing.

6. Welding

   All welding shall be done only by welders certified as to their ability to perform in accordance with accepted testing requirement.

Welding of parts shall be in accordance with structural standards and the Standard Code for Arc and Gas Welding in Building Construction of AWS, and shall only be done where shown, specified, or permitted by the Engineer.

Damage to galvanized areas by welding shall be thoroughly cleaned with wire brushing and all traces of welding flux and loose or cracked zinc coating shall be removed prior to painting. The cleaned area shall be painted with two coats of zinc oxide-zinc dust paint. The paint shall be properly compounded with a suitable vehicle in the ratio of one part zinc oxide to four parts zinc dust by weight. As an alternative to the above, the Contractor may submit for approval the use of a galvanizing rod or galvanizing solder to repair damaged areas.

The welding machine shall be a stable welder, and have suitable functions for the dimension of materials to be welded. The auxiliary tools used for welding shall perform sufficiently and adequately.

The welding machine used for field welding shall be of readily adjustable for electric current.

7. Shop Assembly

Structural units furnished shall be assembled in the shop. An inspection shall be made to determine that the fabrication and the matching of the component parts are correct.

Jigs shall be used for the assembly of units as much as possible to maintain appropriate position of mutual materials.

Approval of the Engineer shall be required when drilling temporary bolt holes or welding temporary support to the assembled structure.

The tolerances shall not exceed those allowed by codes and each unit assembled shall be closely checked to insure that all necessary clearances have been provided and that binding does not occur in any moving part.

In order to maintain accurate finished dimensions and shape, appropriate reverse strain or restraint shall be provided as required. Assembly and disassembly work shall be performed in the presence of the Engineer, unless waived in writing by the Engineer any errors or defects disclosed shall be immediately remedied by the Contractor.

Before disassembly for shipment, component parts of the structures shall be match marked to facilitate erection in the field.

FABRICATION TOLERANCES

1. Dimensional Tolerances for Structural Work

Dimensions shall be measured by means of an approved calibrated steel tape at the time of inspection. Unevenness of plate work shall not exceed the limitation of the standard mill practice as specified in the American Institute of Steel Construction, "Manual of Steel Construction".

2. Camber

Reverse camber in any structural steel members in excess of 1/1,000 of the span length shall cause rejection. The minimum dead load camber for any structural steel member shall be as allowed by Code, or otherwise specified.

INSPECTION AND TEST OF WELDING

1. Inspection of Welding

Inspection of welding shall be executed for the following work phases.

a. Before Welding

Scum, angle of bevel, root clearance, cleaning of surface to be welded, quality of end tab, drying of welding rod.

b. During Welding

Welding procedure, diameter of coil and wire, type of flux, welding current and voltage, welding speed, welding rod position, length of arc, melting, cleaning of slag of each level under surface chapping, supervision of welding rod.

c. After Execution of Welding

Assurance of bead surface, existence of harmful defects, treatment of crater, quality of slag removal, size of fillet, dimension of extra fill of butt welding, treatment of end tab.

2. Testing of Welding

Twenty percent (20%) of welds contributing in the overall strength of the structure and which will be inaccessible for the inspection in service shall be tested.

Welding shall be tested by ultrasonic test to the extent specified herein or as directed by the Engineer.

Where partial inspection is required, the ultrasonic test shall be located at random on the welds so as to indicate typical welding quality.

If ten percent (10%) of the random ultrasonic tested indicate unacceptable defect, the remaining eighty percent (80%) of the welding shall be tested. Repair welding required shall be ultrasonic tested after the repairs are made.

CORRECTIONS

In lieu of the rejection of an entire piece or member containing welding which is unsatisfactory or which indicates inferior workmanship, corrective measures may be permitted by the Engineer whose specific approval shall be obtained for making each correction. Defective or unsound welds or base steel shall be corrected either by removing and replacing the entire weld, or as follows.

1. Excessive convexity or overlap shall be reduced by grinding.

2. Undercuts, lack of weld shall be repaired with necessary reinforcement of weld after removal of any foreign materials such as slag, dust, oil, etc.

3. Any defects such as slag inclusions, incomplete fusion, or inadequate joint penetration, shall be completely removed, cleaned and re-welded.

4. Cracks in welds or base steel, shall be removed to sound steel throughout their length and 5cm beyond each end of the crack, followed by welding. The extent of the crack, depth and length, shall be ascertained by the use of acid etching, magnetic particle

inspection or other equally positive means.

The removal of welded steel shall be done by chipping, grinding, oxygen cutting, oxygen gouging, or air carbon arc gouging and in such a manner that the remaining welded steel or base steel is not nicked or undercut. Defective portions of the welding shall be removed without substantial removal of the base steel.

INSTALLATION

1. Installation Program

   a. Prerequisite Condition

      Prior to executing steel fabrication and field installation, the Contractor shall prepare a comprehensive installation program including engineering supervision organization, fabrication procedures, field installation procedures, material application, machinery applications, inspection procedure, scope and standard of quality judgment, and submit to the Engineer for approval.

   b. Special Technical Engineering

      Special technical engineering different from contract specifications can be applied upon receiving approval of the Engineer.

2. Installation Requirement

   a. Setting of Anchor Bolt and Others

      a. 1. Anchor bolts shall be set in accurate position by using templates.

      a. 2. The setting method shall be proposed to the Engineer for his approval before setting starts.

      a. 3. The threads of bolt shall be cured with an appropriate method against rust and/or any damage before tightening.

      a. 4. Non-shrink mortar shall be placed under base plates, well cured to obtain the sufficient strength before bearing loads are applied to base plates.

   b. Temporary Bracing

      b. 1. Temporary bracing shall be installed as necessary to stay assemblies and assume loads against forces due to transport, erection operations or other work.

      b. 2. Temporary bracing shall be maintained in place until permanent work is properly connected and other construction installed as necessary for support, bracing or staying of permanent work.

      b. 3. Extent and quality of temporary bracing shall be as necessary against wind and other loads, including seismic loads not less than those for which the permanent structure is designed to resist.

   c. Adequacy of Temporary Connections

      During erection, temporary connection work shall be securely made by bolting and/or

welding for all dead load, wind and erection stresses.

d. Alignment

No permanent bolting or welding shall be done until the alignment of all parts with respect to each other shall be true within the respective tolerances required.

e. Field Welding

e. 1. Any shop paint or surfaces adjacent to joints where field welding is to be executed shall be wire brushed to remove paint/primer.

e. 2. Field welding shall conform to the requirements specified herein, except as approved by the Engineer.

f. High Strength Bolts

Final tightening of high strength bolts shall be done by using manufacturer's power operated equipment without any overstress to the threads.

g. Correction of Errors

g. 1. Corrections of minor misfits by use of drift pins, and reaming, chipping or cutting will be permitted and shall be provided as part of erection work.

g. 2. Any errors to be corrected or adjusted, preventing proper assembly, shall be immediately reported to the Engineer, and such corrections or adjustments shall be made as necessary and approved by the Engineer.

g. 3. Cutting or alterations other than as approved will not be permitted.

h. Erection

h. 1. Erection and installation shall be as per approved shop drawings.

h. 2. Each structural unit shall be accurately aligned by the use of steel shims, or other approved methods so that no binding in any moving parts or distortion of any members occurs before it is finally fastened in place.

h. 3. Operations, procedures of erection and bracing shall not cause any damage to works previously placed nor make overstress to any of the building parts or components. Damage caused by such operations shall be repaired as directed by the Engineer at no extra cost to the Employer.

GALVANIZING

PREPARATION

All mild steel parts exposed to weather shall be hot-dipped galvanized after fabrication in accordance with the requirements of ASTM A 123 or ASTM A 153. Prior to galvanizing, the surfaces shall be cleaned of dirt, weld splatter, grease, slag, oil, paint or other deleterious matters. The steel surfaces shall be chemically de-scaled and cleaned with the same abrasive blast or other suitable method as approved by the Engineer.

COATING

The zinc coating shall consist of uniform layers of commercially pure zinc free from abrasions, cracks blisters, chemical spots or other imperfections, and shall adhere firmly to the surface of the steel. The weight of zinc coating per square meter of actual surface shall not be less than 550 grams. Any surface damaged subsequent to galvanizing shall be given two coats of approved zinc rich paints.

PAINTING

This work shall consist of the preparation of the metal surfaces, the application, protection and drying of the painted surfaces, and supplying of all tools, tackle, scaffolding, labor and materials necessary for the entire work. Painting shall be applied in the field or shop as approved by the Engineer.

Unless otherwise specified or approved, all painting work for structural steel shall comply with the requirements of this Section.

SHOP PAINTING

All structural steel shall be given a shop primer after fabrication and cleaning before delivery to the site.

All steel work shall be thoroughly dried and cleaned of all loose mill scale, rust and foreign matters by means of sand blasting or other suitable methods approved by the Engineer before shop painting shall be applied. Each individual piece shall be painted prior to assembly. Portions where
field welding or field contact with concrete is required shall not be painted.

Except for galvanized surfaces and items to be encased in concrete, clean ferrous metal surfaces shall be given one coat of Amerlock 400 Epoxy Primer at 100 Microns or approved equal. Additional coat shall be applied to surfaces that will be concealed or inaccessible for finish painting by Amerlock 400, Top Coat at 150 Microns with color or equivalent.

FIELD PAINTING

After erection, the Contractor shall thoroughly prepare and clean the entire surface of all structural steel from all dirt, grease, rust or other foreign matters. The entire surface of all members shall then be field painted.

MATERIALS

1. Structural Steel Work

    a. After surface preparation, steelwork shall be given one coat of approved prefabricating primer.

    b. Before final assembly of steelwork at the fabricator's shop, two shop coats of special red lead primer shall be applied to the surface of sections to be in permanent contact, meeting faces and all other concealed surfaces. After final assembly, but before delivery to the project site, the steelwork shall likewise be given two shop coats of special red lead primer.

2. Galvanized Steelwork

    All galvanized steelwork shall be treated with zinc chromate two-pack etch primer followed by

one coat of non-etch zinc chromate primer.

3. Miscellaneous Metal Work

Unless otherwise specified in other Sections of the Specifications or shown on the drawing, miscellaneous metal works such as ladders, structural steel ladder rungs, etc. shall be given two shop coats of epoxy primer and two coats of epoxy enamel.

CONSTRUCTION METHODS

1. Cleaning of Surfaces

Surfaces of metal to be painted shall be thoroughly cleaned; removing rust, loose mill scale, dirt, oil or grease, and other foreign substances. Unless cleaning is to be done by sand blasting, all weld areas, before cleaning is started, shall be neutralized with a proper chemical, after which they shall be thoroughly rinsed with water.

Three methods of cleaning are provided herein. The particular method to be used shall be as directed by the Engineer.

2. Hand Cleaning

The removal of rust, scale, and dirt shall be done by the use of metal brushes, scrapers, chisels, hammers or other effective means. Oil and grease shall be removed by the use of gasoline or benzene.

Bristle or wood fiber brushes shall be used for removing loose dirt.

3. Sandblasting

All steel shall be cleaned by sandblasting. The sandblasting shall remove all loose mill scale and other substances. Special attention shall be given to cleaning of corners and re-entrant angles. Before painting, sand adhering to the steel in corners and elsewhere shall be removed. The cleaning shall be approved by the Engineer prior to any painting which shall be done as soon as possible before rust forms.

4. Flame Cleaning

All metal, except surface inside boxed members and other surfaces which shall be inaccessible to the flame cleaning operation after the member is assembled, shall be flame cleaned in accordance with the following operations.

a. Oil, grease, and similar adherent matter shall be removed by washing with a suitable solvent. Excess solvent shall be wiped from the work before processing with subsequent operations.

b. The surface to be painted shall be cleaned and dehydrated (free from occluded moisture) by the passage of oxyacetylene flames which have an oxygen to acetylene ratio of at least 1.0. The oxyacetylene flames shall be applied to the surfaces of the steel in such a manner and at such speed that the surfaces are dehydrated; dirt, rust loose scale in the form of blisters or scabs, and similar foreign matters are freed by the rapid, intense heating by the flames. The number arrangement and manipulation of the flames shall be such that all parts of the surfaces to be painted are adequately cleaned and dehydrated.

c. Promptly after the application of the flames, the surfaces of the steel shall be wire

brushed, hand scraped wherever necessary, and then swept and dusted to remove all free materials and foreign particles.

d. Paint shall be applied promptly after the steel has been cleaned and while the temperature of the steel is still above that of the surrounding atmosphere.

5. Weather Conditions

a. Exterior Coatings

Coatings to surface shall not be applied during foggy or rainy weather, or under the following surface temperature conditions: below 4°C, or over 35°C, unless approved by the Engineer.

b. Interior Coatings

Coatings shall be applied when surfaces to be painted are dry and the following surface temperatures can be maintained: between 18 to 35°C during the application.

6. Application

a. Paint shall be factory tinted and mixed. All paint shall be field mixed before applying in order to keep the pigments in uniform suspension.

b. Field Painting

When the erection work is complete, including all bolting and straightening of bent metal, all adhering rust, scale, dirt, grease or other foreign materials shall be removed as specified above.

As soon as the Engineer has examined and approved each steel and metal works structures, all field bolts, all welds, and any surfaces from which the top or first coat of paint has become worn off, or has otherwise come defective shall be cleaned and thoroughly covered with one coat of paint.

Surfaces to be bolted and surfaces which shall be in contact with concrete, shall not be painted. Surfaces which shall be inaccessible after erection shall be painted with such field coats as are required. When the paint applied for retouching the shop coat has thoroughly dried, and the field cleaning has been satisfactorily completed, such field coats as are required shall be applied. In no case shall a succeeding coat be applied until the previous coat is dry throughout the full thickness of the paint film. All small cracks and cavities which were not sealed in a watertight manner by the first field coat shall be filled with a pasty mixture of red lead and linseed oil before the second coat is applied.

The following provision shall apply to the application of both coats. To secure a maximum coating on edges of plates or shapes, bolt heads and other parts subjected to special wear and attack, the edges shall first be striped with a longitudinal motion and the bolt heads with a rotary motion of the brush, followed immediately by the general painting of the whole surface, including the edges and bolt heads.

The application of the second field coat shall be deferred until adjoining concrete work has been placed and finished. If concreting operations have damaged the paint, the surface shall be re-cleaned and repainted.

c. General Manners

Painting shall be done in a neat and workmanlike manner. Paint may be applied with hand brushes or be spraying, except aluminum paint which preferably shall be applied by spraying. By either method the coating of paint applied shall be smoothly and uniformly spread so that no excess paint shall collect at any point. If the work done by spraying is not satisfactory to the Engineer hand brushing shall be required.

d. Brushing

When brushes are used, the paint shall be so manipulated under the brush as to produce a smooth, uniform, even coating in close contact with the metal or with previously applied paint, and shall be worked into all corners and crevices.

e. Spraying

Power spraying equipment shall be used to apply the paint in a fine spray. Without the addition of any paint, the sprayed area shall be immediately followed by brushing, when necessary, to secure uniform coverage and to eliminate wrinkling, blistering and air holes.

f. Removal of Paint

If the painting is unsatisfactory to the Engineer the paint shall be removed and the metal thoroughly cleaned and repainted.

ITEM 13 : MASONRY WORKS

GENERAL

General Requirements contain provisions and requirements essential to these Specifications and apply to this Section, whether or not referred to herein.

SCOPE OF WORK

This Section includes the furnishing of all labor and materials to complete the work as shown on the drawings and specified herein. The works shall include but not necessarily be limited to the following:

1. Supply and installation of concrete hollow block (CHB) walls with reinforcement

2. Plastering

3. Installing temporary works like scaffolding, platforms, steps, etc.

GENERAL PROVISIONS

The following publications of the issues below but referred to thereafter by basic designation only form a part of these specifications to the extent indicated by the reference thereto:

American Society for Testing and Materials (ASTM) Publications:

A 615 Deformed and Plain Billet-Steel Bars for Concrete Reinforcement

A 33 Concrete Aggregates

C 129 Specification for Non-Load Bearing Concrete Masonry Units C

144 Specification for Aggregate for Masonry Mortar

C 270 Mortar for Unit Masonry

MATERIAL REQUIREMENTS

Materials shall conform to the respective specifications and other requirements specified below

CONCRETE HOLLOW BLOCKS (CHB)

CHB shall be of standard manufacture, machine vibrated with fine and even texture and well-defined edges and conforming with the requirements of ASTM C 129. Unless otherwise specified on the Drawings, It shall have a minimum compressive strength of 4.14 MPa (600 psi). CHB shall be non-load bearing uniform and essentially smooth as normally achieves by standard molding methods and shall be free from any cracks, flaws or other defects.

BEDDING MORTAR

Mortar shall be composed of 1 part of Portland cement, 3 parts of sand and ½ part of lime. It shall have a compressive strength of [14 MPa (2,000 psi)] at 28 days and shall comply with property specifications for type N mortar set forth in ASTM Specification C 270 and as modified herein, proportioned and tested in an approved laboratory at the expense of the Contractor. When tested for water retention, the mortar shall have a flow after suction, of 75 percent or more when mixed to

an initial flow of 125 to 140 percent. When tested for compressive strength, mortar shall be mixed to a flow of 100 to 115 percent. Aggregate for mortar shall conform to ASTM C 144.

PLASTER

Plaster shall comply with the same specification as those for bedding mortar and will include the use of synthetic fibrous reinforcement of type and dosage recommended by the manufacturer.

REINFORCING STEEL BARS AND RODS

Minimum yield strength of reinforcement shall conform with the specifications in Section of Reinforced Concrete.

SAMPLES AND TESTING

1. The following shall be submitted for approval and in addition, representative samples shall be taken periodically from on-the-site stockpiles as required for testing or checking during the progress of the work.

Anchors and ties	:	Two of each type proposed for use
Concrete Hollow Blocks	:	Shapes, sizes and kinds in sufficient numbers to show full range of quality and texture.

2. Sampling and testing, unless otherwise specified, shall be performed by an approved independent commercial testing laboratory at the expense of the Contractor. Certified copies of laboratory test reports, including all test data, shall be submitted at least 10 days before delivery of the units or mortar materials represented by the tests to the project site.

3. Mortar shall be laboratory-proportioned and tested. Certified copies of approved laboratory-established proportions shall be submitted with the required test reports and test data. Approved laboratory-established proportions shall not be changed and materials with different physical or chemical characteristics shall not be used in mortar for the work unless additional evidence is furnished that the mortar meets the specified requirements.

EXECUTION

1. GENERAL

No unit having a film of water on its surface shall be laid. Masonry shall be laid plumb, true to line, with level courses accurately spaced. Bond pattern shall be kept plumb throughout. Corners and reveals shall be plumb and true. Vertical joints shall be shoved tight. Each unit shall be adjusted to final position while mortar is still soft and plastic. Any unit that is disturbed after mortar has stiffened shall be removed and relaid with fresh mortar. Courses shall be so spaced that backing masonry will level off, flush with the face work at all joints where ties occur. Chases and rake-out joints shall be kept free from mortar or other debris.

2. Anchorage to concrete. Anchorage to abutting columns shall be provided only where indicated. Details shall be as indicated including anchorage to underside of beams and slabs.

3. Cutting and fitting, including that required to accommodate the work of others shall be done by masonry mechanics. Wherever possible, full units of the proper size shall be used in lieu of cut units. Cut edges shall be clean, true and sharp. Openings shall be carefully cut, formed or otherwise neatly made for recessed items and for electrical, plumbing, or other mechanical installations so that wall plates, cover plates, or escutcheons required by the