LEGEND:


LOCATION OF PANEL BOARDS

EXISTING ELECTRICAL CABLE WIRES

Panel Board 175AT 3P Main (18 branches 2P); 1-75AT 2P; 4-15AT 2P;10-20AT 2P; 3-30AT 2P 42cm x 88cm x 10cm

Panel Board 175AT 3P Main (18 branches 2P); 6-20AT 2P; 12-30AT 2P 42cm x 88cm x 25cm

Panel Board 300AT, 3P Branches (2-175AT 3P) 60cm x 75cm x 25cm

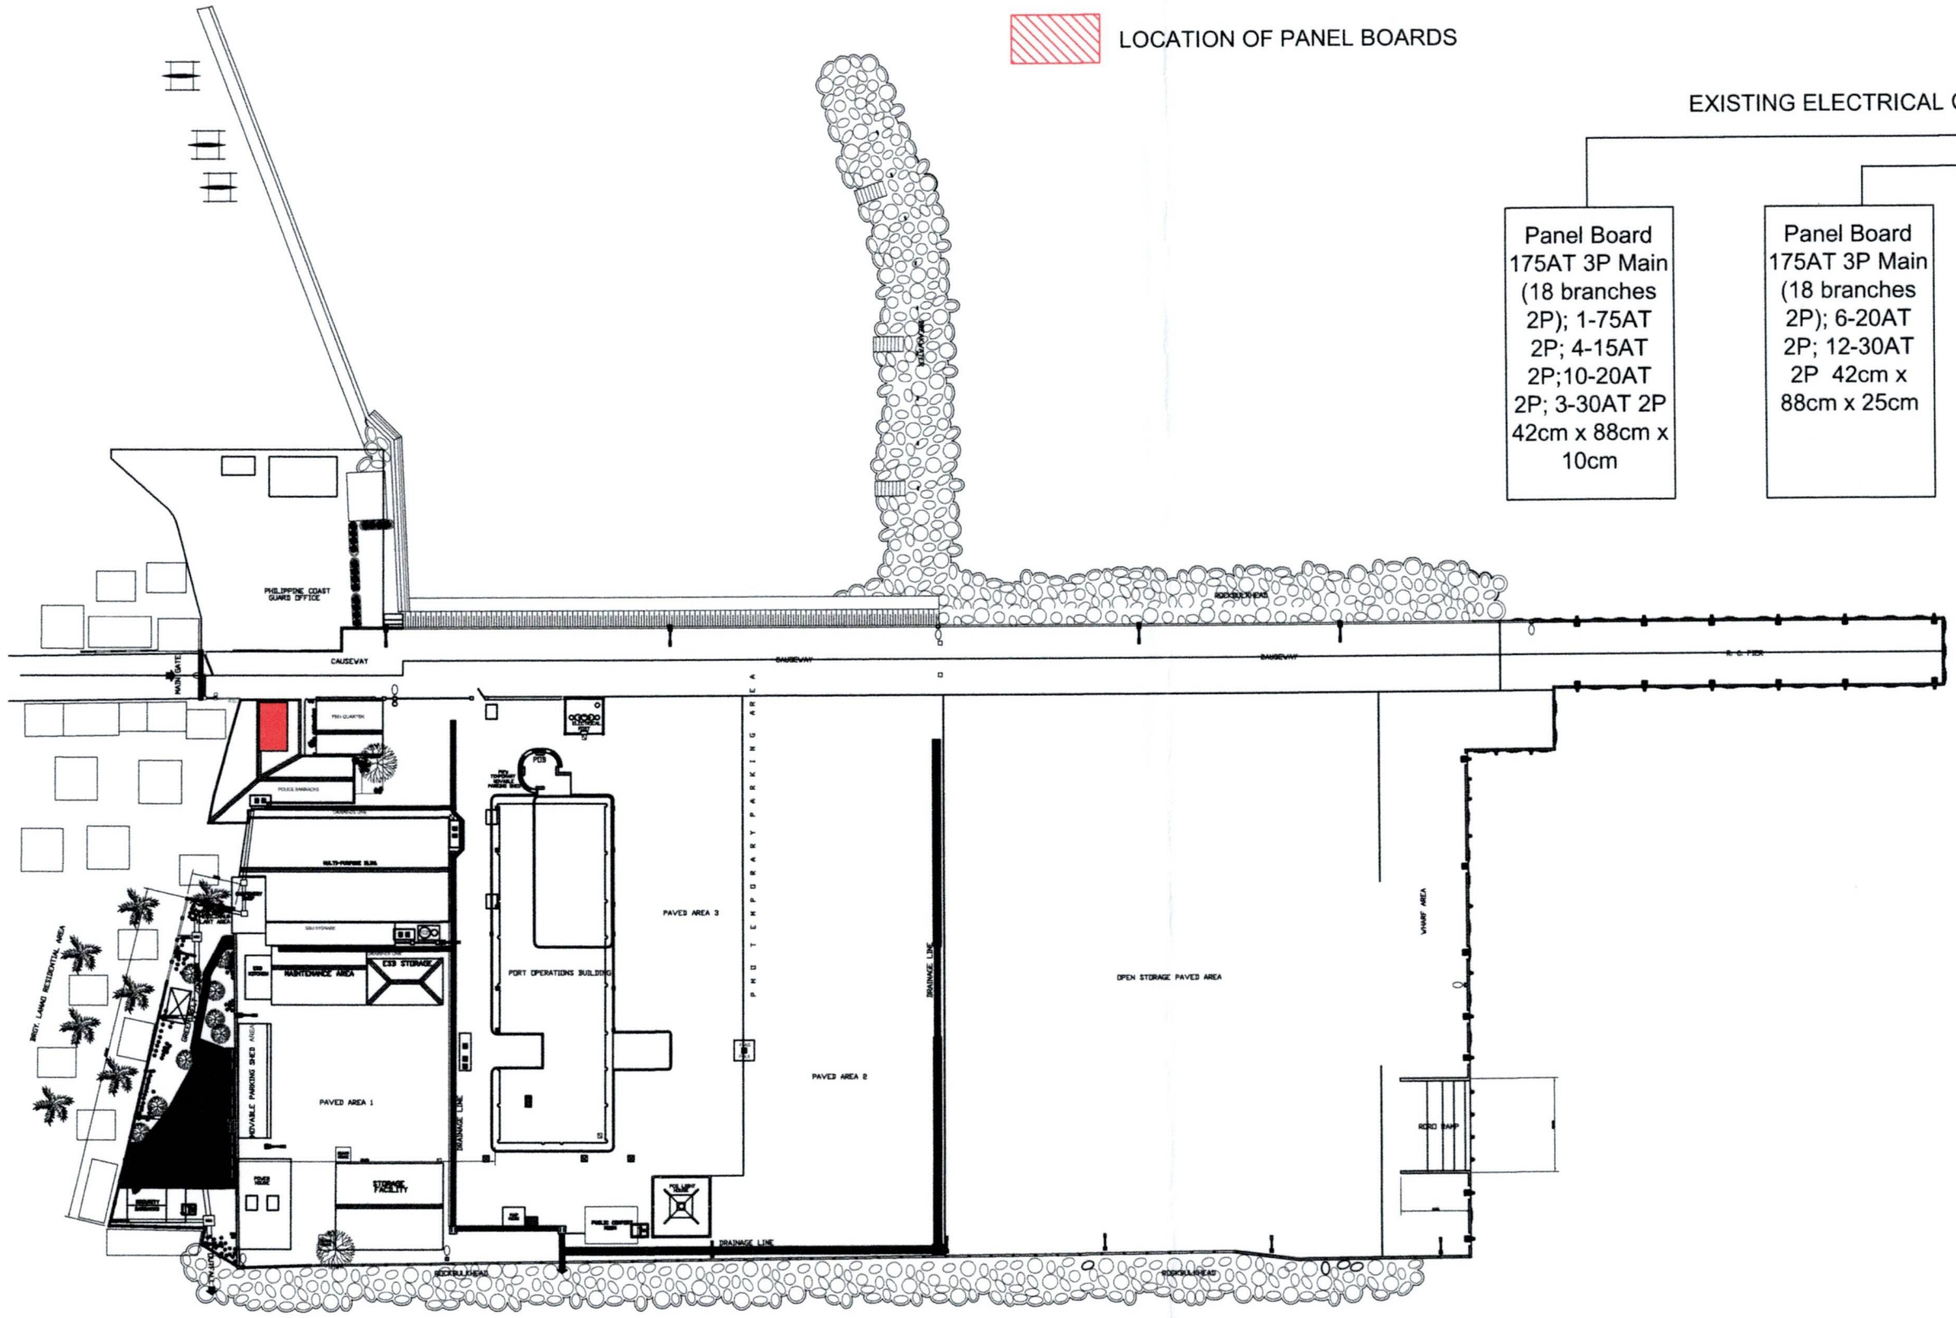

PHILIPPINE PORTS AUTHORITY PORT OF LAMAO BRGY. LAMAO, LIMAY, BATAAN	PROJECT TITLE: MAINTENANCE OF CORRODED PANEL BOARDS AND CIRCUIT BREAKERS OF PORT OF LAMAO BUILDINGS AT PORT OF LAMAO, LIMAY, BATAAN				DATE: MAY 2024
	PREPARED BY: **MAURICIO M. REYES II**, ENGINEER B, PMO-BATAAN/AURORA	CHECKED/REVIEWED BY: **EDGARDO B. ANDAYA JR**, SUPERVISING ENGINEER A, PMO-BATAAN/AURORA	RECOMMENDING APPROVAL: **ALBERT FRANCIS T. GOLES**, ACTING ESD MANAGER, PMO-BATAAN/AURORA	APPROVED BY: **JENNELIZA D. REBONG**, ACTING PORT MANAGER, PMO-BATAAN/AURORA	SHEET CONTENT: LOCATION PLAN DIMENSION: M SHEET No. 1 OF 1