

LEGEND:

--- 2 - 5.5mm2 Cu Wire @ $\frac{3}{4}$ " PVC Pipe Spliced inside of Lighting Pole (L = 342.44m)


FABRICATED CLAMP 2" FLAT BAR OR EQUIVALENT WITH BOLT AND NUT M10 (APPLICABLE TO (A))

EXISTING CONCRETE LIGHTING POST


2 - M10

PLAN

300W LED FLOOD LIGHT DAYLIGHT, 110LM/W 230Vac (To be tapped in the existing wire)

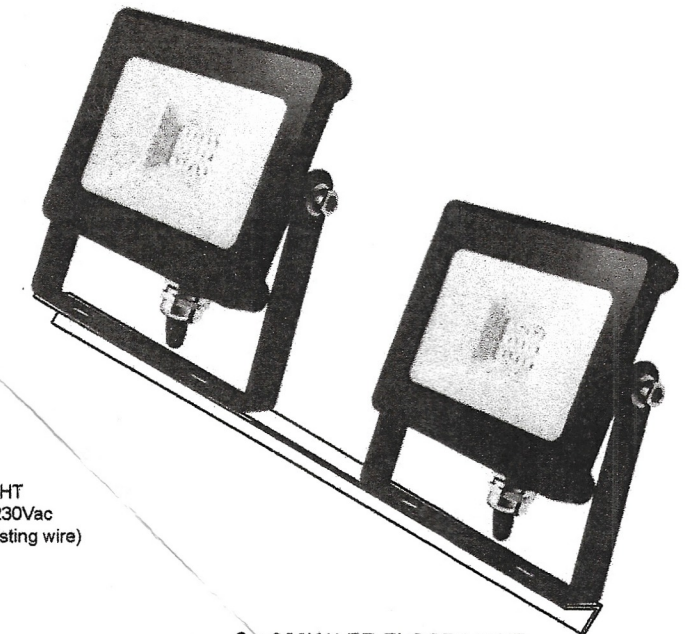

2 x 300W LED FLOOD LIGHT DAYLIGHT, 110LM/W 230Vac

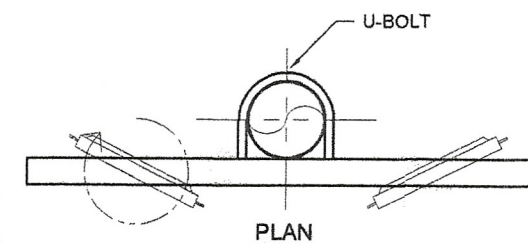

PLAN


EXISTING LIGHTING POLE

300W LED FLOOD LIGHT DAYLIGHT, 110LM/W 230Vac (To be tapped in the existing wire)



2 - M10

GALVANIZED LIGHTING BRACKET FOR TWO (2), (ANGLE BAR 2" or EQUIVALENT) FLOOD LIGHT WITH U-BOLT 2-1/2" ~ 3" (APPLICABLE TO (B), (C), (D), (E) AND (F))

ELEVATION

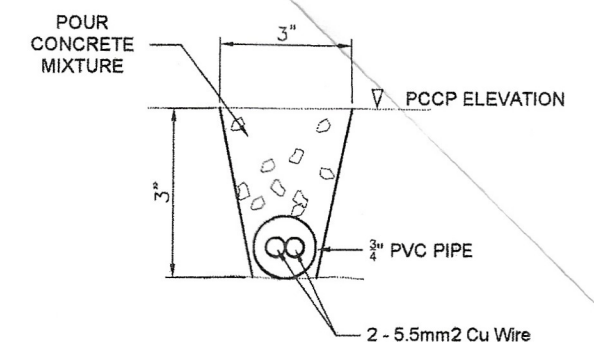

TYP. UNDERGROUND LINE

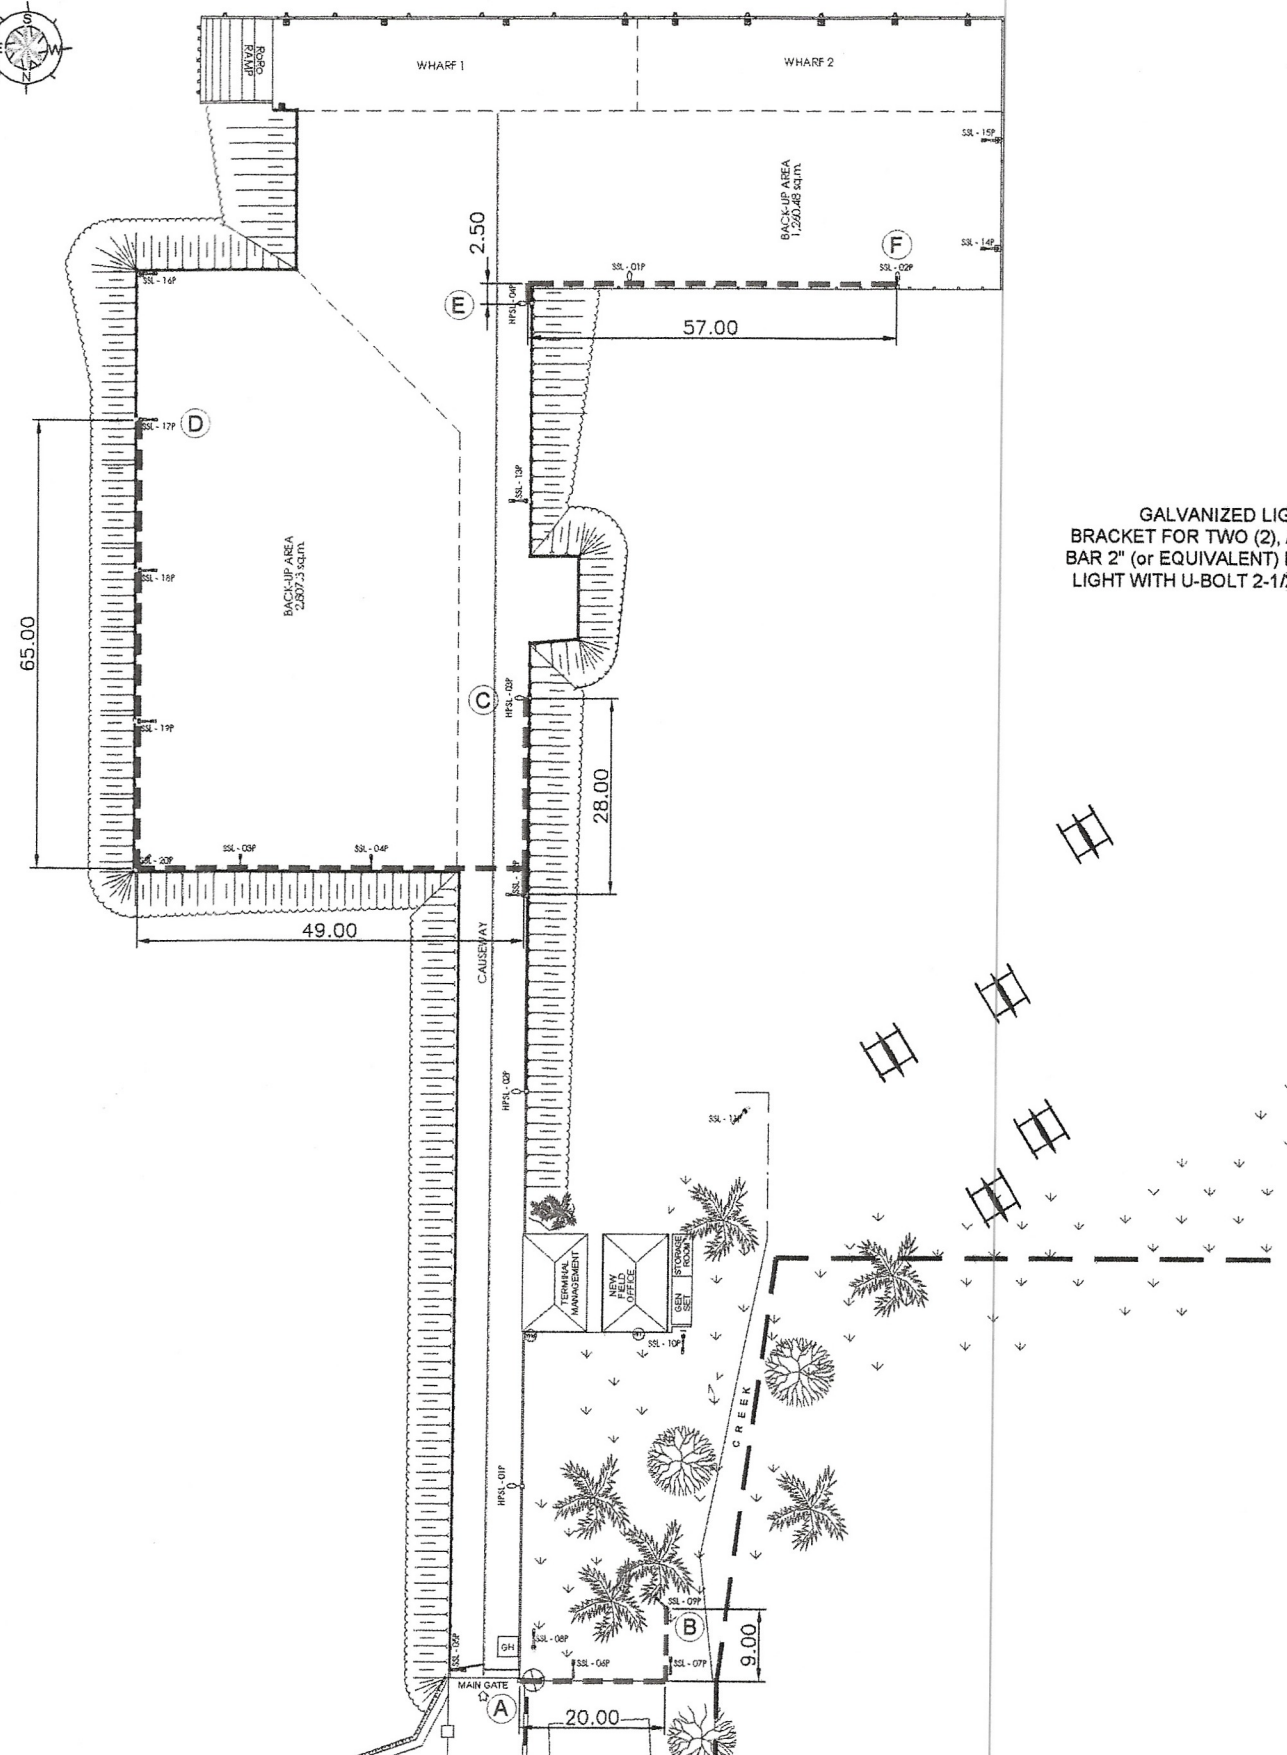

PROJECT TITLE:

MAINTENANCE OF PORT LIGHTING SYSTEM AT PORT OF CASIGURAN AURORA

DRAWN BY:

ROY R. TANAGON

ENG'G ASST A / CAD OPERATOR, PMO-BATAAN/AURORA

CHECKED BY:

EDGARDO B. ANDAYA JR.

SUPERVISING ENGINEER A, PMO-BATAAN/AURORA

RECOMMENDING APPROVAL:

ALBERT FRANCIS T. GOLES

ACTING ESD MANAGER, PMO-BATAAN/AURORA

APPROVED:

JON GABRIEL M. MANANSALA

ACTING PORT MANAGER, PMO-BATAAN/AURORA

SHEET CONTENT:

PORT OF CASIGURAN DEVELOPMENT PLAN
and PORT LIGHTING SYSTEM LAYOUT

DATE:

MAY 22, 2023

DIMENSION:

M

SHEET No.

1 of 1



PORT OF CASIGURAN
BRGY. DIBAONG, CASIGURAN, AURORA