

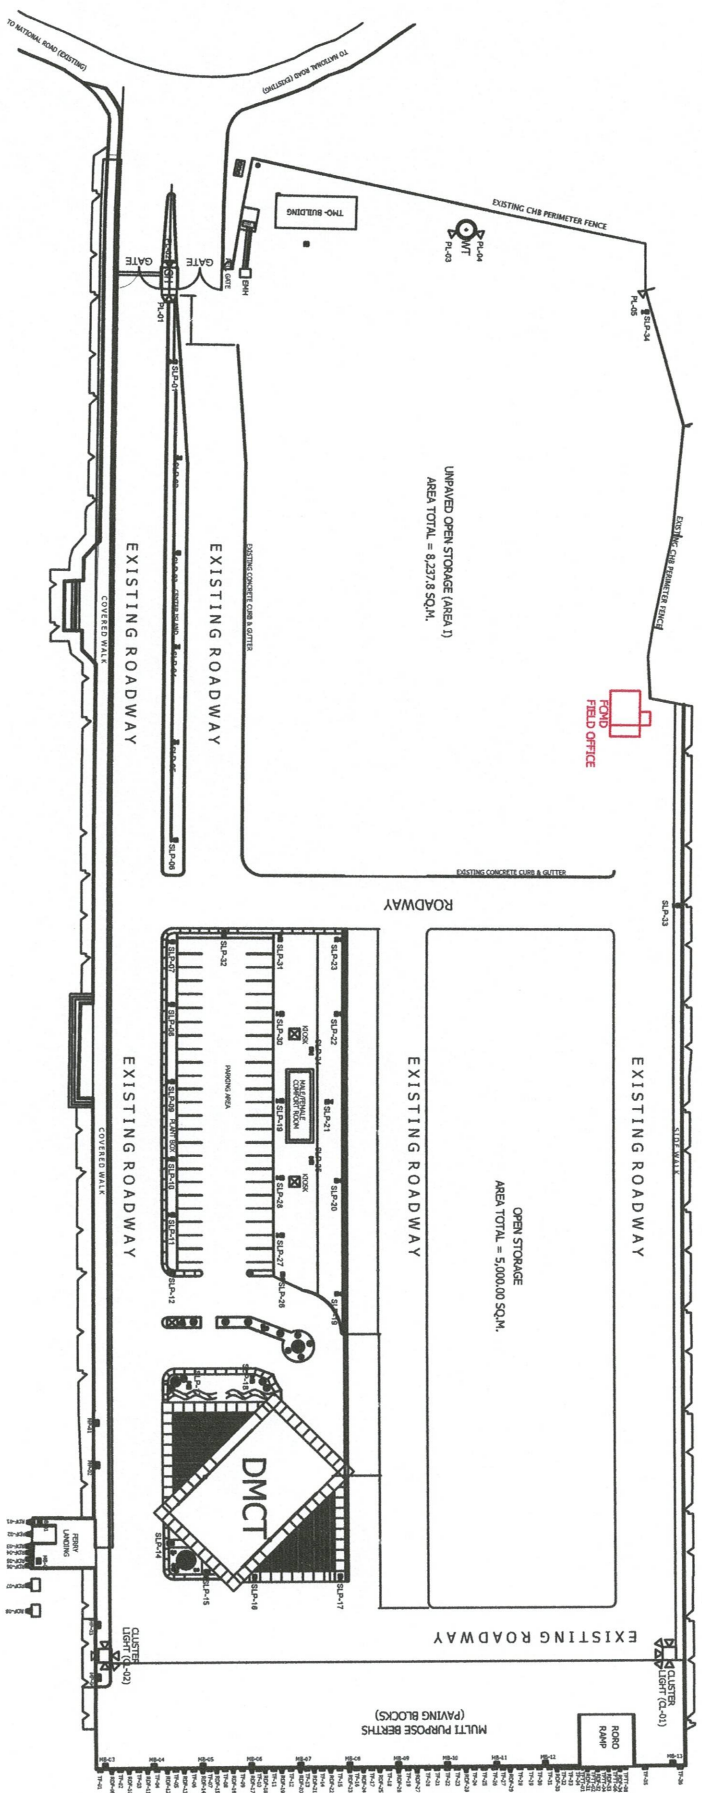


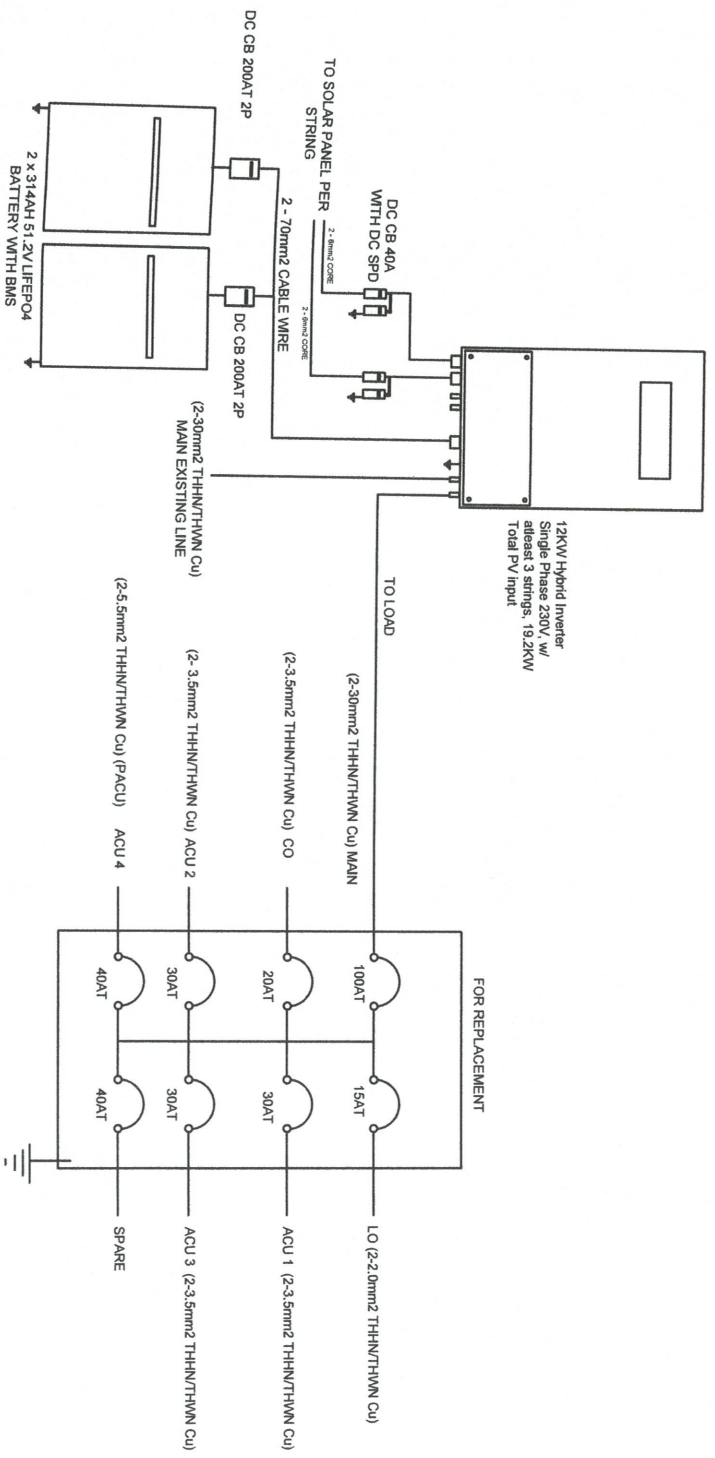

- I. OUTLETS (10), LIGHTING SWITCH (1P-5, 2P-3 ), WIRES AND LIGHTING FIXTURE (LED SQUARE SURFACE TYPE 20W - 10) FOR REPLACEMENT
- II. ALL SOLAR PANELS MUST BE BONDED (GROUNDED) TO EACH OTHER
- III. TOTAL OF 3 STRING OF PANELS (6 PANELS PER STRING).
- IV. ALL GROUND MUST BE CONNECTED TO THE GROUND ROD

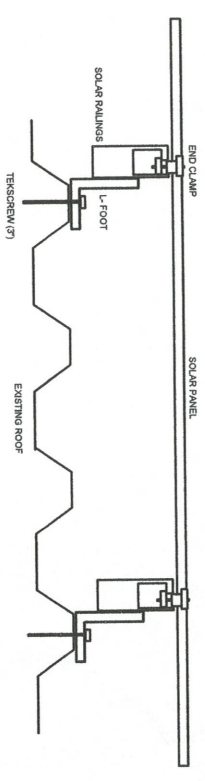

**DAVE HARVEY E. SIBAYAN**  
ENGINEER B PMO-BATAAN/AURORA

PREPARED BY:  
  
**DAVE HARVEY E. SIBAYAN**  
ENGINEER B PMO-BATAAN/AUORA

**EDGARDO B. ANDAYA JR.**  
SUPERVISING ENGINEER A, PMO-BATAAN/AURORA

CHECKED BY:   
**EDGARDO B. ANDAYA JR.**  
 SUPERVISING ENGINEER A, PMO-BATANA/UROR

VAL JONATHAN V. PINEDA

RECOMMENDING APPROVAL:  
VAL JONATHAN V. PINEDA  
ACTING ESD MANAGER, MO-BATANUA/ROR

**NIÑO PAOLO M. BISCOCHO**  
ACTING PORT MANAGER, PIMO-BATAAN/ALUPORA

APPROVED BY: 

**NIÑO PAOLO M. BISCOCHO**

ACTING PORT MANAGER, PMO-BATAAN/AURORA

AS SHOWN

**SHEET CONTENT:**

**AS SHOWN**

JAN 2026

---

1 OF 1