


GENERAL NOTES:

1. ALL ELECTRIC WORKS SHALL BE DONE IN ACCORDANCE WITH ALL THE PROVISIONS OF THE PHILIPPINE ELECTRICAL CODE PART 1, AND ALL THE REGULATIONS OF THE LOCAL AUTHORITY AND THE UTILITY COMPANY, WHICH ARE HEREBY MADE PART OF THE SPECIFICATIONS.
2. ALL MATERIALS SHALL BE NEW AND SHALL CONFORM WITH THE STANDARDS OF THE UNDERWRITER'S LABORATORY OR THE BUREAU OF PRODUCT STANDARDS.
3. THE WORK THROUGHOUT SHALL BE EXECUTED IN THE BEST AND THROUGH MANNER UNDER THE DIRECTION OF AID TO THE SATISFACTION OF THE OWNER OR THE SUPERVISING CIVIL ENGINEER OR THE IN-CHARGED ELECTRICAL ENGINEER. ALL WIRES UNLESS NOTED IN THE DRAWINGS OR THESE SPECIFICATIONS SHALL BE INSTALLED IN CONDUITS.
4. FLEXIBLE CONDUITS SHALL HAVE AN EXCELLENT RESISTANCE TO VIBRATION.
5. PVC CONDUITS SHALL BE INSTALLED IN SUCH MANNER AS NOT TO WEAKEN OR INTERFERE WITH THE STRUCTURE OF THE BUILDING, NO HORIZONTAL RUNS OF EMBEDDED CONDUITS OR TUBING SHALL BE PERMITTED IN SOLID WALL AND PARTITIONS.
6. THE SWITCHES FOR LIGHTING OUTLETS, CONVENIENCE OUTLETS AND BLANK PLATES SHALL BE APPROVED BY THE DESIGNING ENGINEER.
7. ALL WIRES SHALL BE CONTINUOUS FROM OUTLET TO OUTLET AND THERE SHALL BE NO SPLICE EXCEPT IN JUNCTIONS AND PULL BOXES.
8. ALL SWITCHES FOR LIGHTING OUTLETS SHALL BE INSTALLED 1.3 METERS ABOVE FLOOR LEVEL.
9. ALL CONVENIENCE OUTLETS SHALL BE INSTALLED 0.3 METER ABOVE FLOOR LINE EXCEPT OTHERWISE NEEDED TO BE INSTALLED IN A SPECIFIC LOCATION FOR ARCHITECTURAL PURPOSES.
10. THE FEEDER CONDUCTORS SUPPLY OUTDOOR LAMP POST AND OUTDOOR POWER OUTLET SHALL BE INSTALLED IN A SCHEDULE 40 ELECTRICAL UPVC AND THESE CONDUIT SHALL BE SECURELY LIQUID TIGHT, SHALL BE INCASED WITH CONCRETE AND SHALL BURIED NOT LESS THAN 100 mm FROM THE NATURAL GRADE LINE.
11. ALL OUTDOOR LAMP POST AND OUTDOOR POWER OUTLET SHALL BE EQUIPPED WITH GROUND FAULT CIRCUIT INTERRUPTER, ADAPTABILITY OF SUCH GFCI DURING ACTUAL CONSTRUCTION SHALL BE CONSULTED TO THE DESIGNING ENGINEER.
12. THE PANEL BOARD SHALL BE INSTALLED IN SUCH AWAY THAT THE MAIN CIRCUIT BREAKER SHALL BE 1.8 METERS ABOVE FLOOR LINE.
13. ALL CONVENIENCE OUTLETS, SWITCHES FOR LIGHTING OUTLETS AND PANEL BOARDS SHALL BE FLUSH MOUNTED TYPE EXCEPT OTHER WISE DEEMED NECESSARY TO BE FLUSHED MOUNTED DURING ACTUAL CONSTRUCTION.
14. ALL WORKS SHALL BE DONE UNDER THE SUPERVISION OF AN ELECTRICAL ENGINEER OR MASTER ELECTRICIAN.

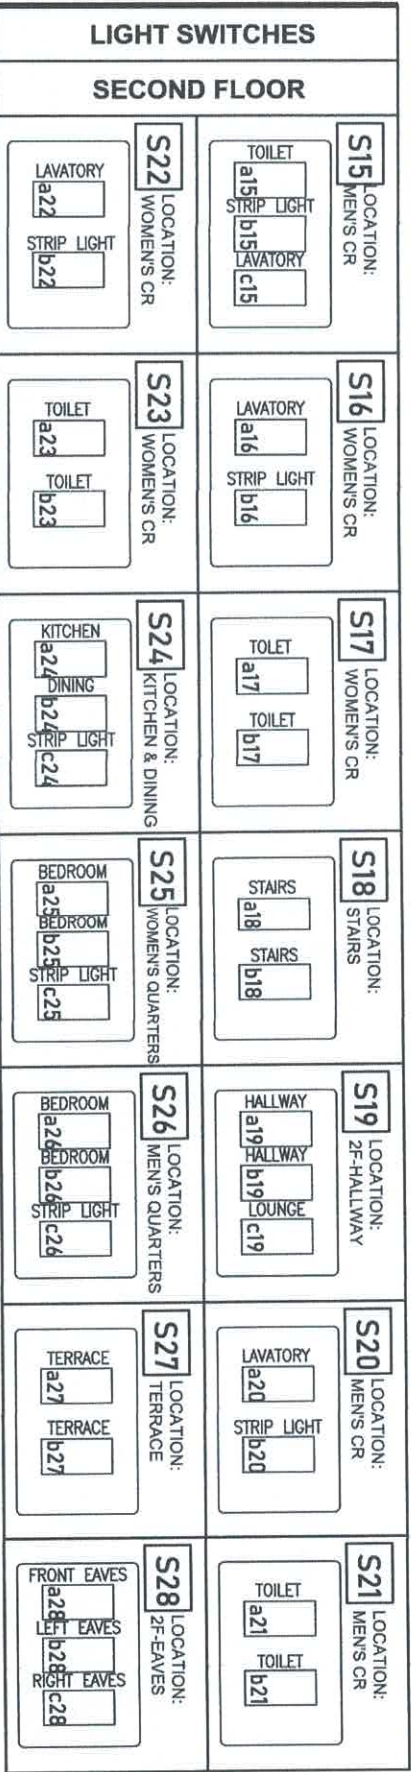

GENERAL NOTE | LIGHT SWITCHES

SPECIFICATIONS:
METALLIC GRAY COLOR, SOFT SWITCH WITH
QUICK CONNECT TERMINALS



PROJECT TITLE	EMERGENCY MAINTENANCE OF ROOFING, CEILING AND ELECTRICAL SYSTEM AT TMO BUILDING				SHEET NO.
PREPARED BY	CHECKED/REVIEWED BY	RECOMMENDING APPROVAL	APPROVED		
MA. JULIA A. SALES, uap DRAFTSMAN IV	CHRISTOPHER M. CADAG SUPERVISING ENGINEER A	JOHN S. DE LOS SANTOS ACTING DIVISION MANAGER A, ESD	MA. MAGNOLIA SINSON-REQUEJO PORT MANAGER		13 16 AUGUST 04, 2025

PHILIPPINE PORTS AUTHORITY

PORT MANAGEMENT OFFICE OF BICOL
REGIONAL GOVERNMENT CENTER,
RAMS, LEGAZPI CITY 4500